

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925377

Luminaire Tested: DFN2DIP-SQ2F0-060D060US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925377
REPORT IS A COMBINATION OF REPORTS P901333 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D060US950-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11333.5 lumens
Efficiency: N/A
Efficacy: 112.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 100.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925377

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US950-FLLONL

Luminous Intensity Polar Plot

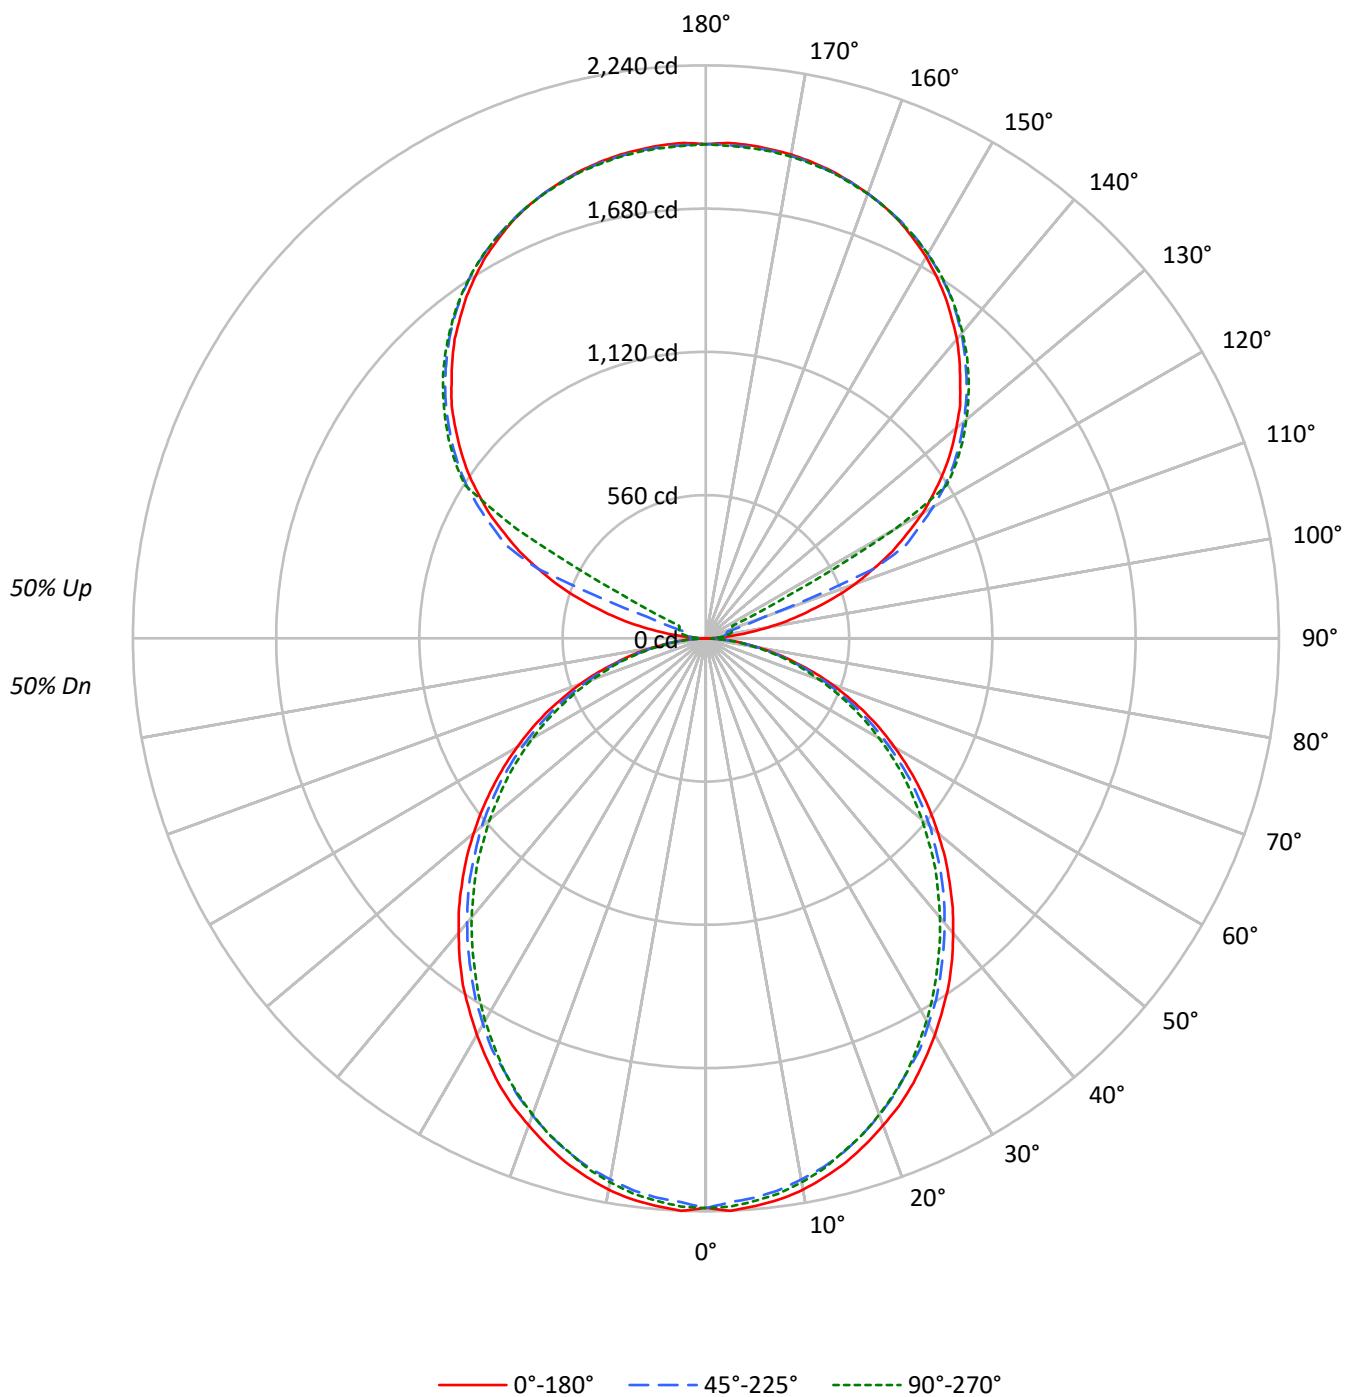

TEST NUMBER: P925377

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4897	4897	4897
5°	4897	4818	4855
10°	4849	4743	4782
15°	4769	4654	4673
20°	4664	4535	4561
25°	4560	4395	4433
30°	4431	4264	4271
35°	4308	4111	4101
40°	4158	3956	3939
45°	4008	3799	3772
50°	3844	3636	3580
55°	3671	3446	3402
60°	3476	3223	3197
65°	3261	2989	2956
70°	2989	2705	2695
75°	2615	2364	2445
80°	2160	1930	1986
85°	1459	1219	1248

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4008 cd/sqm

TEST NUMBER: P925377

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.6	1.8
10°-20°	589.8	5.2
20°-30°	866.8	7.6
30°-40°	1006.7	8.9
40°-50°	1005.5	8.9
50°-60°	876.7	7.7
60°-70°	648.1	5.7
70°-80°	366.7	3.2
80°-90°	100.2	0.9
90°-100°	63.7	0.6
100°-110°	237.5	2.1
110°-120°	629.8	5.6
120°-130°	1044.5	9.2
130°-140°	1109.5	9.8
140°-150°	1031.2	9.1
150°-160°	829.1	7.3
160°-170°	534.2	4.7
170°-180°	183.9	1.6
0°-30°	1666.2	14.7
0°-40°	2673.0	23.6
0°-60°	4555.2	40.2
0°-90°	5670.2	50.0
90°-120°	930.9	8.2
90°-150°	4116.2	36.3
90°-180°	5663.0	50.0
0°-180°	11333.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2227	2227	2227	2227	2227	
5°	2227	2219	2195	2212	2208	211
15°	2120	2108	2080	2088	2078	597
25°	1919	1902	1866	1870	1866	883
35°	1656	1634	1600	1587	1576	1034
45°	1347	1332	1300	1276	1268	1040
55°	1020	1007	981	955	945	912
65°	688	675	653	634	623	680
75°	360	356	345	332	336	384
85°	88	86	84	77	75	98
90°	1	17	28	35	38	10
95°	91	45	54	62	60	108
105°	425	467	85	101	106	454
115°	804	828	862	215	115	791
125°	1136	1155	1181	1191	1195	1014
135°	1406	1429	1441	1455	1452	1086
145°	1631	1630	1654	1663	1656	1020
155°	1796	1784	1800	1809	1798	828
165°	1893	1884	1888	1898	1888	535
175°	1936	1926	1929	1939	1925	184
180°	1932	1932	1932	1932	1932	

TEST NUMBER: P925377

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2227.2	2227.2	2227.2	2227.2	2227.2
2.5°	2240.2	2229.5	2205.8	2227.2	2223.1
5°	2227.2	2218.8	2195.2	2212.2	2208.1
7.5°	2212.2	2199.5	2175.9	2193.2	2188.9
10°	2188.9	2173.9	2148.1	2165.2	2158.8
12.5°	2156.6	2143.8	2118.2	2128.9	2124.6
15°	2120.2	2107.5	2079.5	2088.2	2077.5
17.5°	2075.2	2062.5	2034.6	2045.2	2034.6
20°	2025.9	2013.2	1983.2	1989.6	1981.2
22.5°	1976.9	1957.5	1929.6	1929.6	1925.3
25°	1918.9	1901.9	1865.5	1869.6	1865.5
27.5°	1854.6	1839.6	1811.8	1805.5	1794.9
30°	1790.6	1773.2	1741.2	1734.8	1726.2
32.5°	1721.9	1709.2	1674.8	1661.9	1653.3
35°	1655.6	1634.2	1599.9	1586.9	1576.2
37.5°	1580.6	1561.2	1527.0	1511.9	1501.2
40°	1503.5	1486.2	1452.0	1432.9	1424.2
42.5°	1428.5	1411.3	1377.2	1355.6	1342.9
45°	1347.2	1332.2	1299.9	1276.5	1267.9
47.5°	1267.9	1252.9	1218.6	1195.0	1182.2
50°	1184.3	1173.6	1143.7	1113.6	1102.9
52.5°	1102.9	1087.9	1060.2	1036.6	1021.6
55°	1019.5	1006.6	980.9	955.2	944.6
57.5°	936.0	925.3	897.3	871.7	863.0
60°	852.3	843.9	814.0	790.3	783.9
62.5°	770.9	755.9	734.6	713.2	704.6
65°	687.5	674.7	653.3	633.9	623.2
67.5°	601.9	591.0	571.9	556.9	548.3
70°	522.6	514.0	494.6	479.7	471.3
72.5°	441.2	432.6	422.0	407.0	400.6
75°	359.7	355.7	344.7	332.0	336.3
77.5°	287.0	278.4	274.0	267.7	261.3
80°	214.3	212.0	207.7	201.3	197.0
82.5°	145.7	145.7	143.6	135.0	135.0
85°	87.7	85.7	83.6	77.0	75.0
87.5°	38.6	34.3	30.0	23.7	21.4
90°	1.3	16.8	27.9	35.0	37.7
92.5°	35.0	29.4	33.5	36.3	37.7
95°	90.8	44.6	54.5	61.6	60.1
97.5°	163.5	48.9	71.2	75.6	76.9
100°	247.5	55.9	79.7	90.8	93.6
102.5°	339.6	337.0	82.5	97.8	102.1
105°	424.9	466.9	85.3	100.6	106.3
107.5°	524.2	559.0	88.1	103.4	109.0
110°	619.3	648.5	244.7	104.9	110.4

TEST NUMBER: P925377

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	708.7	733.8	710.1	107.5	111.9
115°	803.7	827.5	862.5	215.3	114.7
117.5°	886.2	914.1	938.0	738.0	371.8
120°	978.5	999.4	1024.7	1041.4	852.7
122.5°	1056.7	1079.1	1107.1	1115.4	1116.9
125°	1136.4	1154.6	1181.1	1191.0	1195.1
127.5°	1209.1	1228.7	1249.7	1263.7	1265.0
130°	1277.6	1300.0	1315.3	1330.7	1329.4
132.5°	1347.5	1365.7	1381.0	1393.6	1392.3
135°	1406.3	1428.7	1441.1	1455.2	1452.4
137.5°	1467.6	1484.4	1498.5	1512.5	1508.4
140°	1527.7	1539.1	1554.4	1566.9	1560.0
142.5°	1578.2	1588.0	1606.2	1617.2	1610.3
145°	1631.3	1629.8	1653.6	1663.4	1656.4
147.5°	1677.3	1673.1	1696.9	1703.8	1698.4
150°	1722.2	1712.3	1734.8	1743.1	1736.1
152.5°	1759.8	1748.7	1769.6	1778.1	1768.2
155°	1796.2	1783.7	1800.5	1808.8	1797.6
157.5°	1825.6	1814.4	1827.0	1836.8	1825.6
160°	1850.8	1842.3	1850.8	1859.1	1849.3
162.5°	1873.0	1864.7	1871.7	1881.5	1868.9
165°	1892.6	1884.3	1888.4	1898.3	1888.4
167.5°	1908.0	1899.6	1903.9	1913.7	1901.0
170°	1920.7	1912.2	1915.1	1924.8	1912.2
172.5°	1929.0	1920.7	1923.5	1933.3	1920.7
175°	1936.0	1926.1	1929.0	1938.7	1924.8
177.5°	1938.7	1929.0	1930.4	1940.2	1927.7
180°	1931.8	1931.8	1931.8	1931.8	1931.8

TEST NUMBER: P925377

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.68	13.54	13.64	14.51	15.78	12.24	13.10	13.19	14.07	15.34
	3H	14.32	15.09	15.29	16.07	17.37	13.83	14.60	14.80	15.58	16.88
	4H	14.90	15.63	15.88	16.61	17.91	14.40	15.13	15.38	16.12	17.42
	6H	15.28	15.95	16.27	16.94	18.26	14.78	15.45	15.77	16.45	17.76
	8H	15.38	16.02	16.38	17.03	18.34	14.88	15.52	15.88	16.53	17.84
	12H	15.42	16.03	16.42	17.03	18.37	14.91	15.52	15.91	16.52	17.86
4H	2H	13.13	13.86	14.12	14.85	16.15	12.77	13.51	13.76	14.49	15.79
	3H	14.97	15.58	15.97	16.60	17.91	14.57	15.18	15.56	16.19	17.51
	4H	15.67	16.23	16.68	17.24	18.58	15.25	15.81	16.25	16.81	18.15
	6H	16.17	16.65	17.19	17.68	19.02	15.74	16.22	16.75	17.25	18.58
	8H	16.31	16.76	17.33	17.78	19.13	15.87	16.32	16.89	17.34	18.70
	12H	16.37	16.78	17.41	17.82	19.17	15.92	16.33	16.96	17.37	18.73
8H	4H	15.86	16.31	16.87	17.33	18.68	15.48	15.93	16.50	16.95	18.30
	6H	16.46	16.84	17.51	17.90	19.25	16.08	16.45	17.12	17.52	18.87
	8H	16.67	17.00	17.72	18.05	19.42	16.28	16.61	17.33	17.66	19.02
	12H	16.79	17.08	17.84	18.12	19.53	16.38	16.67	17.43	17.71	19.12
12H	4H	15.84	16.25	16.88	17.29	18.64	15.47	15.88	16.51	16.92	18.27
	6H	16.49	16.82	17.54	17.87	19.24	16.12	16.44	17.17	17.49	18.86
	8H	16.72	17.00	17.77	18.05	19.46	16.33	16.62	17.39	17.67	19.08