

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925397

Luminaire Tested: DFN2DIP-SQ2F0-070D050US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925397
REPORT IS A COMBINATION OF REPORTS P901323 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-070D050US950-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11333.6 lumens
Efficiency: N/A
Efficacy: 107.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 105.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925397

CATALOG NUMBER: DFN2DIP-SQ2F0-070D050US950-FLLONL

Luminous Intensity Polar Plot

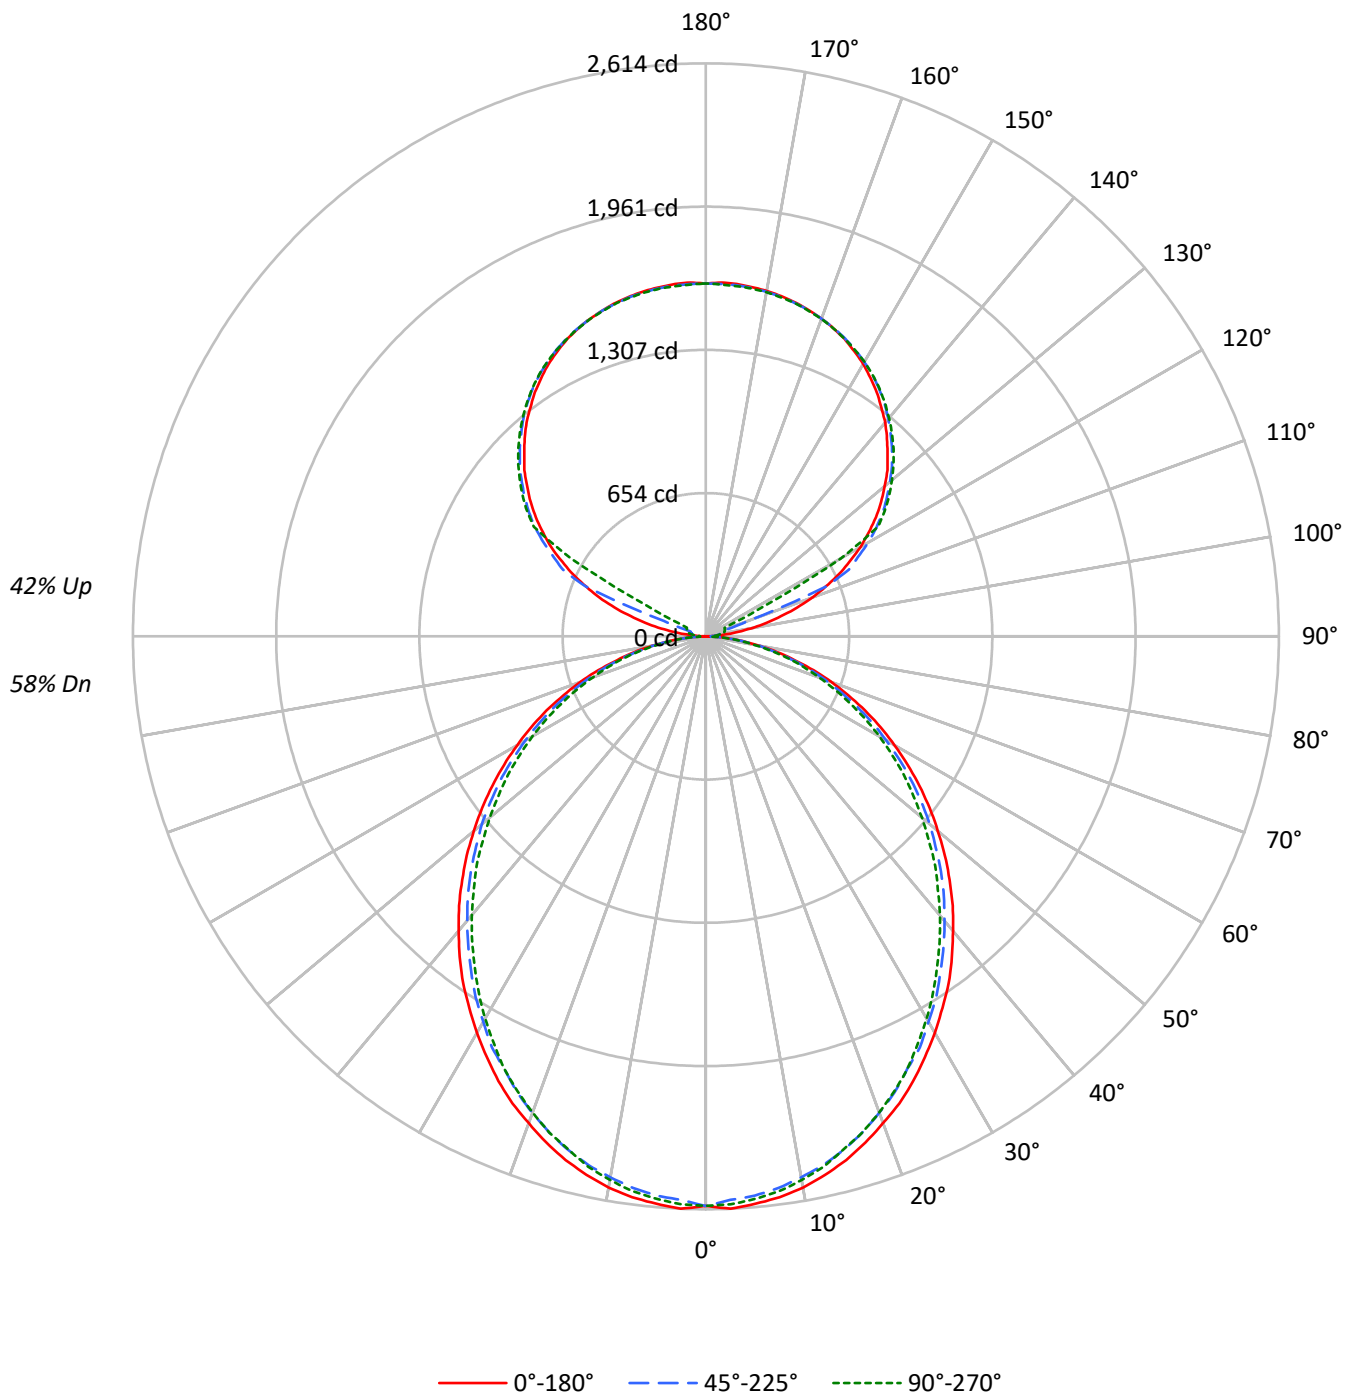

TEST NUMBER: P925397

CATALOG NUMBER: DFN2DIP-SQ2F0-070D050US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	64	64	64
1	100	95	91	88	93	89	86	82	77	75	72	66	65	63	56	55	54
2	91	83	77	72	84	78	72	68	68	64	60	58	55	53	50	47	45
3	83	73	66	60	77	69	62	57	60	55	50	52	48	44	44	41	39
4	76	65	57	51	70	61	54	48	53	47	43	46	42	38	39	36	33
5	70	58	50	43	65	54	47	41	48	42	37	41	37	33	35	32	29
6	64	52	44	38	60	49	41	36	43	37	32	37	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	29	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	18
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5714	5714	5714
5°	5713	5622	5664
10°	5657	5534	5579
15°	5564	5430	5451
20°	5441	5291	5321
25°	5320	5128	5172
30°	5169	4974	4983
35°	5026	4796	4785
40°	4851	4615	4595
45°	4676	4433	4401
50°	4485	4241	4177
55°	4283	4020	3969
60°	4056	3760	3730
65°	3805	3488	3449
70°	3487	3156	3144
75°	3051	2758	2853
80°	2519	2252	2316
85°	1703	1423	1456

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4676 cd/sqm

TEST NUMBER: P925397

CATALOG NUMBER: DFN2DIP-SQ2F0-070D050US950-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	244.6	2.2
10°-20°	688.1	6.1
20°-30°	1011.3	8.9
30°-40°	1174.5	10.4
40°-50°	1173.1	10.4
50°-60°	1022.9	9.0
60°-70°	756.1	6.7
70°-80°	427.8	3.8
80°-90°	115.8	1.0
90°-100°	53.1	0.5
100°-110°	197.9	1.7
110°-120°	524.8	4.6
120°-130°	870.4	7.7
130°-140°	924.6	8.2
140°-150°	859.3	7.6
150°-160°	690.9	6.1
160°-170°	445.2	3.9
170°-180°	153.2	1.4
0°-30°	1943.9	17.2
0°-40°	3118.5	27.5
0°-60°	5314.4	46.9
0°-90°	6614.1	58.4
90°-120°	775.8	6.8
90°-150°	3430.2	30.3
90°-180°	4719.0	41.6
0°-180°	11333.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2598	2598	2598	2598	2598	
5°	2598	2589	2561	2581	2576	247
15°	2474	2459	2426	2436	2424	697
25°	2239	2219	2176	2181	2176	1030
35°	1932	1907	1866	1851	1839	1206
45°	1572	1554	1517	1489	1479	1213
55°	1189	1174	1144	1114	1102	1063
65°	802	787	762	740	727	793
75°	420	415	402	387	392	448
85°	102	100	98	90	88	114
90°	1	14	23	29	31	10
95°	76	37	45	51	50	90
105°	354	389	71	84	88	378
115°	670	690	719	179	96	659
125°	947	962	984	992	996	845
135°	1172	1191	1201	1213	1210	905
145°	1359	1358	1378	1386	1380	850
155°	1497	1486	1500	1507	1498	690
165°	1577	1570	1574	1582	1574	446
175°	1613	1605	1608	1616	1604	154
180°	1610	1610	1610	1610	1610	

TEST NUMBER: P925397

CATALOG NUMBER: DFN2DIP-SQ2F0-070D050US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2598.4	2598.4	2598.4	2598.4	2598.4
2.5°	2613.6	2601.1	2573.5	2598.4	2593.6
5°	2598.4	2588.7	2561.1	2581.0	2576.2
7.5°	2581.0	2566.1	2538.5	2558.7	2553.7
10°	2553.7	2536.1	2506.2	2526.1	2518.7
12.5°	2516.0	2501.2	2471.2	2483.6	2478.6
15°	2473.6	2458.7	2426.1	2436.2	2423.7
17.5°	2421.1	2406.3	2373.6	2386.1	2373.6
20°	2363.5	2348.7	2313.7	2321.2	2311.4
22.5°	2306.3	2283.8	2251.2	2251.2	2246.1
25°	2238.8	2218.8	2176.5	2181.2	2176.5
27.5°	2163.7	2146.2	2113.9	2106.4	2093.9
30°	2089.0	2068.7	2031.4	2024.0	2013.9
32.5°	2008.8	1994.1	1954.0	1938.9	1928.8
35°	1931.5	1906.6	1866.5	1851.4	1838.9
37.5°	1844.0	1821.5	1781.4	1763.9	1751.4
40°	1754.1	1734.0	1693.9	1671.7	1661.6
42.5°	1666.6	1646.5	1606.7	1581.5	1566.7
45°	1571.7	1554.3	1516.6	1489.3	1479.2
47.5°	1479.2	1461.7	1421.7	1394.1	1379.3
50°	1381.7	1369.2	1334.2	1299.3	1286.8
52.5°	1286.8	1269.3	1237.0	1209.4	1191.8
55°	1189.4	1174.4	1144.4	1114.5	1102.0
57.5°	1091.9	1079.5	1046.8	1016.9	1006.9
60°	994.4	984.5	949.6	922.0	914.6
62.5°	899.4	882.0	857.1	832.2	822.1
65°	802.2	787.0	762.2	739.6	727.1
67.5°	702.2	689.6	667.2	649.8	639.7
70°	609.7	599.7	577.1	559.6	549.8
72.5°	514.8	504.8	492.3	474.8	467.4
75°	419.7	414.9	402.1	387.3	392.4
77.5°	334.9	324.7	319.7	312.2	304.9
80°	249.9	247.4	242.3	234.9	229.8
82.5°	169.9	169.9	167.5	157.5	157.5
85°	102.4	100.0	97.6	89.9	87.5
87.5°	45.0	40.1	35.0	27.6	24.9
90°	1.1	13.9	23.3	29.2	31.4
92.5°	29.2	24.5	28.0	30.3	31.4
95°	75.7	37.2	45.4	51.3	50.1
97.5°	136.2	40.8	59.3	63.0	64.0
100°	206.3	46.7	66.4	75.7	78.0
102.5°	283.1	280.8	68.8	81.5	85.1
105°	354.1	389.1	71.1	83.9	88.5
107.5°	436.8	465.8	73.5	86.1	90.9
110°	516.1	540.4	203.9	87.4	92.0

TEST NUMBER: P925397

CATALOG NUMBER: DFN2DIP-SQ2F0-070D050US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	590.6	611.5	591.8	89.7	93.2
115°	669.8	689.6	718.7	179.4	95.6
117.5°	738.5	761.8	781.7	614.9	309.9
120°	815.4	832.8	853.8	867.9	710.5
122.5°	880.5	899.2	922.6	929.6	930.8
125°	946.9	962.2	984.3	992.4	996.0
127.5°	1007.5	1023.8	1041.5	1053.0	1054.2
130°	1064.7	1083.4	1096.1	1108.9	1107.9
132.5°	1123.0	1138.1	1150.8	1161.4	1160.3
135°	1171.9	1190.6	1200.9	1212.7	1210.3
137.5°	1223.0	1237.1	1248.8	1260.4	1257.0
140°	1273.1	1282.6	1295.2	1305.7	1300.0
142.5°	1315.2	1323.4	1338.5	1347.7	1341.9
145°	1359.4	1358.2	1378.0	1386.2	1380.3
147.5°	1397.8	1394.3	1414.1	1419.9	1415.4
150°	1435.1	1427.0	1445.6	1452.6	1446.7
152.5°	1466.5	1457.2	1474.7	1481.8	1473.5
155°	1496.8	1486.4	1500.4	1507.3	1498.1
157.5°	1521.2	1512.0	1522.5	1530.7	1521.2
160°	1542.3	1535.3	1542.3	1549.2	1541.1
162.5°	1560.8	1554.0	1559.7	1567.9	1557.4
165°	1577.2	1570.3	1573.7	1581.8	1573.7
167.5°	1590.0	1583.0	1586.6	1594.7	1584.2
170°	1600.5	1593.5	1595.9	1604.0	1593.5
172.5°	1607.5	1600.5	1602.9	1611.0	1600.5
175°	1613.3	1605.1	1607.5	1615.6	1604.0
177.5°	1615.6	1607.5	1608.7	1616.8	1606.3
180°	1609.8	1609.8	1609.8	1609.8	1609.8

TEST NUMBER: P925397

CATALOG NUMBER: DFN2DIP-SQ2F0-070D050US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.95	14.89	14.83	15.79	16.94	13.51	14.45	14.39	15.35	16.50
	3H	15.60	16.44	16.49	17.35	18.53	15.11	15.95	16.00	16.86	18.04
	4H	16.18	16.97	17.09	17.89	19.07	15.68	16.48	16.59	17.40	18.58
	6H	16.56	17.30	17.49	18.23	19.42	16.06	16.80	16.99	17.73	18.92
	8H	16.66	17.37	17.59	18.31	19.50	16.16	16.86	17.09	17.81	19.00
	12H	16.71	17.38	17.64	18.31	19.53	16.20	16.87	17.13	17.80	19.02
4H	2H	14.41	15.21	15.32	16.13	17.31	14.05	14.85	14.97	15.77	16.95
	3H	16.26	16.93	17.19	17.88	19.07	15.85	16.52	16.78	17.47	18.66
	4H	16.96	17.57	17.90	18.51	19.74	16.54	17.15	17.47	18.09	19.31
	6H	17.46	17.99	18.41	18.96	20.18	17.03	17.56	17.98	18.52	19.75
	8H	17.61	18.10	18.56	19.06	20.29	17.17	17.66	18.12	18.62	19.86
	12H	17.67	18.12	18.64	19.09	20.34	17.23	17.67	18.20	18.65	19.89
8H	4H	17.15	17.64	18.11	18.61	19.84	16.78	17.27	17.73	18.23	19.46
	6H	17.76	18.17	18.74	19.17	20.41	17.38	17.79	18.36	18.79	20.02
	8H	17.97	18.33	18.96	19.32	20.58	17.58	17.94	18.57	18.93	20.18
	12H	18.10	18.41	19.09	19.40	20.70	17.68	18.00	18.68	18.99	20.29
12H	4H	17.14	17.58	18.11	18.56	19.80	16.77	17.21	17.74	18.19	19.43
	6H	17.79	18.15	18.78	19.14	20.39	17.42	17.78	18.40	18.77	20.02
	8H	18.02	18.34	19.01	19.32	20.62	17.64	17.96	18.63	18.94	20.24