

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925413

Luminaire Tested: DFN2DIP-SQ2F0-080D030US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925413
REPORT IS A COMBINATION OF REPORTS P901301 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D030US950-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10389.1 lumens
Efficiency: N/A
Efficacy: 102.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 101.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925413

CATALOG NUMBER: DFN2DIP-SQ2F0-080D030US950-FLLONL

Luminous Intensity Polar Plot

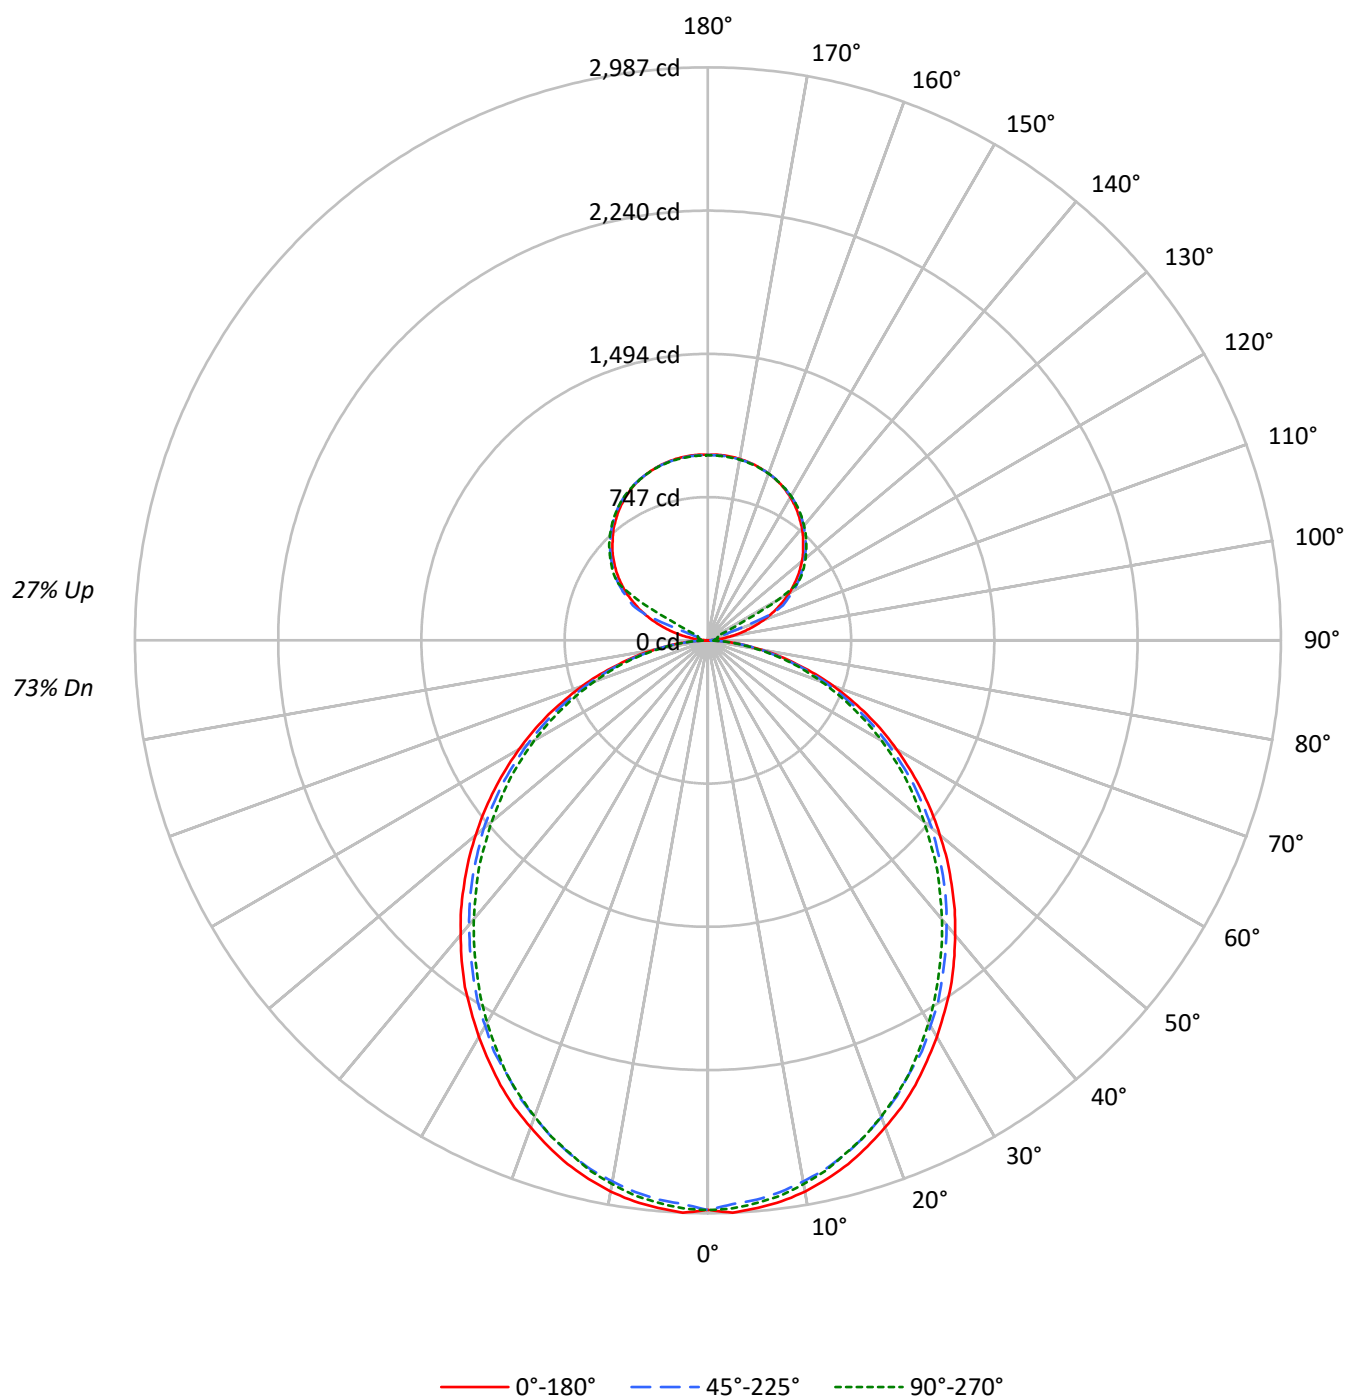

TEST NUMBER: P925413

CATALOG NUMBER: DFN2DIP-SQ2F0-080D030US950-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	107	107	107	107	96	96	96	86	86	86	77	77	77
1	103	98	94	91	97	94	90	87	84	82	79	76	74	72	68	67	65
2	94	86	80	74	89	82	76	71	74	69	66	67	63	60	60	57	55
3	86	76	68	62	81	72	65	60	65	60	55	59	55	51	53	50	47
4	78	67	59	53	74	64	57	51	58	52	47	53	48	44	48	44	40
5	72	60	51	45	68	57	50	44	52	46	41	47	42	38	43	39	35
6	67	54	45	39	63	52	44	38	47	41	36	43	37	33	39	35	31
7	62	49	41	35	58	47	39	34	43	36	32	39	34	30	36	31	28
8	57	44	36	31	54	43	35	30	39	33	28	36	30	27	33	28	25
9	53	41	33	28	51	39	32	27	36	30	25	33	28	24	30	26	22
10	50	38	30	25	48	36	29	24	33	27	23	31	25	22	28	24	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6530	6530	6530
5°	6529	6425	6473
10°	6465	6324	6376
15°	6359	6206	6230
20°	6219	6047	6081
25°	6079	5860	5910
30°	5908	5685	5695
35°	5744	5481	5469
40°	5544	5274	5252
45°	5344	5066	5030
50°	5126	4847	4774
55°	4895	4595	4535
60°	4635	4297	4263
65°	4349	3986	3942
70°	3985	3607	3593
75°	3487	3153	3260
80°	2880	2573	2647
85°	1946	1625	1664

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5344 cd/sqm

TEST NUMBER: P925413

CATALOG NUMBER: DFN2DIP-SQ2F0-080D030US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	279.5	2.7
10°-20°	786.4	7.6
20°-30°	1155.7	11.1
30°-40°	1342.3	12.9
40°-50°	1340.6	12.9
50°-60°	1169.0	11.3
60°-70°	864.1	8.3
70°-80°	488.9	4.7
80°-90°	130.7	1.3
90°-100°	31.9	0.3
100°-110°	118.7	1.1
110°-120°	314.9	3.0
120°-130°	522.3	5.0
130°-140°	554.8	5.3
140°-150°	515.6	5.0
150°-160°	414.5	4.0
160°-170°	267.1	2.6
170°-180°	91.9	0.9
0°-30°	2221.6	21.4
0°-40°	3563.9	34.3
0°-60°	6073.6	58.5
0°-90°	7557.4	72.7
90°-120°	465.5	4.5
90°-150°	2058.1	19.8
90°-180°	2832.0	27.3
0°-180°	10389.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2970	2970	2970	2970	2970	
5°	2970	2958	2927	2950	2944	282
15°	2827	2810	2773	2784	2770	796
25°	2558	2536	2487	2493	2487	1177
35°	2207	2179	2133	2116	2102	1378
45°	1796	1776	1733	1702	1691	1386
55°	1359	1342	1308	1274	1259	1215
65°	917	900	871	845	831	906
75°	480	474	460	443	448	512
85°	117	114	112	103	100	130
90°	1	8	14	18	19	10
95°	45	22	27	31	30	54
105°	212	233	43	50	53	227
115°	402	414	431	108	57	396
125°	568	577	591	596	598	507
135°	703	714	721	728	726	543
145°	816	815	827	832	828	510
155°	898	892	900	904	899	414
165°	946	942	944	949	944	267
175°	968	963	964	969	962	92
180°	966	966	966	966	966	

TEST NUMBER: P925413

CATALOG NUMBER: DFN2DIP-SQ2F0-080D030US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2969.6	2969.6	2969.6	2969.6	2969.6
2.5°	2986.9	2972.7	2941.2	2969.6	2964.2
5°	2969.6	2958.4	2927.0	2949.7	2944.2
7.5°	2949.7	2932.7	2901.2	2924.2	2918.5
10°	2918.5	2898.4	2864.2	2886.9	2878.5
12.5°	2875.5	2858.5	2824.2	2838.4	2832.7
15°	2827.0	2810.0	2772.7	2784.2	2770.0
17.5°	2767.0	2750.0	2712.7	2727.0	2712.7
20°	2701.3	2684.3	2644.3	2652.8	2641.5
22.5°	2635.8	2610.0	2572.7	2572.7	2567.0
25°	2558.5	2535.8	2487.4	2492.8	2487.4
27.5°	2472.8	2452.8	2415.8	2407.3	2393.1
30°	2387.4	2364.3	2321.7	2313.2	2301.6
32.5°	2295.9	2278.9	2233.1	2215.9	2204.4
35°	2207.4	2178.9	2133.1	2115.9	2101.7
37.5°	2107.4	2081.6	2035.9	2015.9	2001.7
40°	2004.7	1981.6	1936.0	1910.5	1898.9
42.5°	1904.8	1881.7	1836.3	1807.4	1790.6
45°	1796.3	1776.3	1733.2	1702.0	1690.6
47.5°	1690.6	1670.5	1624.8	1593.3	1576.3
50°	1579.1	1564.8	1524.8	1484.8	1470.6
52.5°	1470.6	1450.6	1413.6	1382.2	1362.1
55°	1359.4	1342.1	1307.9	1273.7	1259.4
57.5°	1247.9	1233.7	1196.4	1162.2	1150.6
60°	1136.4	1125.2	1085.2	1053.7	1045.2
62.5°	1027.9	1008.0	979.5	951.0	939.5
65°	916.8	899.5	871.0	845.2	831.0
67.5°	802.5	788.0	762.5	742.6	731.1
70°	696.8	685.3	659.6	639.6	628.3
72.5°	588.3	576.9	562.6	542.6	534.1
75°	479.6	474.1	459.6	442.7	448.4
77.5°	382.6	371.1	365.4	356.9	348.4
80°	285.7	282.7	276.9	268.5	262.6
82.5°	194.2	194.2	191.5	179.9	179.9
85°	117.0	114.2	111.5	102.7	100.0
87.5°	51.5	45.8	40.0	31.5	28.5
90°	0.7	8.4	13.9	17.6	18.8
92.5°	17.6	14.7	16.8	18.2	18.8
95°	45.4	22.3	27.2	30.8	30.1
97.5°	81.8	24.5	35.6	37.8	38.4
100°	123.7	28.0	39.9	45.4	46.8
102.5°	169.8	168.5	41.2	48.8	51.0
105°	212.5	233.4	42.6	50.3	53.1
107.5°	262.1	279.5	44.1	51.7	54.6
110°	309.7	324.3	122.3	52.5	55.2

TEST NUMBER: P925413

CATALOG NUMBER: DFN2DIP-SQ2F0-080D030US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	354.4	366.9	355.1	53.8	55.9
115°	401.8	413.7	431.2	107.6	57.3
117.5°	443.1	457.1	469.0	369.0	185.9
120°	489.2	499.7	512.3	520.7	426.3
122.5°	528.3	539.6	553.6	557.7	558.5
125°	568.2	577.3	590.6	595.5	597.6
127.5°	604.5	614.3	624.9	631.8	632.5
130°	638.8	650.1	657.7	665.3	664.7
132.5°	673.7	682.9	690.5	696.8	696.1
135°	703.1	714.4	720.6	727.6	726.2
137.5°	733.8	742.2	749.3	756.2	754.1
140°	763.9	769.5	777.1	783.4	780.0
142.5°	789.1	794.0	803.1	808.6	805.2
145°	815.7	814.9	826.8	831.7	828.2
147.5°	838.7	836.6	848.5	851.9	849.2
150°	861.1	856.2	867.4	871.5	868.0
152.5°	879.9	874.3	884.8	889.0	884.2
155°	898.1	891.9	900.2	904.4	898.9
157.5°	912.8	907.3	913.6	918.4	912.8
160°	925.4	921.2	925.4	929.6	924.6
162.5°	936.5	932.3	935.9	940.7	934.4
165°	946.3	942.2	944.3	949.1	944.3
167.5°	954.0	949.8	951.9	956.9	950.6
170°	960.3	956.1	957.5	962.4	956.1
172.5°	964.5	960.3	961.7	966.6	960.3
175°	967.9	963.1	964.5	969.4	962.4
177.5°	969.4	964.5	965.3	970.1	963.8
180°	965.9	965.9	965.9	965.9	965.9

TEST NUMBER: P925413

CATALOG NUMBER: DFN2DIP-SQ2F0-080D030US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.55	16.66	16.29	17.42	18.32	15.11	16.22	15.84	16.98	17.88
	3H	17.21	18.21	17.96	18.98	19.91	16.72	17.72	17.47	18.49	19.42
	4H	17.80	18.74	18.56	19.52	20.46	17.31	18.25	18.07	19.02	19.97
	6H	18.20	19.07	18.97	19.85	20.81	17.70	18.57	18.47	19.35	20.31
	8H	18.30	19.13	19.09	19.93	20.90	17.80	18.63	18.59	19.43	20.39
	12H	18.35	19.14	19.14	19.94	20.93	17.84	18.63	18.64	19.43	20.42
4H	2H	16.03	16.98	16.80	17.75	18.70	15.68	16.62	16.45	17.39	18.34
	3H	17.90	18.69	18.68	19.49	20.46	17.49	18.28	18.27	19.09	20.05
	4H	18.61	19.32	19.40	20.13	21.13	18.18	18.90	18.98	19.71	20.70
	6H	19.12	19.74	19.93	20.57	21.57	18.69	19.31	19.50	20.14	21.14
	8H	19.26	19.84	20.08	20.67	21.68	18.83	19.41	19.64	20.24	21.25
	12H	19.34	19.86	20.18	20.71	21.73	18.89	19.41	19.73	20.26	21.28
8H	4H	18.81	19.39	19.63	20.22	21.23	18.43	19.01	19.25	19.84	20.85
	6H	19.43	19.91	20.28	20.78	21.79	19.05	19.53	19.89	20.40	21.41
	8H	19.64	20.07	20.50	20.93	21.96	19.25	19.67	20.10	20.54	21.57
	12H	19.77	20.15	20.63	21.00	22.09	19.36	19.74	20.22	20.59	21.68
12H	4H	18.81	19.33	19.64	20.18	21.20	18.44	18.96	19.28	19.81	20.83
	6H	19.46	19.88	20.31	20.75	21.78	19.08	19.51	19.94	20.38	21.41
	8H	19.70	20.07	20.56	20.93	22.01	19.31	19.69	20.17	20.55	21.63