

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925424

Luminaire Tested: DFN2DIP-SQ2F0-080D060US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925424
REPORT IS A COMBINATION OF REPORTS P899817 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D060US950-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12621.4 lumens
Efficiency: N/A
Efficacy: 101.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 124.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925424

CATALOG NUMBER: DFN2DIP-SQ2F0-080D060US950-FLLFLL

Luminous Intensity Polar Plot

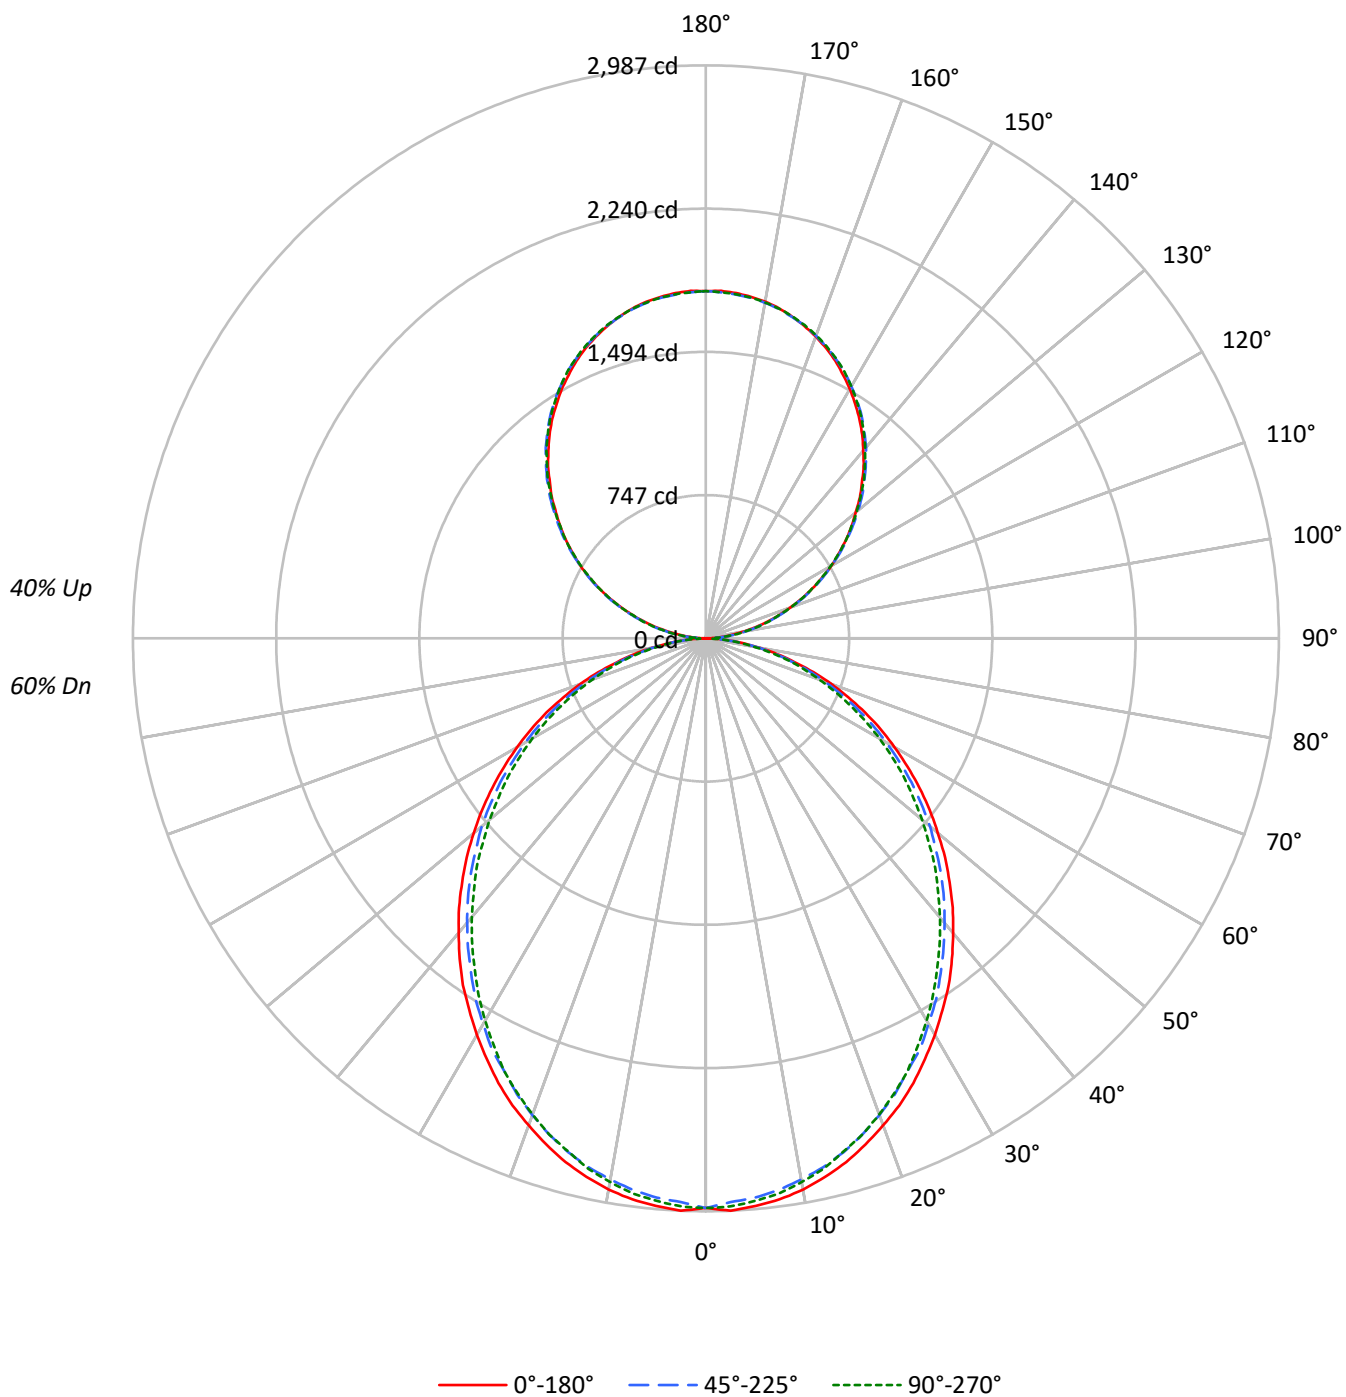

TEST NUMBER: P925424

CATALOG NUMBER: DFN2DIP-SQ2F0-080D060US950-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	110	110	110	110		102	102	102	102		89	89	89		77	77	77		65	65	65
1	100	96	92	88		93	89	86	83		78	75	73		67	66	64		58	56	55
2	91	84	77	72		85	78	73	68		68	64	61		59	56	53		51	48	46
3	83	73	66	60		77	69	62	57		60	55	51		52	48	45		45	42	40
4	76	65	57	51		71	61	54	48		54	48	43		47	42	39		40	37	34
5	70	58	50	44		65	55	47	42		48	42	38		42	37	34		36	33	30
6	64	52	44	38		60	49	42	36		43	37	33		38	33	29		33	29	26
7	60	47	39	33		56	44	37	32		39	33	29		35	30	26		30	26	23
8	55	43	35	30		52	40	33	28		36	30	26		32	27	23		28	24	21
9	52	39	32	26		48	37	30	25		33	27	23		29	24	21		26	22	19
10	48	36	29	24		45	34	27	23		30	25	21		27	22	19		24	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6530	6530	6530
5°	6529	6425	6473
10°	6465	6324	6376
15°	6359	6206	6230
20°	6219	6047	6081
25°	6079	5860	5910
30°	5908	5685	5695
35°	5744	5481	5469
40°	5544	5274	5252
45°	5344	5066	5030
50°	5126	4847	4774
55°	4895	4595	4535
60°	4635	4297	4263
65°	4349	3986	3942
70°	3985	3607	3593
75°	3487	3153	3260
80°	2880	2573	2647
85°	1946	1625	1664

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5344 cd/sqm

TEST NUMBER: P925424

CATALOG NUMBER: DFN2DIP-SQ2F0-080D060US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	279.5	2.2
10°-20°	786.4	6.2
20°-30°	1155.7	9.2
30°-40°	1342.3	10.6
40°-50°	1340.6	10.6
50°-60°	1169.0	9.3
60°-70°	864.1	6.8
70°-80°	488.9	3.9
80°-90°	134.2	1.1
90°-100°	112.0	0.9
100°-110°	355.9	2.8
110°-120°	609.1	4.8
120°-130°	801.1	6.3
130°-140°	899.2	7.1
140°-150°	881.7	7.0
150°-160°	739.6	5.9
160°-170°	490.5	3.9
170°-180°	171.4	1.4
0°-30°	2221.6	17.6
0°-40°	3563.9	28.2
0°-60°	6073.6	48.1
0°-90°	7560.8	59.9
90°-120°	1077.0	8.5
90°-150°	3659.0	29.0
90°-180°	5061.0	40.1
0°-180°	12621.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2970	2970	2970	2970	2970	
5°	2970	2958	2927	2950	2944	282
15°	2827	2810	2773	2784	2770	796
25°	2558	2536	2487	2493	2487	1177
35°	2207	2179	2133	2116	2102	1378
45°	1796	1776	1733	1702	1691	1386
55°	1359	1342	1308	1274	1259	1215
65°	917	900	871	845	831	906
75°	480	474	460	443	448	512
85°	117	114	112	103	100	130
90°	2	20	54	50	52	12
95°	80	95	98	98	95	89
105°	329	333	336	339	339	347
115°	611	620	617	616	611	605
125°	889	903	898	893	892	794
135°	1150	1167	1170	1168	1164	889
145°	1396	1407	1416	1417	1411	872
155°	1596	1601	1606	1613	1608	735
165°	1737	1735	1735	1746	1738	490
175°	1807	1803	1799	1810	1801	172
180°	1810	1810	1810	1810	1810	

TEST NUMBER: P925424

CATALOG NUMBER: DFN2DIP-SQ2F0-080D060US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2969.6	2969.6	2969.6	2969.6	2969.6
2.5°	2986.9	2972.7	2941.2	2969.6	2964.2
5°	2969.6	2958.4	2927.0	2949.7	2944.2
7.5°	2949.7	2932.7	2901.2	2924.2	2918.5
10°	2918.5	2898.4	2864.2	2886.9	2878.5
12.5°	2875.5	2858.5	2824.2	2838.4	2832.7
15°	2827.0	2810.0	2772.7	2784.2	2770.0
17.5°	2767.0	2750.0	2712.7	2727.0	2712.7
20°	2701.3	2684.3	2644.3	2652.8	2641.5
22.5°	2635.8	2610.0	2572.7	2572.7	2567.0
25°	2558.5	2535.8	2487.4	2492.8	2487.4
27.5°	2472.8	2452.8	2415.8	2407.3	2393.1
30°	2387.4	2364.3	2321.7	2313.2	2301.6
32.5°	2295.9	2278.9	2233.1	2215.9	2204.4
35°	2207.4	2178.9	2133.1	2115.9	2101.7
37.5°	2107.4	2081.6	2035.9	2015.9	2001.7
40°	2004.7	1981.6	1936.0	1910.5	1898.9
42.5°	1904.8	1881.7	1836.3	1807.4	1790.6
45°	1796.3	1776.3	1733.2	1702.0	1690.6
47.5°	1690.6	1670.5	1624.8	1593.3	1576.3
50°	1579.1	1564.8	1524.8	1484.8	1470.6
52.5°	1470.6	1450.6	1413.6	1382.2	1362.1
55°	1359.4	1342.1	1307.9	1273.7	1259.4
57.5°	1247.9	1233.7	1196.4	1162.2	1150.6
60°	1136.4	1125.2	1085.2	1053.7	1045.2
62.5°	1027.9	1008.0	979.5	951.0	939.5
65°	916.8	899.5	871.0	845.2	831.0
67.5°	802.5	788.0	762.5	742.6	731.1
70°	696.8	685.3	659.6	639.6	628.3
72.5°	588.3	576.9	562.6	542.6	534.1
75°	479.6	474.1	459.6	442.7	448.4
77.5°	382.6	371.1	365.4	356.9	348.4
80°	285.7	282.7	276.9	268.5	262.6
82.5°	194.2	194.2	191.5	179.9	179.9
85°	117.0	114.2	111.5	102.7	100.0
87.5°	51.5	45.8	40.0	31.5	28.5
90°	1.6	19.7	53.5	50.2	51.8
92.5°	33.9	45.9	47.5	49.1	49.1
95°	79.7	94.9	97.7	97.7	94.9
97.5°	132.6	146.8	152.8	152.8	152.8
100°	193.8	206.3	210.6	210.6	209.0
102.5°	258.2	267.4	273.4	275.0	273.4
105°	328.6	332.9	336.2	339.0	339.0
107.5°	398.4	405.0	405.0	406.0	398.4
110°	466.1	474.8	474.8	474.8	470.4

TEST NUMBER: P925424

CATALOG NUMBER: DFN2DIP-SQ2F0-080D060US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	539.2	548.5	546.8	542.4	539.2
115°	611.2	620.0	617.2	615.6	611.2
117.5°	682.8	694.8	687.1	682.8	678.4
120°	754.8	766.8	754.8	754.8	749.8
122.5°	820.2	835.5	827.9	823.6	820.2
125°	889.0	902.7	898.3	893.4	891.8
127.5°	956.2	973.1	967.1	960.6	956.2
130°	1019.0	1038.6	1035.9	1032.6	1026.6
132.5°	1089.4	1104.6	1105.7	1098.1	1093.7
135°	1150.0	1166.8	1170.1	1168.5	1164.1
137.5°	1217.6	1231.2	1234.0	1232.9	1226.4
140°	1277.1	1290.8	1298.4	1298.4	1292.4
142.5°	1338.2	1351.8	1356.2	1357.8	1351.8
145°	1396.1	1407.0	1415.7	1417.4	1411.3
147.5°	1447.9	1461.5	1468.1	1470.8	1464.8
150°	1501.4	1510.7	1516.7	1521.5	1516.7
152.5°	1548.8	1558.2	1565.8	1571.8	1565.8
155°	1596.3	1600.7	1605.6	1613.3	1608.3
157.5°	1637.3	1640.6	1643.3	1654.2	1646.6
160°	1673.9	1677.1	1678.8	1688.0	1681.5
162.5°	1707.7	1707.7	1709.3	1719.7	1712.0
165°	1736.6	1734.9	1734.9	1745.9	1738.3
167.5°	1762.8	1757.9	1757.9	1768.8	1761.2
170°	1782.5	1778.1	1776.4	1787.3	1778.1
172.5°	1796.1	1791.7	1790.1	1801.0	1791.7
175°	1807.0	1802.7	1799.3	1810.3	1801.0
177.5°	1813.0	1808.7	1805.3	1814.6	1805.3
180°	1810.3	1810.3	1810.3	1810.3	1810.3

TEST NUMBER: P925424

CATALOG NUMBER: DFN2DIP-SQ2F0-080D060US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.54	15.50	15.41	16.39	17.51	14.10	15.06	14.96	15.94	17.07
	3H	16.19	17.05	17.07	17.95	19.10	15.70	16.56	16.58	17.46	18.61
	4H	16.77	17.58	17.66	18.49	19.64	16.28	17.09	17.17	17.99	19.15
	6H	17.16	17.91	18.07	18.82	19.99	16.66	17.41	17.57	18.32	19.49
	8H	17.26	17.97	18.17	18.90	20.07	16.76	17.47	17.67	18.40	19.57
	12H	17.30	17.98	18.22	18.91	20.10	16.80	17.48	17.72	18.40	19.59
4H	2H	15.00	15.82	15.90	16.72	17.88	14.65	15.46	15.55	16.37	17.52
	3H	16.86	17.53	17.77	18.47	19.64	16.45	17.13	17.36	18.06	19.23
	4H	17.56	18.18	18.48	19.11	20.31	17.13	17.75	18.06	18.68	19.88
	6H	18.06	18.59	19.00	19.55	20.75	17.63	18.16	18.56	19.12	20.32
	8H	18.20	18.70	19.14	19.65	20.86	17.77	18.27	18.70	19.21	20.43
	12H	18.27	18.72	19.23	19.69	20.91	17.82	18.27	18.78	19.24	20.46
8H	4H	17.75	18.25	18.69	19.20	20.41	17.37	17.87	18.31	18.82	20.03
	6H	18.36	18.78	19.33	19.77	20.98	17.98	18.39	18.94	19.38	20.59
	8H	18.57	18.94	19.54	19.92	21.15	18.18	18.54	19.15	19.52	20.75
	12H	18.69	19.02	19.67	19.99	21.27	18.28	18.61	19.26	19.58	20.86
12H	4H	17.74	18.19	18.70	19.16	20.37	17.37	17.82	18.33	18.79	20.00
	6H	18.39	18.75	19.36	19.73	20.96	18.01	18.38	18.99	19.36	20.59
	8H	18.62	18.94	19.60	19.91	21.19	18.24	18.56	19.22	19.53	20.81

END OF REPORT