

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925433

Luminaire Tested: DFN2DIP-SQ2F0-080D080US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925433
REPORT IS A COMBINATION OF REPORTS P901361 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D080US950-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15111.4 lumens
Efficiency: N/A
Efficacy: 105.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 143.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925433

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US950-FLLONL

Luminous Intensity Polar Plot

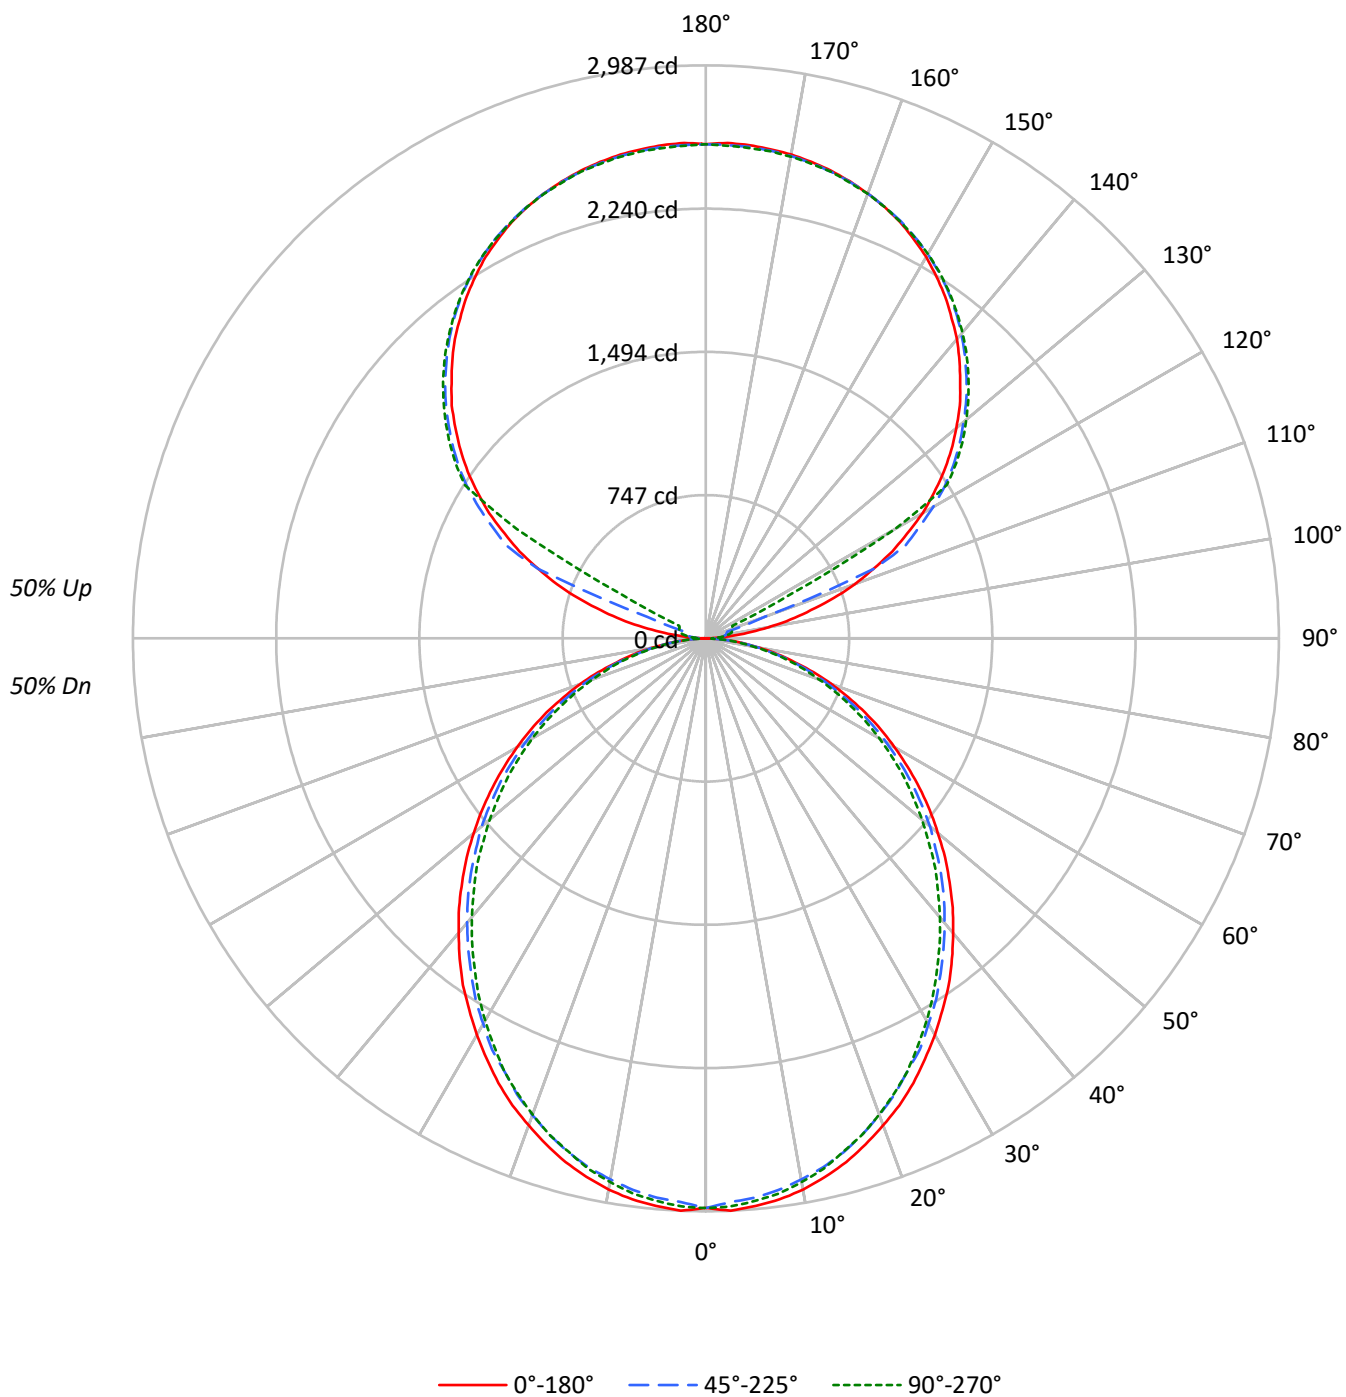

TEST NUMBER: P925433

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6530	6530	6530
5°	6529	6425	6473
10°	6465	6324	6376
15°	6359	6206	6230
20°	6219	6047	6081
25°	6079	5860	5910
30°	5908	5685	5695
35°	5744	5481	5469
40°	5544	5274	5252
45°	5344	5066	5030
50°	5126	4847	4774
55°	4895	4595	4535
60°	4635	4297	4263
65°	4349	3986	3942
70°	3985	3607	3593
75°	3487	3153	3260
80°	2880	2573	2647
85°	1946	1625	1664

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5344 cd/sqm

TEST NUMBER: P925433

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US950-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	279.5	1.8
10°-20°	786.4	5.2
20°-30°	1155.7	7.6
30°-40°	1342.3	8.9
40°-50°	1340.6	8.9
50°-60°	1169.0	7.7
60°-70°	864.1	5.7
70°-80°	488.9	3.2
80°-90°	133.6	0.9
90°-100°	84.9	0.6
100°-110°	316.6	2.1
110°-120°	839.7	5.6
120°-130°	1392.7	9.2
130°-140°	1479.4	9.8
140°-150°	1374.9	9.1
150°-160°	1105.4	7.3
160°-170°	712.3	4.7
170°-180°	245.2	1.6
0°-30°	2221.6	14.7
0°-40°	3563.9	23.6
0°-60°	6073.6	40.2
0°-90°	7560.2	50.0
90°-120°	1241.3	8.2
90°-150°	5488.3	36.3
90°-180°	7551.0	50.0
0°-180°	15111.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2970	2970	2970	2970	2970	
5°	2970	2958	2927	2950	2944	282
15°	2827	2810	2773	2784	2770	796
25°	2558	2536	2487	2493	2487	1177
35°	2207	2179	2133	2116	2102	1378
45°	1796	1776	1733	1702	1691	1386
55°	1359	1342	1308	1274	1259	1215
65°	917	900	871	845	831	906
75°	480	474	460	443	448	512
85°	117	114	112	103	100	130
90°	2	22	37	47	50	14
95°	121	60	73	82	80	143
105°	567	623	114	134	142	605
115°	1072	1103	1150	287	153	1055
125°	1515	1540	1575	1588	1594	1351
135°	1875	1905	1922	1940	1936	1448
145°	2175	2173	2205	2218	2208	1360
155°	2395	2378	2401	2412	2397	1104
165°	2524	2512	2518	2531	2518	713
175°	2581	2568	2572	2585	2566	246
180°	2576	2576	2576	2576	2576	

TEST NUMBER: P925433

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2969.6	2969.6	2969.6	2969.6	2969.6
2.5°	2986.9	2972.7	2941.2	2969.6	2964.2
5°	2969.6	2958.4	2927.0	2949.7	2944.2
7.5°	2949.7	2932.7	2901.2	2924.2	2918.5
10°	2918.5	2898.4	2864.2	2886.9	2878.5
12.5°	2875.5	2858.5	2824.2	2838.4	2832.7
15°	2827.0	2810.0	2772.7	2784.2	2770.0
17.5°	2767.0	2750.0	2712.7	2727.0	2712.7
20°	2701.3	2684.3	2644.3	2652.8	2641.5
22.5°	2635.8	2610.0	2572.7	2572.7	2567.0
25°	2558.5	2535.8	2487.4	2492.8	2487.4
27.5°	2472.8	2452.8	2415.8	2407.3	2393.1
30°	2387.4	2364.3	2321.7	2313.2	2301.6
32.5°	2295.9	2278.9	2233.1	2215.9	2204.4
35°	2207.4	2178.9	2133.1	2115.9	2101.7
37.5°	2107.4	2081.6	2035.9	2015.9	2001.7
40°	2004.7	1981.6	1936.0	1910.5	1898.9
42.5°	1904.8	1881.7	1836.3	1807.4	1790.6
45°	1796.3	1776.3	1733.2	1702.0	1690.6
47.5°	1690.6	1670.5	1624.8	1593.3	1576.3
50°	1579.1	1564.8	1524.8	1484.8	1470.6
52.5°	1470.6	1450.6	1413.6	1382.2	1362.1
55°	1359.4	1342.1	1307.9	1273.7	1259.4
57.5°	1247.9	1233.7	1196.4	1162.2	1150.6
60°	1136.4	1125.2	1085.2	1053.7	1045.2
62.5°	1027.9	1008.0	979.5	951.0	939.5
65°	916.8	899.5	871.0	845.2	831.0
67.5°	802.5	788.0	762.5	742.6	731.1
70°	696.8	685.3	659.6	639.6	628.3
72.5°	588.3	576.9	562.6	542.6	534.1
75°	479.6	474.1	459.6	442.7	448.4
77.5°	382.6	371.1	365.4	356.9	348.4
80°	285.7	282.7	276.9	268.5	262.6
82.5°	194.2	194.2	191.5	179.9	179.9
85°	117.0	114.2	111.5	102.7	100.0
87.5°	51.5	45.8	40.0	31.5	28.5
90°	1.8	22.3	37.2	46.7	50.3
92.5°	46.7	39.2	44.7	48.5	50.3
95°	121.1	59.5	72.6	82.1	80.1
97.5°	218.0	65.3	94.9	100.7	102.5
100°	330.0	74.6	106.3	121.1	124.8
102.5°	452.9	449.2	110.0	130.3	136.1
105°	566.6	622.6	113.7	134.1	141.7
107.5°	698.9	745.4	117.5	137.9	145.4
110°	825.8	864.7	326.3	139.9	147.2

TEST NUMBER: P925433

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	945.0	978.4	946.8	143.4	149.2
115°	1071.6	1103.3	1150.0	287.1	152.9
117.5°	1181.6	1218.8	1250.7	984.0	495.8
120°	1304.7	1332.5	1366.2	1388.5	1136.9
122.5°	1408.9	1438.8	1476.2	1487.3	1489.3
125°	1515.1	1539.5	1574.9	1587.9	1593.5
127.5°	1612.1	1638.2	1666.4	1684.9	1686.7
130°	1703.5	1733.3	1753.7	1774.3	1772.5
132.5°	1796.7	1821.0	1841.4	1858.2	1856.4
135°	1875.0	1904.9	1921.5	1940.3	1936.5
137.5°	1956.9	1979.3	1998.1	2016.7	2011.1
140°	2037.0	2052.1	2072.5	2089.3	2079.9
142.5°	2104.3	2117.3	2141.4	2156.3	2147.0
145°	2175.1	2173.1	2204.8	2217.9	2208.5
147.5°	2236.5	2230.9	2262.5	2271.9	2264.5
150°	2296.2	2283.1	2313.0	2324.0	2314.8
152.5°	2346.5	2331.6	2359.4	2370.8	2357.7
155°	2394.9	2378.3	2400.6	2411.7	2396.9
157.5°	2434.0	2419.2	2436.0	2449.1	2434.0
160°	2467.7	2456.5	2467.7	2478.8	2465.7
162.5°	2497.4	2486.3	2495.6	2508.6	2491.8
165°	2523.5	2512.5	2518.0	2531.0	2518.0
167.5°	2544.0	2532.8	2538.5	2551.6	2534.8
170°	2560.9	2549.6	2553.4	2566.5	2549.6
172.5°	2572.0	2560.9	2564.6	2577.7	2560.9
175°	2581.2	2568.2	2572.0	2585.0	2566.5
177.5°	2585.0	2572.0	2573.9	2587.0	2570.2
180°	2575.7	2575.7	2575.7	2575.7	2575.7

TEST NUMBER: P925433

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US950-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.68	14.54	14.64	15.51	16.78	13.23	14.10	14.19	15.07	16.34
	3H	15.32	16.09	16.29	17.07	18.37	14.83	15.60	15.80	16.58	17.88
	4H	15.89	16.63	16.88	17.61	18.91	15.40	16.13	16.38	17.12	18.42
	6H	16.28	16.95	17.27	17.94	19.26	15.78	16.45	16.77	17.44	18.76
	8H	16.38	17.02	17.38	18.03	19.34	15.88	16.52	16.87	17.52	18.84
	12H	16.42	17.03	17.42	18.03	19.37	15.91	16.52	16.91	17.52	18.86
4H	2H	14.13	14.86	15.12	15.85	17.15	13.77	14.51	14.76	15.49	16.79
	3H	15.97	16.58	16.97	17.60	18.91	15.56	16.17	16.56	17.19	18.50
	4H	16.67	17.23	17.68	18.24	19.58	16.25	16.81	17.25	17.81	19.15
	6H	17.17	17.65	18.18	18.68	20.02	16.74	17.22	17.75	18.25	19.58
	8H	17.31	17.76	18.33	18.78	20.13	16.87	17.32	17.89	18.34	19.69
	12H	17.37	17.78	18.41	18.82	20.17	16.92	17.33	17.96	18.37	19.73
8H	4H	16.86	17.31	17.87	18.33	19.68	16.48	16.93	17.50	17.95	19.30
	6H	17.46	17.84	18.51	18.90	20.25	17.08	17.45	18.12	18.52	19.86
	8H	17.67	18.00	18.72	19.05	20.42	17.28	17.60	18.33	18.66	20.02
	12H	17.79	18.08	18.84	19.12	20.53	17.38	17.67	18.43	18.71	20.12
12H	4H	16.84	17.25	17.88	18.28	19.64	16.47	16.88	17.51	17.91	19.27
	6H	17.49	17.82	18.54	18.87	20.23	17.12	17.44	18.17	18.49	19.86
	8H	17.72	18.00	18.77	19.05	20.46	17.33	17.62	18.39	18.67	20.08