

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903710

Luminaire Tested: DFN2DIP-SQ3F0-060D100US830-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903710
REPORT IS A COMBINATION OF REPORTS P899974 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D100US830-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13148.5 lumens
Efficiency: N/A
Efficacy: 100.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 130.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903710

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US830-RLLFLL

Luminous Intensity Polar Plot

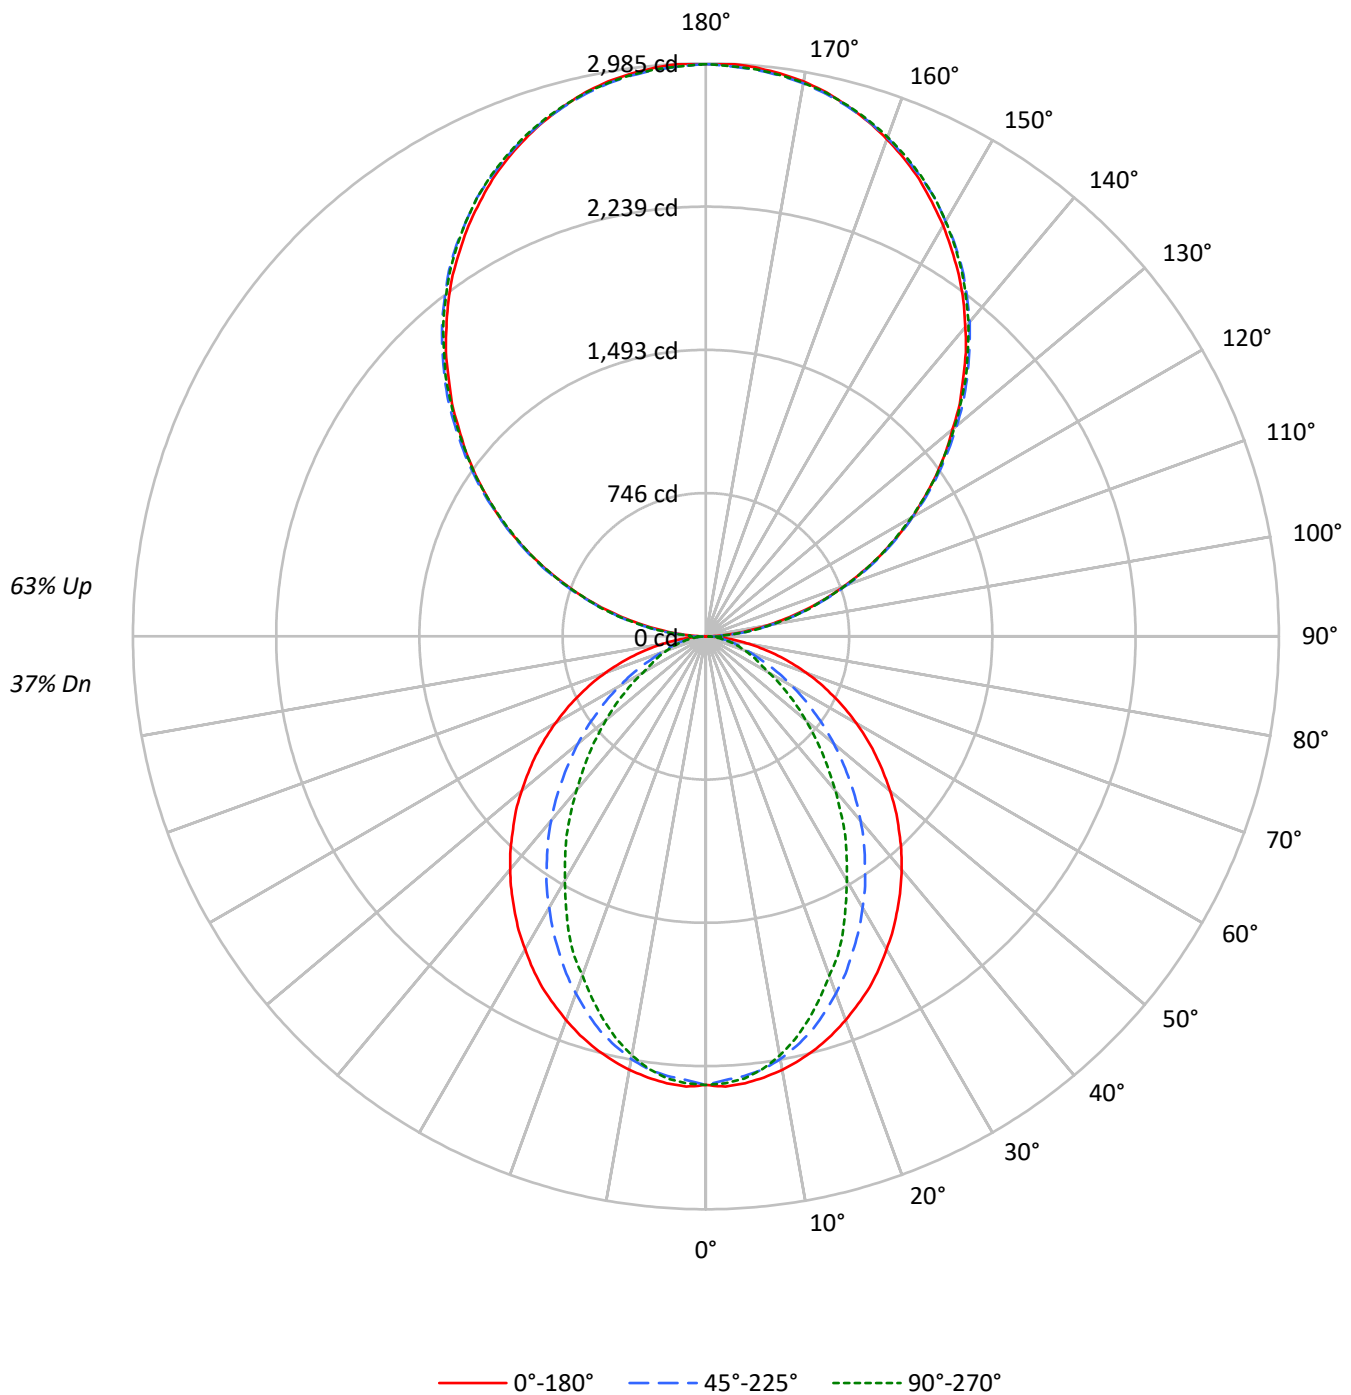

TEST NUMBER: P903710

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US830-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	91	87	84	86	83	80	77	67	65	63	53	51	50	39	38	38
2	87	80	74	69	79	73	68	63	59	56	53	47	44	42	35	34	32
3	79	70	64	58	72	64	58	53	52	48	45	41	39	36	31	29	28
4	73	63	55	49	66	57	51	46	47	42	38	37	34	31	28	26	24
5	67	56	48	42	60	51	44	39	42	37	33	33	30	27	26	23	21
6	62	50	42	37	56	46	39	34	38	33	29	30	27	24	23	21	19
7	57	45	38	32	52	41	35	30	34	29	26	28	24	21	21	19	17
8	53	41	34	29	48	38	31	27	31	26	23	25	22	19	20	17	15
9	49	38	30	25	45	34	28	24	29	24	20	23	20	17	18	16	14
10	46	34	27	23	42	32	25	21	26	22	18	22	18	16	17	14	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2678	2678	2678
5°	2681	2634	2652
10°	2652	2580	2564
15°	2614	2493	2430
20°	2564	2374	2266
25°	2513	2241	2107
30°	2445	2104	1906
35°	2378	1958	1730
40°	2310	1806	1527
45°	2230	1638	1344
50°	2149	1469	1165
55°	2063	1288	993
60°	1964	1100	817
65°	1849	908	734
70°	1710	729	663
75°	1536	639	601
80°	1283	530	518
85°	870	346	385

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2999 cd/sqm

TEST NUMBER: P903710

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US830-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.1	1.7
10°-20°	601.3	4.6
20°-30°	844.3	6.4
30°-40°	920.3	7.0
40°-50°	845.9	6.4
50°-60°	664.3	5.1
60°-70°	432.4	3.3
70°-80°	222.6	1.7
80°-90°	65.3	0.5
90°-100°	184.5	1.4
100°-110°	586.1	4.5
110°-120°	1003.0	7.6
120°-130°	1319.1	10.0
130°-140°	1480.6	11.3
140°-150°	1451.9	11.0
150°-160°	1217.9	9.3
160°-170°	807.7	6.1
170°-180°	282.3	2.1
0°-30°	1664.7	12.7
0°-40°	2585.0	19.7
0°-60°	4095.1	31.1
0°-90°	4815.4	36.6
90°-120°	1773.5	13.5
90°-150°	6025.1	45.8
90°-180°	8333.0	63.4
0°-180°	13148.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2337	2337	2337	2337	2337	
5°	2337	2327	2299	2318	2312	222
15°	2223	2200	2128	2088	2067	626
25°	2018	1950	1811	1724	1692	928
35°	1739	1631	1445	1312	1265	1088
45°	1421	1280	1058	907	857	1098
55°	1081	916	687	561	520	966
65°	730	558	368	296	290	724
75°	389	241	169	154	152	412
85°	91	46	40	40	40	104
90°	3	32	88	83	85	13
95°	131	156	161	161	156	146
105°	541	548	554	558	558	571
115°	1006	1021	1016	1014	1006	996
125°	1464	1486	1479	1471	1468	1308
135°	1894	1921	1927	1924	1917	1464
145°	2299	2317	2331	2334	2324	1436
155°	2629	2636	2644	2656	2648	1210
165°	2860	2857	2857	2875	2862	807
175°	2976	2968	2963	2981	2966	283
180°	2981	2981	2981	2981	2981	

TEST NUMBER: P903710

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US830-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2337.3	2337.3	2337.3	2337.3	2337.3
2.5°	2347.9	2337.3	2313.9	2335.2	2331.0
5°	2337.3	2326.8	2299.1	2318.3	2312.0
7.5°	2318.3	2305.6	2276.1	2284.3	2273.8
10°	2292.8	2278.0	2235.9	2229.4	2216.8
12.5°	2261.3	2242.1	2184.9	2172.4	2149.0
15°	2223.1	2199.7	2127.9	2087.7	2066.6
17.5°	2178.7	2144.8	2055.9	2009.4	1975.6
20°	2127.9	2085.5	1979.8	1927.0	1880.4
22.5°	2072.9	2024.2	1901.5	1829.7	1798.0
25°	2018.0	1950.2	1810.6	1724.0	1692.1
27.5°	1952.5	1880.4	1726.0	1626.5	1577.9
30°	1882.6	1802.0	1632.9	1525.1	1467.9
32.5°	1814.9	1717.5	1544.3	1417.2	1364.2
35°	1738.8	1630.9	1444.8	1311.5	1264.8
37.5°	1664.7	1548.2	1351.7	1205.6	1152.8
40°	1586.4	1459.6	1254.2	1104.1	1049.1
42.5°	1506.1	1370.7	1157.1	1000.4	947.7
45°	1421.4	1279.6	1057.7	907.3	856.6
47.5°	1341.1	1191.0	962.5	812.2	765.7
50°	1252.3	1102.1	869.4	723.3	679.1
52.5°	1165.4	1006.7	780.5	640.9	600.8
55°	1080.8	915.9	687.4	560.6	520.4
57.5°	994.2	824.9	605.0	486.5	452.6
60°	905.3	736.1	518.2	410.5	376.5
62.5°	818.7	649.5	444.1	342.7	325.8
65°	729.8	558.4	368.1	296.2	289.7
67.5°	645.2	473.7	296.2	260.1	253.8
70°	556.3	391.3	245.2	224.2	215.7
72.5°	471.7	315.1	205.1	188.3	184.0
75°	389.2	241.0	169.2	154.4	152.4
77.5°	306.8	171.3	133.3	124.8	120.6
80°	230.5	122.7	101.4	93.1	93.1
82.5°	160.7	82.6	69.7	65.5	65.5
85°	90.9	46.5	40.2	40.2	40.2
87.5°	33.9	16.9	16.9	14.8	14.8
90°	2.7	32.3	88.0	82.7	85.4
92.5°	55.7	75.5	78.2	80.9	80.9
95°	131.2	156.4	160.9	160.9	156.4
97.5°	218.4	241.8	251.7	251.7	251.7
100°	319.1	339.7	346.9	346.9	344.2
102.5°	425.1	440.4	450.3	452.9	450.3
105°	541.0	548.2	553.6	558.1	558.1
107.5°	656.0	666.8	666.8	668.6	656.0
110°	767.5	781.8	781.8	781.8	774.7

TEST NUMBER: P903710

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US830-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	887.9	903.1	900.5	893.2	887.9
115°	1006.5	1020.9	1016.4	1013.7	1006.5
117.5°	1124.3	1144.1	1131.4	1124.3	1117.0
120°	1242.8	1262.6	1242.8	1242.8	1234.8
122.5°	1350.7	1375.8	1363.3	1356.1	1350.7
125°	1464.0	1486.4	1479.2	1471.1	1468.5
127.5°	1574.5	1602.3	1592.4	1581.7	1574.5
130°	1677.8	1710.1	1705.7	1700.3	1690.4
132.5°	1793.8	1818.9	1820.7	1808.2	1800.9
135°	1893.5	1921.4	1926.7	1924.1	1916.8
137.5°	2005.0	2027.4	2031.9	2030.1	2019.3
140°	2102.9	2125.3	2138.0	2138.0	2128.1
142.5°	2203.6	2226.0	2233.2	2235.9	2226.0
145°	2298.8	2316.8	2331.2	2333.8	2323.9
147.5°	2384.2	2406.7	2417.4	2422.0	2412.1
150°	2472.3	2487.6	2497.5	2505.5	2497.5
152.5°	2550.4	2565.7	2578.3	2588.2	2578.3
155°	2628.7	2635.8	2643.9	2656.5	2648.4
157.5°	2696.0	2701.4	2705.9	2723.9	2711.3
160°	2756.3	2761.6	2764.3	2779.6	2768.8
162.5°	2812.0	2812.0	2814.6	2831.7	2819.1
165°	2859.6	2856.8	2856.8	2874.8	2862.3
167.5°	2902.7	2894.6	2894.6	2912.6	2900.0
170°	2935.1	2927.9	2925.2	2943.2	2927.9
172.5°	2957.5	2950.3	2947.6	2965.6	2950.3
175°	2975.5	2968.3	2963.0	2980.9	2965.6
177.5°	2985.4	2978.2	2972.8	2988.0	2972.8
180°	2980.9	2980.9	2980.9	2980.9	2980.9



TEST NUMBER: P903710

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US830-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.14	9.87	10.21	10.94	12.39	5.10	5.83	6.17	6.90	8.35
	3H	10.80	11.46	11.88	12.54	14.01	6.27	6.93	7.35	8.01	9.48
	4H	11.41	12.03	12.50	13.10	14.58	6.72	7.34	7.81	8.41	9.89
	6H	11.82	12.39	12.92	13.47	14.96	7.03	7.60	8.13	8.68	10.17
	8H	11.94	12.48	13.04	13.58	15.06	7.11	7.65	8.21	8.75	10.23
	12H	12.00	12.51	13.10	13.60	15.11	7.15	7.66	8.25	8.75	10.26
4H	2H	9.14	9.76	10.24	10.84	12.32	5.68	6.30	6.78	7.38	8.86
	3H	10.96	11.47	12.06	12.58	14.07	7.01	7.53	8.12	8.64	10.12
	4H	11.64	12.12	12.75	13.21	14.72	7.55	8.03	8.66	9.12	10.63
	6H	12.15	12.55	13.26	13.67	15.17	7.96	8.37	9.08	9.48	10.99
	8H	12.32	12.70	13.43	13.81	15.33	8.08	8.46	9.20	9.57	11.09
	12H	12.41	12.75	13.54	13.87	15.40	8.14	8.48	9.27	9.61	11.13
8H	4H	11.60	11.98	12.72	13.09	14.61	7.82	8.20	8.94	9.31	10.83
	6H	12.16	12.47	13.30	13.62	15.14	8.33	8.64	9.47	9.79	11.31
	8H	12.37	12.64	13.51	13.78	15.31	8.52	8.79	9.66	9.92	11.46
	12H	12.50	12.74	13.65	13.87	15.44	8.62	8.86	9.77	9.99	11.57
12H	4H	11.55	11.89	12.68	13.01	14.54	7.82	8.17	8.95	9.29	10.81
	6H	12.13	12.41	13.28	13.54	15.08	8.38	8.65	9.52	9.78	11.32
	8H	12.35	12.59	13.49	13.72	15.29	8.58	8.82	9.72	9.95	11.52

END OF REPORT