

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903715

Luminaire Tested: DFN2DIP-SQ3F0-060D110US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903715
REPORT IS A COMBINATION OF REPORTS P901512 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D110US830-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15071.2 lumens
Efficiency: N/A
Efficacy: 108.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 139.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903715

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US830-RLLONL

Luminous Intensity Polar Plot

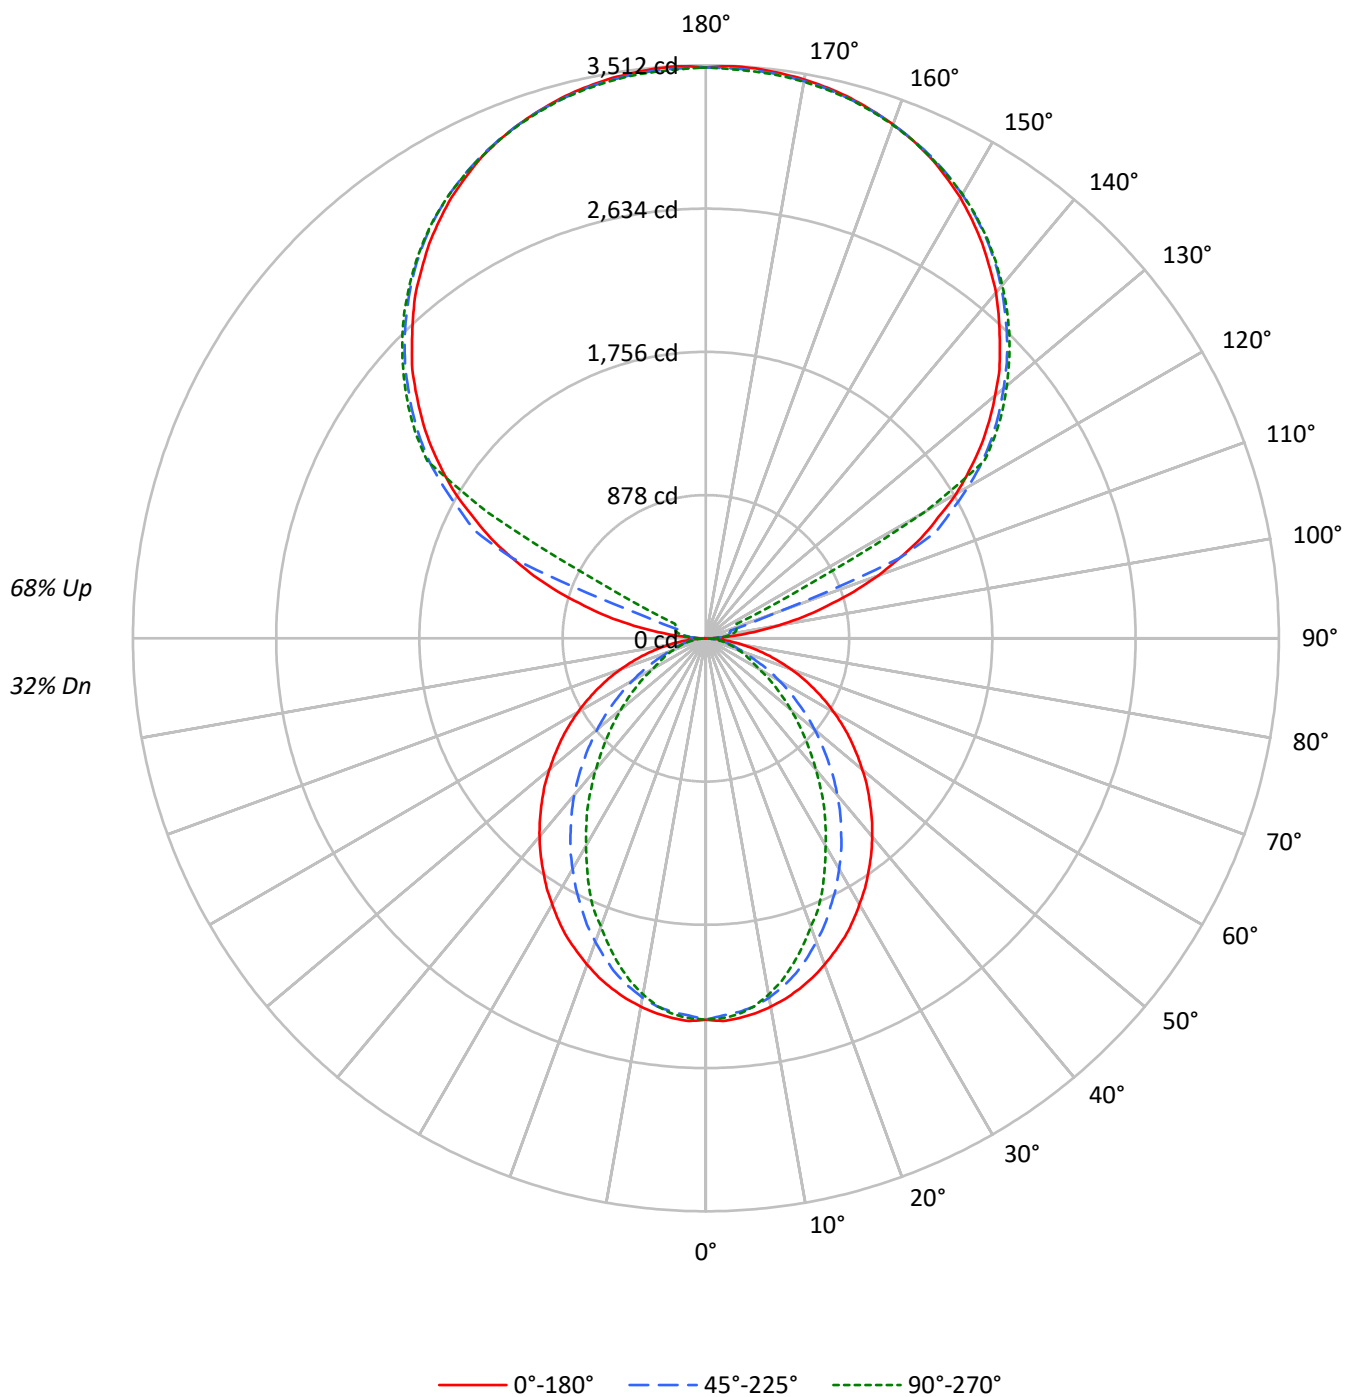

TEST NUMBER: P903715

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	73	73	73	56	56	56	40	40	40
1	94	90	86	83	85	81	78	75	65	63	61	49	48	47	35	35	34
2	86	79	73	68	77	71	66	62	57	54	51	44	42	40	31	30	29
3	78	70	63	57	70	63	57	52	50	46	43	39	36	34	28	26	25
4	72	62	54	48	64	56	49	44	45	40	37	35	32	29	25	23	22
5	66	55	47	42	59	50	43	38	40	35	32	31	28	25	23	21	19
6	61	49	42	36	55	45	38	33	36	31	28	28	25	22	21	19	17
7	56	44	37	32	51	41	34	29	33	28	24	26	22	20	19	17	15
8	52	40	33	28	47	37	30	26	30	25	22	24	20	18	18	15	14
9	48	37	30	25	44	34	27	23	27	23	19	22	18	16	16	14	12
10	45	34	27	22	41	31	25	21	25	21	17	20	17	14	15	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2678	2678	2678
5°	2681	2634	2652
10°	2652	2580	2564
15°	2614	2493	2430
20°	2564	2374	2266
25°	2513	2241	2107
30°	2445	2104	1906
35°	2378	1958	1730
40°	2310	1806	1527
45°	2230	1638	1344
50°	2149	1469	1165
55°	2063	1288	993
60°	1964	1100	817
65°	1849	908	734
70°	1710	729	663
75°	1536	639	601
80°	1283	530	518
85°	870	346	385

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2395 cd/sqm

TEST NUMBER: P903715

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.1	1.5
10°-20°	601.3	4.0
20°-30°	844.3	5.6
30°-40°	920.3	6.1
40°-50°	845.9	5.6
50°-60°	664.3	4.4
60°-70°	432.4	2.9
70°-80°	222.6	1.5
80°-90°	63.0	0.4
90°-100°	115.4	0.8
100°-110°	430.1	2.9
110°-120°	1140.7	7.6
120°-130°	1892.0	12.6
130°-140°	2009.7	13.3
140°-150°	1867.8	12.4
150°-160°	1501.7	10.0
160°-170°	967.6	6.4
170°-180°	333.0	2.2
0°-30°	1664.7	11.0
0°-40°	2585.0	17.2
0°-60°	4095.1	27.2
0°-90°	4813.1	31.9
90°-120°	1686.2	11.2
90°-150°	7455.8	49.5
90°-180°	10258.0	68.1
0°-180°	15071.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2337	2337	2337	2337	2337	
5°	2337	2327	2299	2318	2312	222
15°	2223	2200	2128	2088	2067	626
25°	2018	1950	1811	1724	1692	928
35°	1739	1631	1445	1312	1265	1088
45°	1421	1280	1058	907	857	1098
55°	1081	916	687	561	520	966
65°	730	558	368	296	290	724
75°	389	241	169	154	152	412
85°	91	46	40	40	40	104
90°	2	30	50	63	68	14
95°	164	81	99	112	109	195
105°	770	846	155	182	192	822
115°	1456	1499	1562	390	208	1433
125°	2058	2091	2140	2157	2165	1836
135°	2547	2588	2610	2636	2631	1968
145°	2955	2952	2995	3013	3000	1848
155°	3254	3231	3261	3276	3256	1499
165°	3428	3413	3421	3438	3421	969
175°	3506	3489	3494	3512	3486	334
180°	3499	3499	3499	3499	3499	

TEST NUMBER: P903715

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2337.3	2337.3	2337.3	2337.3	2337.3
2.5°	2347.9	2337.3	2313.9	2335.2	2331.0
5°	2337.3	2326.8	2299.1	2318.3	2312.0
7.5°	2318.3	2305.6	2276.1	2284.3	2273.8
10°	2292.8	2278.0	2235.9	2229.4	2216.8
12.5°	2261.3	2242.1	2184.9	2172.4	2149.0
15°	2223.1	2199.7	2127.9	2087.7	2066.6
17.5°	2178.7	2144.8	2055.9	2009.4	1975.6
20°	2127.9	2085.5	1979.8	1927.0	1880.4
22.5°	2072.9	2024.2	1901.5	1829.7	1798.0
25°	2018.0	1950.2	1810.6	1724.0	1692.1
27.5°	1952.5	1880.4	1726.0	1626.5	1577.9
30°	1882.6	1802.0	1632.9	1525.1	1467.9
32.5°	1814.9	1717.5	1544.3	1417.2	1364.2
35°	1738.8	1630.9	1444.8	1311.5	1264.8
37.5°	1664.7	1548.2	1351.7	1205.6	1152.8
40°	1586.4	1459.6	1254.2	1104.1	1049.1
42.5°	1506.1	1370.7	1157.1	1000.4	947.7
45°	1421.4	1279.6	1057.7	907.3	856.6
47.5°	1341.1	1191.0	962.5	812.2	765.7
50°	1252.3	1102.1	869.4	723.3	679.1
52.5°	1165.4	1006.7	780.5	640.9	600.8
55°	1080.8	915.9	687.4	560.6	520.4
57.5°	994.2	824.9	605.0	486.5	452.6
60°	905.3	736.1	518.2	410.5	376.5
62.5°	818.7	649.5	444.1	342.7	325.8
65°	729.8	558.4	368.1	296.2	289.7
67.5°	645.2	473.7	296.2	260.1	253.8
70°	556.3	391.3	245.2	224.2	215.7
72.5°	471.7	315.1	205.1	188.3	184.0
75°	389.2	241.0	169.2	154.4	152.4
77.5°	306.8	171.3	133.3	124.8	120.6
80°	230.5	122.7	101.4	93.1	93.1
82.5°	160.7	82.6	69.7	65.5	65.5
85°	90.9	46.5	40.2	40.2	40.2
87.5°	33.9	16.9	16.9	14.8	14.8
90°	2.5	30.3	50.5	63.4	68.2
92.5°	63.4	53.3	60.7	65.9	68.2
95°	164.5	80.9	98.6	111.5	108.9
97.5°	296.1	88.7	128.9	136.8	139.2
100°	448.3	101.3	144.3	164.5	169.6
102.5°	615.1	610.3	149.4	177.1	184.9
105°	769.7	845.7	154.6	182.2	192.5
107.5°	949.5	1012.6	159.7	187.3	197.6
110°	1121.7	1174.7	443.2	190.0	199.9



TEST NUMBER: P903715

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1283.8	1329.2	1286.2	194.8	202.6
115°	1455.8	1498.7	1562.3	389.9	207.7
117.5°	1605.2	1655.8	1699.0	1336.7	673.4
120°	1772.4	1810.2	1856.0	1886.3	1544.4
122.5°	1914.0	1954.5	2005.4	2020.4	2023.2
125°	2058.3	2091.4	2139.5	2157.2	2164.7
127.5°	2190.0	2225.4	2263.6	2288.9	2291.3
130°	2314.1	2354.8	2382.4	2410.4	2408.0
132.5°	2440.7	2473.8	2501.5	2524.3	2522.0
135°	2547.2	2587.7	2610.3	2635.9	2630.7
137.5°	2658.4	2688.8	2714.3	2739.6	2732.1
140°	2767.3	2787.7	2815.4	2838.2	2825.6
142.5°	2858.6	2876.4	2909.2	2929.3	2916.7
145°	2954.9	2952.1	2995.1	3012.9	3000.3
147.5°	3038.2	3030.7	3073.6	3086.3	3076.4
150°	3119.3	3101.6	3142.2	3157.2	3144.6
152.5°	3187.6	3167.4	3205.3	3220.7	3202.9
155°	3253.5	3230.8	3261.2	3276.3	3256.1
157.5°	3306.6	3286.5	3309.4	3327.1	3306.6
160°	3352.3	3337.0	3352.3	3367.3	3349.6
162.5°	3392.6	3377.6	3390.2	3408.0	3385.1
165°	3428.1	3413.0	3420.6	3438.3	3420.6
167.5°	3456.0	3440.8	3448.6	3466.3	3443.5
170°	3478.9	3463.6	3468.6	3486.5	3463.6
172.5°	3493.9	3478.9	3484.0	3501.7	3478.9
175°	3506.5	3488.8	3493.9	3511.7	3486.5
177.5°	3511.7	3493.9	3496.6	3514.4	3491.6
180°	3499.1	3499.1	3499.1	3499.1	3499.1

TEST NUMBER: P903715

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.56	9.26	9.67	10.36	11.87	4.52	5.22	5.63	6.32	7.83
	3H	10.23	10.85	11.34	11.96	13.48	5.70	6.32	6.81	7.43	8.95
	4H	10.83	11.42	11.95	12.53	14.06	6.14	6.73	7.26	7.84	9.37
	6H	11.24	11.78	12.37	12.89	14.44	6.44	6.99	7.57	8.10	9.64
	8H	11.36	11.88	12.49	13.00	14.54	6.53	7.05	7.66	8.17	9.71
	12H	11.41	11.91	12.55	13.02	14.58	6.56	7.06	7.70	8.18	9.74
4H	2H	8.56	9.16	9.69	10.26	11.80	5.10	5.70	6.23	6.80	8.33
	3H	10.38	10.87	11.51	12.00	13.55	6.43	6.93	7.57	8.06	9.60
	4H	11.06	11.51	12.20	12.63	14.20	6.97	7.42	8.11	8.55	10.11
	6H	11.56	11.95	12.71	13.10	14.65	7.37	7.76	8.52	8.91	10.46
	8H	11.73	12.10	12.88	13.23	14.80	7.50	7.86	8.64	9.00	10.57
	12H	11.82	12.15	12.98	13.30	14.87	7.55	7.88	8.71	9.03	10.61
8H	4H	11.02	11.38	12.16	12.51	14.09	7.24	7.60	8.38	8.74	10.31
	6H	11.57	11.87	12.74	13.05	14.62	7.74	8.04	8.91	9.22	10.79
	8H	11.78	12.05	12.95	13.20	14.79	7.93	8.19	9.10	9.35	10.94
	12H	11.91	12.14	13.09	13.30	14.92	8.04	8.27	9.21	9.42	11.04
12H	4H	10.96	11.29	12.12	12.44	14.01	7.23	7.56	8.39	8.71	10.29
	6H	11.55	11.81	12.72	12.96	14.55	7.79	8.05	8.96	9.21	10.80
	8H	11.76	11.99	12.93	13.14	14.76	7.99	8.22	9.16	9.37	11.00