

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903727

Luminaire Tested: DFN2DIP-SQ3F0-070D050US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903727
REPORT IS A COMBINATION OF REPORTS P901406 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D050US830-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10273.7 lumens
Efficiency: N/A
Efficacy: 100.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903727

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US830-RLONL

Luminous Intensity Polar Plot

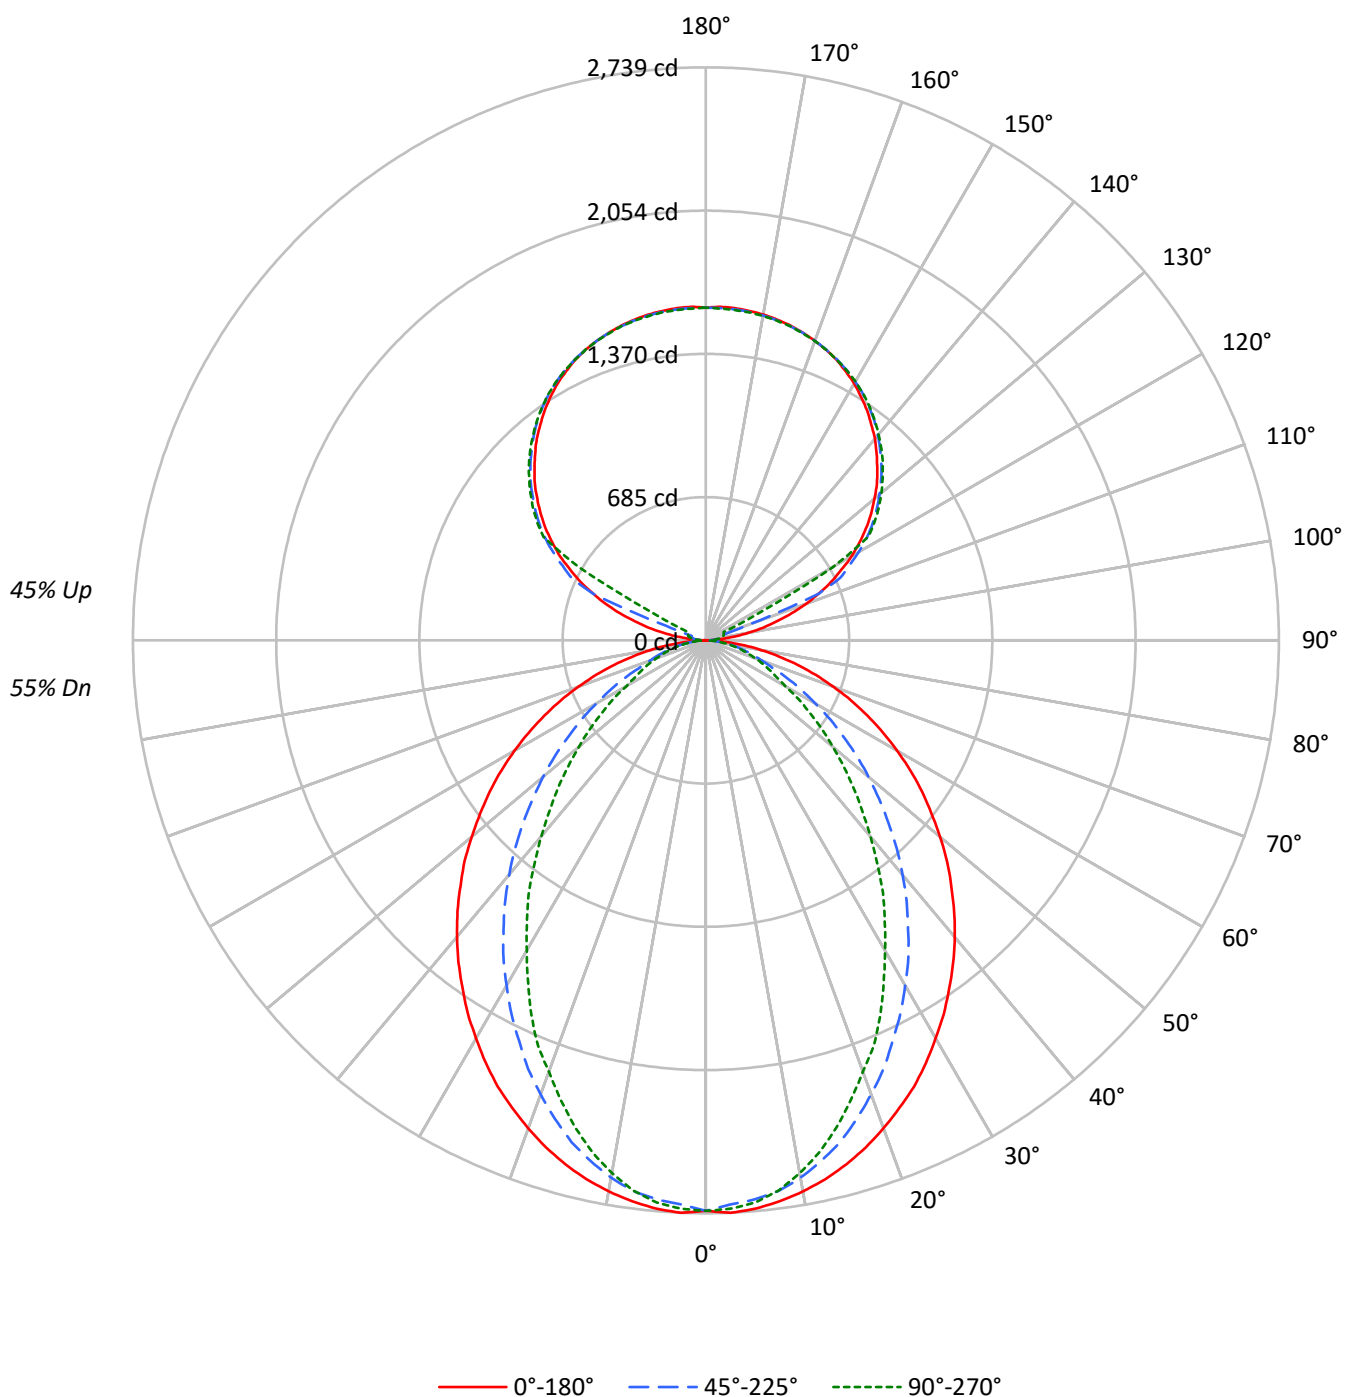

TEST NUMBER: P903727

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	95	91	88	92	89	85	82	76	74	72	65	63	62	54	53	52
2	91	84	78	73	84	78	73	69	67	63	60	57	55	52	48	46	45
3	83	74	67	61	77	69	63	58	60	55	51	51	48	45	43	41	39
4	76	66	58	52	71	62	55	50	54	48	44	46	42	39	39	36	34
5	70	59	51	45	65	55	48	43	48	43	38	42	37	34	35	32	30
6	65	53	45	40	60	50	43	38	44	38	34	38	33	30	32	29	26
7	60	48	40	35	56	45	38	33	40	34	30	35	30	27	30	26	24
8	56	44	36	31	52	41	34	30	36	31	27	32	27	24	27	24	21
9	52	40	33	28	49	38	31	27	34	28	24	29	25	22	25	22	19
10	49	37	30	25	46	35	28	24	31	26	22	27	23	20	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3124	3124	3124
5°	3127	3073	3094
10°	3094	3010	2992
15°	3050	2909	2835
20°	2992	2770	2644
25°	2932	2614	2458
30°	2852	2455	2224
35°	2774	2284	2018
40°	2695	2107	1782
45°	2602	1911	1568
50°	2507	1714	1359
55°	2407	1503	1159
60°	2291	1283	953
65°	2157	1059	856
70°	1995	851	774
75°	1792	746	702
80°	1497	619	605
85°	1015	403	448

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2602 cd/sqm

TEST NUMBER: P903727

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US830-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	255.6	2.5
10°-20°	701.6	6.8
20°-30°	985.0	9.6
30°-40°	1073.7	10.5
40°-50°	986.9	9.6
50°-60°	775.0	7.5
60°-70°	504.5	4.9
70°-80°	259.7	2.5
80°-90°	69.1	0.7
90°-100°	52.5	0.5
100°-110°	195.5	1.9
110°-120°	518.5	5.0
120°-130°	860.0	8.4
130°-140°	913.5	8.9
140°-150°	849.0	8.3
150°-160°	682.6	6.6
160°-170°	439.8	4.3
170°-180°	151.4	1.5
0°-30°	1942.1	18.9
0°-40°	3015.8	29.4
0°-60°	4777.7	46.5
0°-90°	5610.9	54.6
90°-120°	766.5	7.5
90°-150°	3389.0	33.0
90°-180°	4663.0	45.4
0°-180°	10273.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2727	2727	2727	2727	2727	
5°	2727	2714	2682	2705	2697	259
15°	2594	2566	2483	2436	2411	731
25°	2354	2275	2112	2011	1974	1083
35°	2028	1903	1686	1530	1476	1270
45°	1658	1493	1234	1059	999	1281
55°	1261	1068	802	654	607	1127
65°	851	651	429	346	338	844
75°	454	281	197	180	178	480
85°	106	54	47	47	47	122
90°	1	14	23	29	31	10
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1469	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P903727

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2726.9	2726.9	2726.9	2726.9	2726.9
2.5°	2739.1	2726.9	2699.6	2724.5	2719.5
5°	2726.9	2714.5	2682.4	2704.6	2697.3
7.5°	2704.6	2689.9	2655.4	2665.0	2652.8
10°	2675.0	2657.8	2608.5	2600.9	2586.2
12.5°	2638.1	2615.8	2549.1	2534.4	2507.2
15°	2593.6	2566.4	2482.6	2435.7	2411.1
17.5°	2541.8	2502.3	2398.6	2344.3	2304.8
20°	2482.6	2433.1	2309.8	2248.2	2193.8
22.5°	2418.5	2361.6	2218.4	2134.6	2097.7
25°	2354.3	2275.2	2112.3	2011.3	1974.2
27.5°	2277.8	2193.8	2013.6	1897.7	1840.9
30°	2196.4	2102.4	1905.0	1779.3	1712.6
32.5°	2117.3	2003.8	1801.6	1653.4	1591.6
35°	2028.5	1902.6	1685.6	1530.1	1475.6
37.5°	1942.2	1806.3	1577.0	1406.5	1345.0
40°	1850.8	1702.9	1463.3	1288.2	1224.0
42.5°	1757.1	1599.2	1349.9	1167.2	1105.7
45°	1658.4	1492.9	1234.0	1058.6	999.4
47.5°	1564.6	1389.5	1122.9	947.5	893.3
50°	1460.9	1285.8	1014.3	843.9	792.3
52.5°	1359.6	1174.5	910.6	747.7	700.9
55°	1260.9	1068.5	801.9	654.0	607.2
57.5°	1159.9	962.4	705.9	567.6	528.1
60°	1056.2	858.8	604.5	478.9	439.3
62.5°	955.1	757.7	518.1	399.8	380.1
65°	851.4	651.4	429.4	345.6	338.0
67.5°	752.7	552.7	345.6	303.4	296.1
70°	649.0	456.6	286.2	261.6	251.6
72.5°	550.4	367.6	239.3	219.7	214.7
75°	454.0	281.2	197.4	180.1	177.8
77.5°	357.9	199.7	155.5	145.5	140.6
80°	268.9	143.2	118.4	108.7	108.7
82.5°	187.5	96.3	81.4	76.4	76.4
85°	106.0	54.2	46.8	46.8	46.8
87.5°	39.5	19.6	19.6	17.2	17.2
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.7	277.4	68.0	80.5	84.1
105°	349.9	384.5	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	534.0	201.4	86.3	90.9

TEST NUMBER: P903727

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.2	584.7	88.6	92.1
115°	661.8	681.3	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.6	306.1
120°	805.6	822.8	843.6	857.4	702.0
122.5°	870.0	888.4	911.5	918.4	919.6
125°	935.6	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1029.0	1040.4	1041.5
130°	1051.9	1070.4	1082.9	1095.6	1094.6
132.5°	1109.5	1124.5	1137.0	1147.5	1146.3
135°	1157.8	1176.3	1186.5	1198.2	1195.8
137.5°	1208.3	1222.2	1233.8	1245.3	1241.9
140°	1257.8	1267.2	1279.7	1290.1	1284.4
142.5°	1299.4	1307.5	1322.4	1331.5	1325.8
145°	1343.1	1341.9	1361.4	1369.5	1363.8
147.5°	1381.0	1377.5	1397.1	1402.9	1398.4
150°	1417.9	1409.9	1428.2	1435.1	1429.4
152.5°	1448.9	1439.7	1457.0	1464.0	1455.9
155°	1478.8	1468.6	1482.3	1489.2	1480.1
157.5°	1503.0	1493.8	1504.2	1512.3	1503.0
160°	1523.8	1516.8	1523.8	1530.6	1522.6
162.5°	1542.1	1535.3	1541.0	1549.1	1538.7
165°	1558.2	1551.4	1554.8	1562.8	1554.8
167.5°	1570.9	1564.0	1567.5	1575.6	1565.2
170°	1581.3	1574.3	1576.7	1584.7	1574.3
172.5°	1588.2	1581.3	1583.7	1591.7	1581.3
175°	1593.9	1585.8	1588.2	1596.2	1584.7
177.5°	1596.2	1588.2	1589.4	1597.4	1587.1
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P903727

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.49	12.36	12.42	13.30	14.50	7.45	8.32	8.38	9.26	10.47
	3H	13.17	13.95	14.10	14.89	16.12	8.64	9.42	9.57	10.36	11.59
	4H	13.78	14.51	14.73	15.46	16.70	9.09	9.82	10.04	10.77	12.01
	6H	14.20	14.87	15.16	15.83	17.08	9.40	10.08	10.36	11.04	12.29
	8H	14.32	14.96	15.29	15.94	17.19	9.49	10.13	10.46	11.11	12.36
	12H	14.38	14.99	15.35	15.96	17.23	9.53	10.14	10.51	11.11	12.39
4H	2H	11.51	12.25	12.47	13.20	14.44	8.05	8.78	9.01	9.74	10.98
	3H	13.34	13.95	14.31	14.93	16.19	9.40	10.01	10.36	10.99	12.24
	4H	14.03	14.59	15.00	15.56	16.84	9.94	10.50	10.92	11.47	12.75
	6H	14.54	15.02	15.53	16.02	17.30	10.36	10.83	11.34	11.83	13.11
	8H	14.72	15.16	15.70	16.16	17.45	10.48	10.93	11.47	11.92	13.21
	12H	14.81	15.21	15.82	16.22	17.52	10.54	10.95	11.55	11.95	13.25
8H	4H	14.00	14.45	14.99	15.44	16.73	10.22	10.67	11.21	11.66	12.95
	6H	14.56	14.93	15.57	15.96	17.25	10.73	11.10	11.75	12.14	13.42
	8H	14.78	15.10	15.80	16.12	17.43	10.92	11.24	11.94	12.26	13.57
	12H	14.91	15.20	15.94	16.21	17.57	11.03	11.32	12.06	12.33	13.69
12H	4H	13.95	14.36	14.96	15.36	16.66	10.23	10.63	11.23	11.64	12.93
	6H	14.54	14.86	15.56	15.88	17.19	10.78	11.11	11.80	12.13	13.43
	8H	14.76	15.04	15.78	16.06	17.41	10.99	11.27	12.01	12.29	13.64