

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903736

Luminaire Tested: DFN2DIP-SQ3F0-070D080US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903736
REPORT IS A COMBINATION OF REPORTS P899939 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D080US830-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13205.1 lumens
Efficiency: N/A
Efficacy: 104.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 126
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903736

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US830-FLLFLL

Luminous Intensity Polar Plot

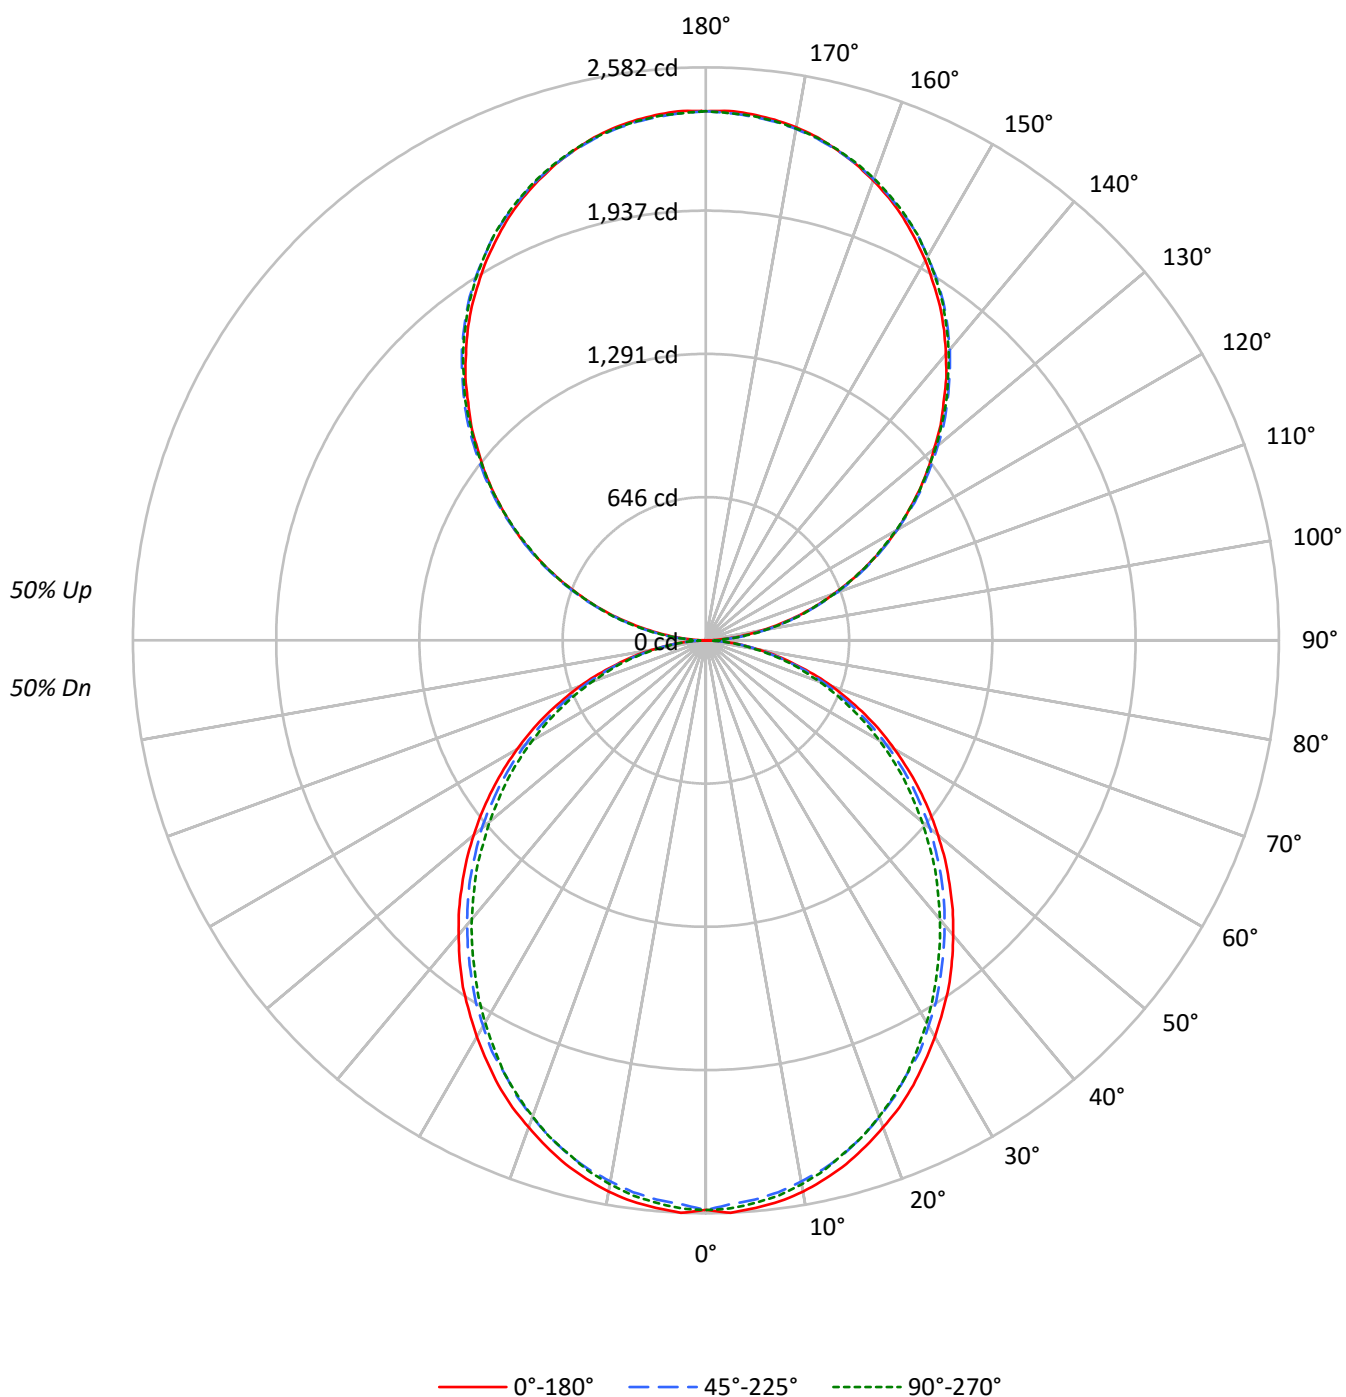

TEST NUMBER: P903736

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	89	86	90	86	83	80	73	70	68	61	59	57	49	48	47
2	89	82	75	70	82	75	70	66	64	60	56	53	50	48	43	41	40
3	81	72	64	58	74	66	60	55	56	51	47	47	43	40	38	36	34
4	74	63	56	49	68	59	52	46	50	45	40	42	38	35	34	31	29
5	68	57	48	42	63	52	45	40	45	39	35	38	33	30	31	28	25
6	63	51	43	37	58	47	40	35	40	35	30	34	30	26	28	25	22
7	58	46	38	32	53	43	35	30	37	31	27	31	27	23	26	22	20
8	54	42	34	28	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	18	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2942	2942	2942
5°	2944	2899	2919
10°	2919	2858	2879
15°	2874	2809	2816
20°	2814	2741	2752
25°	2754	2661	2678
30°	2680	2586	2584
35°	2610	2499	2485
40°	2523	2410	2390
45°	2437	2321	2293
50°	2342	2227	2181
55°	2243	2119	2078
60°	2131	1991	1960
65°	2008	1858	1820
70°	1852	1695	1670
75°	1636	1500	1530
80°	1375	1252	1265
85°	968	830	827

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2437 cd/sqm

TEST NUMBER: P903736

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	241.6	1.8
10°-20°	679.9	5.1
20°-30°	999.1	7.6
30°-40°	1160.4	8.8
40°-50°	1159.0	8.8
50°-60°	1010.6	7.7
60°-70°	747.1	5.7
70°-80°	422.7	3.2
80°-90°	118.3	0.9
90°-100°	147.6	1.1
100°-110°	468.9	3.6
110°-120°	802.4	6.1
120°-130°	1055.3	8.0
130°-140°	1184.5	9.0
140°-150°	1161.5	8.8
150°-160°	974.4	7.4
160°-170°	646.2	4.9
170°-180°	225.9	1.7
0°-30°	1920.6	14.5
0°-40°	3081.0	23.3
0°-60°	5250.6	39.8
0°-90°	6538.6	49.5
90°-120°	1418.8	10.7
90°-150°	4820.1	36.5
90°-180°	6666.0	50.5
0°-180°	13205.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2567	2567	2567	2567	2567	
5°	2567	2558	2530	2550	2545	244
15°	2444	2429	2397	2407	2395	688
25°	2212	2192	2150	2155	2150	1018
35°	1908	1884	1844	1829	1817	1192
45°	1553	1536	1498	1471	1461	1198
55°	1175	1160	1131	1101	1089	1051
65°	793	778	753	731	718	784
75°	415	410	397	383	388	443
85°	101	99	96	89	86	113
90°	2	26	70	66	68	13
95°	105	125	129	129	125	117
105°	433	439	443	446	446	457
115°	805	817	813	811	805	796
125°	1171	1189	1183	1177	1175	1047
135°	1515	1537	1541	1539	1534	1171
145°	1839	1853	1865	1867	1859	1149
155°	2103	2109	2115	2125	2119	968
165°	2288	2286	2286	2300	2290	645
175°	2380	2375	2370	2385	2372	226
180°	2385	2385	2385	2385	2385	

TEST NUMBER: P903736

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2567.2	2567.2	2567.2	2567.2	2567.2
2.5°	2582.2	2569.8	2542.6	2567.2	2562.5
5°	2567.2	2557.6	2530.3	2550.0	2545.2
7.5°	2550.0	2535.3	2508.0	2528.0	2523.0
10°	2523.0	2505.7	2476.1	2495.8	2488.4
12.5°	2485.8	2471.2	2441.6	2453.8	2448.8
15°	2443.9	2429.2	2397.0	2407.0	2394.6
17.5°	2392.0	2377.4	2345.1	2357.5	2345.1
20°	2335.1	2320.5	2285.9	2293.3	2283.6
22.5°	2278.6	2256.4	2224.1	2224.1	2219.1
25°	2211.9	2192.2	2150.3	2155.0	2150.3
27.5°	2137.7	2120.4	2088.5	2081.1	2068.8
30°	2063.9	2043.9	2007.0	1999.7	1989.7
32.5°	1984.7	1970.1	1930.5	1915.6	1905.6
35°	1908.3	1883.7	1844.1	1829.2	1816.8
37.5°	1821.8	1799.6	1760.0	1742.8	1730.4
40°	1733.1	1713.2	1673.6	1651.6	1641.6
42.5°	1646.6	1626.7	1587.4	1562.5	1547.8
45°	1552.8	1535.6	1498.4	1471.4	1461.4
47.5°	1461.4	1444.2	1404.6	1377.3	1362.7
50°	1365.1	1352.7	1318.1	1283.6	1271.3
52.5°	1271.3	1254.1	1222.1	1194.9	1177.5
55°	1175.2	1160.3	1130.7	1101.1	1088.7
57.5°	1078.8	1066.5	1034.3	1004.7	994.8
60°	982.4	972.7	938.2	911.0	903.6
62.5°	888.6	871.4	846.8	822.2	812.2
65°	792.6	777.6	753.0	730.8	718.4
67.5°	693.8	681.3	659.2	642.0	632.0
70°	602.4	592.5	570.1	552.9	543.2
72.5°	508.6	498.7	486.4	469.1	461.8
75°	414.6	409.9	397.3	382.7	387.7
77.5°	330.8	320.8	315.8	308.5	301.2
80°	246.9	244.4	239.4	232.1	227.1
82.5°	167.9	167.9	165.5	155.6	155.6
85°	101.1	98.8	96.4	88.8	86.4
87.5°	44.5	39.6	34.6	27.2	24.6
90°	2.2	25.9	70.5	66.2	68.3
92.5°	44.6	60.4	62.6	64.7	64.7
95°	105.0	125.1	128.7	128.7	125.1
97.5°	174.7	193.4	201.3	201.3	201.3
100°	255.2	271.7	277.5	277.5	275.3
102.5°	340.1	352.3	360.1	362.3	360.1
105°	432.8	438.6	442.9	446.5	446.5
107.5°	524.8	533.5	533.5	534.9	524.8
110°	614.0	625.5	625.5	625.5	619.7

TEST NUMBER: P903736

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	710.3	722.6	720.4	714.6	710.3
115°	805.2	816.7	813.1	811.0	805.2
117.5°	899.4	915.2	905.1	899.4	893.6
120°	994.3	1010.1	994.3	994.3	987.8
122.5°	1080.5	1100.7	1090.6	1084.9	1080.5
125°	1171.1	1189.1	1183.4	1176.9	1174.8
127.5°	1259.6	1281.9	1273.9	1265.4	1259.6
130°	1342.3	1368.1	1364.5	1360.3	1352.4
132.5°	1435.0	1455.1	1456.6	1446.5	1440.8
135°	1514.8	1537.1	1541.4	1539.3	1533.5
137.5°	1603.9	1621.9	1625.5	1624.1	1615.4
140°	1682.3	1700.3	1710.3	1710.3	1702.4
142.5°	1762.8	1780.8	1786.6	1788.8	1780.8
145°	1839.1	1853.4	1864.9	1867.1	1859.2
147.5°	1907.3	1925.3	1933.9	1937.6	1929.7
150°	1977.8	1990.0	1997.9	2004.4	1997.9
152.5°	2040.3	2052.6	2062.7	2070.6	2062.7
155°	2102.9	2108.7	2115.2	2125.2	2118.7
157.5°	2156.8	2161.2	2164.7	2179.1	2169.1
160°	2205.0	2209.3	2211.5	2223.6	2215.1
162.5°	2249.6	2249.6	2251.7	2265.4	2255.3
165°	2287.6	2285.5	2285.5	2299.9	2289.8
167.5°	2322.1	2315.7	2315.7	2330.1	2320.0
170°	2348.1	2342.3	2340.1	2354.6	2342.3
172.5°	2366.1	2360.3	2358.1	2372.5	2360.3
175°	2380.4	2374.6	2370.3	2384.7	2372.5
177.5°	2388.3	2382.6	2378.2	2390.5	2378.2
180°	2384.7	2384.7	2384.7	2384.7	2384.7

TEST NUMBER: P903736

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.94	11.80	11.90	12.77	14.05	10.50	11.35	11.46	12.33	13.61
	3H	12.60	13.36	13.57	14.35	15.65	12.11	12.87	13.08	13.86	15.16
	4H	13.18	13.91	14.17	14.90	16.21	12.69	13.41	13.67	14.40	15.71
	6H	13.58	14.25	14.57	15.24	16.56	13.08	13.75	14.07	14.74	16.06
	8H	13.68	14.32	14.68	15.33	16.65	13.18	13.82	14.18	14.83	16.14
	12H	13.73	14.33	14.73	15.34	16.68	13.22	13.82	14.22	14.83	16.17
4H	2H	11.40	12.12	12.39	13.11	14.42	11.04	11.77	12.03	12.76	14.07
	3H	13.26	13.86	14.26	14.88	16.20	12.85	13.46	13.85	14.47	15.80
	4H	13.97	14.52	14.98	15.53	16.88	13.54	14.10	14.55	15.11	16.46
	6H	14.48	14.96	15.50	15.99	17.33	14.05	14.52	15.07	15.56	16.90
	8H	14.62	15.07	15.65	16.10	17.46	14.19	14.63	15.21	15.66	17.02
	12H	14.70	15.10	15.74	16.14	17.50	14.25	14.65	15.29	15.69	17.06
8H	4H	14.16	14.61	15.18	15.63	16.99	13.78	14.23	14.80	15.26	16.61
	6H	14.78	15.15	15.83	16.22	17.58	14.40	14.77	15.45	15.84	17.19
	8H	15.00	15.33	16.06	16.38	17.76	14.61	14.93	15.66	15.99	17.36
	12H	15.13	15.42	16.19	16.47	17.88	14.72	15.01	15.78	16.05	17.47
12H	4H	14.14	14.55	15.18	15.59	16.95	13.78	14.18	14.82	15.22	16.58
	6H	14.81	15.14	15.87	16.19	17.57	14.44	14.77	15.49	15.82	17.19
	8H	15.05	15.34	16.11	16.39	17.80	14.67	14.96	15.73	16.01	17.42

END OF REPORT