

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903739

Luminaire Tested: DFN2DIP-SQ3F0-070D080US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903739
REPORT IS A COMBINATION OF REPORTS P901460 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D080US830-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13073.0 lumens
Efficiency: N/A
Efficacy: 103.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 126
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903739

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US830-RLLONL

Luminous Intensity Polar Plot

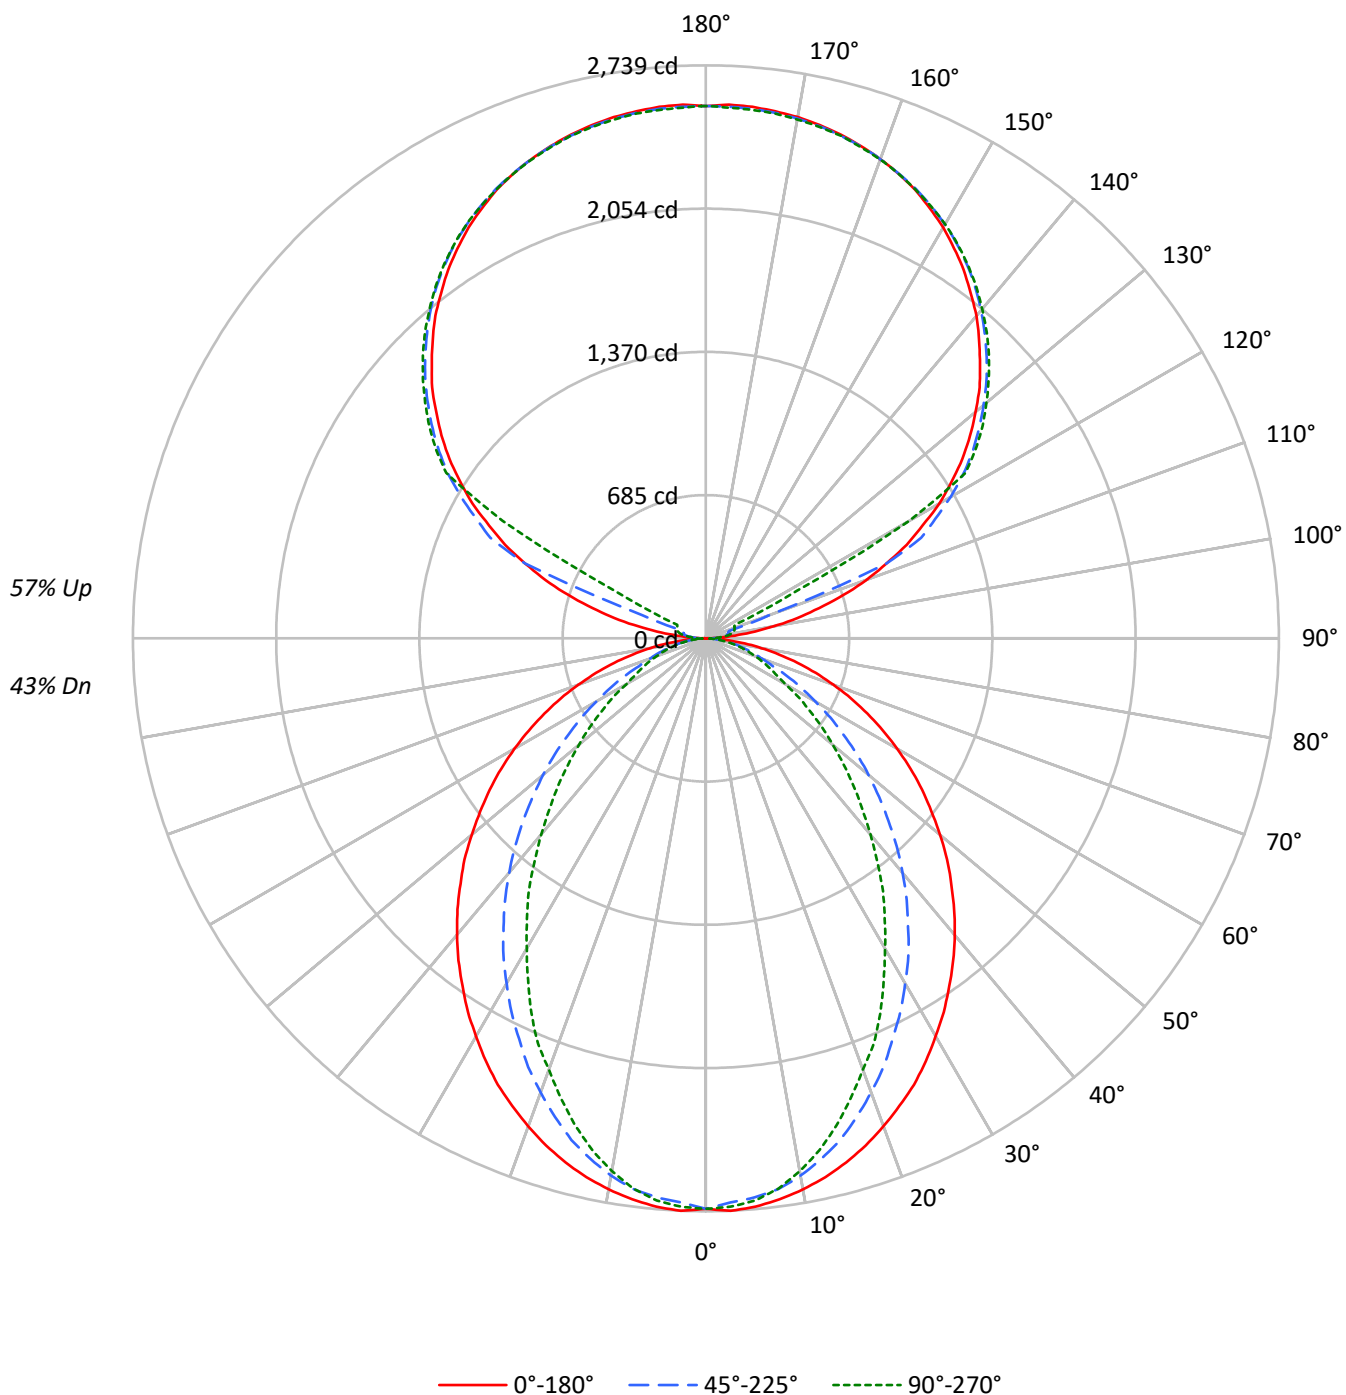

TEST NUMBER: P903739

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	50	50	50
1	97	92	89	85	88	85	82	79	70	68	66	57	55	54	44	44	43
2	88	81	75	70	81	75	70	65	62	58	55	50	48	46	40	38	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	33	32
4	74	64	56	50	68	59	52	47	49	44	40	40	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	36	33	30	29	26	24
6	63	51	43	38	57	47	40	35	40	35	31	33	29	26	26	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	35	29	49	39	32	28	33	28	24	28	24	21	22	20	17
9	50	38	31	26	46	36	29	25	30	25	22	25	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3124	3124	3124
5°	3127	3073	3094
10°	3094	3010	2992
15°	3050	2909	2835
20°	2992	2770	2644
25°	2932	2614	2458
30°	2852	2455	2224
35°	2774	2284	2018
40°	2695	2107	1782
45°	2602	1911	1568
50°	2507	1714	1359
55°	2407	1503	1159
60°	2291	1283	953
65°	2157	1059	856
70°	1995	851	774
75°	1792	746	702
80°	1497	619	605
85°	1015	403	448

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2602 cd/sqm

TEST NUMBER: P903739

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	255.6	2.0
10°-20°	701.6	5.4
20°-30°	985.0	7.5
30°-40°	1073.7	8.2
40°-50°	986.9	7.5
50°-60°	775.0	5.9
60°-70°	504.5	3.9
70°-80°	259.7	2.0
80°-90°	70.7	0.5
90°-100°	83.9	0.6
100°-110°	312.8	2.4
110°-120°	829.6	6.3
120°-130°	1376.0	10.5
130°-140°	1461.6	11.2
140°-150°	1358.4	10.4
150°-160°	1092.1	8.4
160°-170°	703.7	5.4
170°-180°	242.2	1.9
0°-30°	1942.1	14.9
0°-40°	3015.8	23.1
0°-60°	4777.7	36.5
0°-90°	5612.6	42.9
90°-120°	1226.4	9.4
90°-150°	5422.4	41.5
90°-180°	7460.0	57.1
0°-180°	13073.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2727	2727	2727	2727	2727	
5°	2727	2714	2682	2705	2697	259
15°	2594	2566	2483	2436	2411	731
25°	2354	2275	2112	2011	1974	1083
35°	2028	1903	1686	1530	1476	1270
45°	1658	1493	1234	1059	999	1281
55°	1261	1068	802	654	607	1127
65°	851	651	429	346	338	844
75°	454	281	197	180	178	480
85°	106	54	47	47	47	122
90°	2	22	37	46	50	12
95°	120	59	72	81	79	142
105°	560	615	112	132	140	598
115°	1059	1090	1136	284	151	1042
125°	1497	1521	1556	1569	1574	1335
135°	1852	1882	1898	1917	1913	1431
145°	2149	2147	2178	2191	2182	1344
155°	2366	2350	2372	2383	2368	1090
165°	2493	2482	2488	2501	2488	704
175°	2550	2537	2541	2554	2536	243
180°	2545	2545	2545	2545	2545	

TEST NUMBER: P903739

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2726.9	2726.9	2726.9	2726.9	2726.9
2.5°	2739.1	2726.9	2699.6	2724.5	2719.5
5°	2726.9	2714.5	2682.4	2704.6	2697.3
7.5°	2704.6	2689.9	2655.4	2665.0	2652.8
10°	2675.0	2657.8	2608.5	2600.9	2586.2
12.5°	2638.1	2615.8	2549.1	2534.4	2507.2
15°	2593.6	2566.4	2482.6	2435.7	2411.1
17.5°	2541.8	2502.3	2398.6	2344.3	2304.8
20°	2482.6	2433.1	2309.8	2248.2	2193.8
22.5°	2418.5	2361.6	2218.4	2134.6	2097.7
25°	2354.3	2275.2	2112.3	2011.3	1974.2
27.5°	2277.8	2193.8	2013.6	1897.7	1840.9
30°	2196.4	2102.4	1905.0	1779.3	1712.6
32.5°	2117.3	2003.8	1801.6	1653.4	1591.6
35°	2028.5	1902.6	1685.6	1530.1	1475.6
37.5°	1942.2	1806.3	1577.0	1406.5	1345.0
40°	1850.8	1702.9	1463.3	1288.2	1224.0
42.5°	1757.1	1599.2	1349.9	1167.2	1105.7
45°	1658.4	1492.9	1234.0	1058.6	999.4
47.5°	1564.6	1389.5	1122.9	947.5	893.3
50°	1460.9	1285.8	1014.3	843.9	792.3
52.5°	1359.6	1174.5	910.6	747.7	700.9
55°	1260.9	1068.5	801.9	654.0	607.2
57.5°	1159.9	962.4	705.9	567.6	528.1
60°	1056.2	858.8	604.5	478.9	439.3
62.5°	955.1	757.7	518.1	399.8	380.1
65°	851.4	651.4	429.4	345.6	338.0
67.5°	752.7	552.7	345.6	303.4	296.1
70°	649.0	456.6	286.2	261.6	251.6
72.5°	550.4	367.6	239.3	219.7	214.7
75°	454.0	281.2	197.4	180.1	177.8
77.5°	357.9	199.7	155.5	145.5	140.6
80°	268.9	143.2	118.4	108.7	108.7
82.5°	187.5	96.3	81.4	76.4	76.4
85°	106.0	54.2	46.8	46.8	46.8
87.5°	39.5	19.6	19.6	17.2	17.2
90°	1.8	22.1	36.8	46.1	49.7
92.5°	46.1	38.7	44.2	47.9	49.7
95°	119.6	58.8	71.7	81.2	79.2
97.5°	215.4	64.5	93.8	99.5	101.2
100°	326.0	73.7	105.0	119.6	123.3
102.5°	447.4	443.8	108.7	128.8	134.5
105°	559.8	615.1	112.4	132.5	140.0
107.5°	690.5	736.4	116.1	136.2	143.6
110°	815.9	854.3	322.3	138.2	145.4

TEST NUMBER: P903739

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	933.7	966.7	935.5	141.7	147.4
115°	1058.8	1090.1	1136.1	283.6	151.1
117.5°	1167.4	1204.2	1235.7	972.1	489.8
120°	1289.0	1316.5	1349.8	1371.9	1123.2
122.5°	1391.9	1421.5	1458.5	1469.4	1471.4
125°	1496.9	1521.0	1555.9	1568.9	1574.3
127.5°	1592.7	1618.5	1646.3	1664.6	1666.4
130°	1683.0	1712.5	1732.7	1753.0	1751.2
132.5°	1775.1	1799.1	1819.3	1835.9	1834.1
135°	1852.5	1882.0	1898.4	1917.0	1913.3
137.5°	1933.4	1955.5	1974.1	1992.4	1987.0
140°	2012.5	2027.4	2047.6	2064.2	2054.9
142.5°	2079.1	2091.9	2115.7	2130.4	2121.2
145°	2149.0	2147.0	2178.3	2191.2	2182.0
147.5°	2209.6	2204.1	2235.3	2244.6	2237.3
150°	2268.6	2255.7	2285.2	2296.1	2287.0
152.5°	2318.3	2303.6	2331.1	2342.3	2329.4
155°	2366.2	2349.8	2371.8	2382.7	2368.1
157.5°	2404.8	2390.2	2406.8	2419.7	2404.8
160°	2438.1	2427.0	2438.1	2449.0	2436.1
162.5°	2467.4	2456.5	2465.6	2478.5	2461.9
165°	2493.2	2482.3	2487.7	2500.6	2487.7
167.5°	2513.5	2502.4	2508.0	2520.9	2504.3
170°	2530.2	2518.9	2522.7	2535.6	2518.9
172.5°	2541.1	2530.2	2533.8	2546.7	2530.2
175°	2550.2	2537.3	2541.1	2553.9	2535.6
177.5°	2553.9	2541.1	2543.0	2555.9	2539.3
180°	2544.8	2544.8	2544.8	2544.8	2544.8

TEST NUMBER: P903739

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.37	11.15	11.40	12.18	13.55	6.33	7.11	7.36	8.14	9.51
	3H	12.04	12.74	13.07	13.77	15.16	7.51	8.21	8.54	9.24	10.63
	4H	12.65	13.30	13.69	14.34	15.74	7.96	8.61	9.00	9.65	11.05
	6H	13.06	13.66	14.11	14.71	16.12	8.27	8.87	9.32	9.91	11.32
	8H	13.18	13.76	14.24	14.82	16.22	8.35	8.93	9.41	9.99	11.39
	12H	13.24	13.79	14.30	14.84	16.27	8.39	8.94	9.46	9.99	11.42
4H	2H	10.38	11.04	11.43	12.08	13.48	6.92	7.58	7.97	8.61	10.01
	3H	12.20	12.75	13.26	13.81	15.22	8.26	8.80	9.32	9.87	11.28
	4H	12.89	13.39	13.95	14.44	15.88	8.80	9.30	9.86	10.36	11.79
	6H	13.40	13.82	14.47	14.90	16.33	9.21	9.64	10.28	10.72	12.15
	8H	13.57	13.97	14.64	15.04	16.48	9.33	9.73	10.41	10.80	12.25
	12H	13.66	14.02	14.75	15.10	16.55	9.39	9.75	10.48	10.84	12.29
8H	4H	12.85	13.25	13.92	14.32	15.77	9.07	9.47	10.15	10.54	11.99
	6H	13.41	13.74	14.51	14.85	16.29	9.58	9.91	10.68	11.02	12.47
	8H	13.62	13.91	14.73	15.01	16.47	9.77	10.06	10.87	11.15	12.61
	12H	13.76	14.01	14.86	15.10	16.60	9.88	10.13	10.98	11.22	12.72
12H	4H	12.80	13.16	13.89	14.25	15.70	9.07	9.44	10.16	10.52	11.97
	6H	13.38	13.67	14.49	14.77	16.23	9.63	9.92	10.73	11.01	12.47
	8H	13.60	13.85	14.70	14.95	16.45	9.83	10.08	10.94	11.18	12.68

END OF REPORT