

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903773

Luminaire Tested: DFN2DIP-SQ3F0-080D080US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903773
REPORT IS A COMBINATION OF REPORTS P901461 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-080D080US830-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14929.9 lumens
Efficiency: N/A
Efficacy: 109.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 136.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903773

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US830-FLLONL

Luminous Intensity Polar Plot

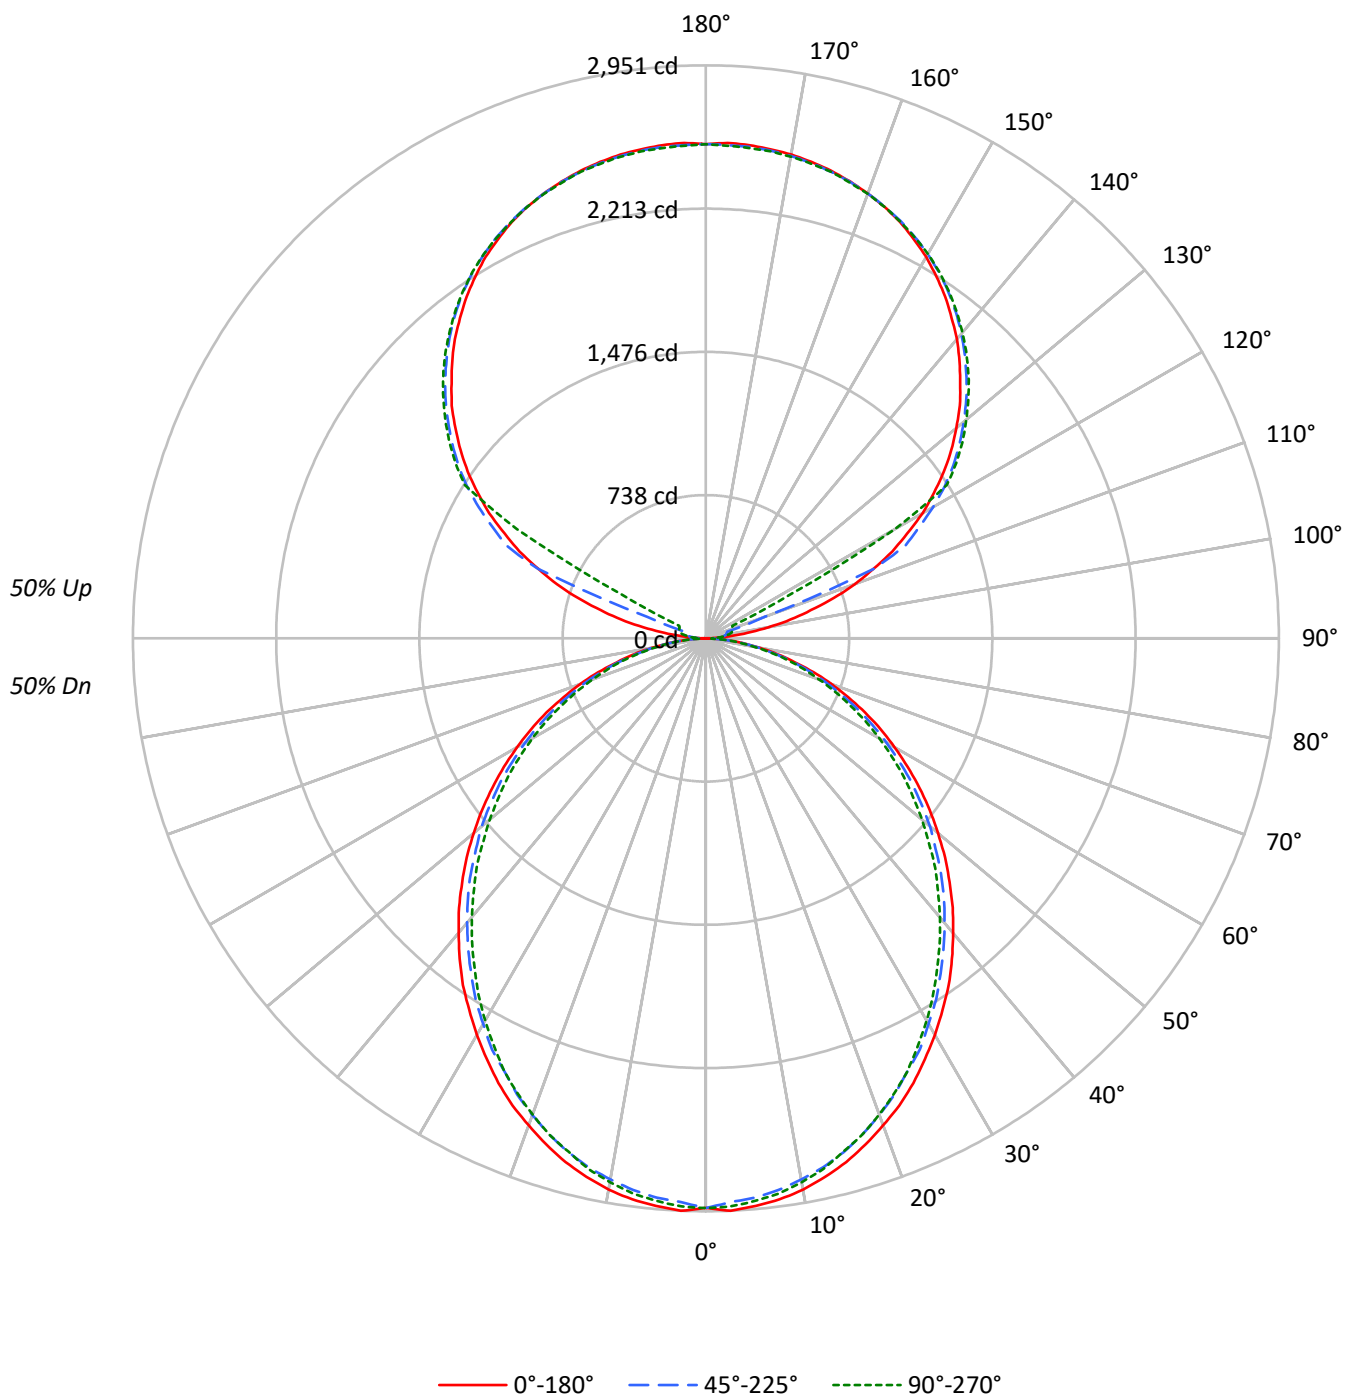

TEST NUMBER: P903773

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3362	3362	3362
5°	3365	3313	3336
10°	3336	3266	3290
15°	3284	3210	3218
20°	3216	3133	3145
25°	3148	3041	3060
30°	3063	2956	2953
35°	2982	2856	2840
40°	2884	2754	2731
45°	2785	2652	2621
50°	2677	2545	2493
55°	2563	2422	2375
60°	2435	2275	2240
65°	2295	2123	2080
70°	2116	1938	1909
75°	1870	1715	1748
80°	1572	1431	1445
85°	1107	949	946

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2785 cd/sqm

TEST NUMBER: P903773

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	276.1	1.8
10°-20°	777.0	5.2
20°-30°	1141.8	7.6
30°-40°	1326.2	8.9
40°-50°	1324.5	8.9
50°-60°	1155.0	7.7
60°-70°	853.8	5.7
70°-80°	483.0	3.2
80°-90°	132.0	0.9
90°-100°	83.9	0.6
100°-110°	312.8	2.1
110°-120°	829.6	5.6
120°-130°	1376.0	9.2
130°-140°	1461.6	9.8
140°-150°	1358.4	9.1
150°-160°	1092.1	7.3
160°-170°	703.7	4.7
170°-180°	242.2	1.6
0°-30°	2195.0	14.7
0°-40°	3521.1	23.6
0°-60°	6000.6	40.2
0°-90°	7469.4	50.0
90°-120°	1226.4	8.2
90°-150°	5422.4	36.3
90°-180°	7460.0	50.0
0°-180°	14929.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2934	2934	2934	2934	2934	
5°	2934	2923	2892	2914	2909	279
15°	2793	2776	2739	2751	2737	787
25°	2528	2505	2458	2463	2458	1163
35°	2181	2153	2108	2090	2076	1362
45°	1775	1755	1712	1682	1670	1370
55°	1343	1326	1292	1258	1244	1201
65°	906	889	860	835	821	896
75°	474	468	454	437	443	506
85°	116	113	110	102	99	129
90°	2	22	37	46	50	14
95°	120	59	72	81	79	142
105°	560	615	112	132	140	598
115°	1059	1090	1136	284	151	1042
125°	1497	1521	1556	1569	1574	1335
135°	1852	1882	1898	1917	1913	1431
145°	2149	2147	2178	2191	2182	1344
155°	2366	2350	2372	2383	2368	1090
165°	2493	2482	2488	2501	2488	704
175°	2550	2537	2541	2554	2536	243
180°	2545	2545	2545	2545	2545	

TEST NUMBER: P903773

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2933.9	2933.9	2933.9	2933.9	2933.9
2.5°	2951.0	2937.0	2905.9	2933.9	2928.6
5°	2933.9	2922.9	2891.8	2914.2	2908.9
7.5°	2914.2	2897.5	2866.4	2889.1	2883.4
10°	2883.4	2863.6	2829.8	2852.2	2843.9
12.5°	2840.9	2824.1	2790.3	2804.3	2798.7
15°	2793.0	2776.3	2739.4	2750.8	2736.8
17.5°	2733.7	2717.0	2680.1	2694.3	2680.1
20°	2668.8	2652.0	2612.5	2620.9	2609.8
22.5°	2604.2	2578.7	2541.8	2541.8	2536.2
25°	2527.8	2505.4	2457.5	2462.9	2457.5
27.5°	2443.1	2423.4	2386.8	2378.4	2364.4
30°	2358.7	2335.9	2293.8	2285.4	2274.0
32.5°	2268.3	2251.5	2206.3	2189.2	2177.9
35°	2180.9	2152.8	2107.5	2090.5	2076.4
37.5°	2082.1	2056.6	2011.5	1991.7	1977.6
40°	1980.7	1957.8	1912.7	1887.5	1876.1
42.5°	1881.9	1859.1	1814.2	1785.7	1769.1
45°	1774.7	1754.9	1712.4	1681.6	1670.3
47.5°	1670.3	1650.5	1605.2	1574.1	1557.4
50°	1560.1	1546.1	1506.5	1467.0	1452.9
52.5°	1452.9	1433.1	1396.7	1365.6	1345.8
55°	1343.0	1326.0	1292.2	1258.4	1244.3
57.5°	1232.9	1218.9	1182.0	1148.2	1136.8
60°	1122.8	1111.7	1072.1	1041.0	1032.6
62.5°	1015.6	995.9	967.7	939.6	928.2
65°	905.8	888.7	860.5	835.1	821.0
67.5°	792.9	778.5	753.4	733.7	722.3
70°	688.4	677.0	651.7	631.9	620.8
72.5°	581.3	570.0	555.8	536.1	527.7
75°	473.8	468.4	454.1	437.3	443.0
77.5°	378.1	366.6	361.0	352.6	344.2
80°	282.3	279.3	273.6	265.2	259.5
82.5°	191.9	191.9	189.2	177.8	177.8
85°	115.6	112.8	110.2	101.5	98.8
87.5°	50.9	45.2	39.5	31.1	28.2
90°	1.8	22.1	36.8	46.1	49.7
92.5°	46.1	38.7	44.2	47.9	49.7
95°	119.6	58.8	71.7	81.2	79.2
97.5°	215.4	64.5	93.8	99.5	101.2
100°	326.0	73.7	105.0	119.6	123.3
102.5°	447.4	443.8	108.7	128.8	134.5
105°	559.8	615.1	112.4	132.5	140.0
107.5°	690.5	736.4	116.1	136.2	143.6
110°	815.9	854.3	322.3	138.2	145.4



TEST NUMBER: P903773

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	933.7	966.7	935.5	141.7	147.4
115°	1058.8	1090.1	1136.1	283.6	151.1
117.5°	1167.4	1204.2	1235.7	972.1	489.8
120°	1289.0	1316.5	1349.8	1371.9	1123.2
122.5°	1391.9	1421.5	1458.5	1469.4	1471.4
125°	1496.9	1521.0	1555.9	1568.9	1574.3
127.5°	1592.7	1618.5	1646.3	1664.6	1666.4
130°	1683.0	1712.5	1732.7	1753.0	1751.2
132.5°	1775.1	1799.1	1819.3	1835.9	1834.1
135°	1852.5	1882.0	1898.4	1917.0	1913.3
137.5°	1933.4	1955.5	1974.1	1992.4	1987.0
140°	2012.5	2027.4	2047.6	2064.2	2054.9
142.5°	2079.1	2091.9	2115.7	2130.4	2121.2
145°	2149.0	2147.0	2178.3	2191.2	2182.0
147.5°	2209.6	2204.1	2235.3	2244.6	2237.3
150°	2268.6	2255.7	2285.2	2296.1	2287.0
152.5°	2318.3	2303.6	2331.1	2342.3	2329.4
155°	2366.2	2349.8	2371.8	2382.7	2368.1
157.5°	2404.8	2390.2	2406.8	2419.7	2404.8
160°	2438.1	2427.0	2438.1	2449.0	2436.1
162.5°	2467.4	2456.5	2465.6	2478.5	2461.9
165°	2493.2	2482.3	2487.7	2500.6	2487.7
167.5°	2513.5	2502.4	2508.0	2520.9	2504.3
170°	2530.2	2518.9	2522.7	2535.6	2518.9
172.5°	2541.1	2530.2	2533.8	2546.7	2530.2
175°	2550.2	2537.3	2541.1	2553.9	2535.6
177.5°	2553.9	2541.1	2543.0	2555.9	2539.3
180°	2544.8	2544.8	2544.8	2544.8	2544.8

TEST NUMBER: P903773

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.45	12.32	12.41	13.29	14.56	11.01	11.87	11.97	12.84	14.11
	3H	13.11	13.88	14.08	14.86	16.16	12.62	13.39	13.59	14.37	15.67
	4H	13.69	14.43	14.68	15.41	16.71	13.20	13.93	14.18	14.92	16.22
	6H	14.09	14.76	15.08	15.75	17.07	13.59	14.26	14.58	15.25	16.57
	8H	14.19	14.84	15.19	15.84	17.15	13.69	14.33	14.69	15.34	16.65
	12H	14.24	14.85	15.24	15.85	17.19	13.73	14.34	14.73	15.34	16.68
4H	2H	11.91	12.64	12.90	13.63	14.93	11.56	12.29	12.54	13.27	14.57
	3H	13.77	14.38	14.77	15.40	16.71	13.36	13.97	14.36	14.99	16.30
	4H	14.48	15.04	15.49	16.05	17.39	14.06	14.62	15.06	15.62	16.96
	6H	14.99	15.47	16.01	16.50	17.84	14.56	15.04	15.58	16.07	17.41
	8H	15.14	15.59	16.16	16.61	17.96	14.70	15.15	15.72	16.18	17.53
	12H	15.21	15.62	16.25	16.66	18.01	14.76	15.17	15.80	16.21	17.56
8H	4H	14.67	15.12	15.69	16.15	17.50	14.30	14.75	15.31	15.77	17.12
	6H	15.30	15.67	16.34	16.74	18.08	14.92	15.29	15.96	16.35	17.70
	8H	15.52	15.84	16.57	16.89	18.26	15.12	15.45	16.17	16.50	17.87
	12H	15.64	15.93	16.70	16.98	18.39	15.23	15.52	16.29	16.57	17.98
12H	4H	14.66	15.06	15.70	16.10	17.46	14.29	14.70	15.33	15.74	17.09
	6H	15.33	15.65	16.38	16.71	18.07	14.95	15.28	16.00	16.33	17.70
	8H	15.57	15.85	16.62	16.90	18.31	15.18	15.47	16.24	16.52	17.93

END OF REPORT