

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903793

Luminaire Tested: DFN2DIP-SQ3F0-090D040US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903793
REPORT IS A COMBINATION OF REPORTS P901391 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D040US830-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12130.5 lumens
Efficiency: N/A
Efficacy: 102.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 118.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903793

CATALOG NUMBER: DFN2DIP-SQ3F0-090D040US830-FLLONL

Luminous Intensity Polar Plot

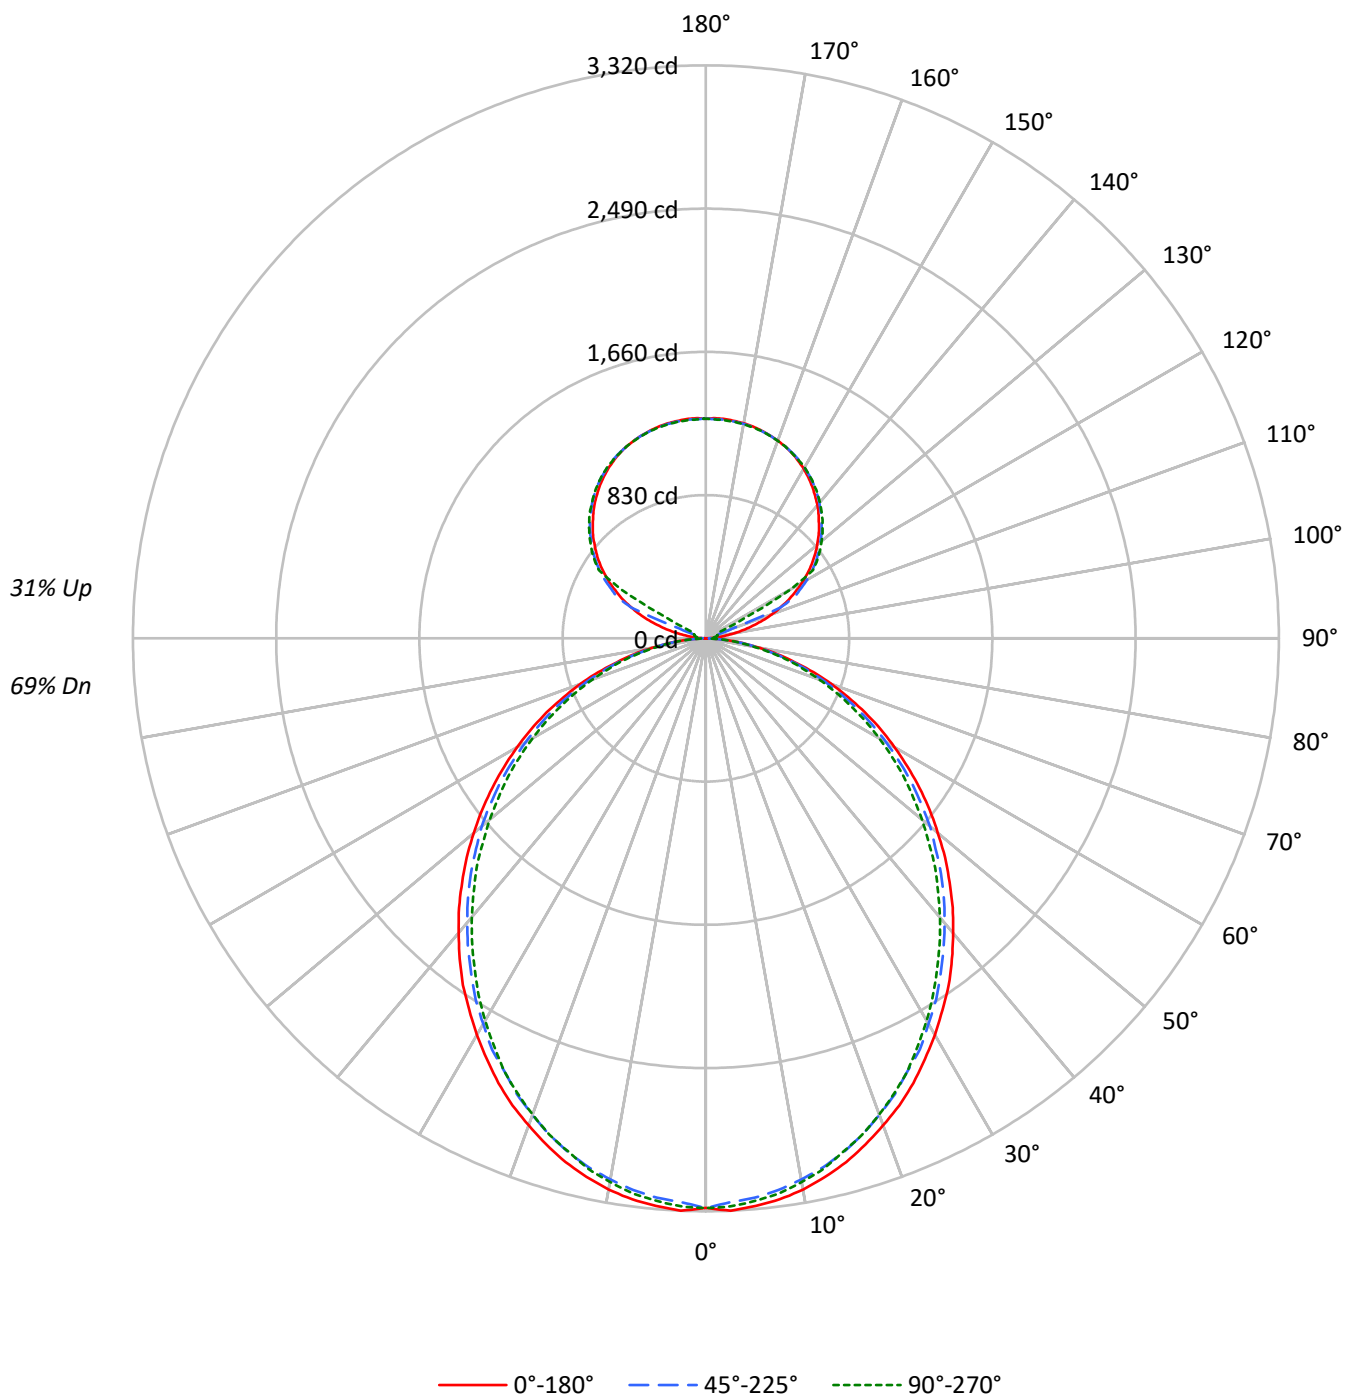

TEST NUMBER: P903793

CATALOG NUMBER: DFN2DIP-SQ3F0-090D040US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	83	83	83	74	74	74
1	102	98	94	90	96	92	89	86	83	80	77	74	72	70	65	64	62
2	93	85	79	74	88	81	75	70	72	68	64	65	61	58	57	55	53
3	85	75	67	61	80	71	64	59	64	59	54	57	53	49	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	46	42	46	42	39
5	71	59	51	45	67	57	49	43	51	45	40	46	41	37	41	37	34
6	66	53	45	39	62	51	43	38	46	40	35	42	36	32	37	33	30
7	61	48	40	34	58	46	39	33	42	36	31	38	33	29	34	30	26
8	57	44	36	31	54	42	35	30	38	32	28	35	29	26	31	27	24
9	53	40	33	27	50	39	31	27	35	29	25	32	27	23	29	25	21
10	50	37	30	25	47	36	29	24	32	27	22	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3782	3782	3782
5°	3786	3727	3753
10°	3753	3674	3701
15°	3695	3611	3620
20°	3618	3524	3538
25°	3541	3422	3443
30°	3446	3325	3322
35°	3355	3213	3195
40°	3244	3098	3073
45°	3133	2984	2949
50°	3011	2864	2805
55°	2884	2724	2672
60°	2740	2560	2520
65°	2582	2388	2341
70°	2381	2180	2147
75°	2104	1930	1967
80°	1768	1609	1626
85°	1245	1066	1064

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3133 cd/sqm

TEST NUMBER: P903793

CATALOG NUMBER: DFN2DIP-SQ3F0-090D040US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	310.7	2.6
10°-20°	874.1	7.2
20°-30°	1284.6	10.6
30°-40°	1492.0	12.3
40°-50°	1490.1	12.3
50°-60°	1299.3	10.7
60°-70°	960.5	7.9
70°-80°	543.4	4.5
80°-90°	145.7	1.2
90°-100°	41.9	0.3
100°-110°	156.4	1.3
110°-120°	414.8	3.4
120°-130°	688.0	5.7
130°-140°	730.8	6.0
140°-150°	679.2	5.6
150°-160°	546.1	4.5
160°-170°	351.9	2.9
170°-180°	121.1	1.0
0°-30°	2469.3	20.4
0°-40°	3961.3	32.7
0°-60°	6750.7	55.7
0°-90°	8400.3	69.2
90°-120°	613.2	5.1
90°-150°	2711.2	22.4
90°-180°	3730.0	30.7
0°-180°	12130.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3301	3301	3301	3301	3301	
5°	3301	3288	3253	3278	3272	313
15°	3142	3123	3082	3095	3079	885
25°	2844	2818	2765	2771	2765	1309
35°	2454	2422	2371	2352	2336	1532
45°	1996	1974	1926	1892	1879	1541
55°	1511	1492	1454	1416	1400	1351
65°	1019	1000	968	940	924	1007
75°	533	527	511	492	498	569
85°	130	127	124	114	111	145
90°	1	11	18	23	25	11
95°	60	29	36	40	40	71
105°	280	308	56	66	70	299
115°	529	545	568	142	76	521
125°	748	760	778	784	787	668
135°	926	941	949	958	957	715
145°	1074	1074	1089	1096	1091	672
155°	1183	1175	1186	1191	1184	545
165°	1247	1241	1244	1250	1244	352
175°	1275	1269	1270	1277	1268	121
180°	1272	1272	1272	1272	1272	

TEST NUMBER: P903793

CATALOG NUMBER: DFN2DIP-SQ3F0-090D040US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3300.7	3300.7	3300.7	3300.7	3300.7
2.5°	3319.9	3304.1	3269.1	3300.7	3294.7
5°	3300.7	3288.2	3253.3	3278.5	3272.4
7.5°	3278.5	3259.7	3224.6	3250.3	3243.9
10°	3243.9	3221.6	3183.5	3208.8	3199.4
12.5°	3196.0	3177.1	3139.1	3154.9	3148.6
15°	3142.2	3123.3	3081.8	3094.6	3078.8
17.5°	3075.4	3056.6	3015.2	3031.0	3015.2
20°	3002.4	2983.5	2939.0	2948.5	2936.0
22.5°	2929.6	2901.1	2859.6	2859.6	2853.2
25°	2843.7	2818.5	2764.7	2770.7	2764.7
27.5°	2748.5	2726.2	2685.2	2675.8	2659.9
30°	2653.5	2627.9	2580.4	2571.0	2558.2
32.5°	2551.8	2533.0	2482.1	2463.0	2450.1
35°	2453.5	2421.9	2371.0	2351.8	2336.0
37.5°	2342.4	2313.8	2262.9	2240.7	2224.9
40°	2228.2	2202.6	2151.7	2123.5	2110.7
42.5°	2117.0	2091.5	2041.0	2009.0	1990.2
45°	1996.5	1974.3	1926.5	1891.8	1879.1
47.5°	1879.1	1856.8	1805.9	1770.9	1752.1
50°	1755.1	1739.3	1694.8	1650.4	1634.6
52.5°	1634.6	1612.3	1571.2	1536.2	1514.0
55°	1511.0	1491.8	1453.7	1415.7	1399.9
57.5°	1387.0	1371.2	1329.8	1291.8	1278.9
60°	1263.1	1250.7	1206.2	1171.2	1161.8
62.5°	1142.5	1120.3	1088.6	1057.1	1044.2
65°	1019.0	999.8	968.1	939.5	923.7
67.5°	892.0	875.9	847.5	825.4	812.6
70°	774.5	761.7	733.1	710.9	698.4
72.5°	653.9	641.1	625.3	603.1	593.7
75°	533.1	527.0	510.9	492.0	498.4
77.5°	425.3	412.6	406.1	396.7	387.3
80°	317.5	314.1	307.7	298.3	292.0
82.5°	215.8	215.8	212.8	200.0	200.0
85°	130.0	127.0	123.9	114.1	111.1
87.5°	57.2	50.8	44.5	35.1	31.7
90°	0.8	11.0	18.4	23.1	24.8
92.5°	23.1	19.3	22.1	23.9	24.8
95°	59.8	29.4	35.8	40.5	39.6
97.5°	107.7	32.2	46.9	49.8	50.6
100°	163.0	36.9	52.5	59.8	61.6
102.5°	223.7	222.0	54.3	64.4	67.2
105°	279.8	307.6	56.2	66.3	69.9
107.5°	345.3	368.3	58.1	68.1	71.8
110°	407.9	427.2	161.2	69.1	72.7

TEST NUMBER: P903793

CATALOG NUMBER: DFN2DIP-SQ3F0-090D040US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	466.8	483.3	467.7	70.9	73.7
115°	529.3	545.0	568.1	141.8	75.6
117.5°	583.7	602.1	617.8	486.1	244.9
120°	644.5	658.3	674.9	686.0	561.7
122.5°	696.0	710.8	729.2	734.7	735.7
125°	748.5	760.5	778.0	784.5	787.2
127.5°	796.4	809.3	823.1	832.4	833.2
130°	841.5	856.3	866.3	876.5	875.6
132.5°	887.5	899.6	909.6	917.9	917.1
135°	926.2	941.0	949.2	958.5	956.7
137.5°	966.7	977.7	987.0	996.2	993.4
140°	1006.3	1013.7	1023.8	1032.1	1027.5
142.5°	1039.5	1045.9	1057.9	1065.2	1060.6
145°	1074.5	1073.6	1089.1	1095.6	1091.0
147.5°	1104.8	1102.0	1117.7	1122.3	1118.7
150°	1134.3	1127.8	1142.6	1148.1	1143.5
152.5°	1159.1	1151.8	1165.5	1171.1	1164.7
155°	1183.1	1174.9	1185.9	1191.4	1184.0
157.5°	1202.4	1195.0	1203.4	1209.8	1202.4
160°	1219.0	1213.4	1219.0	1224.5	1218.0
162.5°	1233.7	1228.2	1232.8	1239.3	1231.0
165°	1246.6	1241.1	1243.9	1250.3	1243.9
167.5°	1256.8	1251.1	1254.1	1260.5	1252.2
170°	1265.1	1259.5	1261.3	1267.8	1259.5
172.5°	1270.5	1265.1	1267.0	1273.4	1265.1
175°	1275.1	1268.7	1270.5	1277.0	1267.8
177.5°	1277.0	1270.5	1271.5	1278.0	1269.7
180°	1272.4	1272.4	1272.4	1272.4	1272.4

TEST NUMBER: P903793

CATALOG NUMBER: DFN2DIP-SQ3F0-090D040US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.47	14.54	14.24	15.33	16.30	13.03	14.09	13.80	14.89	15.85
	3H	15.14	16.10	15.93	16.90	17.90	14.65	15.61	15.44	16.41	17.41
	4H	15.74	16.64	16.54	17.45	18.46	15.24	16.15	16.05	16.96	17.97
	6H	16.14	16.98	16.96	17.80	18.82	15.64	16.48	16.46	17.30	18.32
	8H	16.25	17.05	17.08	17.89	18.91	15.75	16.55	16.58	17.39	18.41
	12H	16.31	17.06	17.14	17.90	18.95	15.80	16.55	16.63	17.39	18.44
4H	2H	13.95	14.86	14.76	15.67	16.68	13.60	14.50	14.40	15.31	16.32
	3H	15.83	16.59	16.65	17.43	18.46	15.42	16.18	16.24	17.03	18.05
	4H	16.55	17.24	17.38	18.08	19.13	16.13	16.81	16.96	17.66	18.71
	6H	17.07	17.67	17.92	18.54	19.59	16.64	17.24	17.49	18.10	19.16
	8H	17.22	17.78	18.08	18.65	19.71	16.79	17.34	17.64	18.21	19.28
	12H	17.31	17.81	18.18	18.69	19.77	16.86	17.36	17.73	18.24	19.32
8H	4H	16.76	17.31	17.61	18.18	19.25	16.38	16.94	17.23	17.80	18.87
	6H	17.39	17.85	18.27	18.76	19.83	17.01	17.47	17.89	18.38	19.45
	8H	17.61	18.02	18.50	18.92	20.01	17.22	17.63	18.11	18.53	19.62
	12H	17.75	18.11	18.64	19.00	20.14	17.34	17.70	18.23	18.59	19.73
12H	4H	16.75	17.25	17.63	18.14	19.21	16.39	16.89	17.26	17.77	18.85
	6H	17.42	17.83	18.31	18.73	19.82	17.05	17.46	17.94	18.36	19.45
	8H	17.67	18.03	18.56	18.92	20.06	17.29	17.65	18.18	18.54	19.68

END OF REPORT