

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903820

Luminaire Tested: DFN2DIP-SQ3F0-090D110US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903820
REPORT IS A COMBINATION OF REPORTS P899997 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D110US830-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17573.7 lumens
Efficiency: N/A
Efficacy: 101.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 173.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903820

CATALOG NUMBER: DFN2DIP-SQ3F0-090D110US830-FLLFLL

Luminous Intensity Polar Plot

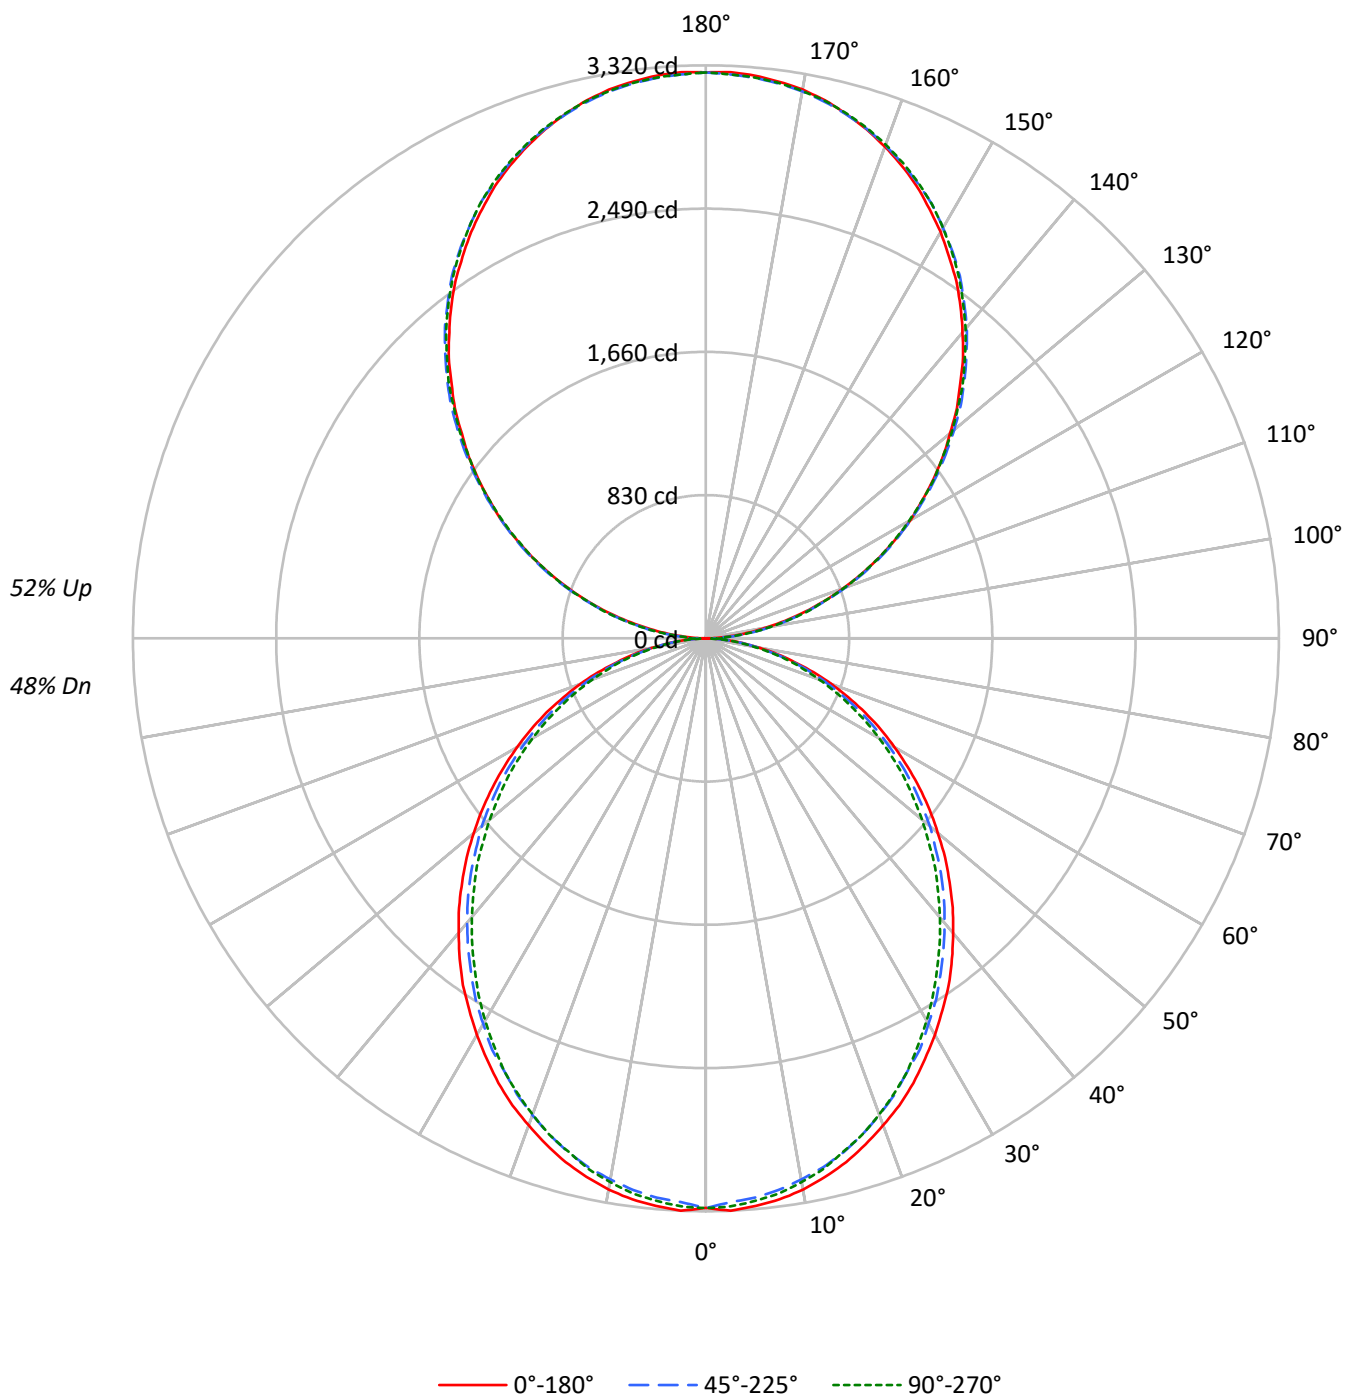

TEST NUMBER: P903820

CATALOG NUMBER: DFN2DIP-SQ3F0-090D110US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	68	68	68	54	54	54
1	97	93	89	86	89	86	82	79	72	70	67	59	58	56	48	47	46
2	89	81	75	70	81	75	70	65	63	59	56	52	49	47	42	40	38
3	81	71	64	58	74	66	60	54	56	51	47	46	43	40	37	35	33
4	74	63	55	49	68	58	51	46	49	44	40	41	37	34	33	31	28
5	68	56	48	42	62	52	45	40	44	39	34	37	33	29	30	27	25
6	62	50	42	37	57	47	40	34	40	34	30	33	29	26	27	24	22
7	58	46	38	32	53	42	35	30	36	31	26	30	26	23	25	22	19
8	54	41	34	28	49	38	32	27	33	27	24	28	23	20	23	20	17
9	50	38	30	25	46	35	28	24	30	25	21	26	21	18	21	18	16
10	47	35	27	23	43	32	26	21	28	23	19	24	19	17	20	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3782	3782	3782
5°	3786	3727	3753
10°	3753	3674	3701
15°	3695	3611	3620
20°	3618	3524	3538
25°	3541	3422	3443
30°	3446	3325	3322
35°	3355	3213	3195
40°	3244	3098	3073
45°	3133	2984	2949
50°	3011	2864	2805
55°	2884	2724	2672
60°	2740	2560	2520
65°	2582	2388	2341
70°	2381	2180	2147
75°	2104	1930	1967
80°	1768	1609	1626
85°	1245	1066	1064

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3298 cd/sqm

TEST NUMBER: P903820

CATALOG NUMBER: DFN2DIP-SQ3F0-090D110US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	310.7	1.8
10°-20°	874.1	5.0
20°-30°	1284.6	7.3
30°-40°	1492.0	8.5
40°-50°	1490.1	8.5
50°-60°	1299.3	7.4
60°-70°	960.5	5.5
70°-80°	543.4	3.1
80°-90°	152.7	0.9
90°-100°	202.9	1.2
100°-110°	644.7	3.7
110°-120°	1103.3	6.3
120°-130°	1451.0	8.3
130°-140°	1628.6	9.3
140°-150°	1597.1	9.1
150°-160°	1339.7	7.6
160°-170°	888.5	5.1
170°-180°	310.5	1.8
0°-30°	2469.3	14.1
0°-40°	3961.3	22.5
0°-60°	6750.7	38.4
0°-90°	8407.4	47.8
90°-120°	1950.9	11.1
90°-150°	6627.6	37.7
90°-180°	9166.0	52.2
0°-180°	17573.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3301	3301	3301	3301	3301	
5°	3301	3288	3253	3278	3272	313
15°	3142	3123	3082	3095	3079	885
25°	2844	2818	2765	2771	2765	1309
35°	2454	2422	2371	2352	2336	1532
45°	1996	1974	1926	1892	1879	1541
55°	1511	1492	1454	1416	1400	1351
65°	1019	1000	968	940	924	1007
75°	533	527	511	492	498	569
85°	130	127	124	114	111	145
90°	3	36	97	91	94	17
95°	144	172	177	177	172	161
105°	595	603	609	614	614	628
115°	1107	1123	1118	1115	1107	1095
125°	1610	1635	1627	1618	1615	1439
135°	2083	2114	2119	2116	2109	1610
145°	2529	2548	2564	2567	2556	1580
155°	2892	2899	2908	2922	2913	1331
165°	3146	3142	3142	3162	3148	887
175°	3273	3265	3259	3279	3262	311
180°	3279	3279	3279	3279	3279	



TEST NUMBER: P903820

CATALOG NUMBER: DFN2DIP-SQ3F0-090D110US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3300.7	3300.7	3300.7	3300.7	3300.7
2.5°	3319.9	3304.1	3269.1	3300.7	3294.7
5°	3300.7	3288.2	3253.3	3278.5	3272.4
7.5°	3278.5	3259.7	3224.6	3250.3	3243.9
10°	3243.9	3221.6	3183.5	3208.8	3199.4
12.5°	3196.0	3177.1	3139.1	3154.9	3148.6
15°	3142.2	3123.3	3081.8	3094.6	3078.8
17.5°	3075.4	3056.6	3015.2	3031.0	3015.2
20°	3002.4	2983.5	2939.0	2948.5	2936.0
22.5°	2929.6	2901.1	2859.6	2859.6	2853.2
25°	2843.7	2818.5	2764.7	2770.7	2764.7
27.5°	2748.5	2726.2	2685.2	2675.8	2659.9
30°	2653.5	2627.9	2580.4	2571.0	2558.2
32.5°	2551.8	2533.0	2482.1	2463.0	2450.1
35°	2453.5	2421.9	2371.0	2351.8	2336.0
37.5°	2342.4	2313.8	2262.9	2240.7	2224.9
40°	2228.2	2202.6	2151.7	2123.5	2110.7
42.5°	2117.0	2091.5	2041.0	2009.0	1990.2
45°	1996.5	1974.3	1926.5	1891.8	1879.1
47.5°	1879.1	1856.8	1805.9	1770.9	1752.1
50°	1755.1	1739.3	1694.8	1650.4	1634.6
52.5°	1634.6	1612.3	1571.2	1536.2	1514.0
55°	1511.0	1491.8	1453.7	1415.7	1399.9
57.5°	1387.0	1371.2	1329.8	1291.8	1278.9
60°	1263.1	1250.7	1206.2	1171.2	1161.8
62.5°	1142.5	1120.3	1088.6	1057.1	1044.2
65°	1019.0	999.8	968.1	939.5	923.7
67.5°	892.0	875.9	847.5	825.4	812.6
70°	774.5	761.7	733.1	710.9	698.4
72.5°	653.9	641.1	625.3	603.1	593.7
75°	533.1	527.0	510.9	492.0	498.4
77.5°	425.3	412.6	406.1	396.7	387.3
80°	317.5	314.1	307.7	298.3	292.0
82.5°	215.8	215.8	212.8	200.0	200.0
85°	130.0	127.0	123.9	114.1	111.1
87.5°	57.2	50.8	44.5	35.1	31.7
90°	2.9	35.6	96.9	91.0	93.9
92.5°	61.3	83.0	86.0	89.0	89.0
95°	144.3	172.0	176.9	176.9	172.0
97.5°	240.3	265.9	276.8	276.8	276.8
100°	350.9	373.6	381.5	381.5	378.6
102.5°	467.6	484.4	495.3	498.2	495.3
105°	595.1	603.0	609.0	613.9	613.9
107.5°	721.6	733.5	733.5	735.5	721.6
110°	844.2	860.1	860.1	860.1	852.2

TEST NUMBER: P903820

CATALOG NUMBER: DFN2DIP-SQ3F0-090D110US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	976.7	993.4	990.5	982.6	976.7
115°	1107.2	1122.9	1118.0	1115.1	1107.2
117.5°	1236.7	1258.4	1244.5	1236.7	1228.8
120°	1367.2	1388.9	1367.2	1367.2	1358.3
122.5°	1485.8	1513.4	1499.6	1491.7	1485.8
125°	1610.3	1635.0	1627.1	1618.3	1615.2
127.5°	1731.9	1762.6	1751.7	1739.8	1731.9
130°	1845.6	1881.2	1876.2	1870.3	1859.4
132.5°	1973.1	2000.8	2002.8	1989.0	1981.0
135°	2082.8	2113.5	2119.4	2116.5	2108.6
137.5°	2205.5	2230.1	2235.1	2233.1	2221.3
140°	2313.2	2337.9	2351.7	2351.7	2340.9
142.5°	2423.9	2448.6	2456.5	2459.5	2448.6
145°	2528.7	2548.4	2564.3	2567.2	2556.4
147.5°	2622.6	2647.3	2659.2	2664.1	2653.3
150°	2719.5	2736.3	2747.1	2756.1	2747.1
152.5°	2805.5	2822.3	2836.1	2847.0	2836.1
155°	2891.5	2899.4	2908.3	2922.2	2913.2
157.5°	2965.6	2971.6	2976.5	2996.2	2982.4
160°	3031.9	3037.8	3040.7	3057.6	3045.7
162.5°	3093.1	3093.1	3096.2	3114.9	3101.1
165°	3145.5	3142.5	3142.5	3162.3	3148.5
167.5°	3193.0	3184.1	3184.1	3203.9	3190.0
170°	3228.6	3220.7	3217.7	3237.4	3220.7
172.5°	3253.3	3245.4	3242.4	3262.2	3245.4
175°	3273.1	3265.2	3259.2	3279.0	3262.2
177.5°	3283.9	3276.0	3270.1	3286.9	3270.1
180°	3279.0	3279.0	3279.0	3279.0	3279.0

TEST NUMBER: P903820

CATALOG NUMBER: DFN2DIP-SQ3F0-090D110US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.65	12.50	12.63	13.49	14.79	11.21	12.05	12.19	13.04	14.34
	3H	13.31	14.06	14.30	15.06	16.39	12.82	13.57	13.81	14.57	15.90
	4H	13.89	14.61	14.89	15.61	16.94	13.40	14.11	14.40	15.12	16.45
	6H	14.29	14.95	15.30	15.95	17.30	13.79	14.45	14.80	15.45	16.80
	8H	14.39	15.02	15.41	16.04	17.38	13.89	14.52	14.91	15.54	16.88
	12H	14.44	15.03	15.46	16.05	17.42	13.93	14.52	14.95	15.54	16.91
4H	2H	12.11	12.82	13.12	13.83	15.16	11.75	12.47	12.76	13.47	14.80
	3H	13.97	14.57	14.98	15.60	16.94	13.56	14.16	14.58	15.19	16.53
	4H	14.68	15.22	15.70	16.25	17.62	14.25	14.80	15.28	15.82	17.19
	6H	15.19	15.66	16.22	16.70	18.07	14.76	15.23	15.79	16.27	17.64
	8H	15.33	15.77	16.37	16.81	18.19	14.90	15.34	15.93	16.38	17.76
	12H	15.40	15.80	16.46	16.86	18.24	14.96	15.35	16.01	16.41	17.79
8H	4H	14.87	15.31	15.90	16.35	17.73	14.49	14.93	15.53	15.97	17.35
	6H	15.49	15.86	16.55	16.94	18.31	15.11	15.47	16.17	16.55	17.93
	8H	15.71	16.03	16.78	17.10	18.49	15.32	15.64	16.38	16.70	18.10
	12H	15.84	16.12	16.91	17.18	18.62	15.43	15.71	16.50	16.77	18.21
12H	4H	14.85	15.25	15.91	16.30	17.69	14.48	14.88	15.54	15.94	17.32
	6H	15.52	15.84	16.59	16.91	18.30	15.15	15.47	16.21	16.53	17.93
	8H	15.76	16.04	16.83	17.10	18.54	15.38	15.66	16.45	16.72	18.16