

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903850

Luminaire Tested: DFN2DIP-SQ3F0-100D090US830-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903850
REPORT IS A COMBINATION OF REPORTS P899964 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D090US830-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15518.9 lumens
Efficiency: N/A
Efficacy: 92.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 167
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903850

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US830-RLLFLL

Luminous Intensity Polar Plot

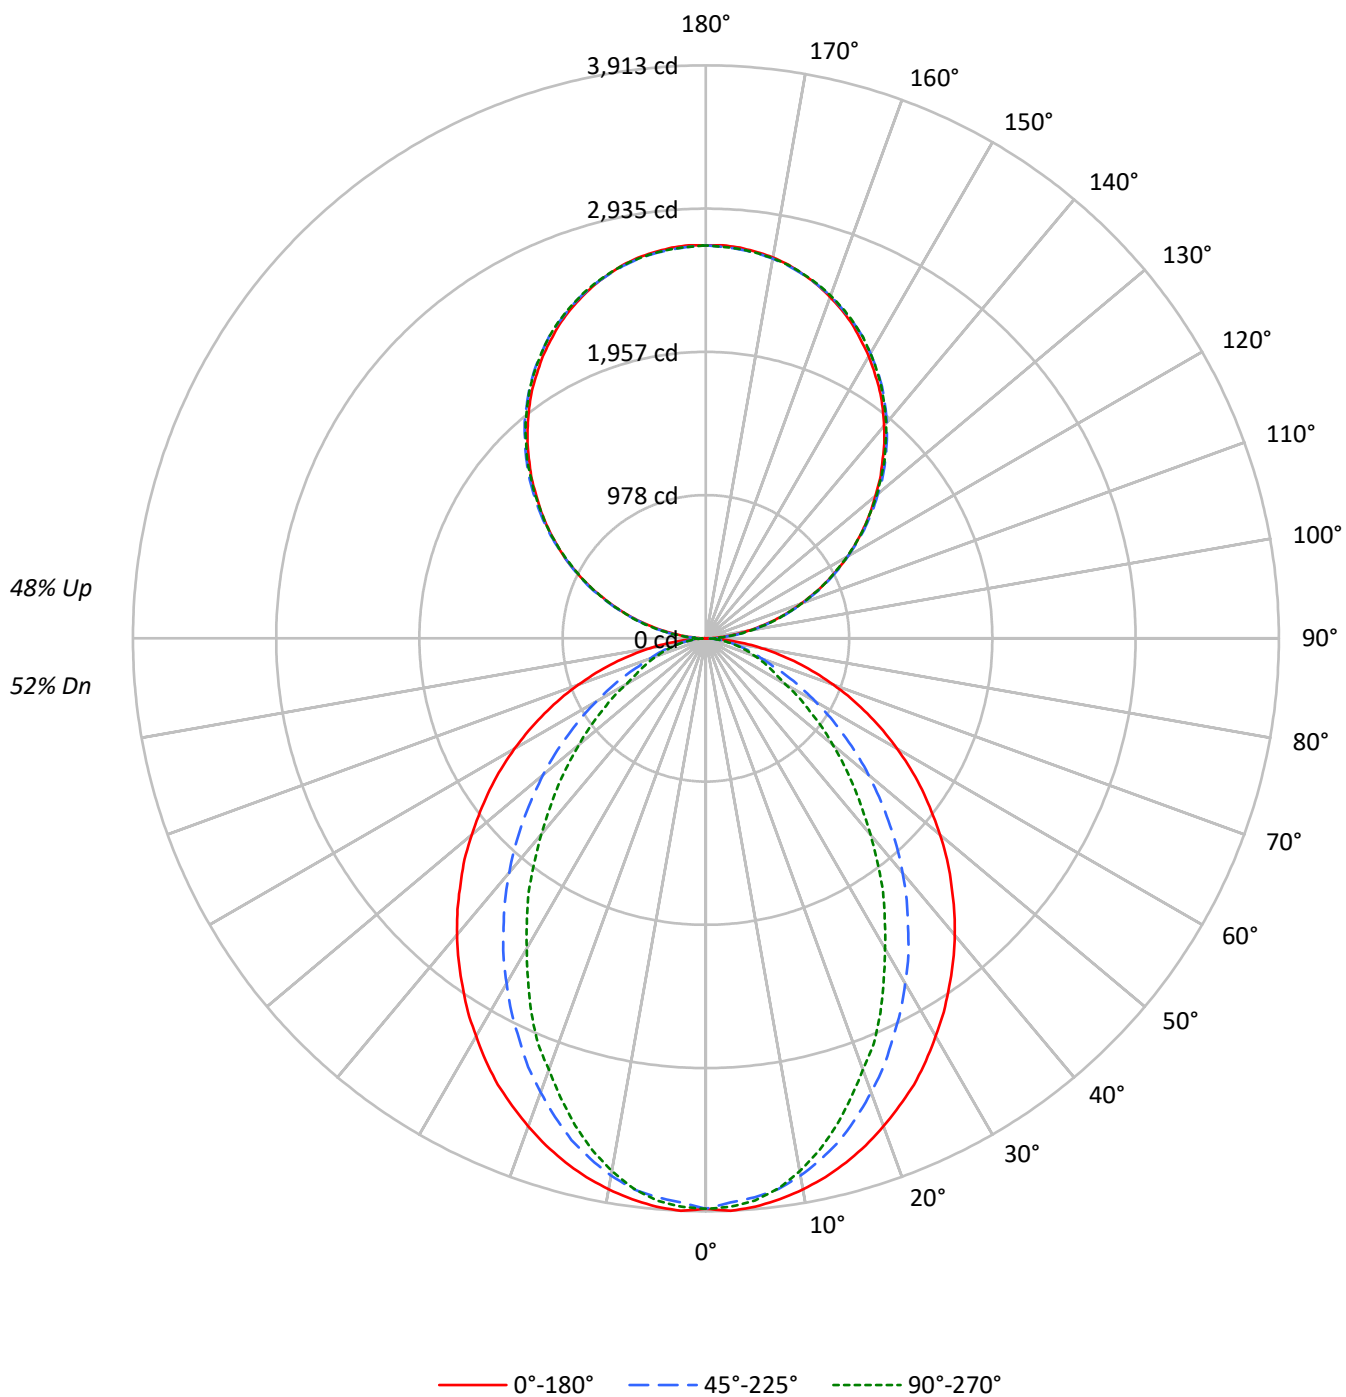

TEST NUMBER: P903850

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US830-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	99	99	99	99	84	84	84	70	70	70	58	58	58
1	99	94	91	87	91	88	84	82	75	72	70	63	61	60	52	51	50
2	90	83	77	72	83	77	72	68	66	62	59	56	53	51	46	44	43
3	83	73	66	61	76	68	62	57	59	54	50	50	46	43	41	39	37
4	76	65	58	52	70	61	54	49	52	47	43	45	41	38	37	34	32
5	70	59	51	45	64	55	48	42	47	42	38	40	36	33	34	31	28
6	64	53	45	39	60	49	42	37	43	37	33	37	32	29	31	28	25
7	60	48	40	35	55	45	38	33	39	33	29	33	29	26	28	25	23
8	56	43	36	31	51	41	34	29	36	30	26	31	26	23	26	23	20
9	52	40	32	28	48	37	31	26	33	27	24	28	24	21	24	21	19
10	48	37	30	25	45	34	28	24	30	25	21	26	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4463	4463	4463
5°	4468	4390	4419
10°	4421	4301	4274
15°	4357	4156	4050
20°	4274	3957	3777
25°	4188	3735	3512
30°	4075	3507	3177
35°	3963	3263	2883
40°	3849	3010	2546
45°	3718	2730	2240
50°	3581	2448	1942
55°	3438	2147	1655
60°	3273	1833	1361
65°	3082	1513	1224
70°	2851	1215	1105
75°	2560	1065	1002
80°	2139	884	864
85°	1451	576	641

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3718 cd/sqm

TEST NUMBER: P903850

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US830-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	365.1	2.4
10°-20°	1002.2	6.5
20°-30°	1407.1	9.1
30°-40°	1533.9	9.9
40°-50°	1409.8	9.1
50°-60°	1107.2	7.1
60°-70°	720.7	4.6
70°-80°	371.0	2.4
80°-90°	102.3	0.7
90°-100°	166.0	1.1
100°-110°	527.5	3.4
110°-120°	902.7	5.8
120°-130°	1187.2	7.6
130°-140°	1332.5	8.6
140°-150°	1306.7	8.4
150°-160°	1096.1	7.1
160°-170°	726.9	4.7
170°-180°	254.1	1.6
0°-30°	2774.5	17.9
0°-40°	4308.3	27.8
0°-60°	6825.3	44.0
0°-90°	8019.2	51.7
90°-120°	1596.2	10.3
90°-150°	5422.6	34.9
90°-180°	7500.0	48.3
0°-180°	15518.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3896	3896	3896	3896	3896	
5°	3896	3878	3832	3864	3853	369
15°	3705	3666	3546	3480	3444	1044
25°	3363	3250	3018	2873	2820	1547
35°	2898	2718	2408	2186	2108	1814
45°	2369	2133	1763	1512	1428	1830
55°	1801	1526	1146	934	867	1610
65°	1216	931	613	494	483	1206
75°	649	402	282	257	254	686
85°	152	77	67	67	67	174
90°	2	29	79	74	77	15
95°	118	141	145	145	141	131
105°	487	493	498	502	502	514
115°	906	919	915	912	906	896
125°	1318	1338	1331	1324	1322	1177
135°	1704	1729	1734	1732	1725	1317
145°	2069	2085	2098	2100	2092	1293
155°	2366	2372	2380	2391	2384	1089
165°	2574	2571	2571	2587	2576	726
175°	2678	2671	2667	2683	2669	254
180°	2683	2683	2683	2683	2683	

TEST NUMBER: P903850

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US830-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3895.5	3895.5	3895.5	3895.5	3895.5
2.5°	3913.1	3895.5	3856.6	3892.1	3885.1
5°	3895.5	3877.9	3831.9	3863.8	3853.2
7.5°	3863.8	3842.7	3793.4	3807.2	3789.7
10°	3821.4	3796.7	3726.4	3715.6	3694.7
12.5°	3768.8	3736.9	3641.5	3620.6	3581.7
15°	3705.1	3666.2	3546.5	3479.6	3444.4
17.5°	3631.0	3574.6	3426.5	3349.0	3292.6
20°	3546.5	3475.8	3299.7	3211.8	3134.0
22.5°	3454.9	3373.7	3169.1	3049.5	2996.7
25°	3363.3	3250.4	3017.6	2873.2	2820.2
27.5°	3254.0	3134.0	2876.6	2710.9	2629.8
30°	3137.7	3003.4	2721.4	2541.9	2446.6
32.5°	3024.8	2862.4	2573.7	2362.0	2273.7
35°	2897.9	2718.1	2408.0	2185.8	2108.0
37.5°	2774.6	2580.4	2252.8	2009.3	1921.4
40°	2644.0	2432.7	2090.5	1840.2	1748.6
42.5°	2510.1	2284.5	1928.5	1667.5	1579.5
45°	2369.1	2132.7	1762.8	1512.2	1427.7
47.5°	2235.2	1985.0	1604.2	1353.6	1276.2
50°	2087.1	1836.8	1449.0	1205.5	1131.8
52.5°	1942.3	1677.9	1300.9	1068.2	1001.3
55°	1801.3	1526.4	1145.7	934.3	867.3
57.5°	1657.0	1374.9	1008.4	810.9	754.4
60°	1508.8	1226.8	863.7	684.1	627.6
62.5°	1364.4	1082.4	740.2	571.2	543.1
65°	1216.4	930.6	613.4	493.7	482.9
67.5°	1075.3	789.6	493.7	433.5	423.0
70°	927.2	652.3	408.8	373.6	359.5
72.5°	786.2	525.1	341.9	313.8	306.7
75°	648.6	401.7	282.0	257.3	253.9
77.5°	511.3	285.4	222.2	207.9	200.9
80°	384.1	204.6	169.1	155.2	155.2
82.5°	267.8	137.6	116.3	109.2	109.2
85°	151.5	77.4	66.9	66.9	66.9
87.5°	56.5	28.1	28.1	24.7	24.7
90°	2.5	29.1	79.3	74.4	76.8
92.5°	50.1	68.0	70.4	72.8	72.8
95°	118.1	140.7	144.8	144.8	140.7
97.5°	196.5	217.5	226.5	226.5	226.5
100°	287.1	305.8	312.2	312.2	309.8
102.5°	382.6	396.3	405.2	407.6	405.2
105°	486.9	493.3	498.2	502.3	502.3
107.5°	590.4	600.1	600.1	601.7	590.4
110°	690.7	703.7	703.7	703.7	697.2

TEST NUMBER: P903850

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US830-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	799.1	812.8	810.4	804.0	799.1
115°	905.9	918.8	914.7	912.4	905.9
117.5°	1011.8	1029.6	1018.3	1011.8	1005.3
120°	1118.6	1136.3	1118.6	1118.6	1111.3
122.5°	1215.6	1238.3	1227.0	1220.5	1215.6
125°	1317.6	1337.8	1331.3	1324.0	1321.6
127.5°	1417.0	1442.1	1433.2	1423.5	1417.0
130°	1510.0	1539.2	1535.1	1530.2	1521.4
132.5°	1614.4	1637.0	1638.6	1627.3	1620.9
135°	1704.1	1729.2	1734.1	1731.6	1725.2
137.5°	1804.4	1824.7	1828.7	1827.1	1817.4
140°	1892.6	1912.8	1924.1	1924.1	1915.2
142.5°	1983.2	2003.4	2009.9	2012.3	2003.4
145°	2069.0	2085.1	2098.0	2100.5	2091.6
147.5°	2145.8	2166.0	2175.7	2179.7	2170.9
150°	2225.1	2238.8	2247.7	2254.9	2247.7
152.5°	2295.4	2309.1	2320.4	2329.4	2320.4
155°	2365.8	2372.2	2379.5	2390.9	2383.6
157.5°	2426.4	2431.3	2435.3	2451.5	2440.1
160°	2480.6	2485.5	2487.9	2501.6	2491.9
162.5°	2530.7	2530.7	2533.2	2548.5	2537.2
165°	2573.6	2571.2	2571.2	2587.4	2576.1
167.5°	2612.4	2605.2	2605.2	2621.3	2610.0
170°	2641.6	2635.1	2632.7	2648.8	2635.1
172.5°	2661.7	2655.3	2652.9	2669.1	2655.3
175°	2678.0	2671.4	2666.6	2682.9	2669.1
177.5°	2686.8	2680.4	2675.5	2689.3	2675.5
180°	2682.9	2682.9	2682.9	2682.9	2682.9

TEST NUMBER: P903850

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US830-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.46	13.31	13.41	14.27	15.52	8.42	9.27	9.37	10.23	11.48
	3H	14.14	14.89	15.10	15.86	17.14	9.61	10.36	10.57	11.33	12.61
	4H	14.74	15.46	15.72	16.43	17.71	10.05	10.77	11.03	11.74	13.02
	6H	15.16	15.82	16.15	16.80	18.09	10.37	11.03	11.36	12.01	13.30
	8H	15.29	15.91	16.28	16.91	18.20	10.46	11.08	11.45	12.08	13.37
	12H	15.35	15.94	16.35	16.93	18.25	10.50	11.09	11.50	12.08	13.40
4H	2H	12.48	13.20	13.46	14.17	15.45	9.02	9.73	10.00	10.71	11.99
	3H	14.31	14.90	15.30	15.90	17.20	10.36	10.96	11.35	11.96	13.26
	4H	15.00	15.54	15.99	16.53	17.85	10.91	11.45	11.90	12.45	13.76
	6H	15.51	15.97	16.52	16.99	18.31	11.32	11.79	12.33	12.81	14.12
	8H	15.68	16.12	16.69	17.13	18.46	11.45	11.88	12.46	12.89	14.22
	12H	15.77	16.17	16.80	17.19	18.53	11.51	11.90	12.54	12.93	14.26
8H	4H	14.96	15.40	15.97	16.41	17.74	11.19	11.62	12.20	12.63	13.96
	6H	15.53	15.88	16.56	16.94	18.27	11.70	12.05	12.73	13.11	14.44
	8H	15.74	16.05	16.78	17.10	18.44	11.88	12.20	12.92	13.24	14.59
	12H	15.87	16.15	16.92	17.19	18.58	12.00	12.27	13.04	13.31	14.70
12H	4H	14.92	15.31	15.94	16.34	17.67	11.19	11.58	12.22	12.61	13.95
	6H	15.50	15.82	16.54	16.86	18.21	11.74	12.06	12.79	13.10	14.45
	8H	15.72	16.00	16.76	17.03	18.42	11.95	12.23	12.99	13.26	14.65

END OF REPORT