

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903851

Luminaire Tested: DFN2DIP-SQ3F0-100D090US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903851
REPORT IS A COMBINATION OF REPORTS P901484 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D090US830-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16409.6 lumens
Efficiency: N/A
Efficacy: 98.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 167
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903851

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US830-RLONL

Luminous Intensity Polar Plot

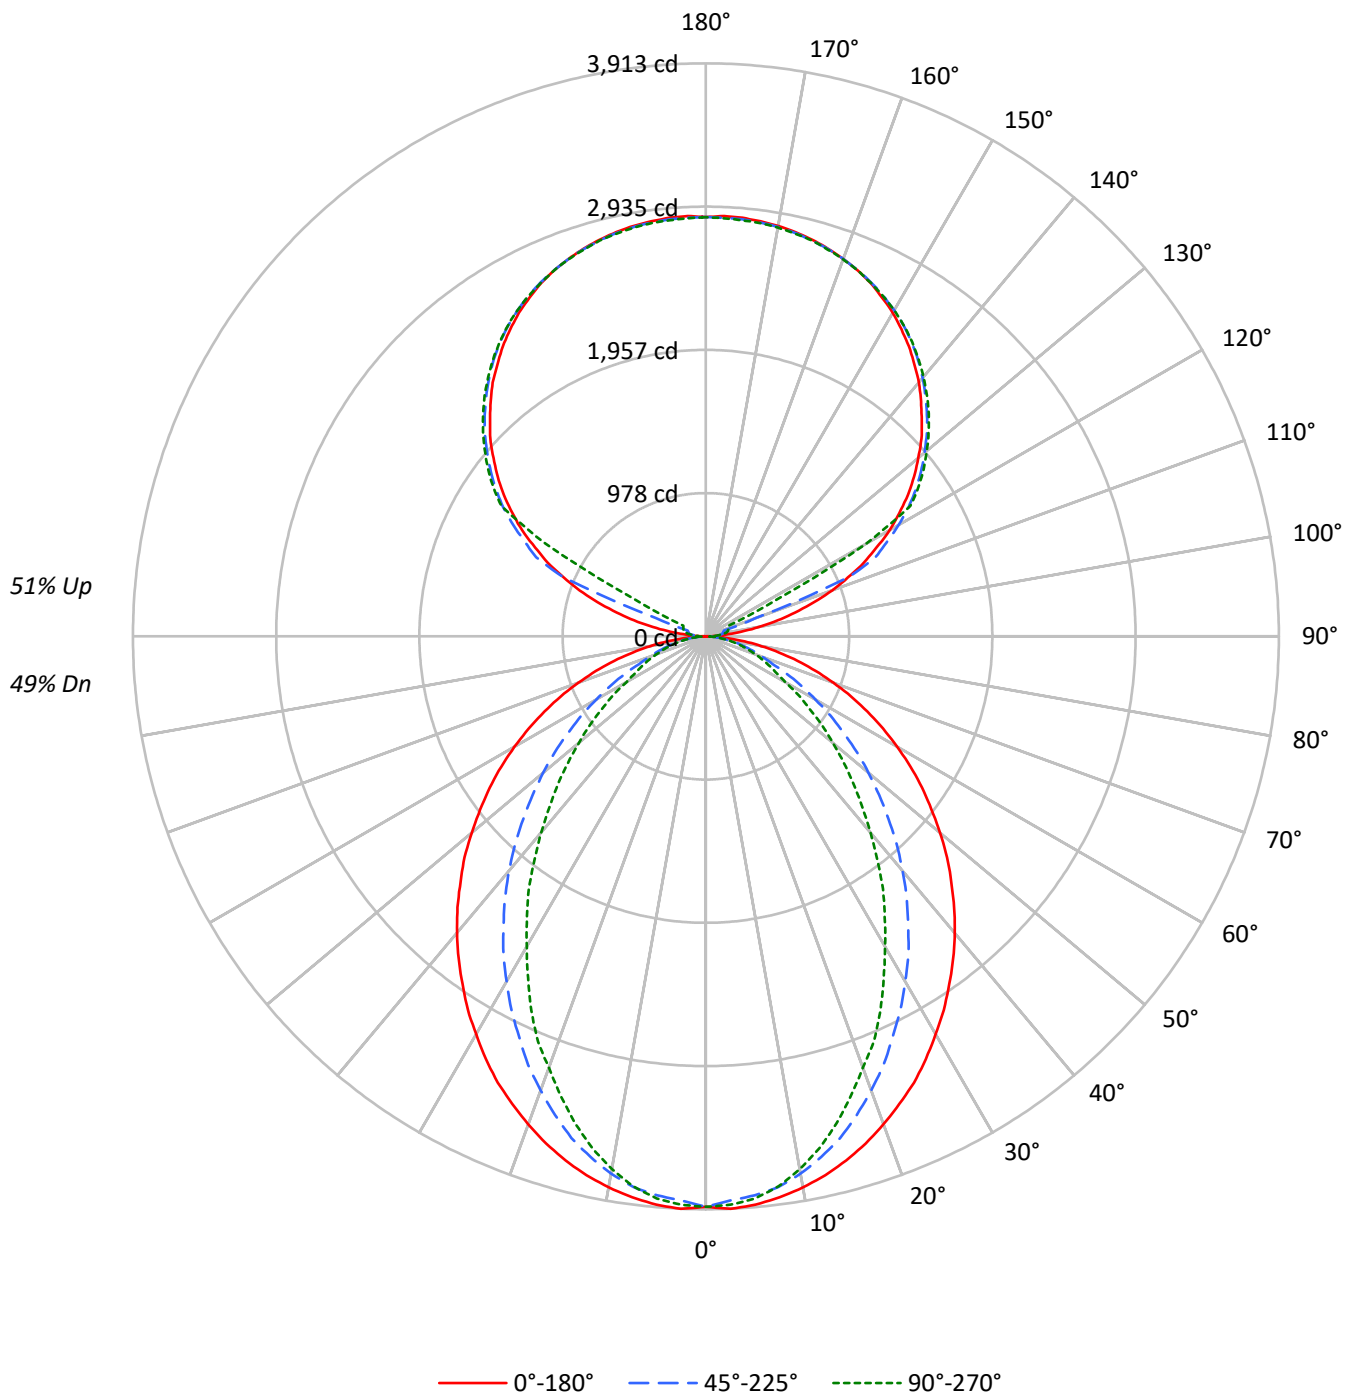

TEST NUMBER: P903851

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	83	81	73	71	69	61	59	58	49	48	47
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	56	57	53	49	48	45	42	39	37	35
4	75	65	57	51	69	60	53	48	51	46	42	43	39	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	29	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	35	30	51	40	33	29	35	29	26	30	26	22	25	22	19
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	18	21	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4463	4463	4463
5°	4468	4390	4419
10°	4421	4301	4274
15°	4357	4156	4050
20°	4274	3957	3777
25°	4188	3735	3512
30°	4075	3507	3177
35°	3963	3263	2883
40°	3849	3010	2546
45°	3718	2730	2240
50°	3581	2448	1942
55°	3438	2147	1655
60°	3273	1833	1361
65°	3082	1513	1224
70°	2851	1215	1105
75°	2560	1065	1002
80°	2139	884	864
85°	1451	576	641

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3718 cd/sqm

TEST NUMBER: P903851

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	365.1	2.2
10°-20°	1002.2	6.1
20°-30°	1407.1	8.6
30°-40°	1533.9	9.3
40°-50°	1409.8	8.6
50°-60°	1107.2	6.7
60°-70°	720.7	4.4
70°-80°	371.0	2.3
80°-90°	99.7	0.6
90°-100°	94.4	0.6
100°-110°	351.9	2.1
110°-120°	933.3	5.7
120°-130°	1548.0	9.4
130°-140°	1644.3	10.0
140°-150°	1528.2	9.3
150°-160°	1228.6	7.5
160°-170°	791.7	4.8
170°-180°	272.5	1.7
0°-30°	2774.5	16.9
0°-40°	4308.3	26.3
0°-60°	6825.3	41.6
0°-90°	8016.6	48.9
90°-120°	1379.6	8.4
90°-150°	6100.2	37.2
90°-180°	8393.0	51.1
0°-180°	16409.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3896	3896	3896	3896	3896	
5°	3896	3878	3832	3864	3853	369
15°	3705	3666	3546	3480	3444	1044
25°	3363	3250	3018	2873	2820	1547
35°	2898	2718	2408	2186	2108	1814
45°	2369	2133	1763	1512	1428	1830
55°	1801	1526	1146	934	867	1610
65°	1216	931	613	494	483	1206
75°	649	402	282	257	254	686
85°	152	77	67	67	67	174
90°	2	25	41	52	56	15
95°	135	66	81	91	89	159
105°	630	692	126	149	157	673
115°	1191	1226	1278	319	170	1173
125°	1684	1711	1750	1765	1771	1502
135°	2084	2117	2136	2157	2152	1610
145°	2418	2415	2451	2465	2455	1512
155°	2662	2644	2668	2681	2664	1227
165°	2805	2792	2799	2813	2799	792
175°	2869	2854	2859	2873	2852	273
180°	2863	2863	2863	2863	2863	

TEST NUMBER: P903851

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3895.5	3895.5	3895.5	3895.5	3895.5
2.5°	3913.1	3895.5	3856.6	3892.1	3885.1
5°	3895.5	3877.9	3831.9	3863.8	3853.2
7.5°	3863.8	3842.7	3793.4	3807.2	3789.7
10°	3821.4	3796.7	3726.4	3715.6	3694.7
12.5°	3768.8	3736.9	3641.5	3620.6	3581.7
15°	3705.1	3666.2	3546.5	3479.6	3444.4
17.5°	3631.0	3574.6	3426.5	3349.0	3292.6
20°	3546.5	3475.8	3299.7	3211.8	3134.0
22.5°	3454.9	3373.7	3169.1	3049.5	2996.7
25°	3363.3	3250.4	3017.6	2873.2	2820.2
27.5°	3254.0	3134.0	2876.6	2710.9	2629.8
30°	3137.7	3003.4	2721.4	2541.9	2446.6
32.5°	3024.8	2862.4	2573.7	2362.0	2273.7
35°	2897.9	2718.1	2408.0	2185.8	2108.0
37.5°	2774.6	2580.4	2252.8	2009.3	1921.4
40°	2644.0	2432.7	2090.5	1840.2	1748.6
42.5°	2510.1	2284.5	1928.5	1667.5	1579.5
45°	2369.1	2132.7	1762.8	1512.2	1427.7
47.5°	2235.2	1985.0	1604.2	1353.6	1276.2
50°	2087.1	1836.8	1449.0	1205.5	1131.8
52.5°	1942.3	1677.9	1300.9	1068.2	1001.3
55°	1801.3	1526.4	1145.7	934.3	867.3
57.5°	1657.0	1374.9	1008.4	810.9	754.4
60°	1508.8	1226.8	863.7	684.1	627.6
62.5°	1364.4	1082.4	740.2	571.2	543.1
65°	1216.4	930.6	613.4	493.7	482.9
67.5°	1075.3	789.6	493.7	433.5	423.0
70°	927.2	652.3	408.8	373.6	359.5
72.5°	786.2	525.1	341.9	313.8	306.7
75°	648.6	401.7	282.0	257.3	253.9
77.5°	511.3	285.4	222.2	207.9	200.9
80°	384.1	204.6	169.1	155.2	155.2
82.5°	267.8	137.6	116.3	109.2	109.2
85°	151.5	77.4	66.9	66.9	66.9
87.5°	56.5	28.1	28.1	24.7	24.7
90°	2.0	24.9	41.3	51.9	55.8
92.5°	51.9	43.5	49.7	53.9	55.8
95°	134.6	66.2	80.7	91.2	89.1
97.5°	242.3	72.6	105.6	111.9	113.9
100°	366.7	82.9	118.1	134.6	138.7
102.5°	503.3	499.4	122.2	144.9	151.3
105°	629.7	692.0	126.4	149.1	157.4
107.5°	776.8	828.5	130.6	153.3	161.6
110°	917.8	961.1	362.6	155.4	163.6

TEST NUMBER: P903851

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1050.4	1087.5	1052.3	159.4	165.8
115°	1191.1	1226.2	1278.2	319.1	169.9
117.5°	1313.3	1354.7	1390.1	1093.7	551.0
120°	1450.1	1481.1	1518.5	1543.3	1263.7
122.5°	1566.0	1599.2	1640.8	1653.0	1655.3
125°	1684.0	1711.1	1750.5	1765.0	1771.1
127.5°	1791.8	1820.8	1852.1	1872.7	1874.7
130°	1893.4	1926.7	1949.3	1972.1	1970.2
132.5°	1997.0	2024.0	2046.6	2065.4	2063.4
135°	2084.1	2117.2	2135.7	2156.6	2152.5
137.5°	2175.1	2199.9	2220.8	2241.5	2235.3
140°	2264.1	2280.9	2303.5	2322.1	2311.9
142.5°	2338.9	2353.4	2380.2	2396.7	2386.4
145°	2417.6	2415.4	2450.6	2465.1	2454.8
147.5°	2485.8	2479.6	2514.8	2525.2	2517.0
150°	2552.2	2537.7	2570.9	2583.1	2572.9
152.5°	2608.0	2591.5	2622.5	2635.1	2620.6
155°	2661.9	2643.5	2668.2	2680.6	2664.1
157.5°	2705.5	2689.0	2707.6	2722.2	2705.5
160°	2742.8	2730.3	2742.8	2755.1	2740.6
162.5°	2775.8	2763.4	2773.8	2788.3	2769.7
165°	2804.8	2792.5	2798.7	2813.2	2798.7
167.5°	2827.7	2815.2	2821.5	2836.0	2817.4
170°	2846.4	2833.8	2838.0	2852.5	2833.8
172.5°	2858.7	2846.4	2850.5	2865.0	2846.4
175°	2869.0	2854.5	2858.7	2873.2	2852.5
177.5°	2873.2	2858.7	2860.9	2875.4	2856.8
180°	2862.9	2862.9	2862.9	2862.9	2862.9

TEST NUMBER: P903851

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.20	13.02	13.18	14.01	15.30	8.16	8.98	9.14	9.97	11.26
	3H	13.87	14.61	14.86	15.60	16.91	9.34	10.08	10.33	11.07	12.38
	4H	14.48	15.17	15.48	16.17	17.49	9.79	10.48	10.79	11.48	12.80
	6H	14.90	15.54	15.91	16.54	17.87	10.10	10.74	11.11	11.74	13.08
	8H	15.02	15.63	16.04	16.65	17.97	10.19	10.80	11.21	11.82	13.14
	12H	15.08	15.66	16.10	16.67	18.02	10.23	10.81	11.25	11.82	13.17
4H	2H	12.22	12.91	13.22	13.91	15.23	8.75	9.45	9.76	10.44	11.76
	3H	14.04	14.62	15.05	15.64	16.98	10.10	10.67	11.11	11.70	13.03
	4H	14.73	15.26	15.75	16.27	17.63	10.64	11.17	11.66	12.18	13.54
	6H	15.24	15.69	16.27	16.73	18.09	11.05	11.50	12.08	12.54	13.90
	8H	15.41	15.83	16.44	16.87	18.24	11.18	11.60	12.21	12.63	14.00
	12H	15.50	15.88	16.55	16.93	18.31	11.24	11.62	12.29	12.67	14.04
8H	4H	14.69	15.12	15.73	16.15	17.52	10.92	11.34	11.95	12.37	13.74
	6H	15.25	15.60	16.31	16.68	18.04	11.42	11.77	12.48	12.85	14.21
	8H	15.47	15.77	16.53	16.83	18.22	11.61	11.92	12.67	12.98	14.36
	12H	15.60	15.87	16.67	16.93	18.35	11.72	11.99	12.79	13.05	14.48
12H	4H	14.65	15.03	15.70	16.07	17.45	10.92	11.30	11.97	12.35	13.72
	6H	15.23	15.54	16.29	16.60	17.98	11.47	11.78	12.54	12.84	14.22
	8H	15.45	15.72	16.51	16.77	18.20	11.68	11.95	12.74	13.00	14.43

END OF REPORT