

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903853

Luminaire Tested: DFN2DIP-SQ3F0-100D100US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903853
REPORT IS A COMBINATION OF REPORTS P901501 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D100US830-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18662.4 lumens
Efficiency: N/A
Efficacy: 106.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 176
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903853

CATALOG NUMBER: DFN2DIP-SQ3F0-100D100US830-FLLONL

Luminous Intensity Polar Plot

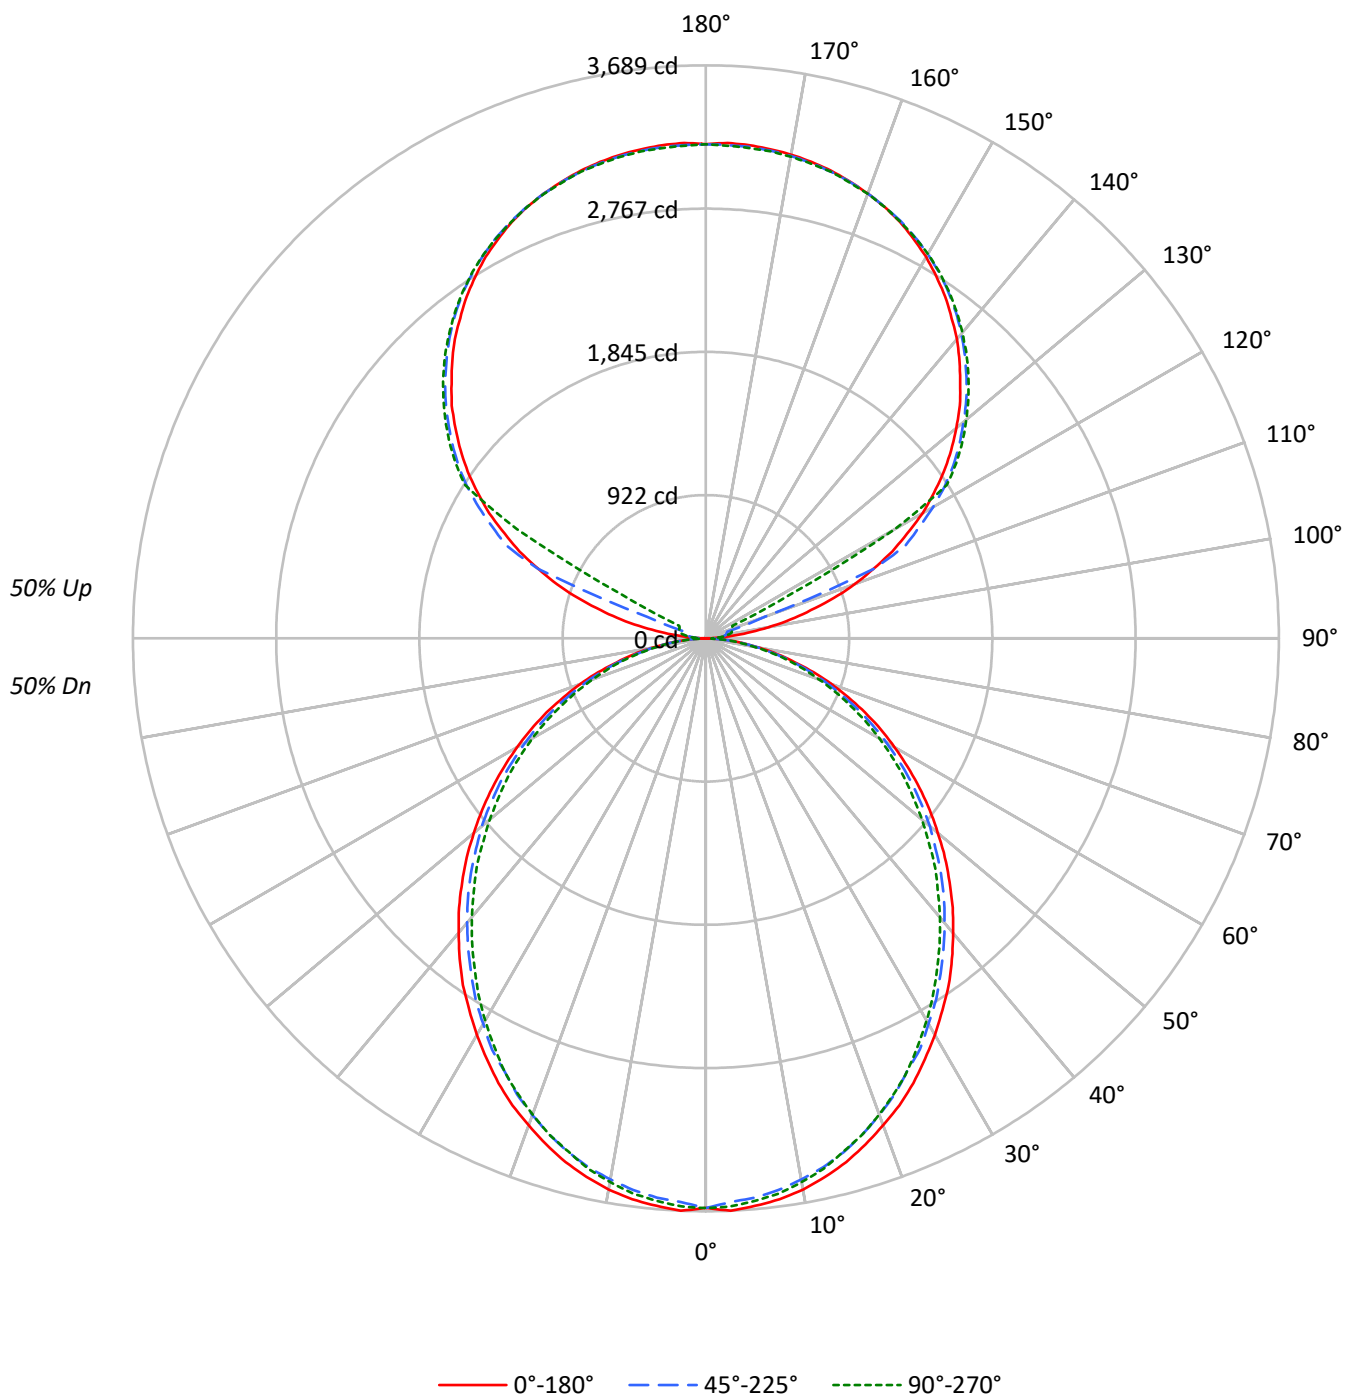

TEST NUMBER: P903853

CATALOG NUMBER: DFN2DIP-SQ3F0-100D100US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4202	4202	4202
5°	4206	4141	4170
10°	4170	4082	4112
15°	4106	4012	4023
20°	4020	3916	3931
25°	3935	3802	3825
30°	3829	3695	3691
35°	3728	3570	3549
40°	3604	3443	3414
45°	3481	3316	3276
50°	3346	3182	3116
55°	3205	3027	2969
60°	3044	2844	2800
65°	2869	2654	2601
70°	2646	2422	2386
75°	2338	2144	2185
80°	1964	1789	1806
85°	1383	1185	1183

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3481 cd/sqm

TEST NUMBER: P903853

CATALOG NUMBER: DFN2DIP-SQ3F0-100D100US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	345.2	1.8
10°-20°	971.2	5.2
20°-30°	1427.3	7.6
30°-40°	1657.7	8.9
40°-50°	1655.7	8.9
50°-60°	1443.7	7.7
60°-70°	1067.2	5.7
70°-80°	603.8	3.2
80°-90°	165.0	0.9
90°-100°	104.9	0.6
100°-110°	391.0	2.1
110°-120°	1037.0	5.6
120°-130°	1720.0	9.2
130°-140°	1827.0	9.8
140°-150°	1698.0	9.1
150°-160°	1365.2	7.3
160°-170°	879.7	4.7
170°-180°	302.8	1.6
0°-30°	2743.7	14.7
0°-40°	4401.4	23.6
0°-60°	7500.8	40.2
0°-90°	9336.8	50.0
90°-120°	1532.9	8.2
90°-150°	6778.0	36.3
90°-180°	9326.0	50.0
0°-180°	18662.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3668	3668	3668	3668	3668	
5°	3668	3654	3615	3643	3636	348
15°	3491	3470	3424	3438	3421	983
25°	3160	3132	3072	3078	3072	1454
35°	2726	2691	2634	2613	2596	1702
45°	2218	2194	2140	2102	2088	1712
55°	1679	1658	1615	1573	1555	1501
65°	1132	1111	1076	1044	1026	1119
75°	592	586	568	547	554	632
85°	144	141	138	127	124	161
90°	2	28	46	58	62	17
95°	150	74	90	101	99	177
105°	700	769	140	166	175	748
115°	1323	1362	1420	354	189	1303
125°	1871	1901	1945	1961	1968	1669
135°	2316	2352	2373	2396	2392	1789
145°	2686	2684	2723	2739	2728	1680
155°	2958	2937	2965	2978	2960	1363
165°	3116	3103	3110	3126	3110	880
175°	3188	3172	3176	3192	3170	303
180°	3181	3181	3181	3181	3181	

TEST NUMBER: P903853

CATALOG NUMBER: DFN2DIP-SQ3F0-100D100US830-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3667.5	3667.5	3667.5	3667.5	3667.5
2.5°	3688.8	3671.2	3632.3	3667.5	3660.7
5°	3667.5	3653.7	3614.7	3642.8	3636.0
7.5°	3642.8	3621.8	3582.9	3611.4	3604.3
10°	3604.3	3579.6	3537.3	3565.4	3554.9
12.5°	3551.1	3530.2	3487.9	3505.5	3498.3
15°	3491.3	3470.3	3424.3	3438.5	3421.0
17.5°	3417.2	3396.3	3350.2	3367.8	3350.2
20°	3335.9	3315.0	3265.6	3276.1	3262.2
22.5°	3255.2	3223.4	3177.3	3177.3	3170.2
25°	3159.8	3131.7	3071.8	3078.5	3071.8
27.5°	3053.8	3029.1	2983.5	2973.1	2955.4
30°	2948.4	2919.9	2867.1	2856.7	2842.4
32.5°	2835.4	2814.4	2757.9	2736.6	2722.3
35°	2726.1	2691.0	2634.4	2613.1	2595.5
37.5°	2602.6	2570.8	2514.3	2489.6	2472.0
40°	2475.8	2447.3	2390.9	2359.5	2345.2
42.5°	2352.3	2323.8	2267.8	2232.2	2211.3
45°	2218.4	2193.7	2140.5	2102.0	2087.8
47.5°	2087.8	2063.1	2006.6	1967.7	1946.7
50°	1950.1	1932.5	1883.1	1833.7	1816.2
52.5°	1816.2	1791.5	1745.8	1706.9	1682.2
55°	1678.9	1657.6	1615.2	1572.9	1555.4
57.5°	1541.2	1523.5	1477.5	1435.3	1421.1
60°	1403.4	1389.6	1340.2	1301.3	1290.8
62.5°	1269.5	1244.8	1209.7	1174.5	1160.3
65°	1132.2	1110.9	1075.7	1043.9	1026.3
67.5°	991.2	973.2	941.8	917.1	902.9
70°	860.5	846.3	814.5	789.9	776.0
72.5°	726.6	712.4	694.8	670.1	659.6
75°	592.3	585.6	567.6	546.7	553.7
77.5°	472.6	458.4	451.2	440.7	430.3
80°	352.8	349.1	342.0	331.5	324.4
82.5°	239.9	239.9	236.5	222.3	222.3
85°	144.4	141.1	137.7	126.9	123.5
87.5°	63.6	56.5	49.4	38.9	35.2
90°	2.2	27.6	45.9	57.7	62.0
92.5°	57.7	48.4	55.2	59.9	62.0
95°	149.5	73.5	89.6	101.4	99.0
97.5°	269.2	80.6	117.3	124.3	126.6
100°	407.6	92.1	131.2	149.5	154.2
102.5°	559.2	554.9	135.8	161.0	168.1
105°	699.7	768.8	140.5	165.6	174.9
107.5°	863.2	920.6	145.2	170.3	179.6
110°	1019.7	1067.9	402.8	172.8	181.7



TEST NUMBER: P903853

CATALOG NUMBER: DFN2DIP-SQ3F0-100D100US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1167.1	1208.3	1169.3	177.1	184.3
115°	1323.4	1362.5	1420.2	354.5	188.9
117.5°	1459.2	1505.2	1544.5	1215.2	612.3
120°	1611.3	1645.7	1687.2	1714.9	1404.1
122.5°	1740.0	1776.9	1823.1	1836.7	1839.2
125°	1871.2	1901.3	1945.0	1961.1	1967.9
127.5°	1990.9	2023.2	2057.9	2080.9	2083.0
130°	2103.8	2140.7	2165.9	2191.2	2189.1
132.5°	2218.8	2248.9	2274.1	2294.8	2292.6
135°	2315.6	2352.5	2373.0	2396.2	2391.6
137.5°	2416.8	2444.4	2467.6	2490.6	2483.7
140°	2515.6	2534.3	2559.4	2580.2	2568.7
142.5°	2598.8	2614.9	2644.7	2663.0	2651.6
145°	2686.2	2683.8	2722.9	2739.0	2727.5
147.5°	2761.9	2755.1	2794.2	2805.7	2796.7
150°	2835.7	2819.6	2856.6	2870.2	2858.7
152.5°	2897.8	2879.5	2914.0	2927.8	2911.7
155°	2957.7	2937.2	2964.8	2978.4	2960.1
157.5°	3006.1	2987.8	3008.5	3024.6	3006.1
160°	3047.6	3033.7	3047.6	3061.3	3045.2
162.5°	3084.2	3070.5	3082.0	3098.1	3077.4
165°	3116.4	3102.8	3109.6	3125.8	3109.6
167.5°	3141.9	3127.9	3135.1	3151.2	3130.4
170°	3162.6	3148.8	3153.4	3169.5	3148.8
172.5°	3176.3	3162.6	3167.3	3183.4	3162.6
175°	3187.8	3171.7	3176.3	3192.5	3169.5
177.5°	3192.5	3176.3	3178.8	3194.9	3174.1
180°	3181.0	3181.0	3181.0	3181.0	3181.0

TEST NUMBER: P903853

CATALOG NUMBER: DFN2DIP-SQ3F0-100D100US830-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.23	13.09	13.19	14.06	15.33	11.78	12.65	12.74	13.62	14.89
	3H	13.88	14.66	14.85	15.64	16.93	13.39	14.17	14.36	15.15	16.44
	4H	14.47	15.20	15.45	16.19	17.49	13.98	14.71	14.96	15.69	16.99
	6H	14.87	15.54	15.86	16.53	17.84	14.37	15.04	15.36	16.03	17.34
	8H	14.97	15.61	15.97	16.62	17.93	14.47	15.11	15.47	16.12	17.43
	12H	15.02	15.63	16.02	16.63	17.96	14.51	15.12	15.51	16.12	17.45
4H	2H	12.69	13.42	13.67	14.40	15.70	12.33	13.06	13.32	14.05	15.35
	3H	14.55	15.16	15.54	16.17	17.49	14.14	14.75	15.14	15.76	17.08
	4H	15.26	15.82	16.26	16.82	18.16	14.83	15.39	15.84	16.40	17.74
	6H	15.77	16.25	16.78	17.28	18.62	15.34	15.82	16.35	16.85	18.18
	8H	15.92	16.36	16.93	17.39	18.74	15.48	15.93	16.50	16.95	18.30
	12H	15.99	16.39	17.02	17.43	18.79	15.54	15.94	16.57	16.98	18.34
8H	4H	15.45	15.90	16.47	16.92	18.27	15.07	15.52	16.09	16.55	17.90
	6H	16.07	16.45	17.12	17.51	18.86	15.69	16.06	16.73	17.13	18.48
	8H	16.29	16.62	17.34	17.67	19.04	15.90	16.23	16.95	17.28	18.64
	12H	16.42	16.71	17.47	17.75	19.16	16.01	16.30	17.06	17.34	18.75
12H	4H	15.43	15.84	16.47	16.88	18.24	15.07	15.47	16.10	16.51	17.87
	6H	16.10	16.43	17.15	17.48	18.85	15.73	16.06	16.78	17.11	18.48
	8H	16.34	16.63	17.39	17.67	19.08	15.96	16.25	17.01	17.29	18.70