

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903871

Luminaire Tested: DFN2DIP-SQ3F0-110D050US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903871
REPORT IS A COMBINATION OF REPORTS P901414 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-110D050US830-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13478.4 lumens
Efficiency: N/A
Efficacy: 90.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 148.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903871

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US830-RLLONL

Luminous Intensity Polar Plot

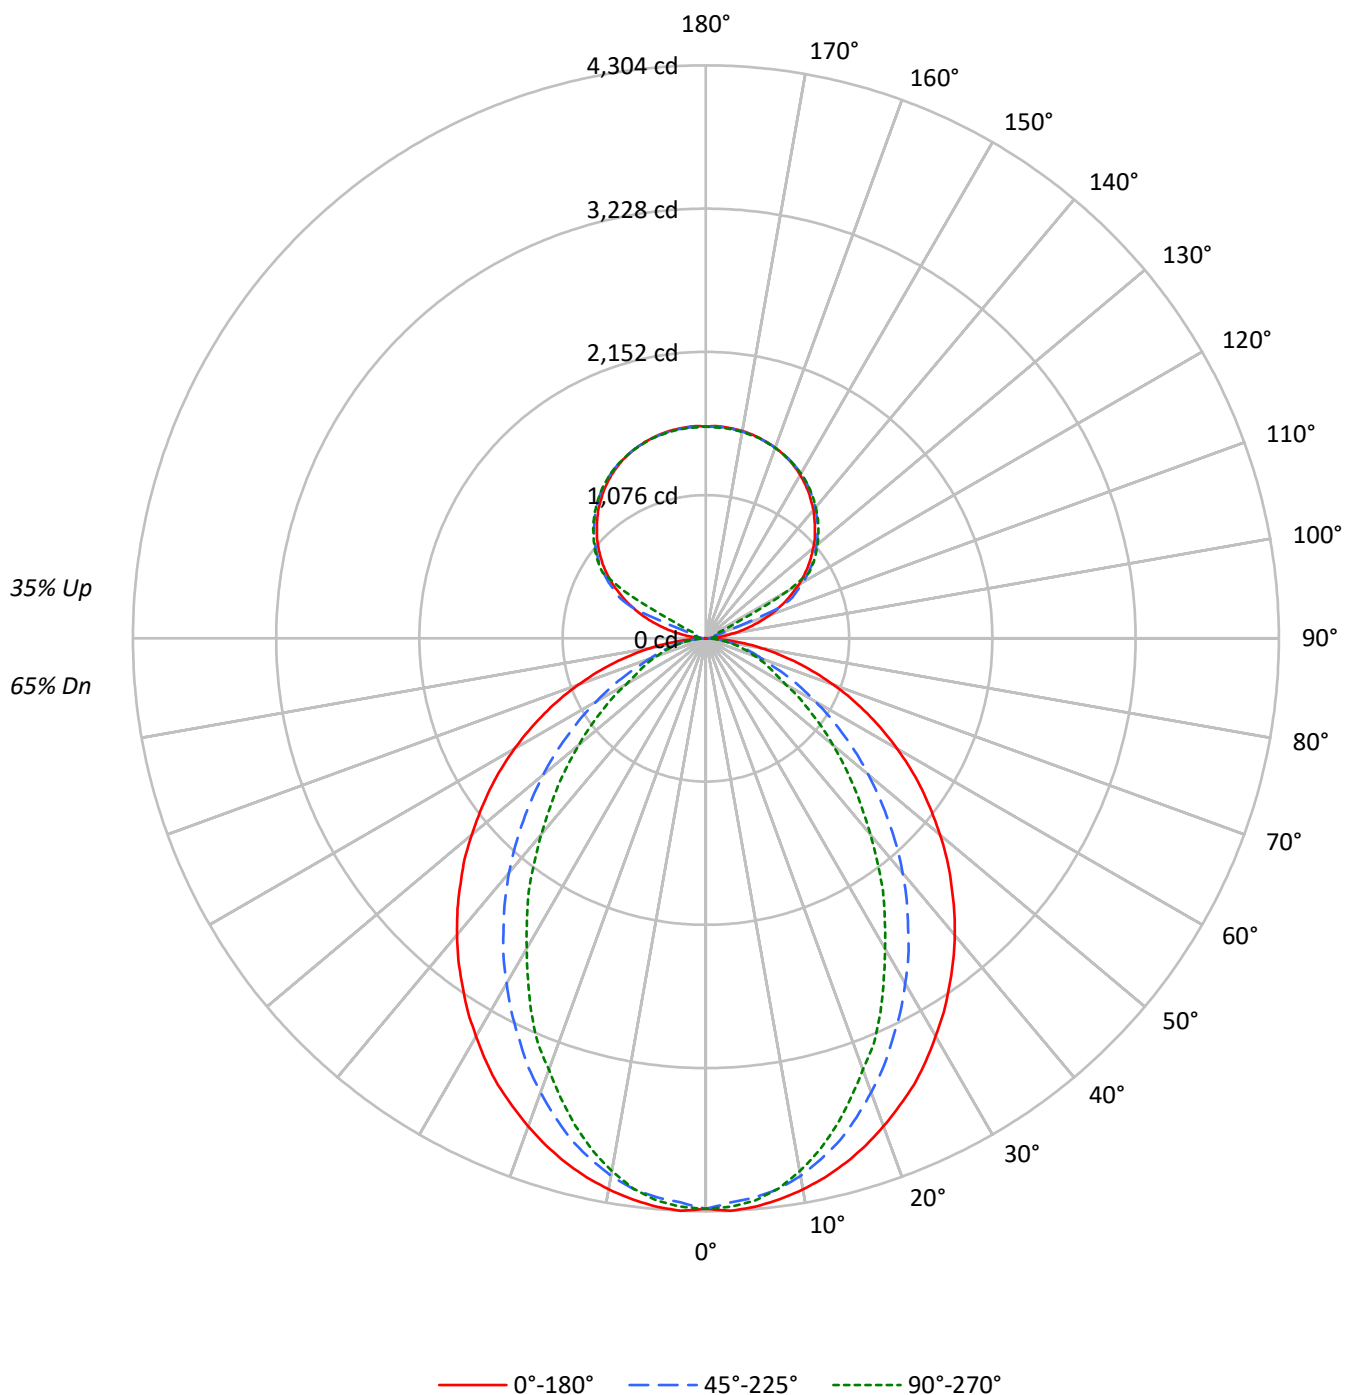

TEST NUMBER: P903871

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	70	70	70
1	102	98	94	91	96	92	89	86	82	79	77	72	70	69	63	62	61
2	93	86	80	75	88	81	76	72	72	68	65	64	61	58	56	54	52
3	86	76	69	63	80	72	66	61	64	59	55	57	53	50	50	48	45
4	79	68	60	54	74	64	57	52	58	52	48	51	47	43	46	42	39
5	72	61	53	47	68	58	51	45	52	46	42	46	42	38	41	38	35
6	67	55	47	41	63	52	45	40	47	41	37	42	37	34	38	34	31
7	62	50	42	37	59	48	40	35	43	37	33	39	34	30	35	31	28
8	58	46	38	33	55	44	36	32	39	34	29	36	31	27	32	28	25
9	54	42	34	29	51	40	33	28	36	31	27	33	28	25	30	26	23
10	51	39	31	27	48	37	30	26	34	28	24	31	26	23	28	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4910	4910	4910
5°	4915	4829	4861
10°	4863	4731	4701
15°	4793	4571	4455
20°	4701	4353	4154
25°	4607	4108	3863
30°	4482	3858	3495
35°	4359	3589	3171
40°	4234	3311	2800
45°	4089	3004	2464
50°	3939	2693	2136
55°	3782	2362	1821
60°	3600	2016	1497
65°	3390	1665	1346
70°	3136	1337	1216
75°	2815	1172	1103
80°	2353	973	951
85°	1595	633	705

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4089 cd/sqm

TEST NUMBER: P903871

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	401.6	3.0
10°-20°	1102.5	8.2
20°-30°	1547.8	11.5
30°-40°	1687.2	12.5
40°-50°	1550.8	11.5
50°-60°	1217.9	9.0
60°-70°	792.7	5.9
70°-80°	408.1	3.0
80°-90°	107.0	0.8
90°-100°	52.5	0.4
100°-110°	195.5	1.5
110°-120°	518.5	3.8
120°-130°	860.0	6.4
130°-140°	913.5	6.8
140°-150°	849.0	6.3
150°-160°	682.6	5.1
160°-170°	439.8	3.3
170°-180°	151.4	1.1
0°-30°	3051.9	22.6
0°-40°	4739.1	35.2
0°-60°	7507.8	55.7
0°-90°	8815.6	65.4
90°-120°	766.5	5.7
90°-150°	3389.0	25.1
90°-180°	4663.0	34.6
0°-180°	13478.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4285	4285	4285	4285	4285	
5°	4285	4266	4215	4250	4239	406
15°	4076	4033	3901	3828	3789	1148
25°	3700	3575	3319	3161	3102	1701
35°	3188	2990	2649	2404	2319	1995
45°	2606	2346	1939	1663	1570	2013
55°	1981	1679	1260	1028	954	1771
65°	1338	1024	675	543	531	1326
75°	713	442	310	283	279	755
85°	167	85	74	74	74	191
90°	1	14	23	29	31	13
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1469	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P903871

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4285.1	4285.1	4285.1	4285.1	4285.1
2.5°	4304.4	4285.1	4242.3	4281.4	4273.6
5°	4285.1	4265.8	4215.1	4250.1	4238.6
7.5°	4250.1	4227.0	4172.7	4188.0	4168.6
10°	4203.6	4176.4	4099.1	4087.1	4064.1
12.5°	4145.6	4110.6	4005.7	3982.6	3939.8
15°	4075.6	4032.9	3901.2	3827.6	3788.8
17.5°	3994.2	3932.1	3769.1	3683.9	3621.8
20°	3901.2	3823.4	3629.6	3532.9	3447.3
22.5°	3800.4	3711.1	3486.1	3354.4	3296.4
25°	3699.6	3575.3	3319.4	3160.6	3102.2
27.5°	3579.5	3447.3	3164.3	2982.0	2892.8
30°	3451.5	3303.8	2993.6	2796.1	2691.1
32.5°	3327.3	3148.7	2831.0	2598.2	2501.1
35°	3187.8	2989.8	2648.8	2404.4	2318.8
37.5°	3052.0	2838.5	2478.0	2210.2	2113.6
40°	2908.4	2676.0	2299.5	2024.2	1923.4
42.5°	2761.1	2513.0	2121.4	1834.2	1737.5
45°	2606.0	2346.0	1939.1	1663.4	1570.5
47.5°	2458.7	2183.5	1764.6	1488.9	1403.8
50°	2295.8	2020.5	1593.9	1326.1	1245.0
52.5°	2136.6	1845.7	1431.0	1175.1	1101.4
55°	1981.4	1679.0	1260.2	1027.7	954.1
57.5°	1822.7	1512.4	1109.2	892.0	829.8
60°	1659.7	1349.5	950.0	752.5	690.4
62.5°	1500.9	1190.7	814.3	628.3	597.4
65°	1337.9	1023.6	674.8	543.1	531.1
67.5°	1182.9	868.6	543.1	476.8	465.3
70°	1019.9	717.6	449.7	411.0	395.4
72.5°	864.8	577.7	376.1	345.2	337.3
75°	713.4	441.9	310.2	283.0	279.4
77.5°	562.4	314.0	244.4	228.8	220.9
80°	422.5	225.1	186.0	170.8	170.8
82.5°	294.5	151.4	128.0	120.2	120.2
85°	166.6	85.2	73.6	73.6	73.6
87.5°	62.1	30.8	30.8	27.1	27.1
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.7	277.4	68.0	80.5	84.1
105°	349.9	384.5	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	534.0	201.4	86.3	90.9



TEST NUMBER: P903871

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.2	584.7	88.6	92.1
115°	661.8	681.3	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.6	306.1
120°	805.6	822.8	843.6	857.4	702.0
122.5°	870.0	888.4	911.5	918.4	919.6
125°	935.6	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1029.0	1040.4	1041.5
130°	1051.9	1070.4	1082.9	1095.6	1094.6
132.5°	1109.5	1124.5	1137.0	1147.5	1146.3
135°	1157.8	1176.3	1186.5	1198.2	1195.8
137.5°	1208.3	1222.2	1233.8	1245.3	1241.9
140°	1257.8	1267.2	1279.7	1290.1	1284.4
142.5°	1299.4	1307.5	1322.4	1331.5	1325.8
145°	1343.1	1341.9	1361.4	1369.5	1363.8
147.5°	1381.0	1377.5	1397.1	1402.9	1398.4
150°	1417.9	1409.9	1428.2	1435.1	1429.4
152.5°	1448.9	1439.7	1457.0	1464.0	1455.9
155°	1478.8	1468.6	1482.3	1489.2	1480.1
157.5°	1503.0	1493.8	1504.2	1512.3	1503.0
160°	1523.8	1516.8	1523.8	1530.6	1522.6
162.5°	1542.1	1535.3	1541.0	1549.1	1538.7
165°	1558.2	1551.4	1554.8	1562.8	1554.8
167.5°	1570.9	1564.0	1567.5	1575.6	1565.2
170°	1581.3	1574.3	1576.7	1584.7	1574.3
172.5°	1588.2	1581.3	1583.7	1591.7	1581.3
175°	1593.9	1585.8	1588.2	1596.2	1584.7
177.5°	1596.2	1588.2	1589.4	1597.4	1587.1
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P903871

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.97	14.95	14.79	15.78	16.82	9.93	10.91	10.75	11.74	12.78
	3H	15.66	16.53	16.49	17.37	18.44	11.12	12.00	11.96	12.84	13.91
	4H	16.27	17.09	17.12	17.94	19.02	11.58	12.40	12.43	13.25	14.33
	6H	16.69	17.45	17.55	18.31	19.40	11.90	12.66	12.76	13.52	14.61
	8H	16.82	17.54	17.69	18.42	19.51	11.99	12.71	12.86	13.59	14.68
	12H	16.89	17.57	17.76	18.44	19.56	12.04	12.72	12.91	13.59	14.71
4H	2H	14.01	14.83	14.86	15.68	16.76	10.54	11.36	11.40	12.22	13.29
	3H	15.84	16.52	16.71	17.41	18.50	11.90	12.58	12.76	13.47	14.56
	4H	16.54	17.16	17.41	18.04	19.16	12.45	13.07	13.32	13.95	15.07
	6H	17.05	17.59	17.95	18.50	19.62	12.87	13.40	13.76	14.31	15.43
	8H	17.23	17.73	18.13	18.63	19.76	12.99	13.49	13.89	14.40	15.53
	12H	17.33	17.78	18.24	18.70	19.84	13.06	13.51	13.98	14.43	15.57
8H	4H	16.51	17.01	17.41	17.91	19.05	12.73	13.23	13.63	14.14	15.27
	6H	17.08	17.49	18.00	18.44	19.57	13.25	13.66	14.17	14.61	15.74
	8H	17.29	17.66	18.23	18.59	19.74	13.44	13.80	14.37	14.74	15.89
	12H	17.43	17.76	18.37	18.68	19.89	13.56	13.88	14.49	14.81	16.01
12H	4H	16.47	16.92	17.39	17.84	18.98	12.74	13.19	13.66	14.12	15.25
	6H	17.05	17.42	17.99	18.36	19.51	13.30	13.66	14.23	14.60	15.75
	8H	17.28	17.60	18.21	18.53	19.73	13.51	13.83	14.44	14.76	15.96

END OF REPORT