

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903900

Luminaire Tested: DFN2DIP-SQ3F0-120D040US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903900
REPORT IS A COMBINATION OF REPORTS P899877 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D040US830-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14534.0 lumens
Efficiency: N/A
Efficacy: 93.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 156.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903900

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US830-FLLFLL

Luminous Intensity Polar Plot

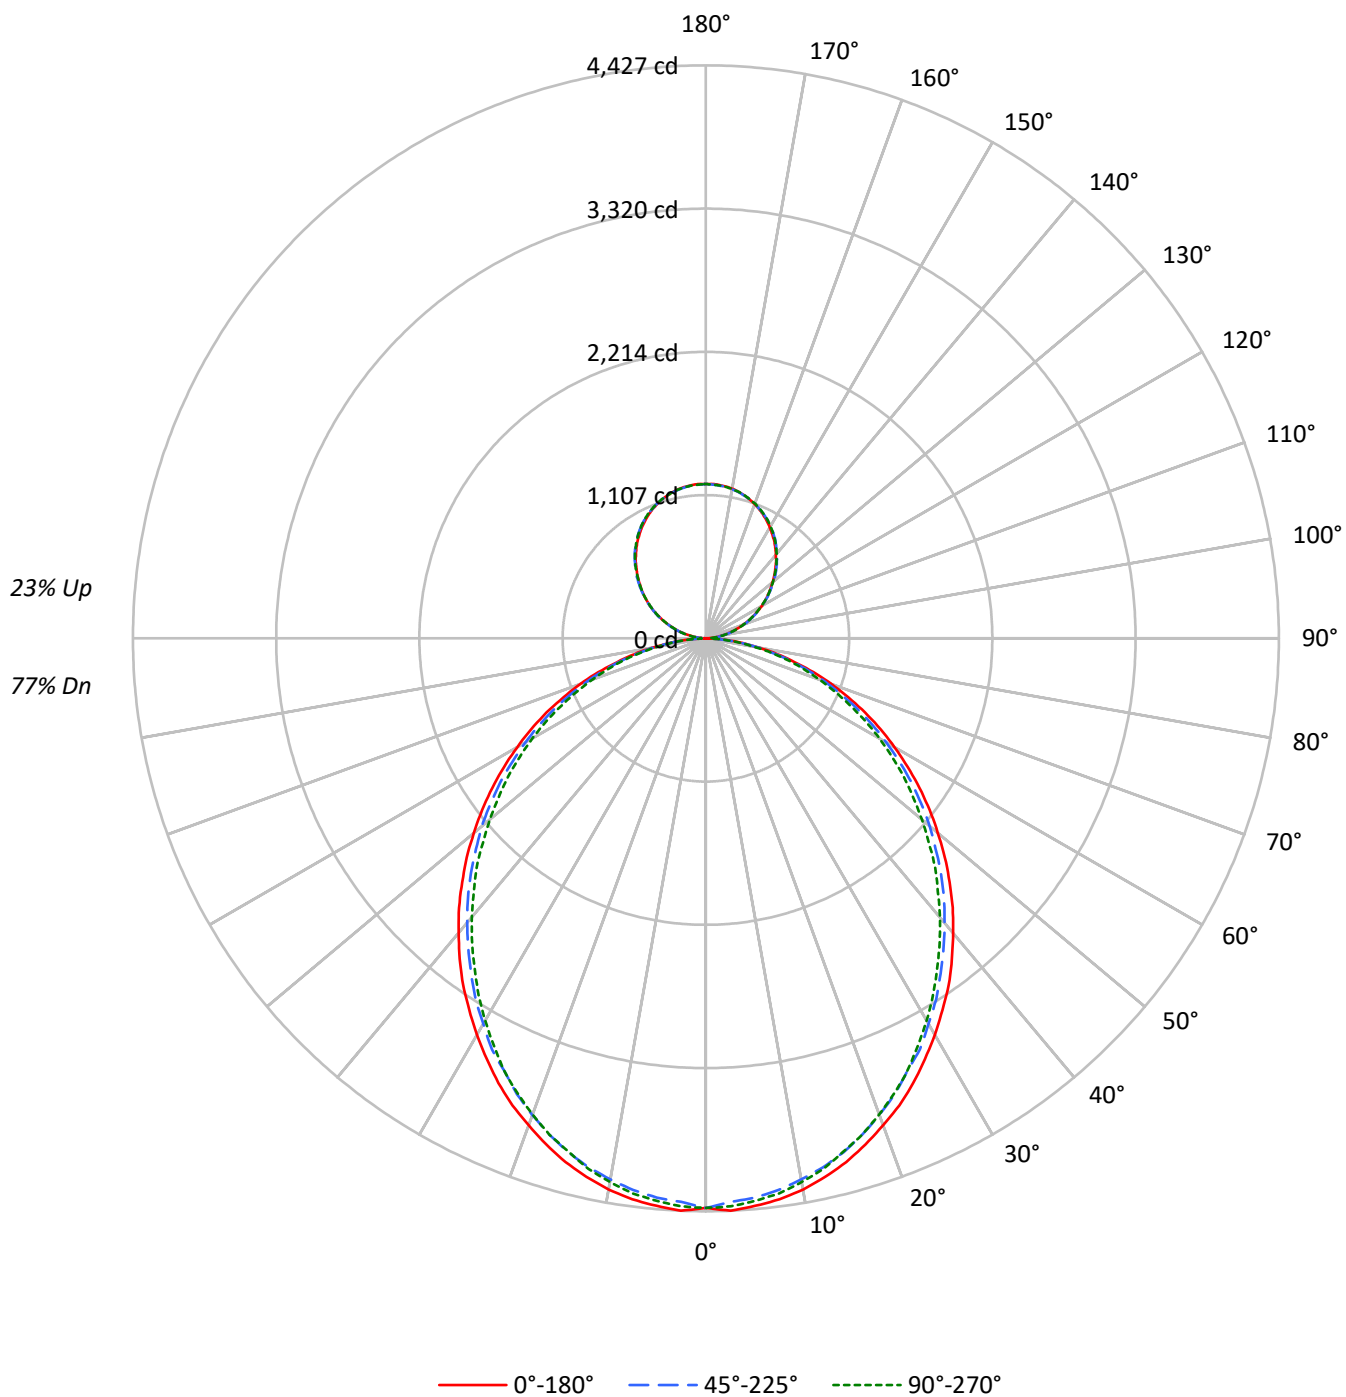

TEST NUMBER: P903900

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US830-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	114	114	114	114	108	108	108	108	98	98	98	89	89	89	81	81	81
1	104	99	95	92	99	95	91	88	86	84	81	79	77	75	72	70	68
2	95	87	80	75	90	83	77	72	76	71	67	69	66	62	63	60	58
3	86	76	69	63	82	73	66	61	67	61	57	61	57	53	56	52	49
4	79	68	59	53	75	65	57	52	60	53	48	55	50	45	50	46	42
5	73	61	52	46	69	58	50	44	53	47	42	49	44	39	45	41	37
6	67	55	46	40	64	52	45	39	48	42	37	45	39	35	41	36	33
7	62	49	41	35	59	48	40	34	44	37	33	41	35	31	37	33	29
8	58	45	37	31	55	43	36	31	40	34	29	37	32	28	34	30	26
9	54	41	33	28	52	40	32	27	37	31	26	34	29	25	32	27	24
10	51	38	30	25	48	37	30	25	34	28	24	32	26	23	30	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5043	5043	5043
5°	5048	4969	5004
10°	5003	4899	4935
15°	4927	4815	4827
20°	4824	4699	4717
25°	4722	4562	4590
30°	4594	4434	4430
35°	4474	4284	4259
40°	4325	4131	4097
45°	4177	3979	3931
50°	4015	3818	3739
55°	3845	3632	3562
60°	3653	3413	3360
65°	3443	3185	3121
70°	3175	2906	2863
75°	2805	2572	2622
80°	2358	2146	2168
85°	1659	1422	1419

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4177 cd/sqm

TEST NUMBER: P903900

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	414.2	2.9
10°-20°	1165.5	8.0
20°-30°	1712.8	11.8
30°-40°	1989.3	13.7
40°-50°	1986.8	13.7
50°-60°	1732.4	11.9
60°-70°	1280.6	8.8
70°-80°	724.6	5.0
80°-90°	194.6	1.3
90°-100°	73.8	0.5
100°-110°	234.4	1.6
110°-120°	401.2	2.8
120°-130°	527.6	3.6
130°-140°	592.2	4.1
140°-150°	580.8	4.0
150°-160°	487.2	3.4
160°-170°	323.1	2.2
170°-180°	112.9	0.8
0°-30°	3292.4	22.7
0°-40°	5281.7	36.3
0°-60°	9000.9	61.9
0°-90°	11200.8	77.1
90°-120°	709.4	4.9
90°-150°	2410.0	16.6
90°-180°	3333.0	22.9
0°-180°	14534.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4401	4401	4401	4401	4401	
5°	4401	4384	4338	4371	4363	418
15°	4190	4164	4109	4126	4105	1180
25°	3792	3758	3686	3694	3686	1745
35°	3271	3229	3161	3136	3115	2043
45°	2662	2632	2569	2522	2505	2054
55°	2015	1989	1938	1888	1866	1801
65°	1359	1333	1291	1253	1232	1343
75°	711	703	681	656	664	759
85°	173	169	165	152	148	193
90°	1	13	35	33	34	14
95°	52	63	64	64	63	58
105°	216	219	221	223	223	228
115°	403	408	406	406	403	398
125°	586	595	592	588	587	523
135°	757	768	771	770	767	585
145°	920	927	932	934	930	575
155°	1051	1054	1058	1063	1059	484
165°	1144	1143	1143	1150	1145	323
175°	1190	1187	1185	1192	1186	113
180°	1192	1192	1192	1192	1192	

TEST NUMBER: P903900

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4401.0	4401.0	4401.0	4401.0	4401.0
2.5°	4426.6	4405.4	4358.8	4401.0	4392.9
5°	4401.0	4384.3	4337.7	4371.3	4363.2
7.5°	4371.3	4346.2	4299.5	4333.6	4325.1
10°	4325.1	4295.4	4244.7	4278.4	4265.9
12.5°	4261.3	4236.2	4185.5	4206.6	4198.0
15°	4189.5	4164.3	4109.1	4126.2	4105.1
17.5°	4100.6	4075.5	4020.2	4041.3	4020.2
20°	4003.2	3978.0	3918.8	3931.3	3914.8
22.5°	3906.2	3868.0	3812.8	3812.8	3804.3
25°	3791.7	3758.0	3686.2	3694.3	3686.2
27.5°	3664.6	3635.0	3580.2	3567.6	3546.6
30°	3538.0	3503.9	3440.6	3428.0	3411.0
32.5°	3402.4	3377.3	3309.5	3283.9	3266.9
35°	3271.3	3229.1	3161.3	3135.7	3114.6
37.5°	3123.1	3085.0	3017.2	2987.6	2966.5
40°	2971.0	2936.9	2869.0	2831.3	2814.2
42.5°	2822.8	2788.7	2721.3	2678.7	2653.5
45°	2662.0	2632.4	2568.6	2522.4	2505.4
47.5°	2505.4	2475.7	2407.9	2361.3	2336.1
50°	2340.1	2319.0	2259.7	2200.5	2179.3
52.5°	2179.3	2149.8	2095.0	2048.2	2018.6
55°	2014.6	1989.0	1938.2	1887.5	1866.4
57.5°	1849.4	1828.2	1773.0	1722.3	1705.2
60°	1684.1	1667.5	1608.3	1561.6	1549.0
62.5°	1523.4	1493.7	1451.6	1409.4	1392.3
65°	1358.7	1333.0	1290.8	1252.6	1231.6
67.5°	1189.4	1167.8	1130.1	1100.5	1083.5
70°	1032.6	1015.6	977.4	947.8	931.2
72.5°	871.9	854.9	833.8	804.2	791.5
75°	710.8	702.7	681.1	656.0	664.5
77.5°	567.0	550.0	541.5	528.9	516.3
80°	423.4	418.9	410.4	397.8	389.3
82.5°	287.8	287.8	283.8	266.7	266.7
85°	173.3	169.3	165.2	152.2	148.2
87.5°	76.3	67.8	59.3	46.7	42.2
90°	1.0	12.9	35.3	33.1	34.1
92.5°	22.2	30.2	31.3	32.3	32.3
95°	52.5	62.6	64.4	64.4	62.6
97.5°	87.4	96.7	100.7	100.7	100.7
100°	127.6	135.9	138.7	138.7	137.7
102.5°	170.0	176.2	180.1	181.2	180.1
105°	216.4	219.2	221.4	223.2	223.2
107.5°	262.4	266.7	266.7	267.4	262.4
110°	307.0	312.7	312.7	312.7	309.9

TEST NUMBER: P903900

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	355.1	361.3	360.1	357.3	355.1
115°	402.6	408.4	406.5	405.5	402.6
117.5°	449.7	457.6	452.6	449.7	446.9
120°	497.2	505.0	497.2	497.2	493.9
122.5°	540.3	550.4	545.4	542.4	540.3
125°	585.6	594.6	591.7	588.4	587.4
127.5°	629.8	640.9	637.0	632.6	629.8
130°	671.1	684.1	682.3	680.1	676.2
132.5°	717.5	727.5	728.3	723.2	720.4
135°	757.4	768.5	770.7	769.6	766.8
137.5°	802.0	811.0	812.8	812.0	807.8
140°	841.1	850.2	855.2	855.2	851.2
142.5°	881.5	890.4	893.2	894.4	890.4
145°	919.5	926.7	932.5	933.6	929.6
147.5°	953.7	962.6	967.0	968.7	964.8
150°	988.9	995.0	999.0	1002.2	999.0
152.5°	1020.2	1026.2	1031.3	1035.3	1031.3
155°	1051.4	1054.3	1057.5	1062.6	1059.3
157.5°	1078.5	1080.5	1082.3	1089.6	1084.5
160°	1102.5	1104.7	1105.7	1111.8	1107.5
162.5°	1124.7	1124.7	1125.9	1132.7	1127.7
165°	1143.9	1142.7	1142.7	1149.9	1144.9
167.5°	1161.1	1157.8	1157.8	1165.1	1160.0
170°	1174.0	1171.1	1170.1	1177.2	1171.1
172.5°	1183.0	1180.2	1179.0	1186.3	1180.2
175°	1190.2	1187.3	1185.2	1192.3	1186.3
177.5°	1194.2	1191.3	1189.1	1195.2	1189.1
180°	1192.3	1192.3	1192.3	1192.3	1192.3

TEST NUMBER: P903900

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.06	16.23	15.74	16.93	17.75	14.61	15.78	15.30	16.49	17.31
	3H	16.74	17.79	17.43	18.50	19.36	16.25	17.30	16.94	18.01	18.87
	4H	17.33	18.33	18.05	19.05	19.92	16.84	17.83	17.56	18.56	19.43
	6H	17.75	18.66	18.48	19.40	20.28	17.25	18.16	17.98	18.90	19.78
	8H	17.86	18.73	18.60	19.49	20.37	17.36	18.23	18.10	18.98	19.87
	12H	17.91	18.75	18.66	19.50	20.41	17.41	18.24	18.15	18.99	19.90
4H	2H	15.55	16.54	16.27	17.27	18.14	15.20	16.19	15.92	16.91	17.78
	3H	17.44	18.27	18.17	19.03	19.92	17.03	17.86	17.76	18.62	19.51
	4H	18.16	18.92	18.91	19.68	20.59	17.74	18.49	18.49	19.25	20.17
	6H	18.69	19.34	19.46	20.13	21.05	18.26	18.91	19.02	19.70	20.62
	8H	18.84	19.46	19.62	20.24	21.17	18.41	19.02	19.18	19.80	20.74
	12H	18.93	19.48	19.72	20.29	21.23	18.48	19.03	19.27	19.84	20.78
8H	4H	18.38	18.99	19.15	19.77	20.71	18.00	18.61	18.77	19.40	20.33
	6H	19.02	19.52	19.82	20.35	21.29	18.63	19.14	19.43	19.96	20.90
	8H	19.24	19.69	20.05	20.51	21.47	18.84	19.30	19.66	20.12	21.07
	12H	19.38	19.78	20.19	20.59	21.60	18.97	19.37	19.78	20.18	21.19
12H	4H	18.38	18.93	19.17	19.73	20.68	18.01	18.56	18.80	19.37	20.31
	6H	19.05	19.50	19.86	20.32	21.28	18.67	19.13	19.49	19.95	20.90
	8H	19.30	19.70	20.11	20.51	21.52	18.92	19.32	19.73	20.13	21.14