

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903908

Luminaire Tested: DFN2DIP-SQ3F0-120D060US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903908
REPORT IS A COMBINATION OF REPORTS P899913 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D060US830-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16202.3 lumens
Efficiency: N/A
Efficacy: 94.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 170.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903908

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US830-FLLFLL

Luminous Intensity Polar Plot

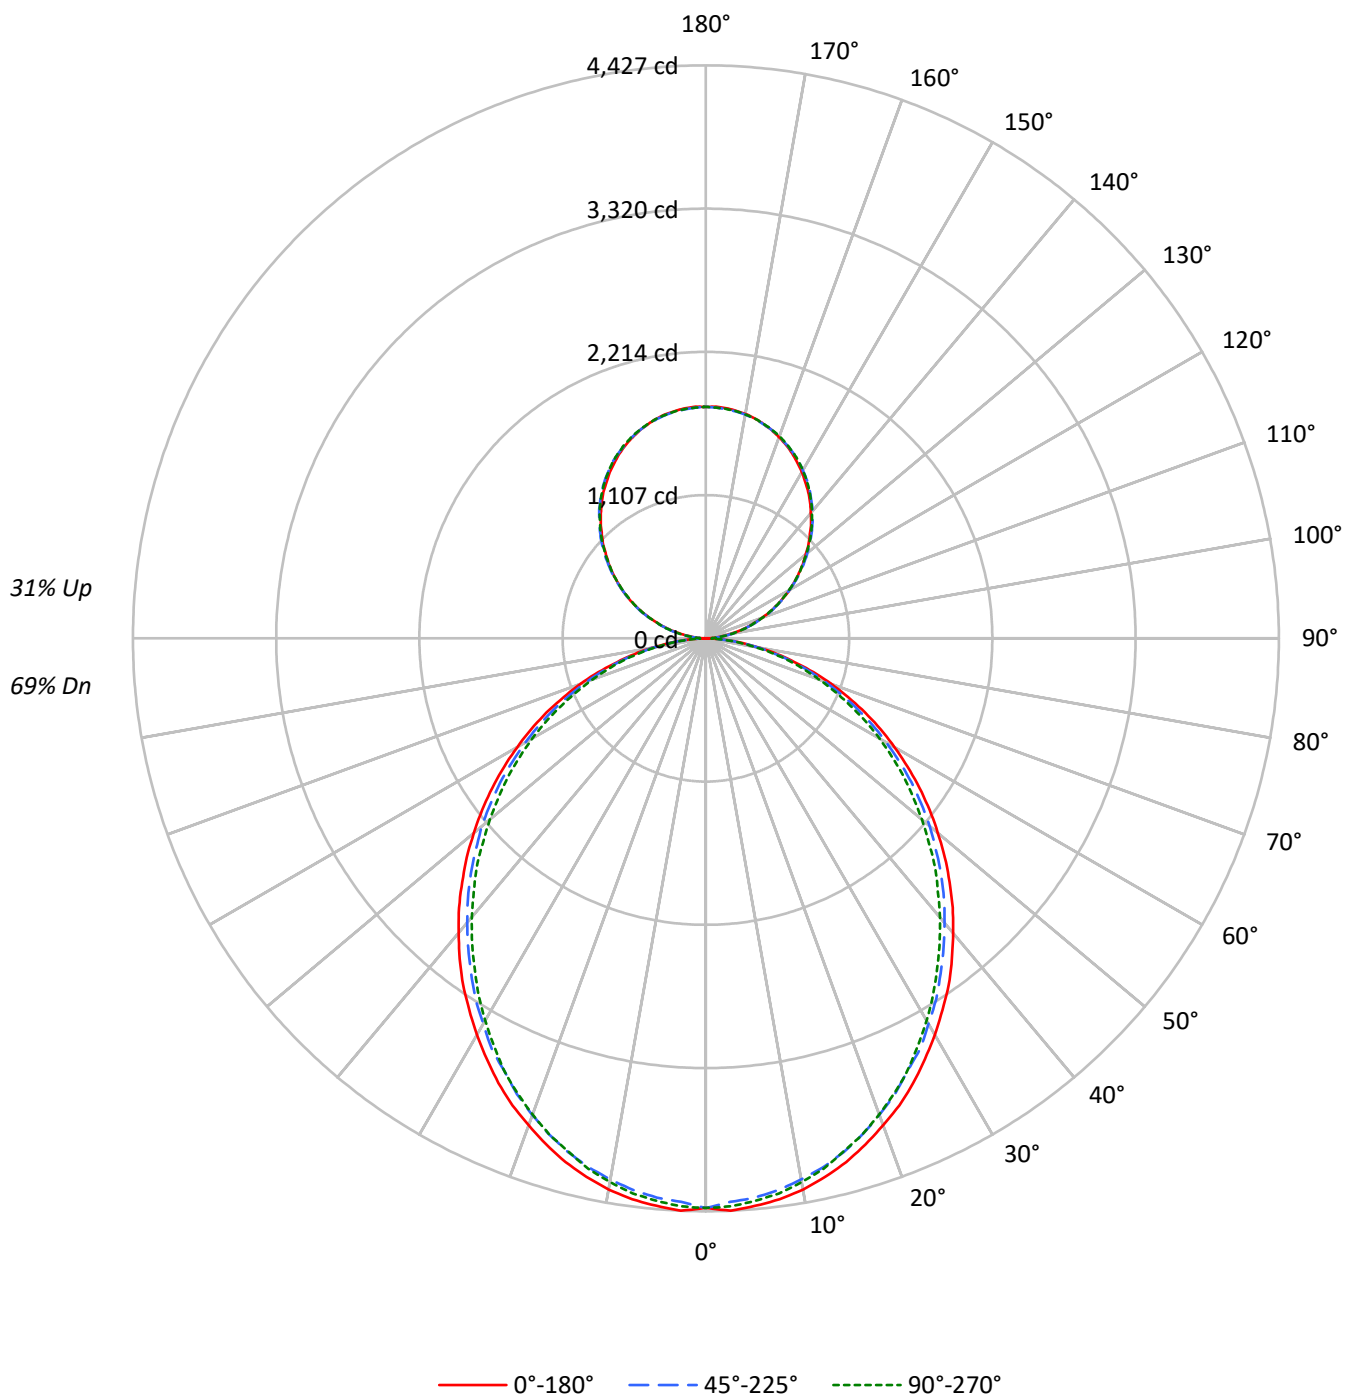

TEST NUMBER: P903908

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US830-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	83	83	83	74	74	74
1	102	98	94	90	96	92	89	86	83	80	77	74	71	70	65	64	62
2	93	85	79	74	88	81	75	70	72	68	64	65	61	58	57	55	52
3	85	75	67	61	80	71	64	59	64	58	54	57	53	49	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	46	42	46	42	39
5	71	59	51	45	67	56	49	43	51	45	40	46	41	37	41	37	34
6	66	53	45	39	62	51	43	38	46	40	35	41	36	32	37	33	30
7	61	48	40	34	58	46	39	33	42	36	31	38	33	29	34	30	26
8	57	44	36	31	54	42	35	30	38	32	28	35	29	26	31	27	24
9	53	40	33	27	50	39	31	26	35	29	25	32	27	23	29	25	21
10	50	37	30	25	47	36	29	24	32	27	22	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5043	5043	5043
5°	5048	4969	5004
10°	5003	4899	4935
15°	4927	4815	4827
20°	4824	4699	4717
25°	4722	4562	4590
30°	4594	4434	4430
35°	4474	4284	4259
40°	4325	4131	4097
45°	4177	3979	3931
50°	4015	3818	3739
55°	3845	3632	3562
60°	3653	3413	3360
65°	3443	3185	3121
70°	3175	2906	2863
75°	2805	2572	2622
80°	2358	2146	2168
85°	1659	1422	1419

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4177 cd/sqm

TEST NUMBER: P903908

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	414.2	2.6
10°-20°	1165.5	7.2
20°-30°	1712.8	10.6
30°-40°	1989.3	12.3
40°-50°	1986.8	12.3
50°-60°	1732.4	10.7
60°-70°	1280.6	7.9
70°-80°	724.6	4.5
80°-90°	196.3	1.2
90°-100°	110.7	0.7
100°-110°	351.6	2.2
110°-120°	601.8	3.7
120°-130°	791.4	4.9
130°-140°	888.4	5.5
140°-150°	871.1	5.4
150°-160°	730.8	4.5
160°-170°	484.6	3.0
170°-180°	169.4	1.0
0°-30°	3292.4	20.3
0°-40°	5281.7	32.6
0°-60°	9000.9	55.6
0°-90°	11202.5	69.1
90°-120°	1064.1	6.6
90°-150°	3615.0	22.3
90°-180°	5000.0	30.9
0°-180°	16202.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4401	4401	4401	4401	4401	
5°	4401	4384	4338	4371	4363	418
15°	4190	4164	4109	4126	4105	1180
25°	3792	3758	3686	3694	3686	1745
35°	3271	3229	3161	3136	3115	2043
45°	2662	2632	2569	2522	2505	2054
55°	2015	1989	1938	1888	1866	1801
65°	1359	1333	1291	1253	1232	1343
75°	711	703	681	656	664	759
85°	173	169	165	152	148	193
90°	2	19	53	50	51	15
95°	79	94	96	96	94	88
105°	325	329	332	335	335	343
115°	604	613	610	608	604	597
125°	878	892	888	883	881	785
135°	1136	1153	1156	1154	1150	878
145°	1379	1390	1399	1400	1394	862
155°	1577	1582	1586	1594	1589	726
165°	1716	1714	1714	1725	1717	484
175°	1785	1781	1778	1789	1779	170
180°	1789	1789	1789	1789	1789	

TEST NUMBER: P903908

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4401.0	4401.0	4401.0	4401.0	4401.0
2.5°	4426.6	4405.4	4358.8	4401.0	4392.9
5°	4401.0	4384.3	4337.7	4371.3	4363.2
7.5°	4371.3	4346.2	4299.5	4333.6	4325.1
10°	4325.1	4295.4	4244.7	4278.4	4265.9
12.5°	4261.3	4236.2	4185.5	4206.6	4198.0
15°	4189.5	4164.3	4109.1	4126.2	4105.1
17.5°	4100.6	4075.5	4020.2	4041.3	4020.2
20°	4003.2	3978.0	3918.8	3931.3	3914.8
22.5°	3906.2	3868.0	3812.8	3812.8	3804.3
25°	3791.7	3758.0	3686.2	3694.3	3686.2
27.5°	3664.6	3635.0	3580.2	3567.6	3546.6
30°	3538.0	3503.9	3440.6	3428.0	3411.0
32.5°	3402.4	3377.3	3309.5	3283.9	3266.9
35°	3271.3	3229.1	3161.3	3135.7	3114.6
37.5°	3123.1	3085.0	3017.2	2987.6	2966.5
40°	2971.0	2936.9	2869.0	2831.3	2814.2
42.5°	2822.8	2788.7	2721.3	2678.7	2653.5
45°	2662.0	2632.4	2568.6	2522.4	2505.4
47.5°	2505.4	2475.7	2407.9	2361.3	2336.1
50°	2340.1	2319.0	2259.7	2200.5	2179.3
52.5°	2179.3	2149.8	2095.0	2048.2	2018.6
55°	2014.6	1989.0	1938.2	1887.5	1866.4
57.5°	1849.4	1828.2	1773.0	1722.3	1705.2
60°	1684.1	1667.5	1608.3	1561.6	1549.0
62.5°	1523.4	1493.7	1451.6	1409.4	1392.3
65°	1358.7	1333.0	1290.8	1252.6	1231.6
67.5°	1189.4	1167.8	1130.1	1100.5	1083.5
70°	1032.6	1015.6	977.4	947.8	931.2
72.5°	871.9	854.9	833.8	804.2	791.5
75°	710.8	702.7	681.1	656.0	664.5
77.5°	567.0	550.0	541.5	528.9	516.3
80°	423.4	418.9	410.4	397.8	389.3
82.5°	287.8	287.8	283.8	266.7	266.7
85°	173.3	169.3	165.2	152.2	148.2
87.5°	76.3	67.8	59.3	46.7	42.2
90°	1.6	19.4	52.9	49.6	51.2
92.5°	33.5	45.3	46.9	48.5	48.5
95°	78.7	93.8	96.5	96.5	93.8
97.5°	131.0	145.1	151.0	151.0	151.0
100°	191.4	203.8	208.1	208.1	206.5
102.5°	255.1	264.2	270.1	271.7	270.1
105°	324.6	328.9	332.2	334.9	334.9
107.5°	393.6	400.1	400.1	401.1	393.6
110°	460.5	469.1	469.1	469.1	464.8

TEST NUMBER: P903908

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	532.7	541.9	540.3	535.9	532.7
115°	603.9	612.6	609.8	608.2	603.9
117.5°	674.6	686.5	678.8	674.6	670.2
120°	745.7	757.6	745.7	745.7	740.8
122.5°	810.4	825.5	817.9	813.7	810.4
125°	878.4	891.8	887.5	882.7	881.1
127.5°	944.7	961.4	955.5	949.0	944.7
130°	1006.7	1026.1	1023.4	1020.2	1014.3
132.5°	1076.3	1091.4	1092.4	1084.9	1080.5
135°	1136.1	1152.8	1156.0	1154.4	1150.1
137.5°	1203.0	1216.4	1219.2	1218.0	1211.6
140°	1261.8	1275.3	1282.8	1282.8	1276.9
142.5°	1322.1	1335.6	1339.9	1341.5	1335.6
145°	1379.3	1390.1	1398.7	1400.3	1394.4
147.5°	1430.5	1444.0	1450.5	1453.1	1447.2
150°	1483.4	1492.5	1498.5	1503.3	1498.5
152.5°	1530.2	1539.5	1547.0	1552.9	1547.0
155°	1577.2	1581.5	1586.3	1593.9	1589.0
157.5°	1617.6	1620.9	1623.5	1634.4	1626.8
160°	1653.8	1657.0	1658.6	1667.7	1661.3
162.5°	1687.2	1687.2	1688.8	1699.0	1691.5
165°	1715.7	1714.1	1714.1	1724.9	1717.4
167.5°	1741.6	1736.8	1736.8	1747.6	1740.0
170°	1761.0	1756.7	1755.1	1765.9	1756.7
172.5°	1774.5	1770.2	1768.6	1779.3	1770.2
175°	1785.3	1781.0	1777.7	1788.6	1779.3
177.5°	1791.2	1787.0	1783.7	1792.8	1783.7
180°	1788.6	1788.6	1788.6	1788.6	1788.6

TEST NUMBER: P903908

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.46	15.53	15.23	16.32	17.29	14.02	15.08	14.79	15.88	16.85
	3H	16.13	17.09	16.92	17.89	18.89	15.64	16.60	16.43	17.40	18.40
	4H	16.73	17.63	17.53	18.44	19.45	16.23	17.14	17.04	17.95	18.96
	6H	17.13	17.97	17.95	18.79	19.81	16.63	17.47	17.45	18.29	19.31
	8H	17.24	18.04	18.07	18.88	19.90	16.74	17.53	17.57	18.38	19.40
	12H	17.30	18.05	18.13	18.89	19.94	16.79	17.54	17.62	18.38	19.43
4H	2H	14.94	15.85	15.75	16.66	17.67	14.59	15.49	15.40	16.30	17.31
	3H	16.82	17.58	17.64	18.42	19.45	16.41	17.17	17.23	18.02	19.04
	4H	17.54	18.23	18.37	19.07	20.13	17.12	17.80	17.95	18.65	19.70
	6H	18.06	18.66	18.91	19.53	20.59	17.63	18.22	18.48	19.09	20.15
	8H	18.21	18.77	19.07	19.64	20.71	17.78	18.33	18.63	19.20	20.27
	12H	18.30	18.80	19.17	19.68	20.76	17.85	18.35	18.72	19.23	20.31
8H	4H	17.75	18.30	18.60	19.17	20.24	17.37	17.93	18.23	18.79	19.86
	6H	18.38	18.84	19.26	19.75	20.82	18.00	18.46	18.88	19.37	20.44
	8H	18.60	19.01	19.49	19.91	21.00	18.21	18.62	19.10	19.52	20.61
	12H	18.74	19.10	19.63	19.99	21.13	18.33	18.69	19.22	19.58	20.72
12H	4H	17.74	18.24	18.62	19.13	20.21	17.37	17.88	18.25	18.76	19.84
	6H	18.41	18.82	19.30	19.72	20.81	18.04	18.45	18.93	19.35	20.44
	8H	18.66	19.02	19.56	19.91	21.05	18.28	18.64	19.17	19.53	20.67