

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903922

Luminaire Tested: DFN2DIP-SQ3F0-120D090US830-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903922
REPORT IS A COMBINATION OF REPORTS P899968 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D090US830-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17121.2 lumens
Efficiency: N/A
Efficacy: 88.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 194.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903922

CATALOG NUMBER: DFN2DIP-SQ3F0-120D090US830-RLFL

Luminous Intensity Polar Plot

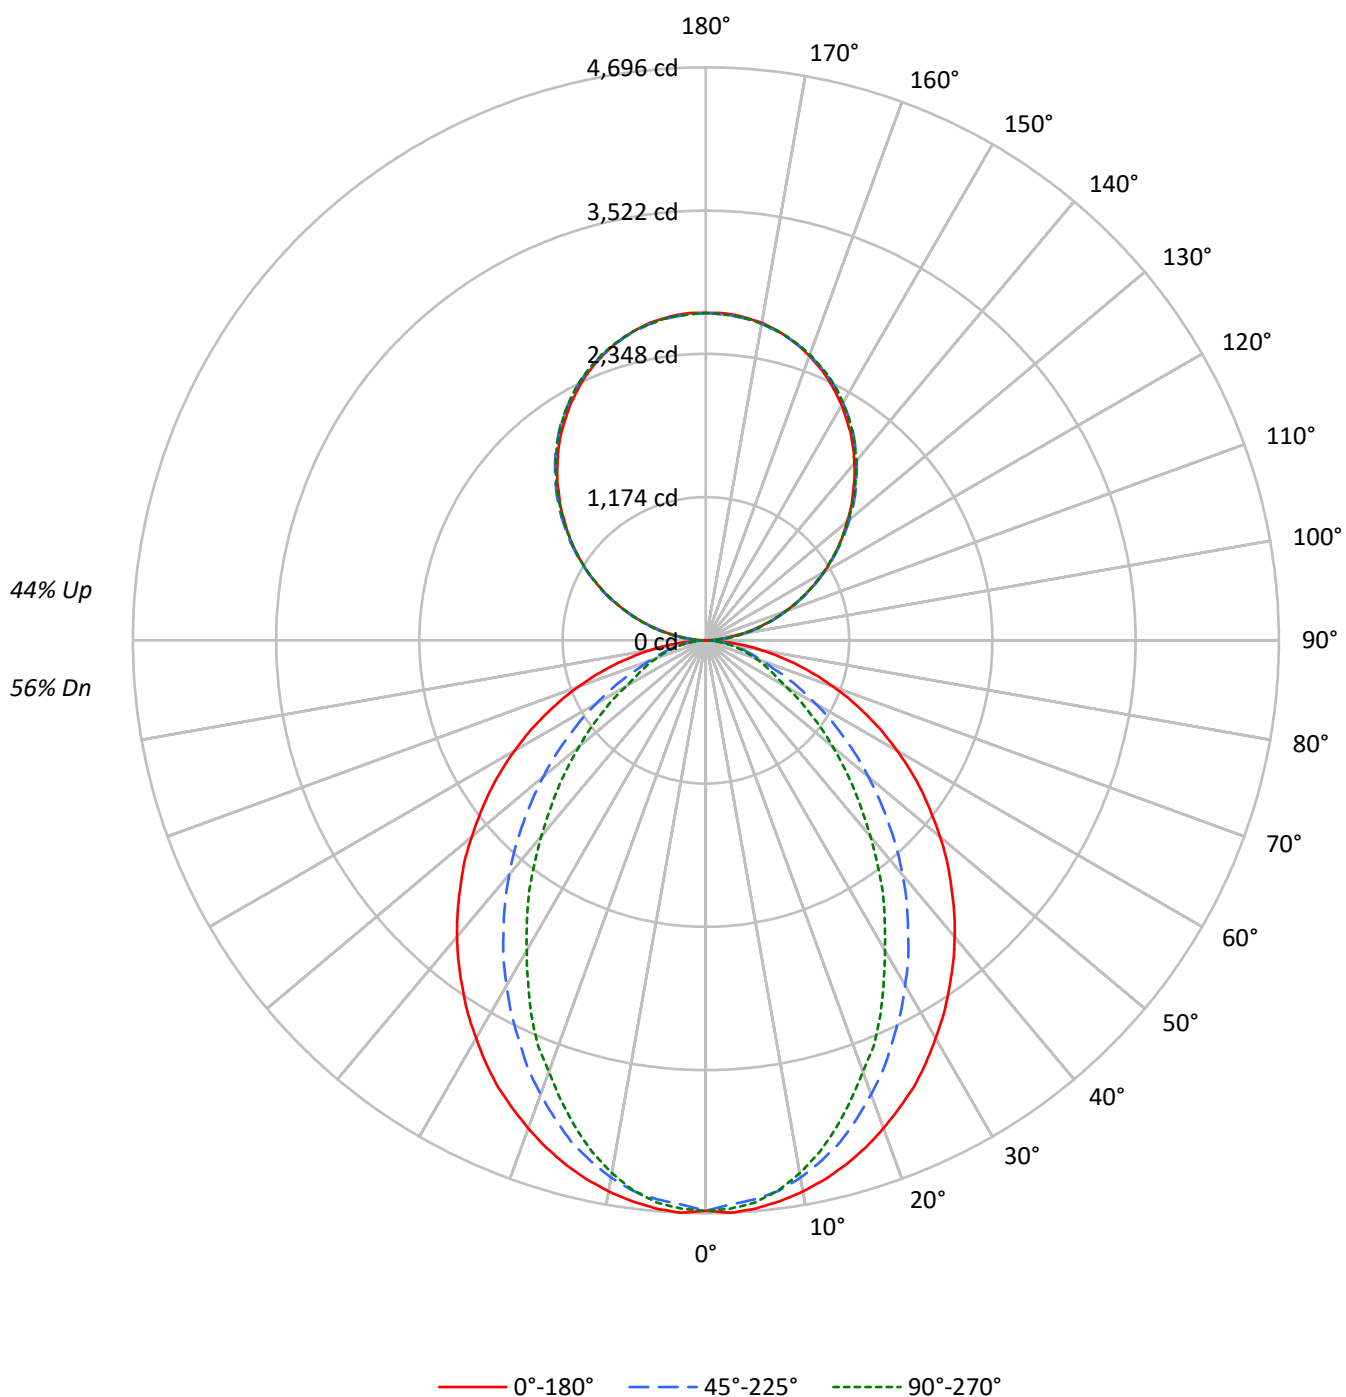

TEST NUMBER: P903922

CATALOG NUMBER: DFN2DIP-SQ3F0-120D090US830-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	100	96	92	88	93	89	86	83	77	75	72	66	64	63	55	54	53
2	91	84	78	73	85	79	73	69	68	64	61	58	56	53	49	47	46
3	84	74	67	62	78	70	63	58	61	56	52	52	49	46	44	42	40
4	77	66	59	53	71	62	55	50	54	49	45	47	43	40	40	37	35
5	71	59	51	46	66	56	49	43	49	43	39	42	38	35	36	33	30
6	65	53	46	40	61	50	43	38	44	38	34	38	34	31	33	30	27
7	61	48	41	35	56	46	39	34	40	35	30	35	31	27	30	27	24
8	56	44	37	31	52	42	35	30	37	31	27	32	28	25	28	25	22
9	53	41	33	28	49	38	32	27	34	28	25	30	25	22	26	23	20
10	49	37	30	25	46	35	29	24	31	26	22	28	23	20	24	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5356	5356	5356
5°	5361	5268	5303
10°	5305	5161	5129
15°	5228	4987	4861
20°	5128	4748	4532
25°	5026	4482	4214
30°	4890	4209	3812
35°	4756	3915	3459
40°	4619	3612	3055
45°	4461	3276	2688
50°	4297	2938	2330
55°	4126	2577	1987
60°	3927	2199	1634
65°	3698	1816	1468
70°	3421	1459	1326
75°	3072	1278	1202
80°	2567	1061	1037
85°	1741	691	769

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4461 cd/sqm

TEST NUMBER: P903922

CATALOG NUMBER: DFN2DIP-SQ3F0-120D090US830-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	438.1	2.6
10°-20°	1202.7	7.0
20°-30°	1688.5	9.9
30°-40°	1840.6	10.8
40°-50°	1691.7	9.9
50°-60°	1328.6	7.8
60°-70°	864.8	5.1
70°-80°	445.2	2.6
80°-90°	121.2	0.7
90°-100°	166.0	1.0
100°-110°	527.5	3.1
110°-120°	902.7	5.3
120°-130°	1187.2	6.9
130°-140°	1332.5	7.8
140°-150°	1306.7	7.6
150°-160°	1096.1	6.4
160°-170°	726.9	4.2
170°-180°	254.1	1.5
0°-30°	3329.4	19.4
0°-40°	5170.0	30.2
0°-60°	8190.3	47.8
0°-90°	9621.5	56.2
90°-120°	1596.2	9.3
90°-150°	5422.6	31.7
90°-180°	7500.0	43.8
0°-180°	17121.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4675	4675	4675	4675	4675	
5°	4675	4654	4598	4636	4624	443
15°	4446	4400	4256	4176	4133	1253
25°	4036	3900	3621	3448	3384	1856
35°	3478	3262	2890	2623	2530	2177
45°	2843	2559	2115	1815	1713	2195
55°	2162	1832	1375	1121	1041	1932
65°	1460	1117	736	592	580	1447
75°	778	482	338	309	305	823
85°	182	93	80	80	80	209
90°	2	29	79	74	77	17
95°	118	141	145	145	141	131
105°	487	493	498	502	502	514
115°	906	919	915	912	906	896
125°	1318	1338	1331	1324	1322	1177
135°	1704	1729	1734	1732	1725	1317
145°	2069	2085	2098	2100	2092	1293
155°	2366	2372	2380	2391	2384	1089
165°	2574	2571	2571	2587	2576	726
175°	2678	2671	2667	2683	2669	254
180°	2683	2683	2683	2683	2683	

TEST NUMBER: P903922

CATALOG NUMBER: DFN2DIP-SQ3F0-120D090US830-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4674.6	4674.6	4674.6	4674.6	4674.6
2.5°	4695.7	4674.6	4628.0	4670.6	4662.0
5°	4674.6	4653.5	4598.3	4636.5	4623.9
7.5°	4636.5	4611.3	4552.1	4568.7	4547.6
10°	4585.8	4556.2	4471.7	4458.7	4433.6
12.5°	4522.4	4484.3	4369.8	4344.7	4298.1
15°	4446.2	4399.5	4255.9	4175.5	4133.3
17.5°	4357.3	4289.5	4111.7	4018.9	3951.1
20°	4255.9	4171.0	3959.6	3854.1	3760.7
22.5°	4145.9	4048.5	3803.0	3659.3	3596.1
25°	4036.0	3900.3	3621.2	3447.9	3384.2
27.5°	3904.9	3760.7	3452.0	3253.2	3155.7
30°	3765.3	3604.2	3265.7	3050.3	2935.8
32.5°	3629.7	3434.9	3088.4	2834.4	2728.5
35°	3477.6	3261.7	2889.6	2623.0	2529.6
37.5°	3329.4	3096.5	2703.3	2411.1	2305.6
40°	3172.8	2919.2	2508.6	2208.3	2098.3
42.5°	3012.1	2741.5	2314.2	2000.9	1895.5
45°	2842.9	2559.3	2115.3	1814.7	1713.2
47.5°	2682.2	2382.0	1925.0	1624.4	1531.4
50°	2504.5	2204.2	1738.8	1446.6	1358.2
52.5°	2330.8	2013.5	1561.0	1281.9	1201.6
55°	2161.6	1831.7	1374.8	1121.2	1040.8
57.5°	1988.3	1649.9	1210.0	973.1	905.3
60°	1810.6	1472.2	1036.3	821.0	753.2
62.5°	1637.4	1298.9	888.3	685.4	651.7
65°	1459.6	1116.7	736.1	592.5	579.5
67.5°	1290.4	947.4	592.5	520.2	507.7
70°	1112.7	782.8	490.6	448.4	431.3
72.5°	943.5	630.2	410.2	376.5	368.1
75°	778.3	482.0	338.5	308.8	304.7
77.5°	613.6	342.4	266.6	249.6	241.0
80°	461.0	245.5	202.8	186.2	186.2
82.5°	321.4	165.1	139.6	131.0	131.0
85°	181.8	92.9	80.3	80.3	80.3
87.5°	67.8	33.6	33.6	29.6	29.6
90°	2.5	29.1	79.3	74.4	76.8
92.5°	50.1	68.0	70.4	72.8	72.8
95°	118.1	140.7	144.8	144.8	140.7
97.5°	196.5	217.5	226.5	226.5	226.5
100°	287.1	305.8	312.2	312.2	309.8
102.5°	382.6	396.3	405.2	407.6	405.2
105°	486.9	493.3	498.2	502.3	502.3
107.5°	590.4	600.1	600.1	601.7	590.4
110°	690.7	703.7	703.7	703.7	697.2



TEST NUMBER: P903922

CATALOG NUMBER: DFN2DIP-SQ3F0-120D090US830-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	799.1	812.8	810.4	804.0	799.1
115°	905.9	918.8	914.7	912.4	905.9
117.5°	1011.8	1029.6	1018.3	1011.8	1005.3
120°	1118.6	1136.3	1118.6	1118.6	1111.3
122.5°	1215.6	1238.3	1227.0	1220.5	1215.6
125°	1317.6	1337.8	1331.3	1324.0	1321.6
127.5°	1417.0	1442.1	1433.2	1423.5	1417.0
130°	1510.0	1539.2	1535.1	1530.2	1521.4
132.5°	1614.4	1637.0	1638.6	1627.3	1620.9
135°	1704.1	1729.2	1734.1	1731.6	1725.2
137.5°	1804.4	1824.7	1828.7	1827.1	1817.4
140°	1892.6	1912.8	1924.1	1924.1	1915.2
142.5°	1983.2	2003.4	2009.9	2012.3	2003.4
145°	2069.0	2085.1	2098.0	2100.5	2091.6
147.5°	2145.8	2166.0	2175.7	2179.7	2170.9
150°	2225.1	2238.8	2247.7	2254.9	2247.7
152.5°	2295.4	2309.1	2320.4	2329.4	2320.4
155°	2365.8	2372.2	2379.5	2390.9	2383.6
157.5°	2426.4	2431.3	2435.3	2451.5	2440.1
160°	2480.6	2485.5	2487.9	2501.6	2491.9
162.5°	2530.7	2530.7	2533.2	2548.5	2537.2
165°	2573.6	2571.2	2571.2	2587.4	2576.1
167.5°	2612.4	2605.2	2605.2	2621.3	2610.0
170°	2641.6	2635.1	2632.7	2648.8	2635.1
172.5°	2661.7	2655.3	2652.9	2669.1	2655.3
175°	2678.0	2671.4	2666.6	2682.9	2669.1
177.5°	2686.8	2680.4	2675.5	2689.3	2675.5
180°	2682.9	2682.9	2682.9	2682.9	2682.9

TEST NUMBER: P903922

CATALOG NUMBER: DFN2DIP-SQ3F0-120D090US830-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.50	14.39	14.41	15.31	16.49	9.46	10.35	10.37	11.27	12.45
	3H	15.18	15.97	16.10	16.90	18.11	10.65	11.44	11.57	12.37	13.58
	4H	15.79	16.53	16.72	17.47	18.69	11.10	11.84	12.03	12.78	14.00
	6H	16.21	16.90	17.16	17.84	19.07	11.42	12.10	12.36	13.05	14.28
	8H	16.33	16.99	17.29	17.95	19.18	11.50	12.16	12.46	13.12	14.35
	12H	16.40	17.02	17.36	17.97	19.22	11.55	12.17	12.51	13.12	14.37
4H	2H	13.53	14.27	14.47	15.21	16.43	10.06	10.81	11.00	11.75	12.96
	3H	15.35	15.97	16.31	16.94	18.17	11.41	12.03	12.36	13.00	14.23
	4H	16.04	16.61	17.01	17.57	18.83	11.96	12.52	12.92	13.48	14.74
	6H	16.56	17.04	17.53	18.03	19.29	12.37	12.86	13.34	13.84	15.10
	8H	16.73	17.19	17.71	18.17	19.43	12.50	12.95	13.47	13.93	15.20
	12H	16.83	17.24	17.82	18.23	19.51	12.56	12.97	13.55	13.97	15.24
8H	4H	16.02	16.47	16.99	17.45	18.72	12.24	12.69	13.21	13.67	14.94
	6H	16.58	16.95	17.58	17.97	19.24	12.75	13.12	13.75	14.14	15.41
	8H	16.79	17.12	17.80	18.13	19.42	12.93	13.27	13.94	14.27	15.56
	12H	16.93	17.22	17.94	18.22	19.55	13.05	13.34	14.06	14.34	15.68
12H	4H	15.97	16.38	16.96	17.37	18.65	12.24	12.65	13.24	13.65	14.92
	6H	16.55	16.88	17.56	17.89	19.18	12.80	13.13	13.80	14.14	15.42
	8H	16.77	17.06	17.78	18.07	19.40	13.00	13.29	14.01	14.30	15.63

END OF REPORT