

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906401

Luminaire Tested: DFN2DIP-SQ3F0-050D100US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906401
REPORT IS A COMBINATION OF REPORTS P901491 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D100US835-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14850.0 lumens
Efficiency: N/A
Efficacy: 124.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 119.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906401

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US835-FLLONL

Luminous Intensity Polar Plot

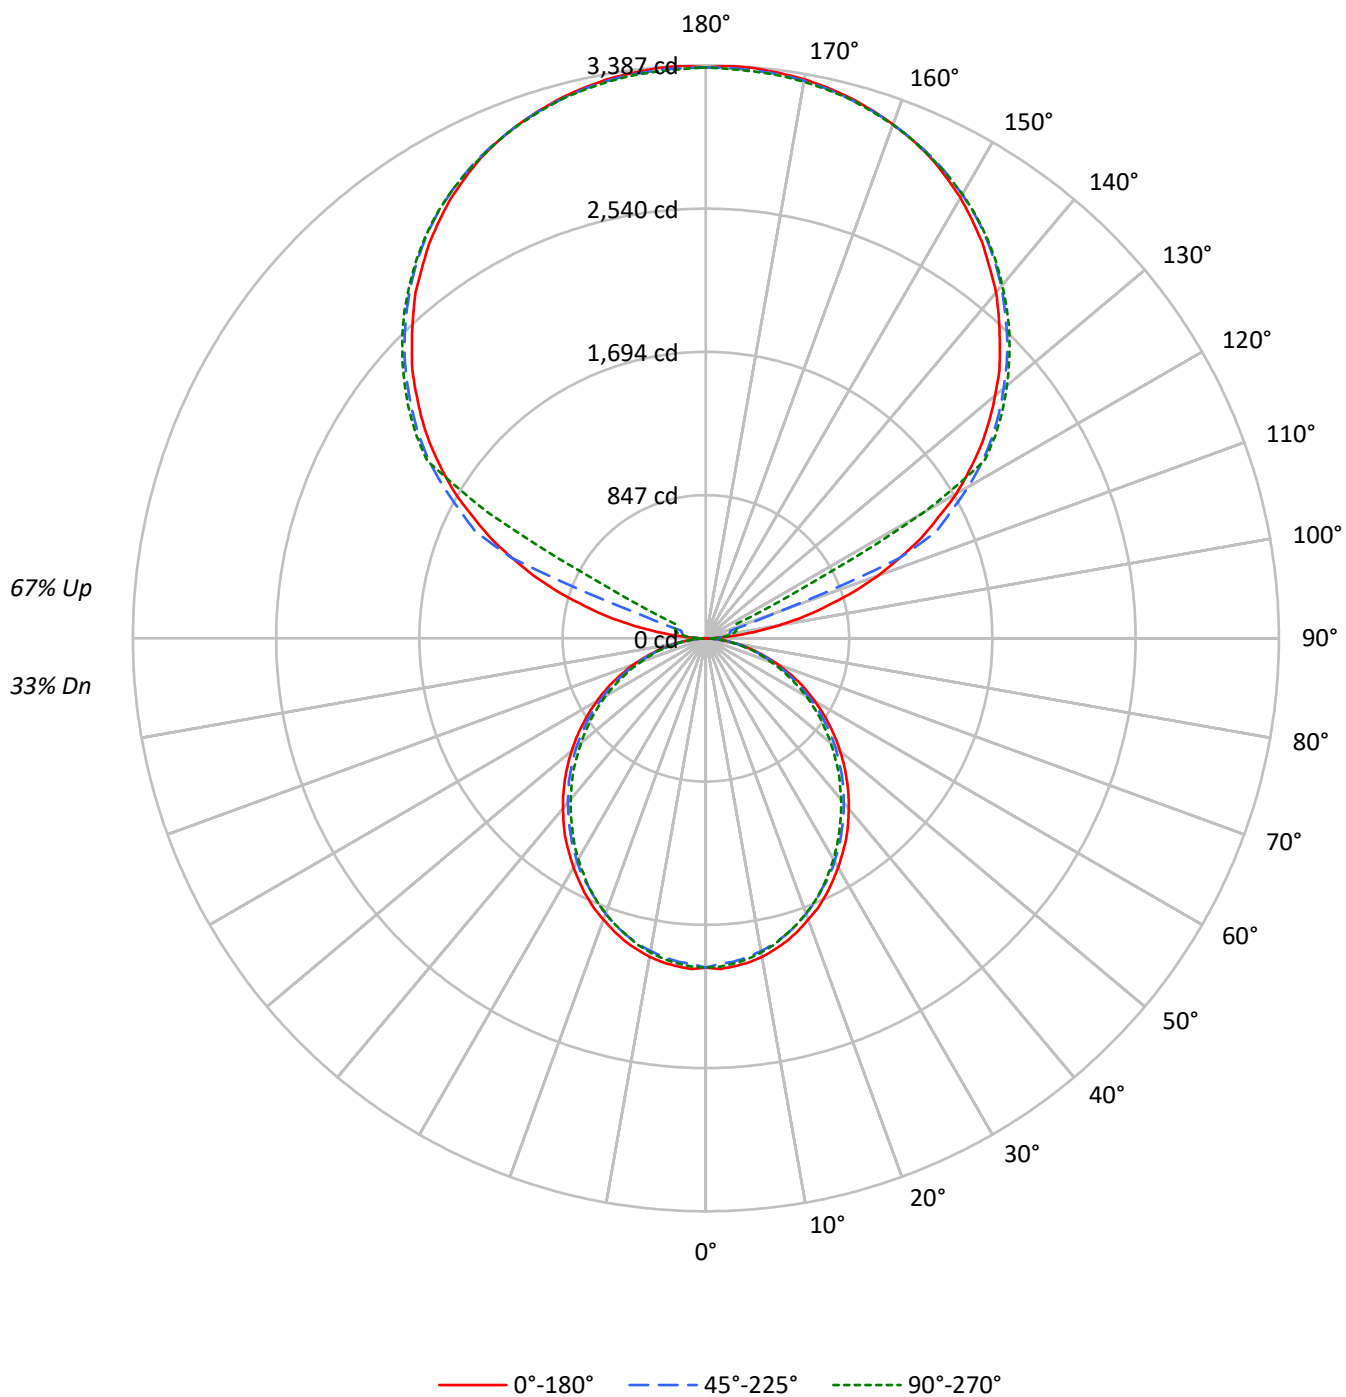

TEST NUMBER: P906401

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2229	2229	2229
5°	2231	2197	2212
10°	2212	2166	2182
15°	2178	2128	2134
20°	2133	2077	2085
25°	2087	2017	2029
30°	2031	1960	1958
35°	1978	1894	1883
40°	1912	1826	1811
45°	1847	1759	1738
50°	1775	1688	1653
55°	1700	1606	1575
60°	1615	1509	1485
65°	1522	1408	1379
70°	1404	1285	1266
75°	1240	1137	1159
80°	1042	949	958
85°	733	628	627

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2311 cd/sqm

TEST NUMBER: P906401

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	183.1	1.2
10°-20°	515.2	3.5
20°-30°	757.2	5.1
30°-40°	879.4	5.9
40°-50°	878.3	5.9
50°-60°	765.8	5.2
60°-70°	566.1	3.8
70°-80°	320.3	2.2
80°-90°	90.5	0.6
90°-100°	111.3	0.7
100°-110°	414.9	2.8
110°-120°	1100.3	7.4
120°-130°	1824.9	12.3
130°-140°	1938.4	13.1
140°-150°	1801.5	12.1
150°-160°	1448.4	9.8
160°-170°	933.3	6.3
170°-180°	321.2	2.2
0°-30°	1455.5	9.8
0°-40°	2334.9	15.7
0°-60°	3979.0	26.8
0°-90°	4955.9	33.4
90°-120°	1626.4	11.0
90°-150°	7191.2	48.4
90°-180°	9894.0	66.6
0°-180°	14850.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1946	1946	1946	1946	1946	
5°	1946	1938	1918	1932	1929	185
15°	1852	1841	1816	1824	1815	522
25°	1676	1661	1630	1633	1630	771
35°	1446	1428	1398	1386	1377	903
45°	1177	1164	1136	1115	1108	908
55°	891	879	857	834	825	796
65°	601	589	571	554	544	594
75°	314	311	301	290	294	335
85°	77	75	73	67	66	85
90°	2	29	49	61	66	14
95°	159	78	95	108	105	188
105°	742	816	149	176	186	793
115°	1404	1446	1507	376	200	1382
125°	1985	2017	2064	2081	2088	1771
135°	2457	2496	2518	2542	2537	1898
145°	2850	2847	2889	2906	2894	1782
155°	3138	3116	3146	3160	3141	1446
165°	3306	3292	3299	3316	3299	934
175°	3382	3365	3370	3387	3363	322
180°	3375	3375	3375	3375	3375	

TEST NUMBER: P906401

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1945.5	1945.5	1945.5	1945.5	1945.5
2.5°	1956.8	1947.5	1926.9	1945.5	1942.0
5°	1945.5	1938.2	1917.5	1932.4	1928.9
7.5°	1932.4	1921.3	1900.7	1915.8	1912.0
10°	1912.0	1898.9	1876.5	1891.3	1885.8
12.5°	1883.8	1872.7	1850.3	1859.6	1855.8
15°	1852.0	1840.9	1816.5	1824.1	1814.7
17.5°	1812.7	1801.6	1777.2	1786.5	1777.2
20°	1769.7	1758.6	1732.4	1737.9	1730.6
22.5°	1726.8	1709.9	1685.5	1685.5	1681.7
25°	1676.2	1661.3	1629.5	1633.1	1629.5
27.5°	1620.0	1606.9	1582.7	1577.1	1567.8
30°	1564.0	1549.0	1521.0	1515.4	1507.9
32.5°	1504.1	1493.0	1463.0	1451.7	1444.2
35°	1446.1	1427.5	1397.5	1386.2	1376.9
37.5°	1380.6	1363.8	1333.8	1320.7	1311.4
40°	1313.4	1298.3	1268.3	1251.6	1244.1
42.5°	1247.9	1232.8	1203.0	1184.1	1173.0
45°	1176.8	1163.7	1135.5	1115.1	1107.5
47.5°	1107.5	1094.4	1064.5	1043.8	1032.7
50°	1034.5	1025.2	999.0	972.8	963.4
52.5°	963.4	950.3	926.1	905.5	892.4
55°	890.6	879.3	856.8	834.4	825.1
57.5°	817.5	808.2	783.8	761.4	753.8
60°	744.5	737.2	711.0	690.3	684.8
62.5°	673.5	660.4	641.7	623.0	615.5
65°	600.6	589.3	570.6	553.8	544.4
67.5°	525.8	516.3	499.6	486.5	478.9
70°	456.5	449.0	432.1	419.0	411.7
72.5°	385.5	377.9	368.6	355.5	349.9
75°	314.2	310.6	301.1	290.0	293.8
77.5°	250.7	243.1	239.4	233.8	228.3
80°	187.2	185.2	181.4	175.9	172.1
82.5°	127.2	127.2	125.4	117.9	117.9
85°	76.6	74.8	73.0	67.3	65.5
87.5°	33.7	30.0	26.2	20.6	18.7
90°	2.3	29.3	48.7	61.2	65.8
92.5°	61.2	51.3	58.6	63.5	65.8
95°	158.6	78.0	95.1	107.6	105.0
97.5°	285.6	85.5	124.4	131.9	134.3
100°	432.4	97.7	139.2	158.6	163.6
102.5°	593.3	588.7	144.1	170.8	178.3
105°	742.4	815.7	149.1	175.7	185.6
107.5°	915.8	976.7	154.0	180.7	190.5
110°	1081.9	1133.0	427.4	183.3	192.8

TEST NUMBER: P906401

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1238.2	1282.0	1240.6	187.9	195.5
115°	1404.1	1445.6	1506.8	376.1	200.4
117.5°	1548.2	1597.0	1638.7	1289.3	649.6
120°	1709.5	1746.0	1790.1	1819.4	1489.7
122.5°	1846.1	1885.2	1934.2	1948.7	1951.3
125°	1985.3	2017.2	2063.6	2080.7	2087.9
127.5°	2112.3	2146.5	2183.3	2207.7	2210.0
130°	2232.0	2271.2	2297.9	2324.8	2322.5
132.5°	2354.1	2386.0	2412.7	2434.7	2432.4
135°	2456.8	2495.9	2517.7	2542.3	2537.4
137.5°	2564.1	2593.4	2618.0	2642.4	2635.1
140°	2669.0	2688.8	2715.4	2737.5	2725.3
142.5°	2757.2	2774.3	2805.9	2825.3	2813.2
145°	2850.0	2847.4	2888.9	2906.0	2893.8
147.5°	2930.3	2923.1	2964.5	2976.7	2967.2
150°	3008.6	2991.5	3030.7	3045.2	3033.0
152.5°	3074.4	3055.0	3091.6	3106.3	3089.2
155°	3138.0	3116.2	3145.5	3160.0	3140.6
157.5°	3189.3	3169.9	3191.9	3209.0	3189.3
160°	3233.4	3218.6	3233.4	3247.9	3230.8
162.5°	3272.2	3257.7	3269.9	3287.0	3265.0
165°	3306.4	3291.9	3299.2	3316.3	3299.2
167.5°	3333.4	3318.6	3326.2	3343.3	3321.2
170°	3355.4	3340.7	3345.6	3362.7	3340.7
172.5°	3369.9	3355.4	3360.4	3377.5	3355.4
175°	3382.1	3365.0	3369.9	3387.1	3362.7
177.5°	3387.1	3369.9	3372.6	3389.7	3367.6
180°	3374.9	3374.9	3374.9	3374.9	3374.9

TEST NUMBER: P906401

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.25	8.98	9.34	10.07	11.56	7.81	8.54	8.89	9.62	11.11
	3H	9.90	10.55	10.99	11.64	13.15	9.41	10.06	10.50	11.15	12.66
	4H	10.47	11.09	11.58	12.19	13.70	9.98	10.60	11.09	11.70	13.21
	6H	10.86	11.43	11.98	12.53	14.06	10.36	10.93	11.48	12.03	13.56
	8H	10.96	11.51	12.08	12.62	14.14	10.46	11.00	11.58	12.12	13.64
	12H	11.01	11.52	12.13	12.63	14.17	10.50	11.01	11.62	12.12	13.66
4H	2H	8.69	9.31	9.81	10.41	11.92	8.34	8.96	9.45	10.05	11.57
	3H	10.54	11.06	11.66	12.18	13.71	10.13	10.65	11.25	11.77	13.30
	4H	11.24	11.72	12.37	12.83	14.38	10.82	11.30	11.95	12.41	13.96
	6H	11.75	12.16	12.88	13.29	14.83	11.32	11.72	12.45	12.86	14.40
	8H	11.89	12.27	13.02	13.40	14.95	11.45	11.84	12.59	12.96	14.52
	12H	11.96	12.30	13.10	13.44	15.00	11.51	11.85	12.66	12.99	14.55
8H	4H	11.43	11.81	12.56	12.93	14.49	11.05	11.43	12.18	12.56	14.11
	6H	12.05	12.36	13.20	13.53	15.08	11.66	11.98	12.81	13.15	14.70
	8H	12.26	12.54	13.42	13.69	15.26	11.87	12.14	13.03	13.29	14.86
	12H	12.38	12.63	13.55	13.77	15.38	11.97	12.21	13.14	13.36	14.97
12H	4H	11.40	11.75	12.55	12.89	14.45	11.04	11.38	12.18	12.52	14.08
	6H	12.07	12.35	13.23	13.50	15.07	11.70	11.98	12.86	13.12	14.70
	8H	12.30	12.55	13.47	13.69	15.30	11.92	12.17	13.09	13.31	14.92

END OF REPORT