

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906404

Luminaire Tested: DFN2DIP-SQ3F0-050D110US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906404
REPORT IS A COMBINATION OF REPORTS P899989 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D110US835-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14685.0 lumens
Efficiency: N/A
Efficacy: 114.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 128.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906404

CATALOG NUMBER: DFN2DIP-SQ3F0-050D110US835-FLLFLL

Luminous Intensity Polar Plot

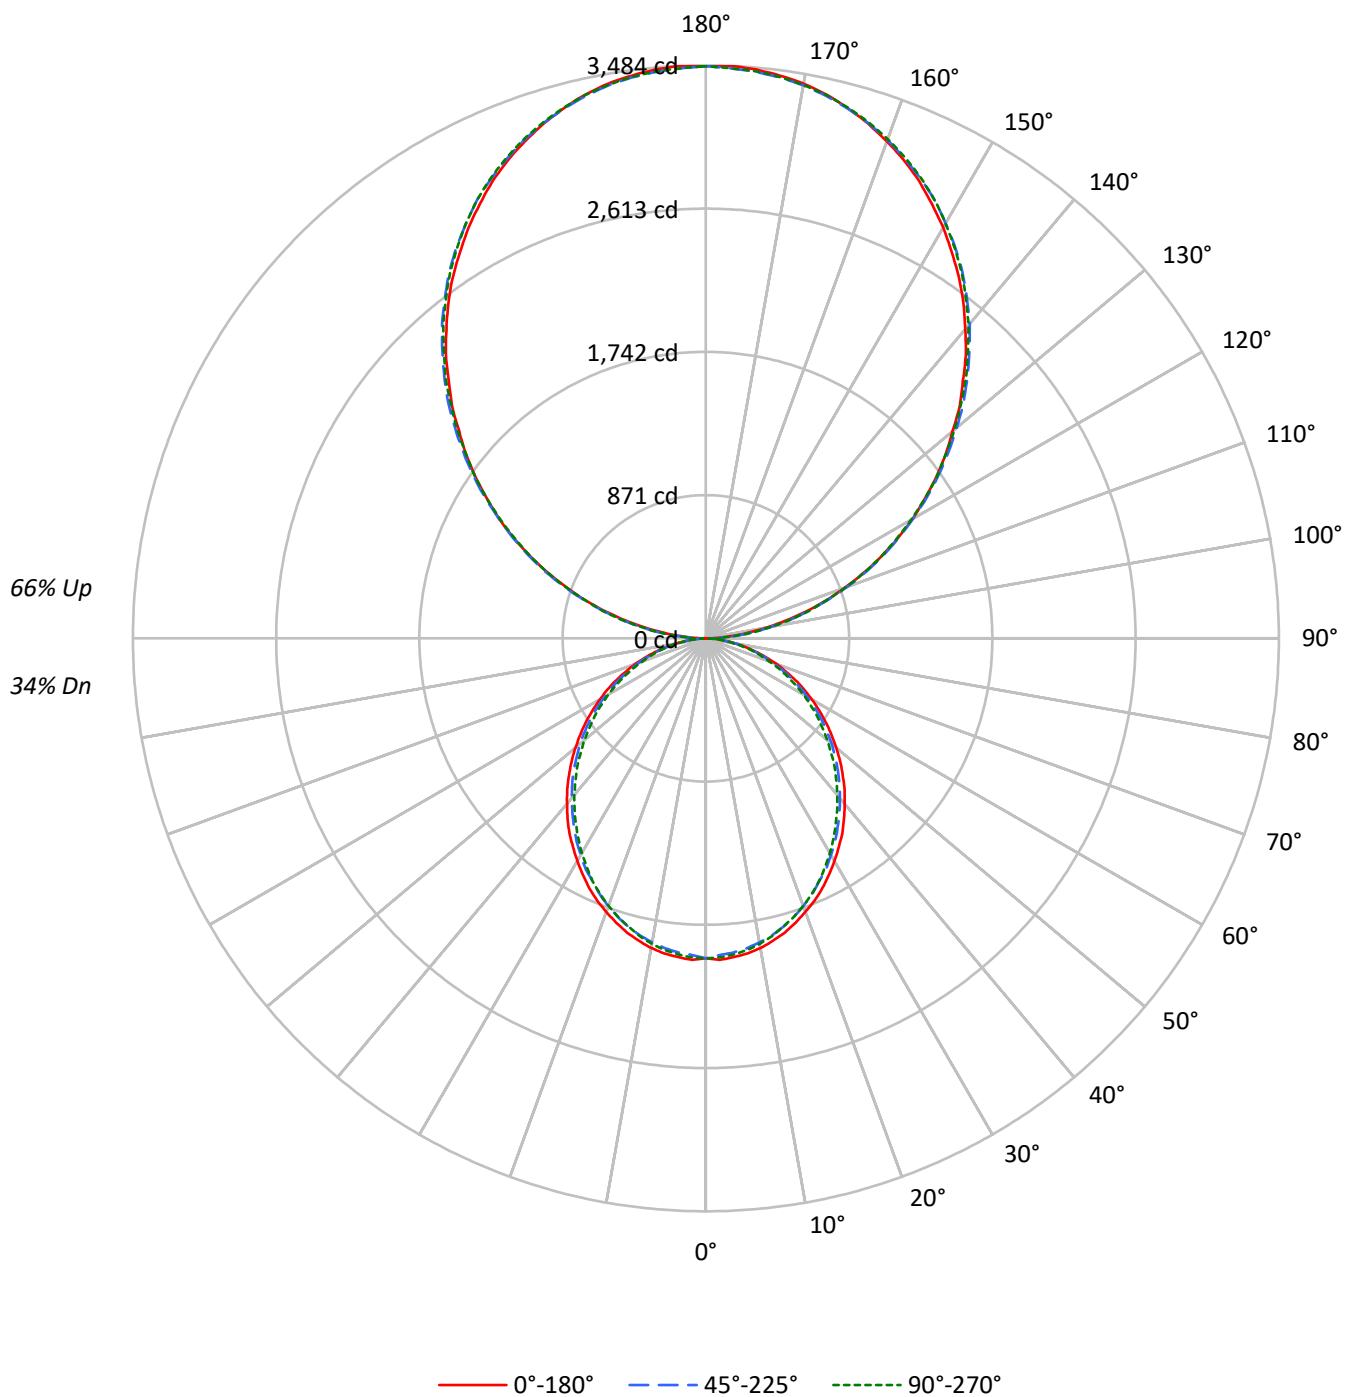

TEST NUMBER: P906404

CATALOG NUMBER: DFN2DIP-SQ3F0-050D110US835-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	49	47	36	36	35
2	86	78	73	67	77	71	66	62	57	53	50	44	42	40	32	31	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	44	45	40	36	35	31	29	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	19
6	60	48	41	35	54	44	37	32	36	31	27	28	24	22	21	18	16
7	56	44	36	31	50	40	33	28	32	27	24	25	22	19	19	16	15
8	52	40	32	27	46	36	29	25	29	24	21	23	20	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	14	12
10	45	33	26	21	40	30	24	20	25	20	17	20	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2229	2229	2229
5°	2231	2197	2212
10°	2212	2166	2182
15°	2178	2128	2134
20°	2133	2077	2085
25°	2087	2017	2029
30°	2031	1960	1958
35°	1978	1894	1883
40°	1912	1826	1811
45°	1847	1759	1738
50°	1775	1688	1653
55°	1700	1606	1575
60°	1615	1509	1485
65°	1522	1408	1379
70°	1404	1285	1266
75°	1240	1137	1159
80°	1042	949	958
85°	733	628	627

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3498 cd/sqm

TEST NUMBER: P906404

CATALOG NUMBER: DFN2DIP-SQ3F0-050D110US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	183.1	1.2
10°-20°	515.2	3.5
20°-30°	757.2	5.2
30°-40°	879.4	6.0
40°-50°	878.3	6.0
50°-60°	765.8	5.2
60°-70°	566.1	3.9
70°-80°	320.3	2.2
80°-90°	94.4	0.6
90°-100°	215.3	1.5
100°-110°	684.0	4.7
110°-120°	1170.5	8.0
120°-130°	1539.4	10.5
130°-140°	1727.9	11.8
140°-150°	1694.4	11.5
150°-160°	1421.4	9.7
160°-170°	942.6	6.4
170°-180°	329.5	2.2
0°-30°	1455.5	9.9
0°-40°	2334.9	15.9
0°-60°	3979.0	27.1
0°-90°	4959.9	33.8
90°-120°	2069.8	14.1
90°-150°	7031.6	47.9
90°-180°	9725.0	66.2
0°-180°	14685.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1946	1946	1946	1946	1946	
5°	1946	1938	1918	1932	1929	185
15°	1852	1841	1816	1824	1815	522
25°	1676	1661	1630	1633	1630	771
35°	1446	1428	1398	1386	1377	903
45°	1177	1164	1136	1115	1108	908
55°	891	879	857	834	825	796
65°	601	589	571	554	544	594
75°	314	311	301	290	294	335
85°	77	75	73	67	66	85
90°	3	38	103	96	100	14
95°	153	182	188	188	182	170
105°	631	640	646	651	651	666
115°	1175	1191	1186	1183	1175	1162
125°	1708	1735	1726	1717	1714	1527
135°	2210	2242	2249	2246	2237	1708
145°	2683	2704	2721	2724	2712	1676
155°	3068	3076	3086	3100	3091	1412
165°	3337	3334	3334	3355	3340	941
175°	3473	3464	3458	3479	3461	330
180°	3479	3479	3479	3479	3479	

TEST NUMBER: P906404

CATALOG NUMBER: DFN2DIP-SQ3F0-050D110US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1945.5	1945.5	1945.5	1945.5	1945.5
2.5°	1956.8	1947.5	1926.9	1945.5	1942.0
5°	1945.5	1938.2	1917.5	1932.4	1928.9
7.5°	1932.4	1921.3	1900.7	1915.8	1912.0
10°	1912.0	1898.9	1876.5	1891.3	1885.8
12.5°	1883.8	1872.7	1850.3	1859.6	1855.8
15°	1852.0	1840.9	1816.5	1824.1	1814.7
17.5°	1812.7	1801.6	1777.2	1786.5	1777.2
20°	1769.7	1758.6	1732.4	1737.9	1730.6
22.5°	1726.8	1709.9	1685.5	1685.5	1681.7
25°	1676.2	1661.3	1629.5	1633.1	1629.5
27.5°	1620.0	1606.9	1582.7	1577.1	1567.8
30°	1564.0	1549.0	1521.0	1515.4	1507.9
32.5°	1504.1	1493.0	1463.0	1451.7	1444.2
35°	1446.1	1427.5	1397.5	1386.2	1376.9
37.5°	1380.6	1363.8	1333.8	1320.7	1311.4
40°	1313.4	1298.3	1268.3	1251.6	1244.1
42.5°	1247.9	1232.8	1203.0	1184.1	1173.0
45°	1176.8	1163.7	1135.5	1115.1	1107.5
47.5°	1107.5	1094.4	1064.5	1043.8	1032.7
50°	1034.5	1025.2	999.0	972.8	963.4
52.5°	963.4	950.3	926.1	905.5	892.4
55°	890.6	879.3	856.8	834.4	825.1
57.5°	817.5	808.2	783.8	761.4	753.8
60°	744.5	737.2	711.0	690.3	684.8
62.5°	673.5	660.4	641.7	623.0	615.5
65°	600.6	589.3	570.6	553.8	544.4
67.5°	525.8	516.3	499.6	486.5	478.9
70°	456.5	449.0	432.1	419.0	411.7
72.5°	385.5	377.9	368.6	355.5	349.9
75°	314.2	310.6	301.1	290.0	293.8
77.5°	250.7	243.1	239.4	233.8	228.3
80°	187.2	185.2	181.4	175.9	172.1
82.5°	127.2	127.2	125.4	117.9	117.9
85°	76.6	74.8	73.0	67.3	65.5
87.5°	33.7	30.0	26.2	20.6	18.7
90°	3.1	37.8	102.8	96.5	99.6
92.5°	65.0	88.1	91.2	94.4	94.4
95°	153.1	182.5	187.7	187.7	182.5
97.5°	254.9	282.1	293.7	293.7	293.7
100°	372.3	396.4	404.8	404.8	401.7
102.5°	496.1	513.9	525.5	528.6	525.5
105°	631.4	639.8	646.1	651.3	651.3
107.5°	765.6	778.2	778.2	780.3	765.6
110°	895.7	912.5	912.5	912.5	904.1

TEST NUMBER: P906404

CATALOG NUMBER: DFN2DIP-SQ3F0-050D110US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1036.2	1054.0	1050.9	1042.5	1036.2
115°	1174.7	1191.4	1186.2	1183.1	1174.7
117.5°	1312.1	1335.1	1320.4	1312.1	1303.7
120°	1450.5	1473.6	1450.5	1450.5	1441.1
122.5°	1576.4	1605.7	1591.0	1582.6	1576.4
125°	1708.5	1734.7	1726.3	1716.9	1713.7
127.5°	1837.5	1870.0	1858.5	1845.9	1837.5
130°	1958.1	1995.9	1990.6	1984.3	1972.8
132.5°	2093.4	2122.8	2124.9	2110.2	2101.8
135°	2209.8	2242.3	2248.6	2245.5	2237.1
137.5°	2339.9	2366.1	2371.3	2369.2	2356.7
140°	2454.2	2480.4	2495.1	2495.1	2483.6
142.5°	2571.7	2597.9	2606.3	2609.4	2597.9
145°	2682.8	2703.8	2720.6	2723.7	2712.2
147.5°	2782.5	2808.7	2821.3	2826.5	2815.0
150°	2885.3	2903.1	2914.6	2924.1	2914.6
152.5°	2976.5	2994.3	3009.0	3020.6	3009.0
155°	3067.8	3076.1	3085.6	3100.3	3090.8
157.5°	3146.4	3152.7	3157.9	3178.9	3164.2
160°	3216.7	3223.0	3226.1	3244.0	3231.4
162.5°	3281.7	3281.7	3284.9	3304.8	3290.1
165°	3337.3	3334.1	3334.1	3355.1	3340.4
167.5°	3387.6	3378.2	3378.2	3399.2	3384.5
170°	3425.4	3417.0	3413.9	3434.8	3417.0
172.5°	3451.6	3443.2	3440.1	3461.1	3443.2
175°	3472.6	3464.2	3457.9	3478.9	3461.1
177.5°	3484.1	3475.7	3469.4	3487.3	3469.4
180°	3478.9	3478.9	3478.9	3478.9	3478.9

TEST NUMBER: P906404

CATALOG NUMBER: DFN2DIP-SQ3F0-050D110US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.30	9.03	9.38	10.11	11.60	7.85	8.59	8.94	9.67	11.16
	3H	9.94	10.60	11.04	11.69	13.20	9.45	10.11	10.55	11.20	12.70
	4H	10.52	11.14	11.63	12.24	13.75	10.03	10.65	11.13	11.74	13.25
	6H	10.91	11.48	12.02	12.58	14.10	10.41	10.98	11.52	12.08	13.60
	8H	11.01	11.56	12.13	12.67	14.18	10.51	11.05	11.63	12.17	13.68
	12H	11.05	11.57	12.17	12.68	14.22	10.54	11.06	11.67	12.17	13.71
4H	2H	8.74	9.36	9.85	10.46	11.96	8.38	9.01	9.50	10.10	11.61
	3H	10.59	11.11	11.71	12.23	13.75	10.18	10.70	11.30	11.82	13.34
	4H	11.29	11.77	12.41	12.88	14.42	10.87	11.35	11.99	12.46	14.00
	6H	11.80	12.20	12.92	13.34	14.87	11.36	11.77	12.49	12.91	14.44
	8H	11.94	12.32	13.07	13.45	15.00	11.50	11.89	12.63	13.01	14.56
	12H	12.00	12.35	13.15	13.49	15.04	11.56	11.90	12.70	13.04	14.59
8H	4H	11.47	11.86	12.60	12.98	14.53	11.10	11.48	12.23	12.60	14.15
	6H	12.09	12.41	13.24	13.58	15.12	11.71	12.03	12.86	13.19	14.74
	8H	12.31	12.59	13.47	13.73	15.30	11.92	12.19	13.07	13.34	14.91
	12H	12.43	12.67	13.59	13.82	15.42	12.02	12.26	13.18	13.41	15.01
12H	4H	11.45	11.80	12.60	12.94	14.49	11.08	11.43	12.23	12.57	14.12
	6H	12.12	12.40	13.28	13.54	15.11	11.75	12.02	12.90	13.17	14.74
	8H	12.35	12.60	13.51	13.74	15.34	11.97	12.21	13.13	13.36	14.96

END OF REPORT