

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906434

Luminaire Tested: DFN2DIP-SQ3F0-060D090US835-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906434
REPORT IS A COMBINATION OF REPORTS P899956 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D090US835-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13065.0 lumens
Efficiency: N/A
Efficacy: 107.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 121.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906434

CATALOG NUMBER: DFN2DIP-SQ3F0-060D090US835-RLLFLL

Luminous Intensity Polar Plot

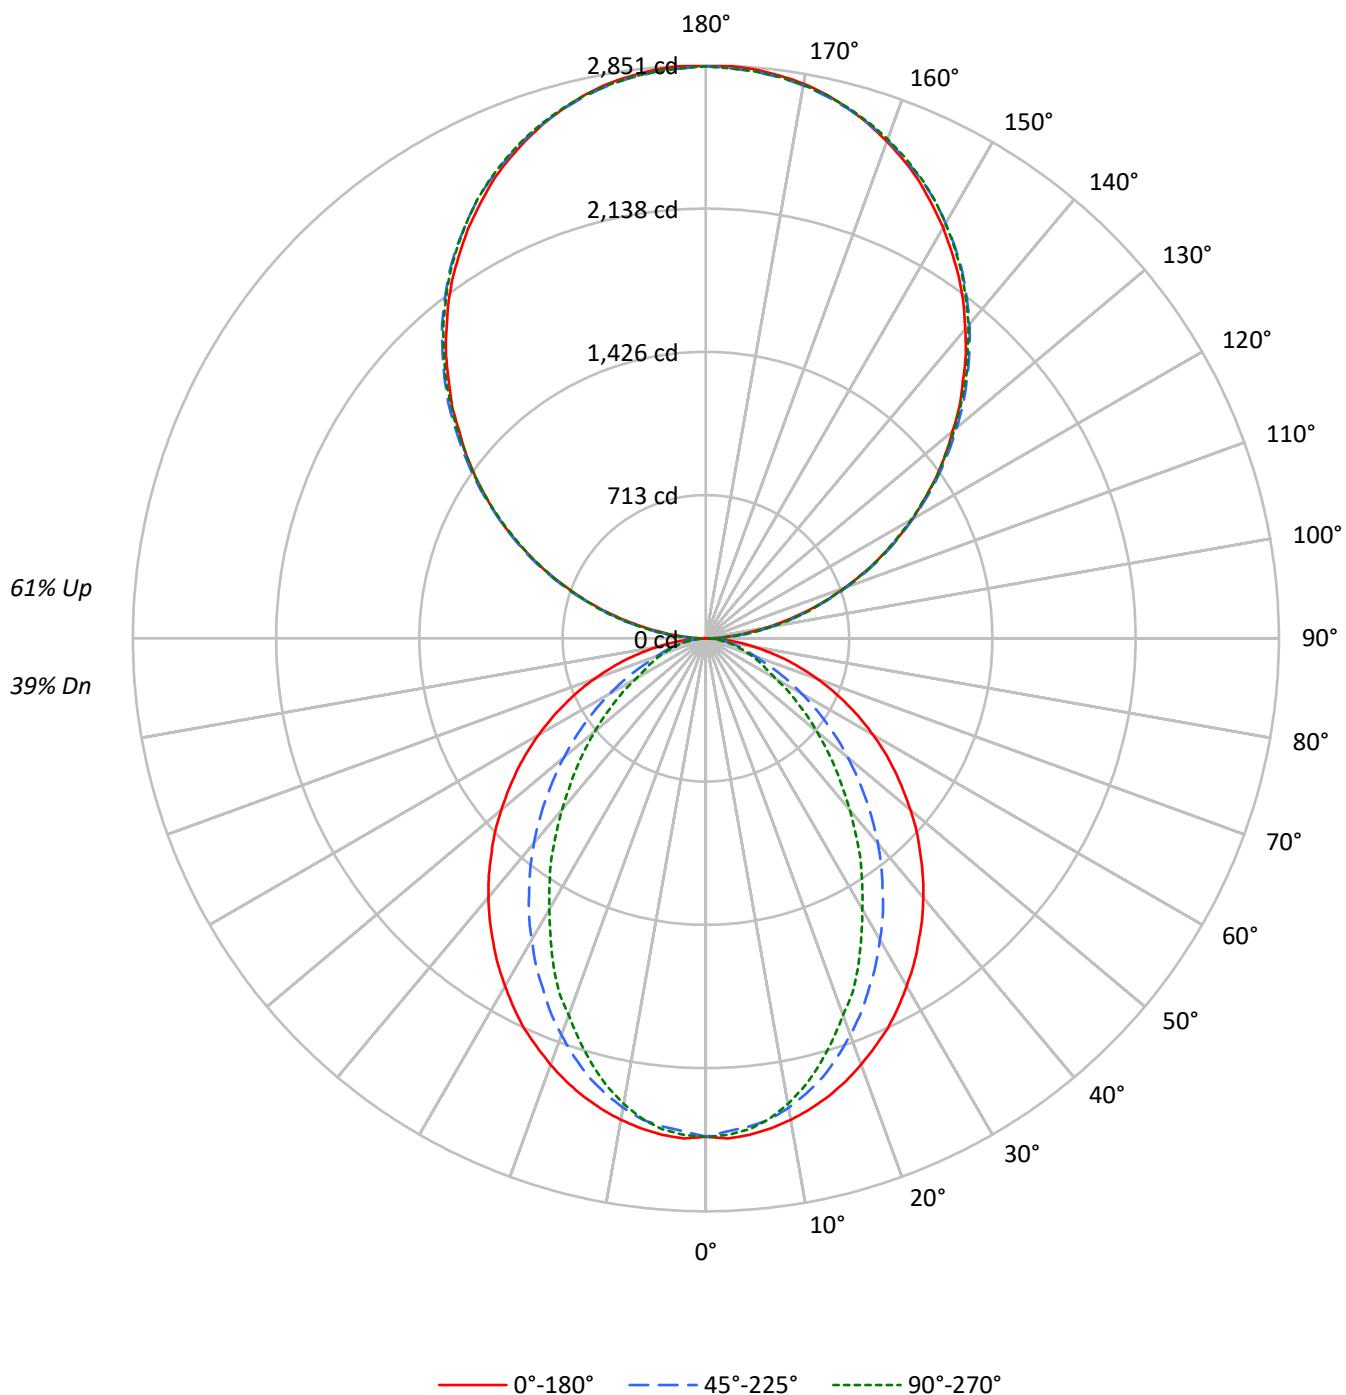

TEST NUMBER: P906434

CATALOG NUMBER: DFN2DIP-SQ3F0-060D090US835-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	96	92	88	85	87	83	80	78	68	66	64	54	53	51	41	40	40
2	87	80	75	70	79	73	68	64	60	57	54	48	46	44	37	35	34
3	80	71	64	58	73	65	59	54	53	49	46	43	40	37	33	31	29
4	73	63	55	50	66	58	51	46	48	43	39	38	35	32	30	27	26
5	67	56	48	43	61	52	45	40	43	38	34	35	31	28	27	24	22
6	62	51	43	37	56	46	40	35	39	33	30	31	28	25	25	22	20
7	57	46	38	33	52	42	35	30	35	30	26	29	25	22	22	20	18
8	53	41	34	29	49	38	32	27	32	27	23	26	22	20	21	18	16
9	50	38	31	26	45	35	29	24	29	24	21	24	20	18	19	17	15
10	46	35	28	23	42	32	26	22	27	22	19	22	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2841	2841	2841
5°	2844	2794	2813
10°	2814	2738	2721
15°	2774	2645	2578
20°	2720	2519	2404
25°	2666	2377	2236
30°	2594	2233	2022
35°	2523	2077	1835
40°	2450	1916	1621
45°	2367	1738	1426
50°	2280	1559	1236
55°	2189	1367	1054
60°	2083	1167	867
65°	1962	963	779
70°	1815	774	703
75°	1630	678	638
80°	1361	563	550
85°	923	367	408

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2862 cd/sqm

TEST NUMBER: P906434

CATALOG NUMBER: DFN2DIP-SQ3F0-060D090US835-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	232.4	1.8
10°-20°	638.0	4.9
20°-30°	895.7	6.9
30°-40°	976.4	7.5
40°-50°	897.4	6.9
50°-60°	704.8	5.4
60°-70°	458.8	3.5
70°-80°	236.1	1.8
80°-90°	68.4	0.5
90°-100°	176.1	1.3
100°-110°	559.6	4.3
110°-120°	957.7	7.3
120°-130°	1259.5	9.6
130°-140°	1413.8	10.8
140°-150°	1386.4	10.6
150°-160°	1163.0	8.9
160°-170°	771.2	5.9
170°-180°	269.6	2.1
0°-30°	1766.2	13.5
0°-40°	2742.6	21.0
0°-60°	4344.8	33.3
0°-90°	5108.1	39.1
90°-120°	1693.5	13.0
90°-150°	5753.1	44.0
90°-180°	7957.0	60.9
0°-180°	13065.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2480	2480	2480	2480	2480	
5°	2480	2469	2439	2460	2453	235
15°	2359	2334	2258	2215	2193	665
25°	2141	2069	1921	1829	1795	985
35°	1845	1730	1533	1391	1342	1155
45°	1508	1358	1122	963	909	1165
55°	1147	972	729	595	552	1025
65°	774	592	390	314	307	768
75°	413	256	180	164	162	437
85°	96	49	43	43	43	111
90°	3	31	84	79	82	13
95°	125	149	154	154	149	139
105°	517	523	529	533	533	545
115°	961	975	970	968	961	951
125°	1398	1419	1412	1405	1402	1249
135°	1808	1835	1840	1837	1830	1398
145°	2195	2212	2226	2228	2219	1372
155°	2510	2517	2525	2537	2529	1155
165°	2730	2728	2728	2745	2733	770
175°	2841	2834	2829	2846	2832	270
180°	2846	2846	2846	2846	2846	

TEST NUMBER: P906434

CATALOG NUMBER: DFN2DIP-SQ3F0-060D090US835-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2479.8	2479.8	2479.8	2479.8	2479.8
2.5°	2491.0	2479.8	2455.0	2477.6	2473.1
5°	2479.8	2468.6	2439.3	2459.6	2452.9
7.5°	2459.6	2446.2	2414.8	2423.6	2412.4
10°	2432.6	2416.9	2372.2	2365.3	2351.9
12.5°	2399.1	2378.8	2318.1	2304.8	2280.0
15°	2358.6	2333.8	2257.6	2215.0	2192.6
17.5°	2311.5	2275.5	2181.2	2131.9	2096.0
20°	2257.6	2212.6	2100.5	2044.5	1995.0
22.5°	2199.3	2147.6	2017.4	1941.2	1907.6
25°	2141.0	2069.1	1921.0	1829.1	1795.3
27.5°	2071.5	1995.0	1831.2	1725.7	1674.1
30°	1997.4	1911.9	1732.4	1618.1	1557.4
32.5°	1925.5	1822.2	1638.4	1503.6	1447.4
35°	1844.8	1730.3	1532.9	1391.4	1341.9
37.5°	1766.2	1642.6	1434.1	1279.1	1223.1
40°	1683.1	1548.6	1330.7	1171.4	1113.1
42.5°	1597.9	1454.3	1227.6	1061.4	1005.5
45°	1508.1	1357.6	1122.2	962.6	908.8
47.5°	1422.9	1263.6	1021.2	861.7	812.4
50°	1328.6	1169.3	922.4	767.4	720.5
52.5°	1236.4	1068.1	828.1	680.0	637.4
55°	1146.7	971.7	729.3	594.8	552.1
57.5°	1054.8	875.2	641.9	516.2	480.2
60°	960.5	781.0	549.8	435.5	399.5
62.5°	868.6	689.1	471.2	363.6	345.7
65°	774.3	592.4	390.5	314.3	307.4
67.5°	684.5	502.6	314.3	276.0	269.3
70°	590.2	415.2	260.2	237.9	228.8
72.5°	500.5	334.3	217.6	199.8	195.2
75°	412.9	255.7	179.5	163.8	161.7
77.5°	325.5	181.7	141.4	132.4	127.9
80°	244.5	130.2	107.6	98.8	98.8
82.5°	170.5	87.6	74.0	69.5	69.5
85°	96.4	49.3	42.6	42.6	42.6
87.5°	36.0	17.9	17.9	15.7	15.7
90°	2.6	30.9	84.1	78.9	81.5
92.5°	53.2	72.1	74.7	77.2	77.2
95°	125.3	149.3	153.6	153.6	149.3
97.5°	208.5	230.8	240.3	240.3	240.3
100°	304.6	324.4	331.2	331.2	328.7
102.5°	405.9	420.5	429.9	432.5	429.9
105°	516.6	523.4	528.6	532.9	532.9
107.5°	626.4	636.7	636.7	638.4	626.4
110°	732.8	746.6	746.6	746.6	739.7

TEST NUMBER: P906434

CATALOG NUMBER: DFN2DIP-SQ3F0-060D090US835-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	847.8	862.4	859.8	853.0	847.8
115°	961.1	974.8	970.5	968.0	961.1
117.5°	1073.5	1092.4	1080.4	1073.5	1066.6
120°	1186.8	1205.6	1186.8	1186.8	1179.0
122.5°	1289.7	1313.8	1301.8	1294.9	1289.7
125°	1397.9	1419.3	1412.5	1404.7	1402.2
127.5°	1503.4	1530.0	1520.6	1510.3	1503.4
130°	1602.1	1633.0	1628.7	1623.5	1614.1
132.5°	1712.8	1736.8	1738.5	1726.5	1719.7
135°	1808.0	1834.6	1839.8	1837.2	1830.4
137.5°	1914.4	1935.9	1940.2	1938.5	1928.2
140°	2008.0	2029.4	2041.4	2041.4	2032.0
142.5°	2104.1	2125.5	2132.4	2135.0	2125.5
145°	2195.1	2212.2	2225.9	2228.5	2219.1
147.5°	2276.6	2298.0	2308.3	2312.6	2303.2
150°	2360.7	2375.3	2384.7	2392.4	2384.7
152.5°	2435.3	2449.9	2461.9	2471.4	2461.9
155°	2510.0	2516.8	2524.6	2536.6	2528.9
157.5°	2574.3	2579.5	2583.8	2600.9	2588.9
160°	2631.8	2637.0	2639.6	2654.1	2643.8
162.5°	2685.0	2685.0	2687.6	2703.9	2691.9
165°	2730.5	2727.9	2727.9	2745.1	2733.1
167.5°	2771.7	2764.0	2764.0	2781.1	2769.1
170°	2802.6	2795.7	2793.2	2810.3	2795.7
172.5°	2824.0	2817.2	2814.6	2831.8	2817.2
175°	2841.2	2834.3	2829.2	2846.4	2831.8
177.5°	2850.6	2843.8	2838.6	2853.2	2838.6
180°	2846.4	2846.4	2846.4	2846.4	2846.4

TEST NUMBER: P906434

CATALOG NUMBER: DFN2DIP-SQ3F0-060D090US835-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.63	10.38	10.68	11.43	12.85	5.59	6.34	6.64	7.39	8.81
	3H	11.29	11.96	12.36	13.02	14.46	6.76	7.43	7.83	8.49	9.93
	4H	11.90	12.53	12.97	13.59	15.04	7.21	7.84	8.28	8.90	10.35
	6H	12.31	12.89	13.39	13.96	15.42	7.52	8.10	8.60	9.17	10.63
	8H	12.43	12.99	13.52	14.07	15.52	7.60	8.16	8.69	9.24	10.69
	12H	12.49	13.02	13.58	14.09	15.57	7.64	8.17	8.73	9.24	10.72
4H	2H	9.63	10.27	10.71	11.33	12.78	6.17	6.81	7.25	7.87	9.32
	3H	11.45	11.98	12.54	13.07	14.53	7.51	8.03	8.59	9.12	10.58
	4H	12.14	12.62	13.23	13.70	15.18	8.05	8.53	9.14	9.61	11.09
	6H	12.64	13.06	13.74	14.16	15.63	8.45	8.87	9.55	9.97	11.45
	8H	12.81	13.20	13.91	14.30	15.79	8.58	8.96	9.68	10.06	11.55
	12H	12.90	13.25	14.02	14.36	15.85	8.64	8.99	9.75	10.09	11.59
8H	4H	12.10	12.48	13.20	13.58	15.07	8.32	8.70	9.42	9.80	11.29
	6H	12.65	12.97	13.77	14.11	15.60	8.82	9.14	9.95	10.28	11.77
	8H	12.87	13.15	13.99	14.27	15.77	9.01	9.29	10.14	10.41	11.92
	12H	13.00	13.24	14.13	14.36	15.90	9.12	9.37	10.25	10.48	12.03
12H	4H	12.04	12.39	13.16	13.50	15.00	8.32	8.67	9.43	9.78	11.27
	6H	12.63	12.91	13.76	14.03	15.53	8.87	9.15	10.00	10.27	11.78
	8H	12.84	13.09	13.97	14.20	15.75	9.07	9.32	10.20	10.43	11.98

END OF REPORT