

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906461

Luminaire Tested: DFN2DIP-SQ3F0-070D070US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906461
REPORT IS A COMBINATION OF REPORTS P901441 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D070US835-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13860.0 lumens
Efficiency: N/A
Efficacy: 117.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 118.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906461

CATALOG NUMBER: DFN2DIP-SQ3F0-070D070US835-FLLONL

Luminous Intensity Polar Plot

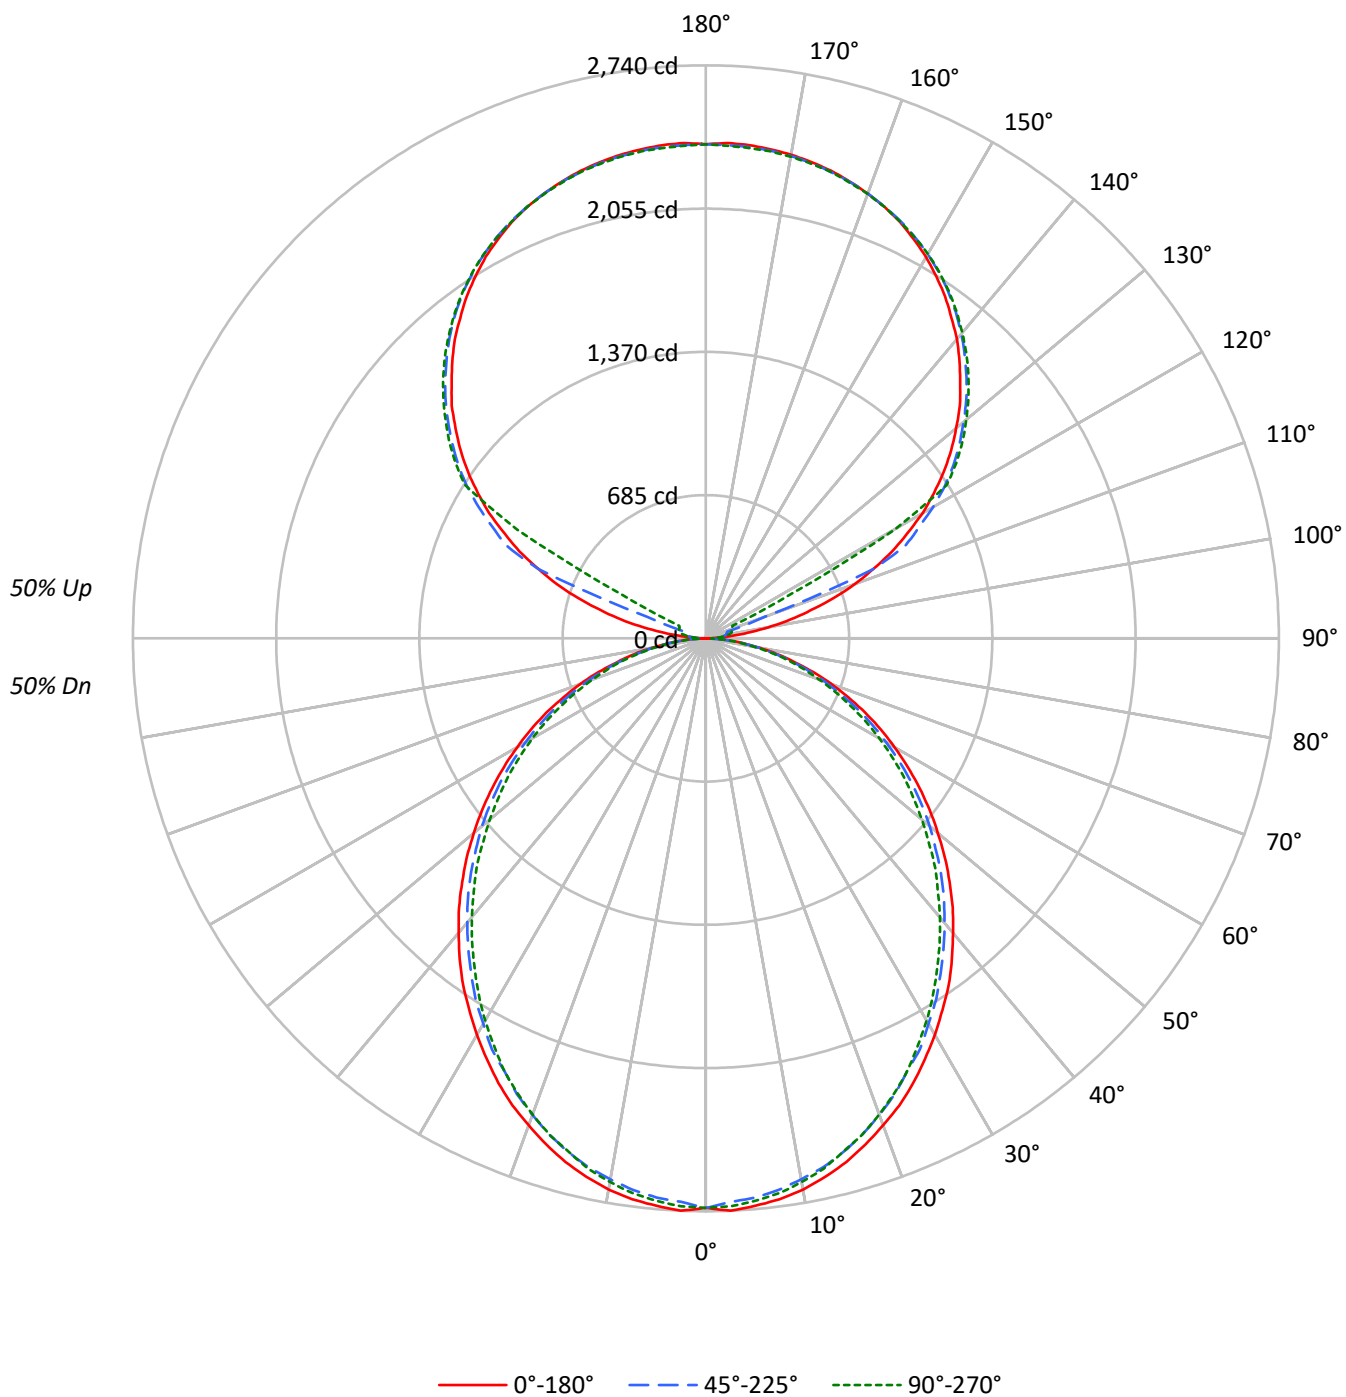

TEST NUMBER: P906461

CATALOG NUMBER: DFN2DIP-SQ3F0-070D070US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3121	3121	3121
5°	3124	3075	3097
10°	3097	3032	3054
15°	3049	2980	2988
20°	2985	2908	2920
25°	2922	2824	2841
30°	2844	2744	2741
35°	2769	2651	2636
40°	2677	2557	2536
45°	2585	2462	2433
50°	2485	2363	2314
55°	2380	2248	2205
60°	2261	2112	2079
65°	2131	1971	1931
70°	1965	1798	1772
75°	1736	1592	1623
80°	1459	1328	1341
85°	1027	881	878

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2585 cd/sqm

TEST NUMBER: P906461

CATALOG NUMBER: DFN2DIP-SQ3F0-070D070US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	256.4	1.8
10°-20°	721.3	5.2
20°-30°	1060.0	7.6
30°-40°	1231.1	8.9
40°-50°	1229.6	8.9
50°-60°	1072.2	7.7
60°-70°	792.6	5.7
70°-80°	448.4	3.2
80°-90°	122.5	0.9
90°-100°	77.9	0.6
100°-110°	290.4	2.1
110°-120°	770.2	5.6
120°-130°	1277.4	9.2
130°-140°	1356.9	9.8
140°-150°	1261.1	9.1
150°-160°	1013.9	7.3
160°-170°	653.3	4.7
170°-180°	224.9	1.6
0°-30°	2037.7	14.7
0°-40°	3268.8	23.6
0°-60°	5570.6	40.2
0°-90°	6934.2	50.0
90°-120°	1138.5	8.2
90°-150°	5033.8	36.3
90°-180°	6926.0	50.0
0°-180°	13860.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2724	2724	2724	2724	2724	
5°	2724	2714	2685	2705	2700	259
15°	2593	2577	2543	2554	2541	730
25°	2347	2326	2281	2286	2281	1080
35°	2025	1998	1956	1941	1928	1264
45°	1648	1629	1590	1561	1550	1271
55°	1247	1231	1200	1168	1155	1115
65°	841	825	799	775	762	831
75°	440	435	422	406	411	470
85°	107	105	102	94	92	120
90°	2	20	34	43	46	13
95°	111	55	67	75	74	131
105°	520	571	104	123	130	555
115°	983	1012	1055	263	140	968
125°	1390	1412	1444	1456	1462	1239
135°	1720	1747	1762	1780	1776	1328
145°	1995	1993	2022	2034	2026	1248
155°	2197	2181	2202	2212	2198	1012
165°	2314	2304	2309	2321	2309	654
175°	2368	2356	2359	2371	2354	225
180°	2362	2362	2362	2362	2362	

TEST NUMBER: P906461

CATALOG NUMBER: DFN2DIP-SQ3F0-070D070US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2723.7	2723.7	2723.7	2723.7	2723.7
2.5°	2739.6	2726.5	2697.6	2723.7	2718.7
5°	2723.7	2713.5	2684.6	2705.4	2700.4
7.5°	2705.4	2689.8	2660.9	2682.1	2676.8
10°	2676.8	2658.4	2627.0	2647.9	2640.1
12.5°	2637.3	2621.8	2590.4	2603.4	2598.1
15°	2592.9	2577.3	2543.1	2553.7	2540.6
17.5°	2537.8	2522.3	2488.1	2501.2	2488.1
20°	2477.5	2462.0	2425.3	2433.1	2422.8
22.5°	2417.5	2393.9	2359.7	2359.7	2354.4
25°	2346.7	2325.8	2281.4	2286.4	2281.4
27.5°	2268.0	2249.7	2215.8	2208.0	2194.9
30°	2189.7	2168.5	2129.4	2121.6	2111.0
32.5°	2105.7	2090.2	2048.2	2032.4	2021.8
35°	2024.6	1998.5	1956.5	1940.7	1927.6
37.5°	1932.9	1909.3	1867.3	1849.0	1835.9
40°	1838.7	1817.6	1775.6	1752.3	1741.7
42.5°	1747.0	1725.9	1684.2	1657.8	1642.2
45°	1647.5	1629.2	1589.7	1561.1	1550.5
47.5°	1550.5	1532.2	1490.2	1461.3	1445.8
50°	1448.3	1435.2	1398.5	1361.9	1348.8
52.5°	1348.8	1330.5	1296.6	1267.7	1249.3
55°	1246.8	1231.0	1199.6	1168.2	1155.1
57.5°	1144.6	1131.5	1097.3	1065.9	1055.4
60°	1042.3	1032.0	995.4	966.5	958.7
62.5°	942.8	924.5	898.4	872.3	861.7
65°	840.9	825.0	798.9	775.3	762.2
67.5°	736.1	722.8	699.4	681.1	670.5
70°	639.1	628.6	604.9	586.6	576.3
72.5°	539.6	529.1	516.0	497.7	489.9
75°	439.9	434.9	421.5	406.0	411.3
77.5°	351.0	340.4	335.1	327.3	319.6
80°	262.0	259.3	254.0	246.2	240.9
82.5°	178.1	178.1	175.6	165.1	165.1
85°	107.3	104.8	102.3	94.2	91.7
87.5°	47.2	42.0	36.7	28.9	26.1
90°	1.6	20.5	34.1	42.8	46.1
92.5°	42.8	35.9	41.0	44.5	46.1
95°	111.0	54.6	66.6	75.3	73.5
97.5°	199.9	59.9	87.1	92.4	94.0
100°	302.7	68.4	97.4	111.0	114.5
102.5°	415.3	412.1	100.9	119.6	124.8
105°	519.7	571.0	104.3	123.0	129.9
107.5°	641.0	683.7	107.8	126.5	133.4
110°	757.4	793.1	299.2	128.3	135.0

TEST NUMBER: P906461

CATALOG NUMBER: DFN2DIP-SQ3F0-070D070US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	866.8	897.4	868.4	131.5	136.8
115°	982.9	1011.9	1054.7	263.3	140.3
117.5°	1083.8	1117.9	1147.1	902.5	454.7
120°	1196.6	1222.2	1253.1	1273.6	1042.8
122.5°	1292.2	1319.6	1354.0	1364.1	1365.9
125°	1389.7	1412.0	1444.5	1456.5	1461.5
127.5°	1478.6	1502.5	1528.3	1545.4	1547.0
130°	1562.4	1589.8	1608.5	1627.4	1625.8
132.5°	1647.9	1670.2	1688.9	1704.3	1702.7
135°	1719.7	1747.1	1762.4	1779.6	1776.2
137.5°	1794.8	1815.4	1832.6	1849.7	1844.6
140°	1868.3	1882.1	1900.8	1916.2	1907.7
142.5°	1930.0	1942.0	1964.1	1977.7	1969.2
145°	1995.0	1993.2	2022.2	2034.2	2025.7
147.5°	2051.2	2046.2	2075.2	2083.7	2077.0
150°	2106.0	2094.1	2121.5	2131.6	2123.1
152.5°	2152.1	2138.5	2164.1	2174.4	2162.5
155°	2196.6	2181.3	2201.8	2212.0	2198.4
157.5°	2232.5	2218.9	2234.3	2246.3	2232.5
160°	2263.4	2253.0	2263.4	2273.5	2261.5
162.5°	2290.6	2280.4	2288.9	2300.9	2285.5
165°	2314.5	2304.4	2309.4	2321.4	2309.4
167.5°	2333.4	2323.0	2328.3	2340.3	2324.9
170°	2348.8	2338.5	2341.9	2353.9	2338.5
172.5°	2359.0	2348.8	2352.3	2364.2	2348.8
175°	2367.5	2355.5	2359.0	2370.9	2353.9
177.5°	2370.9	2359.0	2360.8	2372.8	2357.3
180°	2362.4	2362.4	2362.4	2362.4	2362.4

TEST NUMBER: P906461

CATALOG NUMBER: DFN2DIP-SQ3F0-070D070US835-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.19	12.06	12.15	13.03	14.30	10.75	11.61	11.71	12.58	13.86
	3H	12.85	13.62	13.82	14.61	15.90	12.36	13.13	13.33	14.11	15.41
	4H	13.44	14.17	14.42	15.15	16.45	12.94	13.67	13.92	14.66	15.96
	6H	13.83	14.51	14.82	15.50	16.81	13.33	14.01	14.32	15.00	16.31
	8H	13.94	14.58	14.93	15.58	16.89	13.43	14.07	14.43	15.08	16.39
	12H	13.98	14.59	14.99	15.59	16.93	13.47	14.08	14.48	15.08	16.42
4H	2H	11.65	12.38	12.64	13.37	14.67	11.30	12.03	12.28	13.01	14.32
	3H	13.51	14.12	14.51	15.14	16.45	13.10	13.72	14.10	14.73	16.05
	4H	14.22	14.78	15.23	15.79	17.13	13.80	14.36	14.80	15.37	16.70
	6H	14.73	15.22	15.75	16.25	17.58	14.30	14.78	15.32	15.81	17.15
	8H	14.88	15.33	15.90	16.35	17.71	14.44	14.89	15.46	15.92	17.27
	12H	14.95	15.36	15.99	16.40	17.75	14.50	14.91	15.54	15.95	17.30
8H	4H	14.42	14.86	15.43	15.89	17.24	14.04	14.49	15.06	15.51	16.86
	6H	15.04	15.41	16.08	16.48	17.83	14.66	15.03	15.70	16.09	17.44
	8H	15.26	15.59	16.31	16.64	18.00	14.87	15.19	15.92	16.24	17.61
	12H	15.39	15.67	16.44	16.72	18.13	14.98	15.26	16.03	16.31	17.72
12H	4H	14.40	14.81	15.44	15.85	17.20	14.03	14.44	15.07	15.48	16.83
	6H	15.07	15.40	16.12	16.45	17.82	14.70	15.02	15.75	16.08	17.44
	8H	15.31	15.59	16.36	16.64	18.05	14.93	15.21	15.98	16.26	17.67