

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906497

Luminaire Tested: DFN2DIP-SQ3F0-080D070US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906497
REPORT IS A COMBINATION OF REPORTS P901443 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-080D070US835-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14850.0 lumens
Efficiency: N/A
Efficacy: 115.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 128.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906497

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-FLLONL

Luminous Intensity Polar Plot

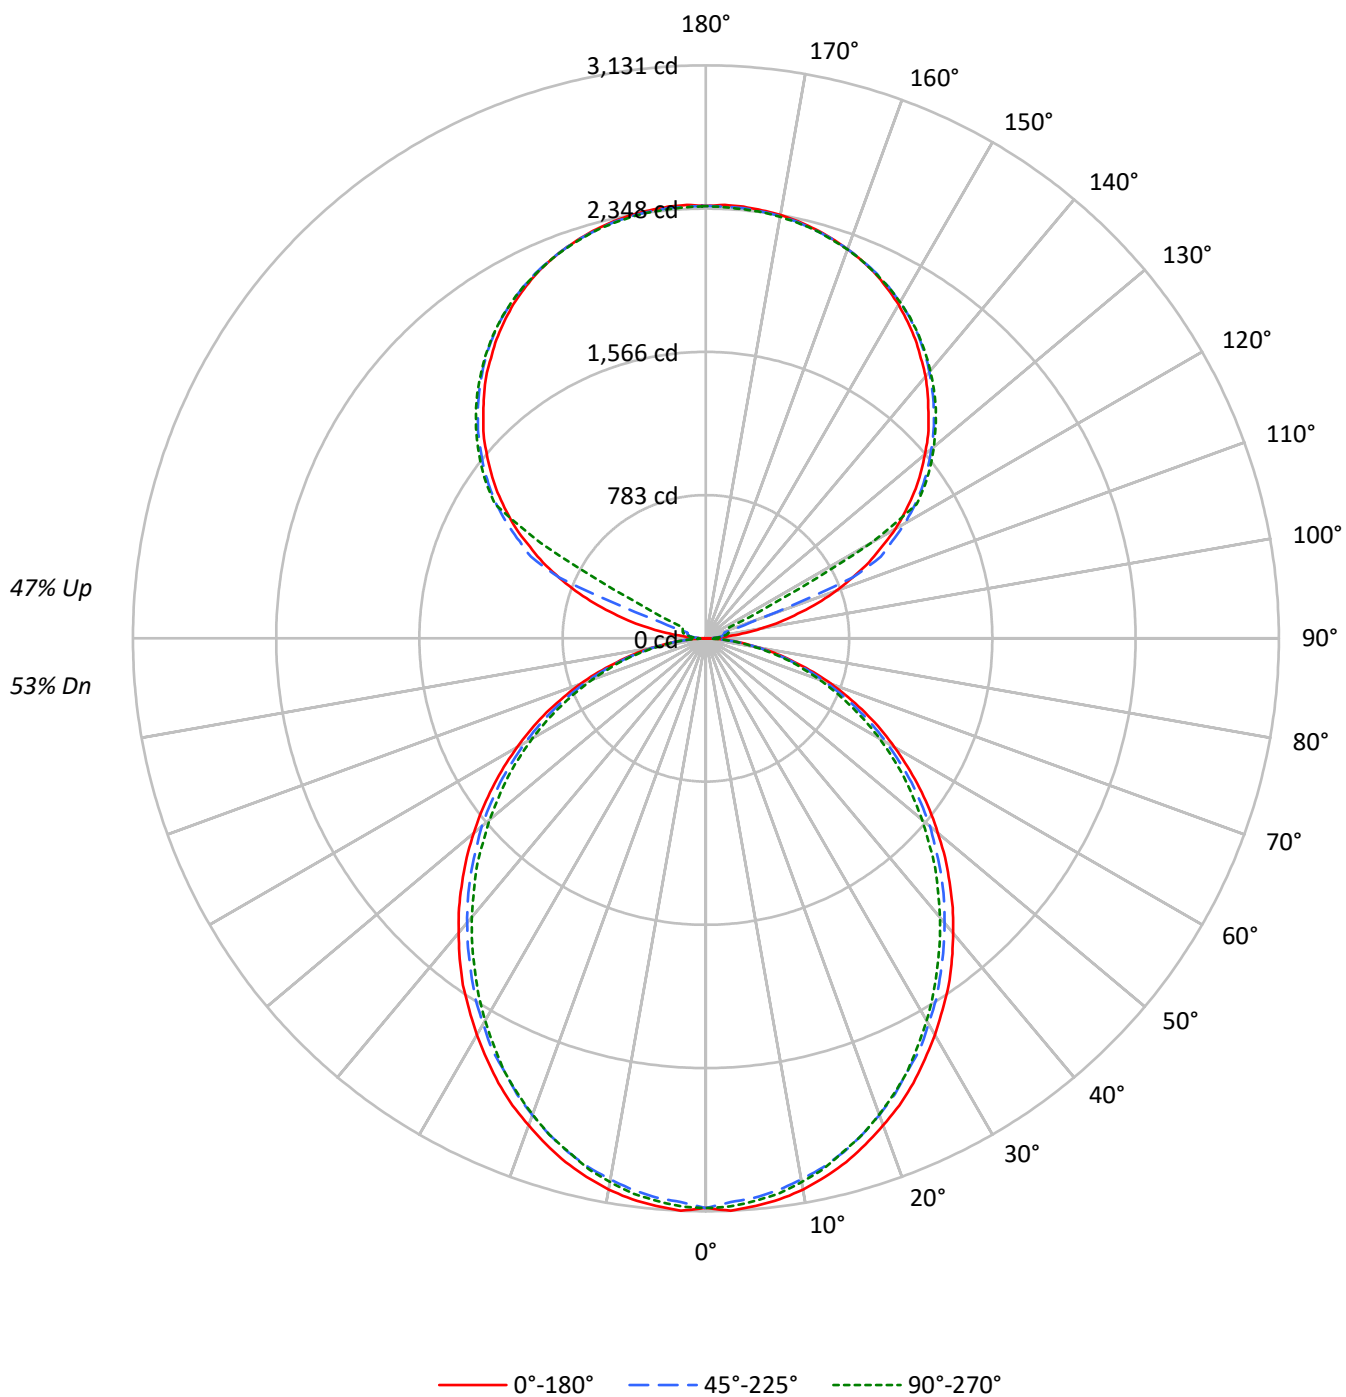

TEST NUMBER: P906497

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	94	90	87	91	87	84	81	75	72	70	63	61	60	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	76	67	61	56	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	53	47	51	46	42	44	40	36	37	33	31
5	69	57	49	43	63	53	46	41	46	40	36	39	35	31	33	30	27
6	63	51	43	37	59	48	41	35	41	36	31	35	31	28	30	26	24
7	59	46	38	33	54	43	36	31	38	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	25	30	25	22	25	22	19
9	51	38	31	26	47	36	29	25	31	26	22	27	23	20	23	20	17
10	47	35	28	23	44	33	26	22	29	24	20	25	21	18	21	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3567	3567	3567
5°	3570	3515	3540
10°	3539	3465	3490
15°	3485	3406	3414
20°	3412	3324	3337
25°	3340	3227	3247
30°	3250	3136	3133
35°	3164	3030	3013
40°	3059	2922	2898
45°	2955	2814	2781
50°	2840	2701	2645
55°	2720	2569	2520
60°	2584	2414	2376
65°	2435	2252	2207
70°	2246	2056	2025
75°	1984	1820	1855
80°	1668	1518	1533
85°	1174	1006	1004

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2955 cd/sqm

TEST NUMBER: P906497

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	293.0	2.0
10°-20°	824.3	5.6
20°-30°	1211.5	8.2
30°-40°	1407.0	9.5
40°-50°	1405.3	9.5
50°-60°	1225.4	8.3
60°-70°	905.8	6.1
70°-80°	512.5	3.5
80°-90°	139.4	0.9
90°-100°	77.9	0.5
100°-110°	290.4	2.0
110°-120°	770.2	5.2
120°-130°	1277.4	8.6
130°-140°	1356.9	9.1
140°-150°	1261.1	8.5
150°-160°	1013.9	6.8
160°-170°	653.3	4.4
170°-180°	224.9	1.5
0°-30°	2328.8	15.7
0°-40°	3735.8	25.2
0°-60°	6366.4	42.9
0°-90°	7924.2	53.4
90°-120°	1138.5	7.7
90°-150°	5033.8	33.9
90°-180°	6926.0	46.6
0°-180°	14850.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3113	3113	3113	3113	3113	
5°	3113	3101	3068	3092	3086	295
15°	2963	2946	2906	2918	2904	835
25°	2682	2658	2607	2613	2607	1234
35°	2314	2284	2236	2218	2203	1445
45°	1883	1862	1817	1784	1772	1453
55°	1425	1407	1371	1335	1320	1274
65°	961	943	913	886	871	950
75°	503	497	482	464	470	537
85°	123	120	117	108	105	137
90°	2	20	34	43	46	14
95°	111	55	67	75	74	131
105°	520	571	104	123	130	555
115°	983	1012	1055	263	140	968
125°	1390	1412	1444	1456	1462	1239
135°	1720	1747	1762	1780	1776	1328
145°	1995	1993	2022	2034	2026	1248
155°	2197	2181	2202	2212	2198	1012
165°	2314	2304	2309	2321	2309	654
175°	2368	2356	2359	2371	2354	225
180°	2362	2362	2362	2362	2362	

TEST NUMBER: P906497

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3112.8	3112.8	3112.8	3112.8	3112.8
2.5°	3130.9	3116.0	3083.0	3112.8	3107.1
5°	3112.8	3101.1	3068.1	3091.9	3086.2
7.5°	3091.9	3074.1	3041.1	3065.2	3059.2
10°	3059.2	3038.2	3002.3	3026.1	3017.3
12.5°	3014.1	2996.3	2960.4	2975.3	2969.3
15°	2963.3	2945.5	2906.4	2918.5	2903.6
17.5°	2900.4	2882.6	2843.5	2858.5	2843.5
20°	2831.5	2813.7	2771.8	2780.7	2768.9
22.5°	2762.9	2735.9	2696.8	2696.8	2690.8
25°	2681.9	2658.1	2607.3	2613.0	2607.3
27.5°	2592.0	2571.1	2532.3	2523.4	2508.5
30°	2502.5	2478.3	2433.6	2424.7	2412.6
32.5°	2406.6	2388.8	2340.8	2322.7	2310.7
35°	2313.8	2284.0	2236.0	2217.9	2203.0
37.5°	2209.0	2182.0	2134.1	2113.1	2098.2
40°	2101.4	2077.2	2029.3	2002.6	1990.5
42.5°	1996.6	1972.4	1924.8	1894.6	1876.9
45°	1882.9	1861.9	1816.8	1784.1	1772.1
47.5°	1772.1	1751.1	1703.1	1670.1	1652.3
50°	1655.2	1640.3	1598.3	1556.4	1541.5
52.5°	1541.5	1520.5	1481.8	1448.8	1427.8
55°	1424.9	1406.8	1371.0	1335.1	1320.1
57.5°	1308.1	1293.2	1254.1	1218.2	1206.1
60°	1191.2	1179.5	1137.5	1104.5	1095.6
62.5°	1077.5	1056.6	1026.7	996.9	984.8
65°	961.0	942.9	913.0	886.0	871.1
67.5°	841.2	826.0	799.3	778.4	766.3
70°	730.4	718.3	691.4	670.4	658.6
72.5°	616.7	604.7	589.7	568.8	559.9
75°	502.7	497.0	481.8	464.0	470.0
77.5°	401.1	389.0	383.0	374.1	365.2
80°	299.5	296.3	290.3	281.4	275.3
82.5°	203.6	203.6	200.7	188.6	188.6
85°	122.6	119.7	116.9	107.7	104.8
87.5°	54.0	48.0	41.9	33.0	29.9
90°	1.6	20.5	34.1	42.8	46.1
92.5°	42.8	35.9	41.0	44.5	46.1
95°	111.0	54.6	66.6	75.3	73.5
97.5°	199.9	59.9	87.1	92.4	94.0
100°	302.7	68.4	97.4	111.0	114.5
102.5°	415.3	412.1	100.9	119.6	124.8
105°	519.7	571.0	104.3	123.0	129.9
107.5°	641.0	683.7	107.8	126.5	133.4
110°	757.4	793.1	299.2	128.3	135.0

TEST NUMBER: P906497

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	866.8	897.4	868.4	131.5	136.8
115°	982.9	1011.9	1054.7	263.3	140.3
117.5°	1083.8	1117.9	1147.1	902.5	454.7
120°	1196.6	1222.2	1253.1	1273.6	1042.8
122.5°	1292.2	1319.6	1354.0	1364.1	1365.9
125°	1389.7	1412.0	1444.5	1456.5	1461.5
127.5°	1478.6	1502.5	1528.3	1545.4	1547.0
130°	1562.4	1589.8	1608.5	1627.4	1625.8
132.5°	1647.9	1670.2	1688.9	1704.3	1702.7
135°	1719.7	1747.1	1762.4	1779.6	1776.2
137.5°	1794.8	1815.4	1832.6	1849.7	1844.6
140°	1868.3	1882.1	1900.8	1916.2	1907.7
142.5°	1930.0	1942.0	1964.1	1977.7	1969.2
145°	1995.0	1993.2	2022.2	2034.2	2025.7
147.5°	2051.2	2046.2	2075.2	2083.7	2077.0
150°	2106.0	2094.1	2121.5	2131.6	2123.1
152.5°	2152.1	2138.5	2164.1	2174.4	2162.5
155°	2196.6	2181.3	2201.8	2212.0	2198.4
157.5°	2232.5	2218.9	2234.3	2246.3	2232.5
160°	2263.4	2253.0	2263.4	2273.5	2261.5
162.5°	2290.6	2280.4	2288.9	2300.9	2285.5
165°	2314.5	2304.4	2309.4	2321.4	2309.4
167.5°	2333.4	2323.0	2328.3	2340.3	2324.9
170°	2348.8	2338.5	2341.9	2353.9	2338.5
172.5°	2359.0	2348.8	2352.3	2364.2	2348.8
175°	2367.5	2355.5	2359.0	2370.9	2353.9
177.5°	2370.9	2359.0	2360.8	2372.8	2357.3
180°	2362.4	2362.4	2362.4	2362.4	2362.4

TEST NUMBER: P906497

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.96	12.85	12.89	13.80	15.02	11.52	12.41	12.44	13.35	14.58
	3H	13.62	14.42	14.56	15.37	16.62	13.13	13.93	14.07	14.88	16.13
	4H	14.21	14.96	15.16	15.92	17.18	13.71	14.47	14.67	15.43	16.68
	6H	14.60	15.30	15.57	16.27	17.53	14.10	14.80	15.07	15.77	17.03
	8H	14.71	15.37	15.68	16.35	17.62	14.21	14.87	15.18	15.85	17.12
	12H	14.76	15.39	15.73	16.36	17.65	14.25	14.88	15.22	15.85	17.14
4H	2H	12.42	13.18	13.38	14.14	15.39	12.07	12.82	13.03	13.78	15.04
	3H	14.29	14.92	15.26	15.91	17.18	13.88	14.51	14.85	15.50	16.77
	4H	15.00	15.58	15.98	16.56	17.85	14.57	15.15	15.55	16.13	17.43
	6H	15.51	16.01	16.50	17.01	18.31	15.08	15.58	16.07	16.58	17.87
	8H	15.66	16.12	16.65	17.12	18.43	15.22	15.69	16.21	16.69	17.99
	12H	15.73	16.15	16.74	17.17	18.48	15.28	15.70	16.29	16.72	18.03
8H	4H	15.19	15.66	16.18	16.66	17.96	14.82	15.28	15.81	16.28	17.59
	6H	15.82	16.20	16.84	17.25	18.55	15.43	15.82	16.45	16.86	18.17
	8H	16.04	16.38	17.06	17.40	18.73	15.64	15.98	16.67	17.01	18.33
	12H	16.17	16.47	17.20	17.49	18.85	15.76	16.05	16.78	17.08	18.44
12H	4H	15.18	15.60	16.19	16.61	17.93	14.81	15.23	15.82	16.25	17.56
	6H	15.85	16.19	16.87	17.22	18.54	15.47	15.81	16.50	16.84	18.17
	8H	16.09	16.39	17.12	17.41	18.78	15.71	16.00	16.74	17.03	18.39