

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906498

Luminaire Tested: DFN2DIP-SQ3F0-080D070US835-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906498
REPORT IS A COMBINATION OF REPORTS P899924 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-080D070US835-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12995.0 lumens
Efficiency: N/A
Efficacy: 101.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 128.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906498

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-RLLFLL

Luminous Intensity Polar Plot

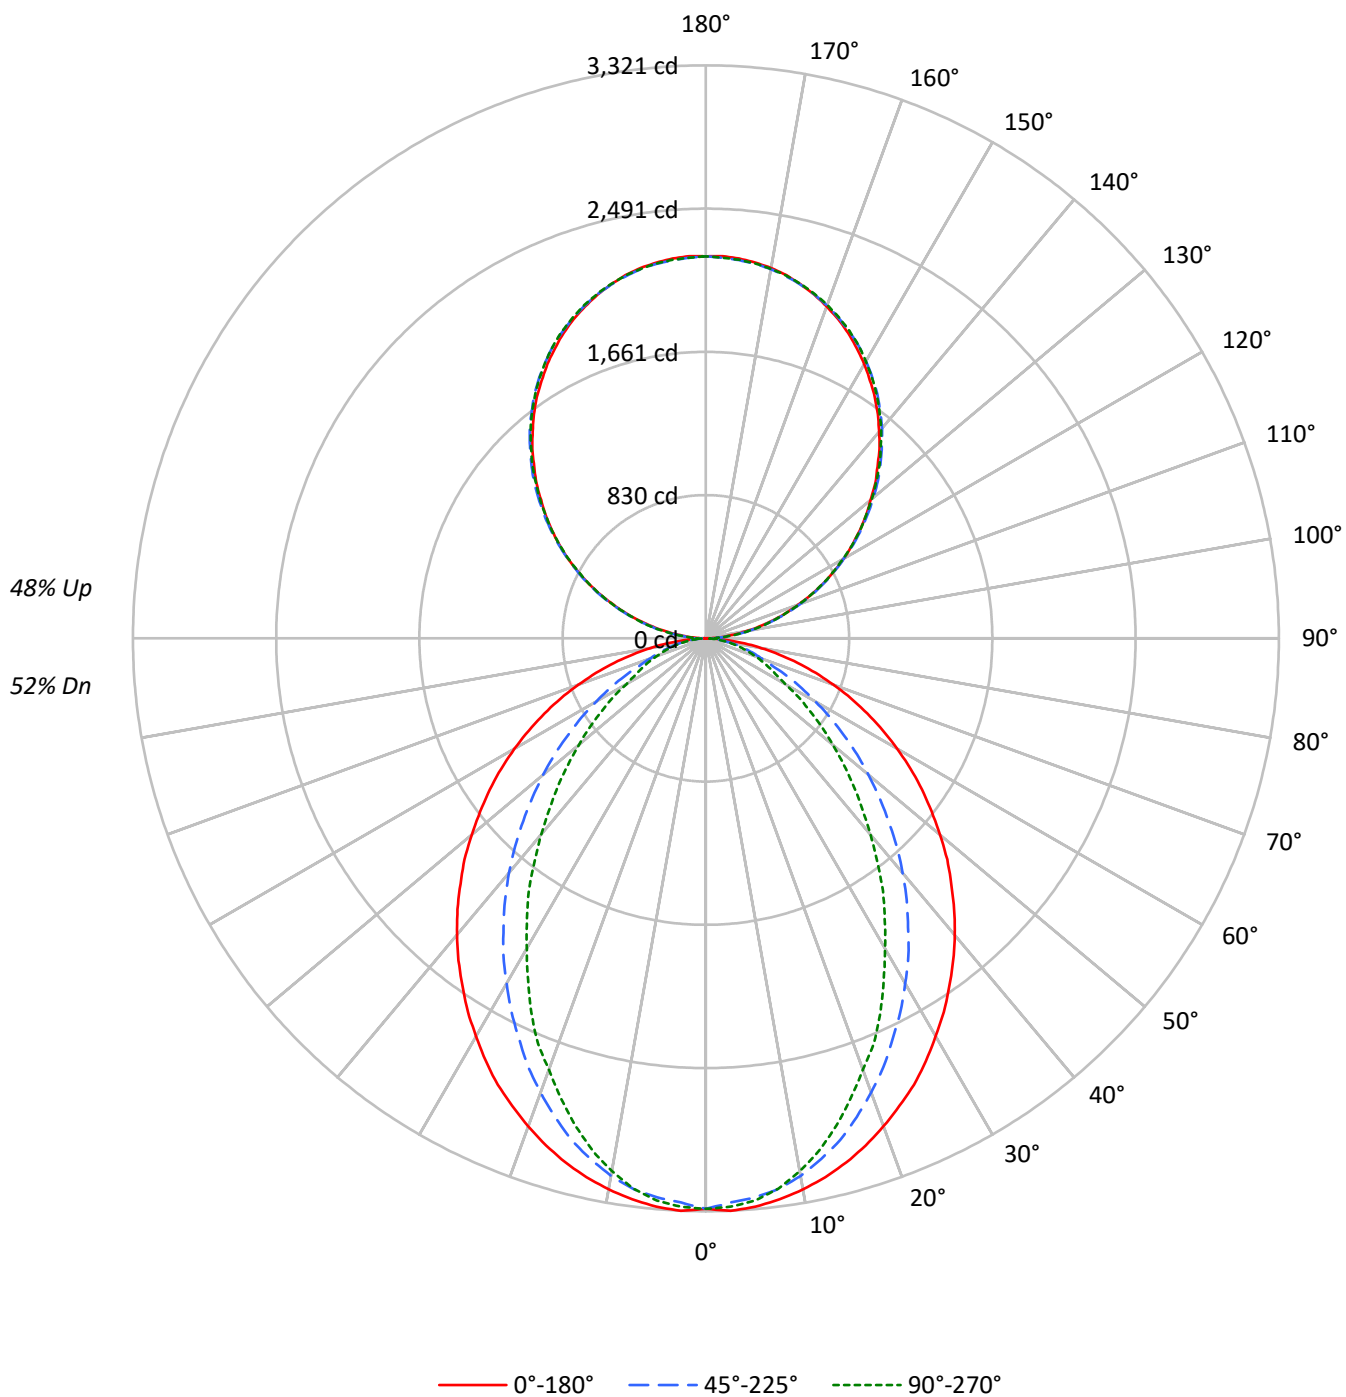

TEST NUMBER: P906498

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	58	58	58
1	99	95	91	88	91	88	85	82	75	73	71	63	62	60	52	51	50
2	90	83	77	72	83	77	72	68	66	63	59	56	53	51	47	45	43
3	83	74	67	61	76	69	62	57	59	54	50	50	47	44	42	39	37
4	76	66	58	52	70	61	54	49	53	48	43	45	41	38	38	35	33
5	70	59	51	45	65	55	48	43	47	42	38	41	36	33	34	31	29
6	65	53	45	39	60	49	42	37	43	37	33	37	33	29	31	28	25
7	60	48	40	35	55	45	38	33	39	34	30	34	29	26	29	25	23
8	56	44	36	31	52	41	34	29	36	30	26	31	27	23	26	23	21
9	52	40	33	28	48	38	31	26	33	28	24	29	24	21	24	21	19
10	49	37	30	25	45	35	28	24	30	25	22	26	22	19	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3788	3788	3788
5°	3792	3726	3751
10°	3752	3650	3628
15°	3698	3527	3438
20°	3627	3359	3205
25°	3555	3170	2981
30°	3458	2977	2697
35°	3364	2769	2447
40°	3267	2555	2161
45°	3155	2318	1902
50°	3039	2078	1648
55°	2918	1822	1405
60°	2778	1555	1155
65°	2616	1284	1038
70°	2420	1032	938
75°	2173	904	851
80°	1815	750	733
85°	1231	489	544

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3155 cd/sqm

TEST NUMBER: P906498

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	309.9	2.4
10°-20°	850.7	6.5
20°-30°	1194.3	9.2
30°-40°	1301.9	10.0
40°-50°	1196.6	9.2
50°-60°	939.7	7.2
60°-70°	611.7	4.7
70°-80°	314.9	2.4
80°-90°	86.7	0.7
90°-100°	137.0	1.1
100°-110°	435.3	3.3
110°-120°	744.9	5.7
120°-130°	979.6	7.5
130°-140°	1099.6	8.5
140°-150°	1078.3	8.3
150°-160°	904.5	7.0
160°-170°	599.9	4.6
170°-180°	209.7	1.6
0°-30°	2354.9	18.1
0°-40°	3656.8	28.1
0°-60°	5793.1	44.6
0°-90°	6806.3	52.4
90°-120°	1317.2	10.1
90°-150°	4474.7	34.4
90°-180°	6189.0	47.6
0°-180°	12995.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3306	3306	3306	3306	3306	
5°	3306	3292	3252	3279	3270	314
15°	3145	3112	3010	2953	2924	886
25°	2855	2759	2561	2439	2394	1313
35°	2460	2307	2044	1855	1789	1540
45°	2011	1810	1496	1284	1212	1553
55°	1529	1296	972	793	736	1366
65°	1032	790	521	419	410	1024
75°	550	341	239	218	216	582
85°	129	66	57	57	57	148
90°	2	24	65	61	63	13
95°	97	116	120	120	116	108
105°	402	407	411	414	414	424
115°	748	758	755	753	748	739
125°	1087	1104	1099	1093	1091	972
135°	1406	1427	1431	1429	1424	1087
145°	1707	1721	1731	1733	1726	1067
155°	1952	1958	1964	1973	1967	899
165°	2124	2122	2122	2135	2126	599
175°	2210	2204	2200	2214	2202	210
180°	2214	2214	2214	2214	2214	

TEST NUMBER: P906498

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3306.4	3306.4	3306.4	3306.4	3306.4
2.5°	3321.3	3306.4	3273.4	3303.5	3297.5
5°	3306.4	3291.5	3252.4	3279.4	3270.5
7.5°	3279.4	3261.6	3219.7	3231.5	3216.5
10°	3243.5	3222.6	3162.9	3153.7	3135.9
12.5°	3198.8	3171.8	3090.8	3073.0	3040.0
15°	3144.8	3111.8	3010.2	2953.4	2923.5
17.5°	3081.9	3034.0	2908.3	2842.6	2794.6
20°	3010.2	2950.2	2800.7	2726.1	2660.0
22.5°	2932.4	2863.5	2689.9	2588.3	2543.5
25°	2854.6	2758.8	2561.3	2438.8	2393.7
27.5°	2761.9	2660.0	2441.6	2301.0	2232.1
30°	2663.2	2549.2	2309.9	2157.5	2076.5
32.5°	2567.3	2429.6	2184.5	2004.8	1929.9
35°	2459.7	2307.0	2043.8	1855.3	1789.2
37.5°	2354.9	2190.2	1912.1	1705.4	1630.8
40°	2244.2	2064.8	1774.3	1561.9	1484.1
42.5°	2130.5	1939.1	1636.8	1415.3	1340.6
45°	2010.8	1810.2	1496.2	1283.5	1211.8
47.5°	1897.2	1684.8	1361.6	1148.9	1083.2
50°	1771.4	1559.1	1229.9	1023.2	960.6
52.5°	1648.6	1424.1	1104.1	906.7	849.9
55°	1528.9	1295.6	972.4	793.0	736.2
57.5°	1406.4	1167.0	855.9	688.3	640.3
60°	1280.6	1041.3	733.0	580.6	532.7
62.5°	1158.1	918.7	628.3	484.8	461.0
65°	1032.4	789.8	520.6	419.1	409.8
67.5°	912.7	670.2	419.1	367.9	359.1
70°	787.0	553.7	347.0	317.1	305.1
72.5°	667.3	445.7	290.2	266.4	260.3
75°	550.5	341.0	239.4	218.4	215.6
77.5°	434.0	242.2	188.6	176.5	170.5
80°	326.0	173.7	143.5	131.7	131.7
82.5°	227.3	116.8	98.7	92.7	92.7
85°	128.6	65.7	56.8	56.8	56.8
87.5°	47.9	23.8	23.8	21.0	21.0
90°	2.0	24.0	65.4	61.4	63.4
92.5°	41.4	56.1	58.1	60.1	60.1
95°	97.4	116.1	119.5	119.5	116.1
97.5°	162.2	179.5	186.9	186.9	186.9
100°	236.9	252.3	257.6	257.6	255.6
102.5°	315.7	327.0	334.4	336.4	334.4
105°	401.8	407.1	411.1	414.5	414.5
107.5°	487.2	495.2	495.2	496.6	487.2
110°	570.0	580.7	580.7	580.7	575.3

TEST NUMBER: P906498

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	659.4	670.8	668.8	663.4	659.4
115°	747.5	758.2	754.9	752.9	747.5
117.5°	834.9	849.6	840.3	834.9	829.6
120°	923.0	937.7	923.0	923.0	917.0
122.5°	1003.1	1021.8	1012.5	1007.1	1003.1
125°	1087.2	1103.9	1098.6	1092.6	1090.6
127.5°	1169.3	1190.0	1182.7	1174.7	1169.3
130°	1246.1	1270.1	1266.8	1262.8	1255.4
132.5°	1332.2	1350.9	1352.2	1342.9	1337.5
135°	1406.3	1426.9	1431.0	1428.9	1423.6
137.5°	1489.0	1505.7	1509.0	1507.7	1499.7
140°	1561.8	1578.5	1587.8	1587.8	1580.5
142.5°	1636.5	1653.2	1658.5	1660.5	1653.2
145°	1707.3	1720.6	1731.3	1733.3	1726.0
147.5°	1770.7	1787.4	1795.4	1798.7	1791.4
150°	1836.1	1847.4	1854.8	1860.8	1854.8
152.5°	1894.1	1905.5	1914.8	1922.2	1914.8
155°	1952.2	1957.5	1963.6	1972.9	1966.9
157.5°	2002.3	2006.3	2009.6	2023.0	2013.6
160°	2047.0	2051.0	2053.0	2064.3	2056.3
162.5°	2088.4	2088.4	2090.4	2103.0	2093.7
165°	2123.7	2121.7	2121.7	2135.1	2125.7
167.5°	2155.8	2149.8	2149.8	2163.1	2153.8
170°	2179.8	2174.5	2172.5	2185.8	2174.5
172.5°	2196.5	2191.1	2189.1	2202.5	2191.1
175°	2209.8	2204.5	2200.5	2213.8	2202.5
177.5°	2217.2	2211.8	2207.8	2219.2	2207.8
180°	2213.8	2213.8	2213.8	2213.8	2213.8

TEST NUMBER: P906498

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.96	12.81	12.90	13.76	15.00	7.92	8.77	8.86	9.73	10.96
	3H	13.63	14.39	14.59	15.36	16.62	9.10	9.86	10.06	10.83	12.09
	4H	14.24	14.96	15.21	15.93	17.20	9.55	10.27	10.52	11.24	12.51
	6H	14.66	15.32	15.64	16.29	17.58	9.87	10.53	10.85	11.50	12.79
	8H	14.78	15.41	15.77	16.40	17.68	9.95	10.58	10.94	11.57	12.86
	12H	14.84	15.44	15.84	16.43	17.73	10.00	10.59	10.99	11.58	12.88
4H	2H	11.98	12.70	12.95	13.66	14.94	8.52	9.23	9.49	10.20	11.47
	3H	13.80	14.40	14.79	15.40	16.68	9.86	10.46	10.84	11.46	12.74
	4H	14.49	15.04	15.49	16.03	17.34	10.40	10.95	11.40	11.94	13.25
	6H	15.00	15.47	16.01	16.49	17.80	10.82	11.28	11.82	12.30	13.61
	8H	15.18	15.61	16.18	16.62	17.94	10.94	11.38	11.95	12.39	13.71
	12H	15.27	15.66	16.29	16.69	18.02	11.00	11.40	12.03	12.42	13.75
8H	4H	14.46	14.90	15.47	15.91	17.23	10.68	11.12	11.69	12.13	13.45
	6H	15.02	15.38	16.05	16.43	17.75	11.19	11.55	12.22	12.60	13.92
	8H	15.24	15.55	16.27	16.59	17.93	11.38	11.70	12.42	12.73	14.07
	12H	15.37	15.65	16.41	16.68	18.06	11.49	11.77	12.53	12.80	14.19
12H	4H	14.41	14.81	15.44	15.83	17.16	10.69	11.08	11.71	12.11	13.43
	6H	15.00	15.32	16.03	16.35	17.69	11.24	11.56	12.28	12.60	13.93
	8H	15.21	15.49	16.26	16.53	17.91	11.45	11.73	12.49	12.76	14.14