

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906499

Luminaire Tested: DFN2DIP-SQ3F0-080D070US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906499
REPORT IS A COMBINATION OF REPORTS P901444 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-080D070US835-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13730.0 lumens
Efficiency: N/A
Efficacy: 106.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 128.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906499

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-RLLONL

Luminous Intensity Polar Plot

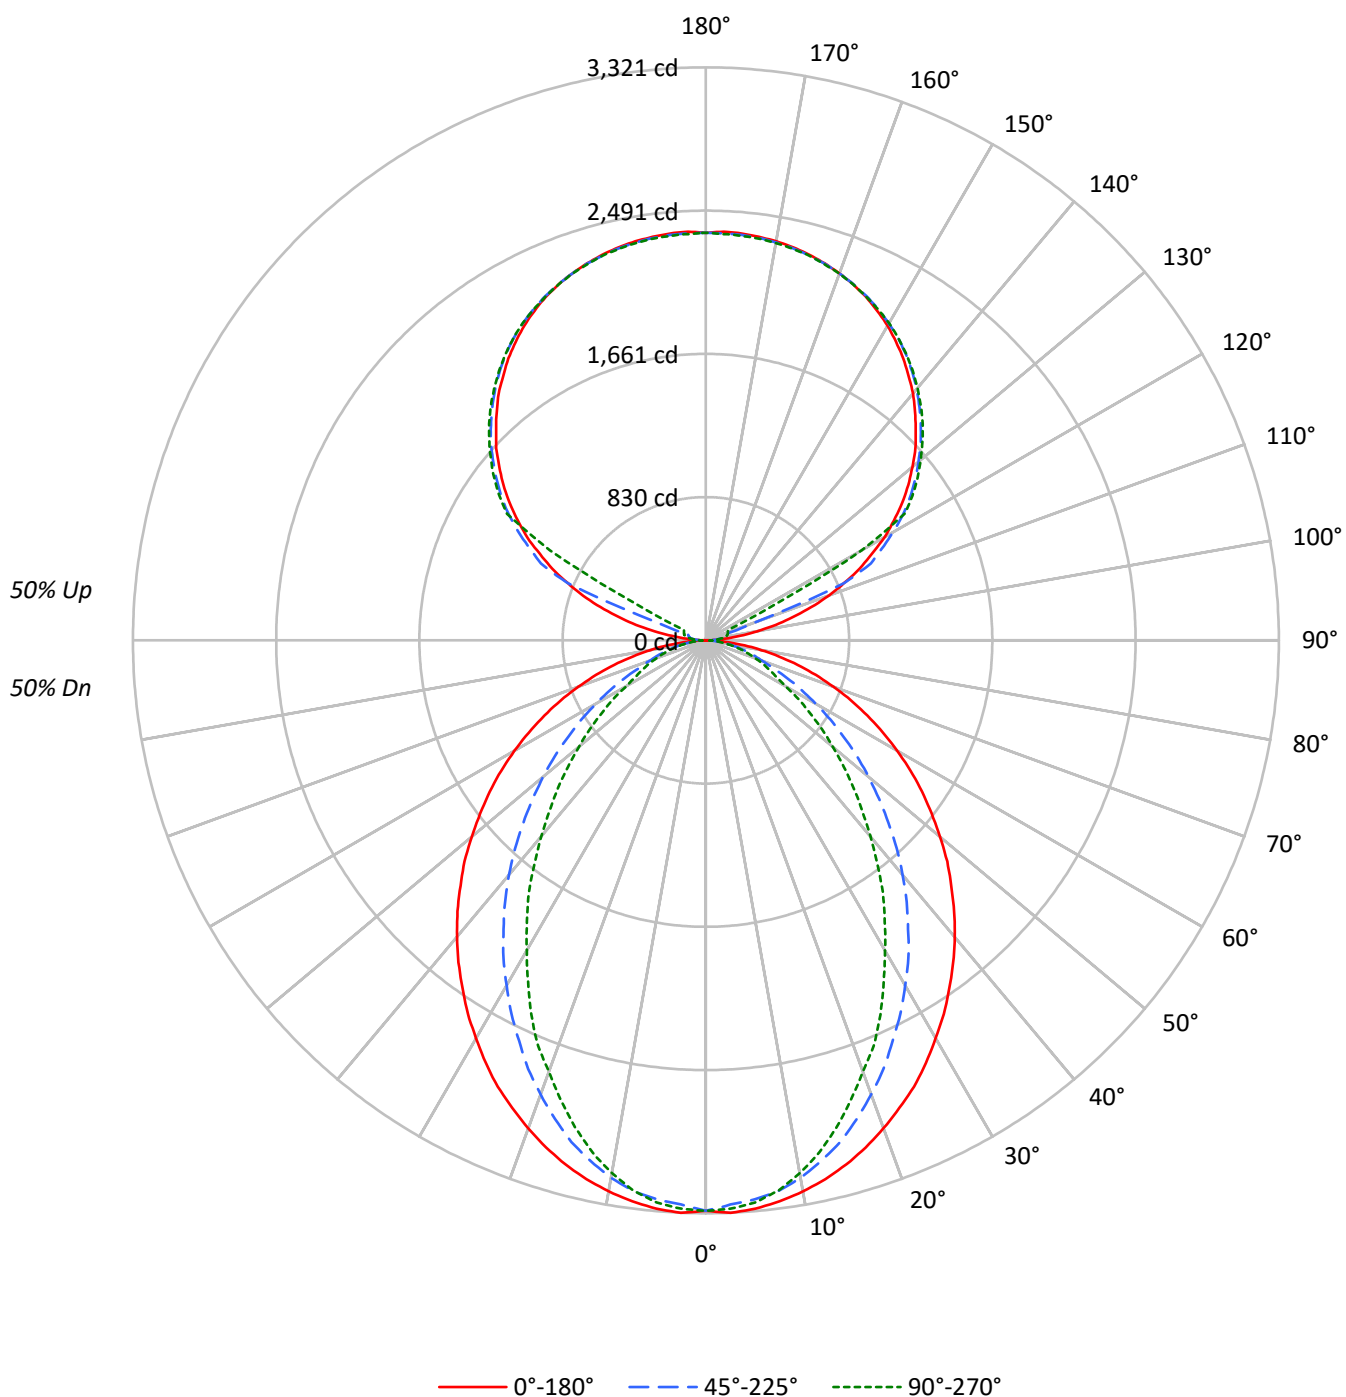

TEST NUMBER: P906499

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	94	90	87	90	87	84	81	74	71	69	61	60	58	50	49	48
2	90	83	77	72	83	77	71	67	65	61	58	54	52	49	45	43	41
3	82	73	66	60	76	68	62	57	58	53	49	49	45	42	40	38	36
4	75	65	57	52	69	60	54	48	52	47	42	44	40	37	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	33	30	27
6	64	52	44	39	59	49	42	37	42	37	32	36	32	28	30	27	24
7	59	47	40	34	55	44	37	32	38	33	29	33	28	25	27	24	22
8	55	43	36	30	51	40	34	29	35	30	26	30	26	23	25	22	20
9	51	39	32	27	48	37	30	26	32	27	23	28	23	21	23	20	18
10	48	36	29	25	45	34	28	23	30	25	21	26	22	19	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3788	3788	3788
5°	3792	3726	3751
10°	3752	3650	3628
15°	3698	3527	3438
20°	3627	3359	3205
25°	3555	3170	2981
30°	3458	2977	2697
35°	3364	2769	2447
40°	3267	2555	2161
45°	3155	2318	1902
50°	3039	2078	1648
55°	2918	1822	1405
60°	2778	1555	1155
65°	2616	1284	1038
70°	2420	1032	938
75°	2173	904	851
80°	1815	750	733
85°	1231	489	544

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3155 cd/sqm

TEST NUMBER: P906499

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	309.9	2.3
10°-20°	850.7	6.2
20°-30°	1194.3	8.7
30°-40°	1301.9	9.5
40°-50°	1196.6	8.7
50°-60°	939.7	6.8
60°-70°	611.7	4.5
70°-80°	314.9	2.3
80°-90°	84.5	0.6
90°-100°	77.9	0.6
100°-110°	290.4	2.1
110°-120°	770.2	5.6
120°-130°	1277.4	9.3
130°-140°	1356.9	9.9
140°-150°	1261.1	9.2
150°-160°	1013.9	7.4
160°-170°	653.3	4.8
170°-180°	224.9	1.6
0°-30°	2354.9	17.2
0°-40°	3656.8	26.6
0°-60°	5793.1	42.2
0°-90°	6804.2	49.6
90°-120°	1138.5	8.3
90°-150°	5033.8	36.7
90°-180°	6926.0	50.4
0°-180°	13730.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3306	3306	3306	3306	3306	
5°	3306	3292	3252	3279	3270	314
15°	3145	3112	3010	2953	2924	886
25°	2855	2759	2561	2439	2394	1313
35°	2460	2307	2044	1855	1789	1540
45°	2011	1810	1496	1284	1212	1553
55°	1529	1296	972	793	736	1366
65°	1032	790	521	419	410	1024
75°	550	341	239	218	216	582
85°	129	66	57	57	57	148
90°	2	20	34	43	46	13
95°	111	55	67	75	74	131
105°	520	571	104	123	130	555
115°	983	1012	1055	263	140	968
125°	1390	1412	1444	1456	1462	1239
135°	1720	1747	1762	1780	1776	1328
145°	1995	1993	2022	2034	2026	1248
155°	2197	2181	2202	2212	2198	1012
165°	2314	2304	2309	2321	2309	654
175°	2368	2356	2359	2371	2354	225
180°	2362	2362	2362	2362	2362	



TEST NUMBER: P906499

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3306.4	3306.4	3306.4	3306.4	3306.4
2.5°	3321.3	3306.4	3273.4	3303.5	3297.5
5°	3306.4	3291.5	3252.4	3279.4	3270.5
7.5°	3279.4	3261.6	3219.7	3231.5	3216.5
10°	3243.5	3222.6	3162.9	3153.7	3135.9
12.5°	3198.8	3171.8	3090.8	3073.0	3040.0
15°	3144.8	3111.8	3010.2	2953.4	2923.5
17.5°	3081.9	3034.0	2908.3	2842.6	2794.6
20°	3010.2	2950.2	2800.7	2726.1	2660.0
22.5°	2932.4	2863.5	2689.9	2588.3	2543.5
25°	2854.6	2758.8	2561.3	2438.8	2393.7
27.5°	2761.9	2660.0	2441.6	2301.0	2232.1
30°	2663.2	2549.2	2309.9	2157.5	2076.5
32.5°	2567.3	2429.6	2184.5	2004.8	1929.9
35°	2459.7	2307.0	2043.8	1855.3	1789.2
37.5°	2354.9	2190.2	1912.1	1705.4	1630.8
40°	2244.2	2064.8	1774.3	1561.9	1484.1
42.5°	2130.5	1939.1	1636.8	1415.3	1340.6
45°	2010.8	1810.2	1496.2	1283.5	1211.8
47.5°	1897.2	1684.8	1361.6	1148.9	1083.2
50°	1771.4	1559.1	1229.9	1023.2	960.6
52.5°	1648.6	1424.1	1104.1	906.7	849.9
55°	1528.9	1295.6	972.4	793.0	736.2
57.5°	1406.4	1167.0	855.9	688.3	640.3
60°	1280.6	1041.3	733.0	580.6	532.7
62.5°	1158.1	918.7	628.3	484.8	461.0
65°	1032.4	789.8	520.6	419.1	409.8
67.5°	912.7	670.2	419.1	367.9	359.1
70°	787.0	553.7	347.0	317.1	305.1
72.5°	667.3	445.7	290.2	266.4	260.3
75°	550.5	341.0	239.4	218.4	215.6
77.5°	434.0	242.2	188.6	176.5	170.5
80°	326.0	173.7	143.5	131.7	131.7
82.5°	227.3	116.8	98.7	92.7	92.7
85°	128.6	65.7	56.8	56.8	56.8
87.5°	47.9	23.8	23.8	21.0	21.0
90°	1.6	20.5	34.1	42.8	46.1
92.5°	42.8	35.9	41.0	44.5	46.1
95°	111.0	54.6	66.6	75.3	73.5
97.5°	199.9	59.9	87.1	92.4	94.0
100°	302.7	68.4	97.4	111.0	114.5
102.5°	415.3	412.1	100.9	119.6	124.8
105°	519.7	571.0	104.3	123.0	129.9
107.5°	641.0	683.7	107.8	126.5	133.4
110°	757.4	793.1	299.2	128.3	135.0

TEST NUMBER: P906499

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	866.8	897.4	868.4	131.5	136.8
115°	982.9	1011.9	1054.7	263.3	140.3
117.5°	1083.8	1117.9	1147.1	902.5	454.7
120°	1196.6	1222.2	1253.1	1273.6	1042.8
122.5°	1292.2	1319.6	1354.0	1364.1	1365.9
125°	1389.7	1412.0	1444.5	1456.5	1461.5
127.5°	1478.6	1502.5	1528.3	1545.4	1547.0
130°	1562.4	1589.8	1608.5	1627.4	1625.8
132.5°	1647.9	1670.2	1688.9	1704.3	1702.7
135°	1719.7	1747.1	1762.4	1779.6	1776.2
137.5°	1794.8	1815.4	1832.6	1849.7	1844.6
140°	1868.3	1882.1	1900.8	1916.2	1907.7
142.5°	1930.0	1942.0	1964.1	1977.7	1969.2
145°	1995.0	1993.2	2022.2	2034.2	2025.7
147.5°	2051.2	2046.2	2075.2	2083.7	2077.0
150°	2106.0	2094.1	2121.5	2131.6	2123.1
152.5°	2152.1	2138.5	2164.1	2174.4	2162.5
155°	2196.6	2181.3	2201.8	2212.0	2198.4
157.5°	2232.5	2218.9	2234.3	2246.3	2232.5
160°	2263.4	2253.0	2263.4	2273.5	2261.5
162.5°	2290.6	2280.4	2288.9	2300.9	2285.5
165°	2314.5	2304.4	2309.4	2321.4	2309.4
167.5°	2333.4	2323.0	2328.3	2340.3	2324.9
170°	2348.8	2338.5	2341.9	2353.9	2338.5
172.5°	2359.0	2348.8	2352.3	2364.2	2348.8
175°	2367.5	2355.5	2359.0	2370.9	2353.9
177.5°	2370.9	2359.0	2360.8	2372.8	2357.3
180°	2362.4	2362.4	2362.4	2362.4	2362.4

TEST NUMBER: P906499

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.70	12.53	12.67	13.50	14.78	7.66	8.49	8.63	9.46	10.74
	3H	13.37	14.11	14.35	15.10	16.40	8.84	9.58	9.82	10.57	11.87
	4H	13.98	14.68	14.97	15.67	16.98	9.29	9.99	10.28	10.98	12.29
	6H	14.40	15.04	15.40	16.03	17.36	9.60	10.25	10.61	11.24	12.56
	8H	14.52	15.13	15.53	16.14	17.46	9.69	10.30	10.70	11.31	12.63
	12H	14.58	15.16	15.59	16.17	17.51	9.73	10.31	10.74	11.32	12.66
4H	2H	11.72	12.41	12.71	13.40	14.72	8.25	8.95	9.25	9.94	11.25
	3H	13.54	14.12	14.55	15.14	16.46	9.60	10.18	10.60	11.20	12.52
	4H	14.23	14.76	15.24	15.77	17.12	10.14	10.67	11.15	11.68	13.03
	6H	14.74	15.19	15.76	16.23	17.57	10.55	11.01	11.58	12.04	13.39
	8H	14.91	15.34	15.94	16.36	17.72	10.67	11.10	11.70	12.13	13.49
	12H	15.00	15.39	16.05	16.43	17.79	10.74	11.12	11.78	12.16	13.53
8H	4H	14.19	14.62	15.22	15.65	17.01	10.41	10.84	11.44	11.87	13.23
	6H	14.75	15.10	15.80	16.18	17.53	10.92	11.28	11.97	12.35	13.70
	8H	14.97	15.28	16.03	16.33	17.71	11.11	11.42	12.17	12.47	13.85
	12H	15.10	15.37	16.16	16.42	17.84	11.22	11.50	12.28	12.55	13.96
12H	4H	14.14	14.53	15.19	15.57	16.94	10.42	10.80	11.46	11.85	13.21
	6H	14.73	15.04	15.79	16.09	17.47	10.97	11.28	12.03	12.34	13.71
	8H	14.95	15.22	16.01	16.27	17.69	11.18	11.45	12.24	12.50	13.92