

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906569

Luminaire Tested: DFN2DIP-SQ3F0-100D070US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906569
REPORT IS A COMBINATION OF REPORTS P901447 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D070US835-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16830.0 lumens
Efficiency: N/A
Efficacy: 111.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 151
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906569

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US835-FLLONL

Luminous Intensity Polar Plot

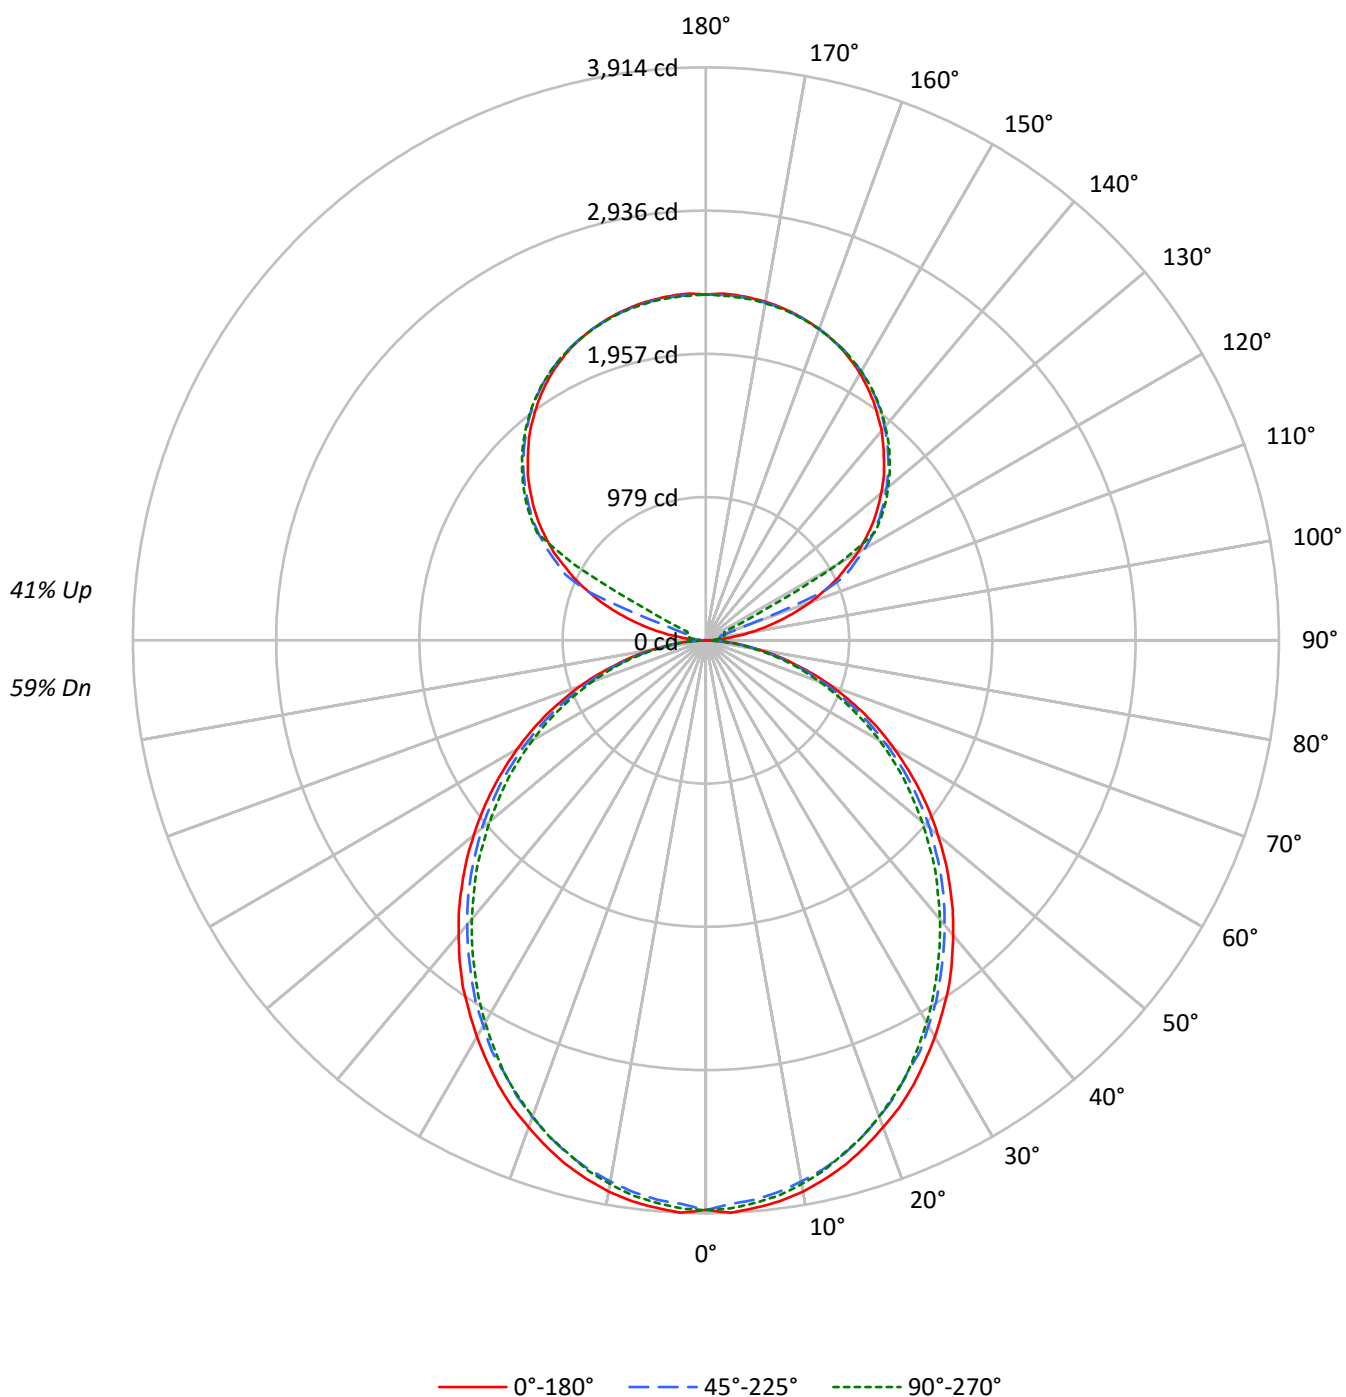

TEST NUMBER: P906569

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	95	91	88	93	89	86	83	77	75	73	67	65	63	57	56	54
2	91	83	77	72	85	78	72	68	68	64	60	59	55	53	50	48	46
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	44	41	39
4	76	65	57	51	71	61	54	48	53	48	43	46	42	38	40	36	34
5	70	58	50	44	65	54	47	41	48	42	37	42	37	33	36	32	29
6	64	52	44	38	60	49	41	36	43	37	33	38	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	30	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	27	23	27	23	21
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4458	4458	4458
5°	4463	4393	4424
10°	4424	4331	4363
15°	4356	4257	4268
20°	4265	4155	4171
25°	4175	4034	4059
30°	4062	3920	3916
35°	3955	3787	3766
40°	3824	3653	3623
45°	3693	3518	3476
50°	3550	3376	3306
55°	3400	3212	3150
60°	3230	3017	2970
65°	3044	2816	2759
70°	2807	2569	2531
75°	2480	2274	2319
80°	2084	1897	1917
85°	1467	1258	1254

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3693 cd/sqm

TEST NUMBER: P906569

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	366.2	2.2
10°-20°	1030.4	6.1
20°-30°	1514.3	9.0
30°-40°	1758.8	10.5
40°-50°	1756.6	10.4
50°-60°	1531.7	9.1
60°-70°	1132.3	6.7
70°-80°	640.6	3.8
80°-90°	173.2	1.0
90°-100°	77.9	0.5
100°-110°	290.4	1.7
110°-120°	770.2	4.6
120°-130°	1277.4	7.6
130°-140°	1356.9	8.1
140°-150°	1261.1	7.5
150°-160°	1013.9	6.0
160°-170°	653.3	3.9
170°-180°	224.9	1.3
0°-30°	2911.0	17.3
0°-40°	4669.7	27.7
0°-60°	7958.0	47.3
0°-90°	9904.2	58.8
90°-120°	1138.5	6.8
90°-150°	5033.8	29.9
90°-180°	6926.0	41.2
0°-180°	16830.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3891	3891	3891	3891	3891	
5°	3891	3876	3835	3865	3858	369
15°	3704	3682	3633	3648	3630	1043
25°	3352	3323	3259	3266	3259	1543
35°	2892	2855	2795	2772	2754	1806
45°	2354	2327	2271	2230	2215	1816
55°	1781	1759	1714	1669	1650	1592
65°	1201	1179	1141	1108	1089	1188
75°	628	621	602	580	588	671
85°	153	150	146	135	131	171
90°	2	20	34	43	46	16
95°	111	55	67	75	74	131
105°	520	571	104	123	130	555
115°	983	1012	1055	263	140	968
125°	1390	1412	1444	1456	1462	1239
135°	1720	1747	1762	1780	1776	1328
145°	1995	1993	2022	2034	2026	1248
155°	2197	2181	2202	2212	2198	1012
165°	2314	2304	2309	2321	2309	654
175°	2368	2356	2359	2371	2354	225
180°	2362	2362	2362	2362	2362	

TEST NUMBER: P906569

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3891.1	3891.1	3891.1	3891.1	3891.1
2.5°	3913.7	3895.0	3853.7	3891.1	3883.9
5°	3891.1	3876.4	3835.1	3864.9	3857.7
7.5°	3864.9	3842.6	3801.3	3831.5	3824.0
10°	3824.0	3797.8	3752.9	3782.7	3771.6
12.5°	3767.6	3745.4	3700.5	3719.2	3711.6
15°	3704.1	3681.9	3633.0	3648.1	3629.5
17.5°	3625.5	3603.3	3554.4	3573.1	3554.4
20°	3539.3	3517.1	3464.7	3475.8	3461.1
22.5°	3453.6	3419.9	3371.0	3371.0	3363.5
25°	3352.4	3322.6	3259.1	3266.2	3259.1
27.5°	3240.0	3213.8	3165.4	3154.3	3135.6
30°	3128.1	3097.9	3041.9	3030.8	3015.7
32.5°	3008.2	2986.0	2926.0	2903.4	2888.3
35°	2892.3	2855.0	2795.0	2772.4	2753.7
37.5°	2761.3	2727.5	2667.6	2641.4	2622.7
40°	2626.7	2596.5	2536.6	2503.3	2488.2
42.5°	2495.7	2465.5	2406.0	2368.3	2346.1
45°	2353.6	2327.4	2271.0	2230.1	2215.1
47.5°	2215.1	2188.9	2128.9	2087.6	2065.4
50°	2069.0	2050.3	1997.9	1945.5	1926.9
52.5°	1926.9	1900.7	1852.2	1811.0	1784.8
55°	1781.2	1758.6	1713.7	1668.8	1650.2
57.5°	1635.1	1616.4	1567.6	1522.8	1507.7
60°	1489.0	1474.3	1421.9	1380.6	1369.5
62.5°	1346.9	1320.7	1283.4	1246.1	1231.0
65°	1201.2	1178.6	1141.3	1107.5	1088.9
67.5°	1051.6	1032.5	999.2	973.0	957.9
70°	913.0	897.9	864.2	838.0	823.3
72.5°	770.9	755.8	737.2	711.0	699.8
75°	628.4	621.3	602.2	580.0	587.5
77.5°	501.4	486.3	478.7	467.6	456.5
80°	374.3	370.4	362.8	351.7	344.2
82.5°	254.5	254.5	250.9	235.8	235.8
85°	153.2	149.7	146.1	134.6	131.0
87.5°	67.5	59.9	52.4	41.3	37.3
90°	1.6	20.5	34.1	42.8	46.1
92.5°	42.8	35.9	41.0	44.5	46.1
95°	111.0	54.6	66.6	75.3	73.5
97.5°	199.9	59.9	87.1	92.4	94.0
100°	302.7	68.4	97.4	111.0	114.5
102.5°	415.3	412.1	100.9	119.6	124.8
105°	519.7	571.0	104.3	123.0	129.9
107.5°	641.0	683.7	107.8	126.5	133.4
110°	757.4	793.1	299.2	128.3	135.0

TEST NUMBER: P906569

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	866.8	897.4	868.4	131.5	136.8
115°	982.9	1011.9	1054.7	263.3	140.3
117.5°	1083.8	1117.9	1147.1	902.5	454.7
120°	1196.6	1222.2	1253.1	1273.6	1042.8
122.5°	1292.2	1319.6	1354.0	1364.1	1365.9
125°	1389.7	1412.0	1444.5	1456.5	1461.5
127.5°	1478.6	1502.5	1528.3	1545.4	1547.0
130°	1562.4	1589.8	1608.5	1627.4	1625.8
132.5°	1647.9	1670.2	1688.9	1704.3	1702.7
135°	1719.7	1747.1	1762.4	1779.6	1776.2
137.5°	1794.8	1815.4	1832.6	1849.7	1844.6
140°	1868.3	1882.1	1900.8	1916.2	1907.7
142.5°	1930.0	1942.0	1964.1	1977.7	1969.2
145°	1995.0	1993.2	2022.2	2034.2	2025.7
147.5°	2051.2	2046.2	2075.2	2083.7	2077.0
150°	2106.0	2094.1	2121.5	2131.6	2123.1
152.5°	2152.1	2138.5	2164.1	2174.4	2162.5
155°	2196.6	2181.3	2201.8	2212.0	2198.4
157.5°	2232.5	2218.9	2234.3	2246.3	2232.5
160°	2263.4	2253.0	2263.4	2273.5	2261.5
162.5°	2290.6	2280.4	2288.9	2300.9	2285.5
165°	2314.5	2304.4	2309.4	2321.4	2309.4
167.5°	2333.4	2323.0	2328.3	2340.3	2324.9
170°	2348.8	2338.5	2341.9	2353.9	2338.5
172.5°	2359.0	2348.8	2352.3	2364.2	2348.8
175°	2367.5	2355.5	2359.0	2370.9	2353.9
177.5°	2370.9	2359.0	2360.8	2372.8	2357.3
180°	2362.4	2362.4	2362.4	2362.4	2362.4

TEST NUMBER: P906569

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.21	14.16	14.09	15.06	16.19	12.77	13.71	13.64	14.61	15.75
	3H	14.87	15.72	15.76	16.63	17.79	14.38	15.23	15.27	16.14	17.30
	4H	15.46	16.26	16.37	17.18	18.35	14.97	15.77	15.87	16.68	17.86
	6H	15.86	16.60	16.78	17.52	18.71	15.36	16.10	16.28	17.02	18.21
	8H	15.97	16.67	16.89	17.61	18.80	15.47	16.17	16.39	17.11	18.29
	12H	16.02	16.69	16.95	17.62	18.83	15.51	16.18	16.44	17.11	18.32
4H	2H	13.68	14.48	14.59	15.39	16.57	13.32	14.13	14.23	15.04	16.21
	3H	15.55	16.22	16.47	17.16	18.35	15.14	15.81	16.06	16.75	17.94
	4H	16.26	16.87	17.19	17.81	19.03	15.84	16.45	16.77	17.39	18.60
	6H	16.78	17.30	17.72	18.27	19.48	16.34	16.87	17.29	17.83	19.05
	8H	16.92	17.42	17.87	18.38	19.60	16.49	16.98	17.44	17.94	19.17
	12H	17.00	17.45	17.97	18.42	19.65	16.55	17.00	17.52	17.97	19.20
8H	4H	16.46	16.95	17.41	17.91	19.14	16.08	16.58	17.03	17.53	18.76
	6H	17.09	17.50	18.06	18.50	19.72	16.70	17.11	17.68	18.11	19.34
	8H	17.31	17.67	18.29	18.66	19.90	16.91	17.27	17.90	18.26	19.51
	12H	17.44	17.76	18.42	18.74	20.03	17.03	17.35	18.01	18.33	19.62
12H	4H	16.45	16.89	17.41	17.87	19.10	16.08	16.52	17.05	17.50	18.73
	6H	17.12	17.48	18.10	18.47	19.71	16.74	17.11	17.73	18.09	19.34
	8H	17.36	17.68	18.35	18.66	19.95	16.98	17.30	17.96	18.28	19.57