

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906659

Luminaire Tested: DFN2DIP-SQ3F0-120D110US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906659
REPORT IS A COMBINATION OF REPORTS P901524 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D110US835-RLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 21090.0 lumens
Efficiency: N/A
Efficacy: 99.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 211.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906659

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US835-RLLONL

Luminous Intensity Polar Plot

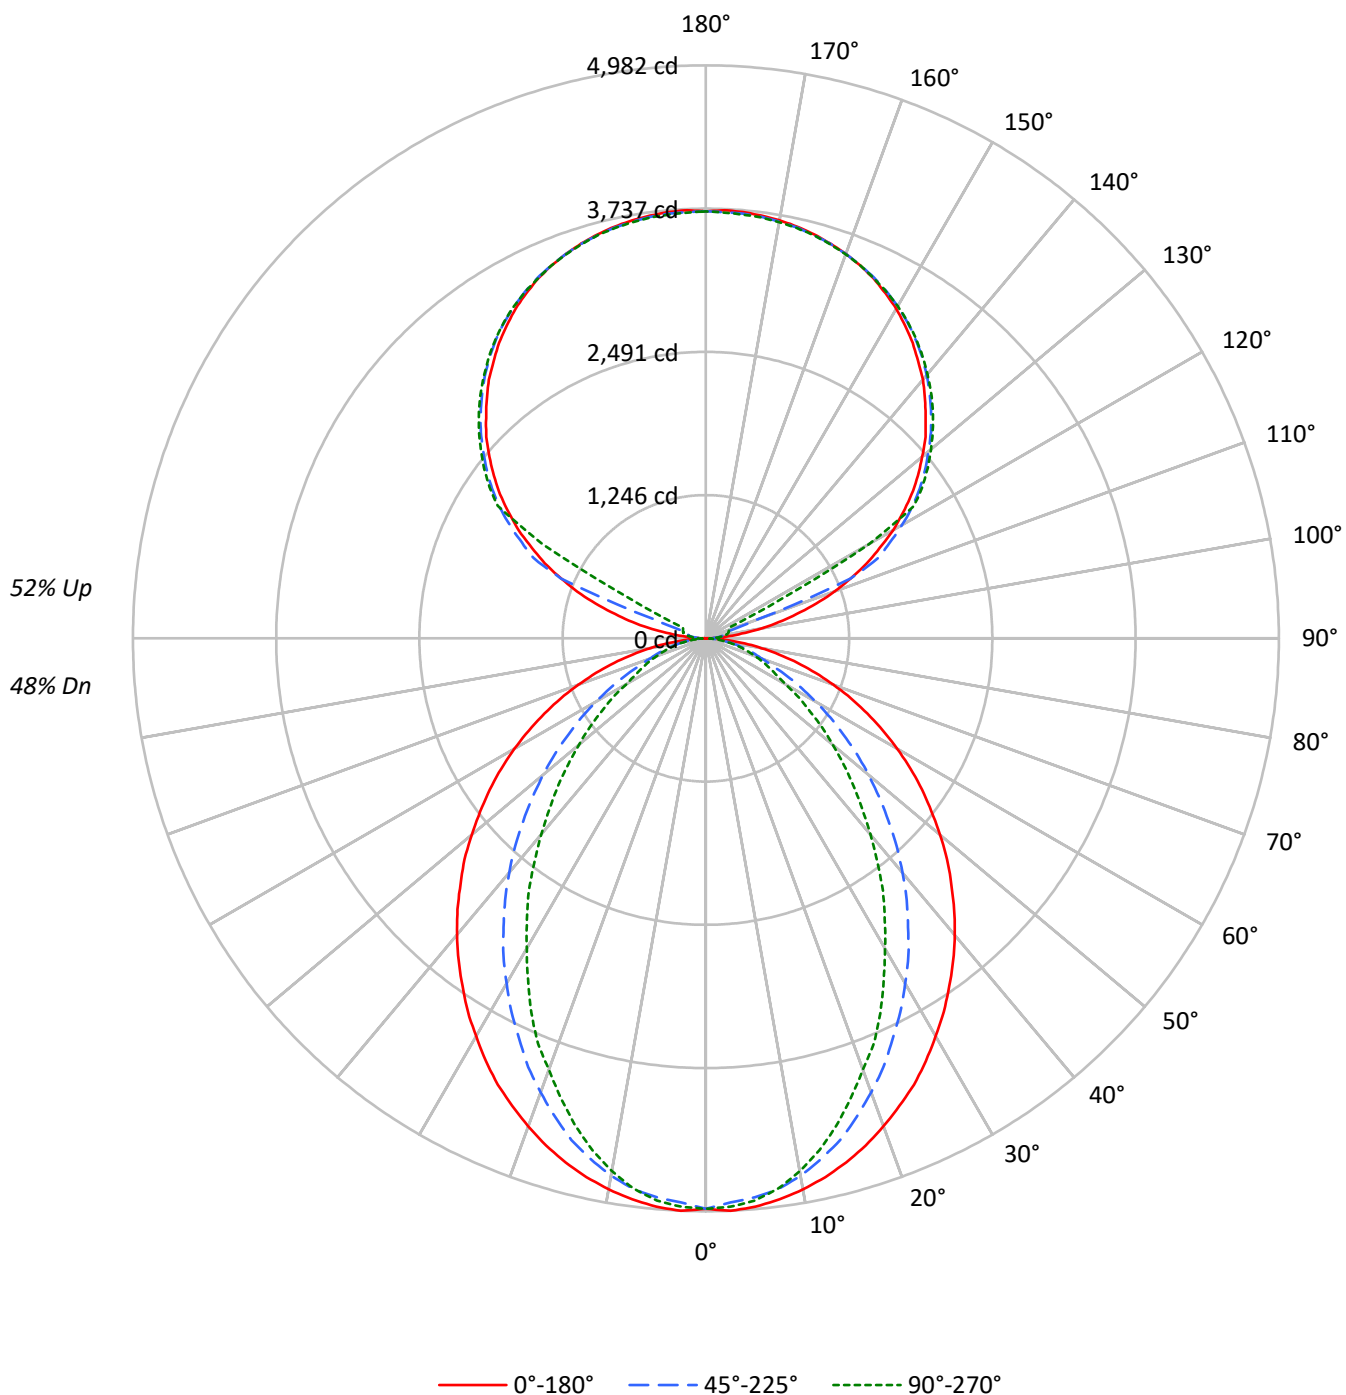

TEST NUMBER: P906659

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	68	68	68	55	55	55
1	98	94	90	87	90	87	83	80	73	71	69	60	59	58	49	48	47
2	90	82	77	72	82	76	71	67	64	61	58	54	51	49	44	42	40
3	82	73	66	60	75	67	61	56	57	53	49	48	45	42	39	37	35
4	75	65	57	51	69	60	53	48	51	46	42	43	39	36	35	33	30
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	36	42	36	32	35	31	28	29	26	24
7	59	47	39	34	54	44	37	32	38	32	29	32	28	25	27	24	21
8	55	43	35	30	51	40	33	29	35	29	25	30	25	22	25	22	19
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	27	23	29	24	21	25	21	18	21	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5683	5683	5683
5°	5688	5589	5626
10°	5628	5475	5442
15°	5547	5291	5157
20°	5441	5038	4808
25°	5332	4755	4471
30°	5188	4465	4045
35°	5046	4154	3670
40°	4901	3833	3241
45°	4733	3476	2852
50°	4559	3117	2473
55°	4377	2734	2108
60°	4167	2333	1733
65°	3924	1927	1558
70°	3629	1548	1407
75°	3259	1356	1276
80°	2723	1125	1100
85°	1847	733	816

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 4733 cd/sqm

TEST NUMBER: P906659

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US835-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	464.8	2.2
10°-20°	1276.0	6.1
20°-30°	1791.5	8.5
30°-40°	1952.8	9.3
40°-50°	1794.9	8.5
50°-60°	1409.6	6.7
60°-70°	917.5	4.4
70°-80°	472.3	2.2
80°-90°	127.1	0.6
90°-100°	122.4	0.6
100°-110°	456.3	2.2
110°-120°	1210.3	5.7
120°-130°	2007.3	9.5
130°-140°	2132.2	10.1
140°-150°	1981.7	9.4
150°-160°	1593.2	7.6
160°-170°	1026.6	4.9
170°-180°	353.3	1.7
0°-30°	3532.3	16.7
0°-40°	5485.2	26.0
0°-60°	8689.6	41.2
0°-90°	10206.5	48.4
90°-120°	1789.0	8.5
90°-150°	7910.3	37.5
90°-180°	10883.0	51.6
0°-180°	21090.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4960	4960	4960	4960	4960	
5°	4960	4937	4879	4919	4906	470
15°	4717	4668	4515	4430	4385	1329
25°	4282	4138	3842	3658	3590	1969
35°	3690	3460	3066	2783	2684	2309
45°	3016	2715	2244	1925	1818	2329
55°	2293	1943	1459	1190	1104	2049
65°	1549	1185	781	629	615	1535
75°	826	511	359	328	323	873
85°	193	99	85	85	85	221
90°	3	32	54	67	72	20
95°	174	86	105	118	116	207
105°	817	897	164	193	204	873
115°	1544	1590	1658	414	220	1521
125°	2184	2219	2270	2289	2297	1948
135°	2702	2746	2769	2797	2791	2088
145°	3135	3132	3178	3197	3183	1961
155°	3452	3428	3460	3476	3455	1591
165°	3637	3621	3629	3648	3629	1028
175°	3720	3702	3707	3726	3699	354
180°	3712	3712	3712	3712	3712	

TEST NUMBER: P906659

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4959.6	4959.6	4959.6	4959.6	4959.6
2.5°	4982.0	4959.6	4910.1	4955.3	4946.2
5°	4959.6	4937.2	4878.6	4919.1	4905.8
7.5°	4919.1	4892.4	4829.6	4847.2	4824.8
10°	4865.3	4833.9	4744.3	4730.5	4703.9
12.5°	4798.1	4757.7	4636.2	4609.6	4560.1
15°	4717.2	4667.7	4515.3	4430.0	4385.3
17.5°	4622.9	4551.0	4362.4	4263.9	4192.0
20°	4515.3	4425.3	4201.0	4089.1	3990.0
22.5°	4398.6	4295.3	4034.8	3882.4	3815.3
25°	4282.0	4138.1	3841.9	3658.1	3590.5
27.5°	4142.9	3990.0	3662.4	3451.5	3348.1
30°	3994.8	3823.9	3464.8	3236.2	3114.8
32.5°	3851.0	3644.3	3276.7	3007.2	2894.8
35°	3689.6	3460.5	3065.7	2782.9	2683.8
37.5°	3532.4	3285.3	2868.1	2558.1	2446.2
40°	3366.2	3097.2	2661.5	2342.9	2226.2
42.5°	3195.7	2908.6	2455.3	2122.9	2011.0
45°	3016.2	2715.3	2244.3	1925.3	1817.6
47.5°	2845.7	2527.2	2042.4	1723.4	1624.8
50°	2657.2	2338.6	1844.8	1534.8	1441.0
52.5°	2472.9	2136.2	1656.2	1360.0	1274.8
55°	2293.4	1943.4	1458.6	1189.5	1104.3
57.5°	2109.5	1750.5	1283.8	1032.4	960.5
60°	1921.0	1561.9	1099.5	871.0	799.1
62.5°	1737.2	1378.1	942.4	727.2	691.4
65°	1548.6	1184.8	781.0	628.6	614.8
67.5°	1369.1	1005.2	628.6	551.9	538.6
70°	1180.5	830.5	520.5	475.7	457.6
72.5°	1001.0	668.6	435.2	399.5	390.5
75°	825.7	511.4	359.1	327.6	323.3
77.5°	651.0	363.3	282.9	264.8	255.7
80°	489.1	260.5	215.2	197.6	197.6
82.5°	341.0	175.2	148.1	139.0	139.0
85°	192.9	98.6	85.2	85.2	85.2
87.5°	71.9	35.7	35.7	31.4	31.4
90°	2.6	32.2	53.6	67.3	72.4
92.5°	67.3	56.5	64.4	69.9	72.4
95°	174.5	85.8	104.6	118.3	115.5
97.5°	314.2	94.1	136.8	145.1	147.7
100°	475.6	107.5	153.1	174.5	179.9
102.5°	652.6	647.5	158.5	187.9	196.2
105°	816.6	897.3	164.0	193.3	204.2
107.5°	1007.4	1074.3	169.4	198.7	209.6
110°	1190.1	1246.3	470.2	201.6	212.1

TEST NUMBER: P906659

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1362.1	1410.2	1364.6	206.7	215.0
115°	1544.5	1590.1	1657.5	413.7	220.4
117.5°	1703.1	1756.7	1802.6	1418.2	714.5
120°	1880.4	1920.6	1969.1	2001.3	1638.6
122.5°	2030.7	2073.7	2127.6	2143.6	2146.5
125°	2183.8	2218.9	2269.9	2288.7	2296.7
127.5°	2323.5	2361.1	2401.6	2428.4	2431.0
130°	2455.2	2498.3	2527.6	2557.3	2554.8
132.5°	2589.5	2624.6	2654.0	2678.2	2675.7
135°	2702.5	2745.5	2769.4	2796.6	2791.1
137.5°	2820.5	2852.7	2879.8	2906.6	2898.6
140°	2936.0	2957.6	2987.0	3011.2	2997.8
142.5°	3032.9	3051.7	3086.5	3107.9	3094.5
145°	3135.0	3132.1	3177.7	3196.6	3183.2
147.5°	3223.4	3215.4	3261.0	3274.4	3263.9
150°	3309.5	3290.7	3333.7	3349.7	3336.3
152.5°	3381.9	3360.5	3400.7	3417.0	3398.2
155°	3451.8	3427.8	3460.0	3476.0	3454.6
157.5°	3508.2	3486.8	3511.1	3529.9	3508.2
160°	3556.7	3540.4	3556.7	3572.6	3553.8
162.5°	3599.4	3583.5	3596.9	3615.7	3591.5
165°	3637.1	3621.1	3629.1	3647.9	3629.1
167.5°	3666.7	3650.5	3658.8	3677.6	3653.4
170°	3691.0	3674.7	3680.1	3699.0	3674.7
172.5°	3706.9	3691.0	3696.4	3715.2	3691.0
175°	3720.3	3701.5	3706.9	3725.8	3699.0
177.5°	3725.8	3706.9	3709.8	3728.6	3704.4
180°	3712.4	3712.4	3712.4	3712.4	3712.4

TEST NUMBER: P906659

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.00	13.81	13.97	14.80	16.10	8.96	9.78	9.94	10.76	12.06
	3H	14.67	15.40	15.66	16.40	17.71	10.14	10.87	11.13	11.87	13.18
	4H	15.27	15.97	16.28	16.96	18.29	10.58	11.28	11.59	12.27	13.60
	6H	15.69	16.33	16.70	17.33	18.67	10.90	11.53	11.91	12.54	13.88
	8H	15.82	16.42	16.83	17.44	18.78	10.99	11.59	12.00	12.61	13.95
	12H	15.88	16.45	16.90	17.46	18.82	11.03	11.60	12.05	12.61	13.97
4H	2H	13.01	13.70	14.02	14.70	16.03	9.55	10.24	10.56	11.24	12.57
	3H	14.83	15.41	15.85	16.44	17.78	10.89	11.47	11.91	12.49	13.83
	4H	15.52	16.05	16.55	17.07	18.43	11.43	11.96	12.46	12.98	14.34
	6H	16.03	16.48	17.07	17.53	18.89	11.84	12.30	12.88	13.34	14.70
	8H	16.21	16.63	17.24	17.66	19.04	11.97	12.39	13.00	13.43	14.80
	12H	16.30	16.68	17.35	17.73	19.11	12.03	12.41	13.08	13.46	14.84
8H	4H	15.49	15.91	16.52	16.95	18.32	11.71	12.13	12.74	13.17	14.54
	6H	16.05	16.40	17.11	17.47	18.85	12.22	12.57	13.28	13.64	15.02
	8H	16.26	16.57	17.33	17.63	19.02	12.40	12.71	13.47	13.77	15.16
	12H	16.40	16.66	17.47	17.72	19.16	12.52	12.79	13.59	13.84	15.28
12H	4H	15.44	15.82	16.49	16.87	18.25	11.71	12.09	12.77	13.14	14.52
	6H	16.02	16.33	17.09	17.39	18.78	12.27	12.57	13.33	13.64	15.03
	8H	16.24	16.51	17.31	17.57	19.00	12.47	12.74	13.54	13.80	15.23

END OF REPORT