

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909074

Luminaire Tested: DFN2DIP-SQ3F0-040D050US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909074
REPORT IS A COMBINATION OF REPORTS P899880 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-040D050US840-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7902.2 lumens
Efficiency: N/A
Efficacy: 114.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 69.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909074

CATALOG NUMBER: DFN2DIP-SQ3F0-040D050US840-RLLFLL

Luminous Intensity Polar Plot

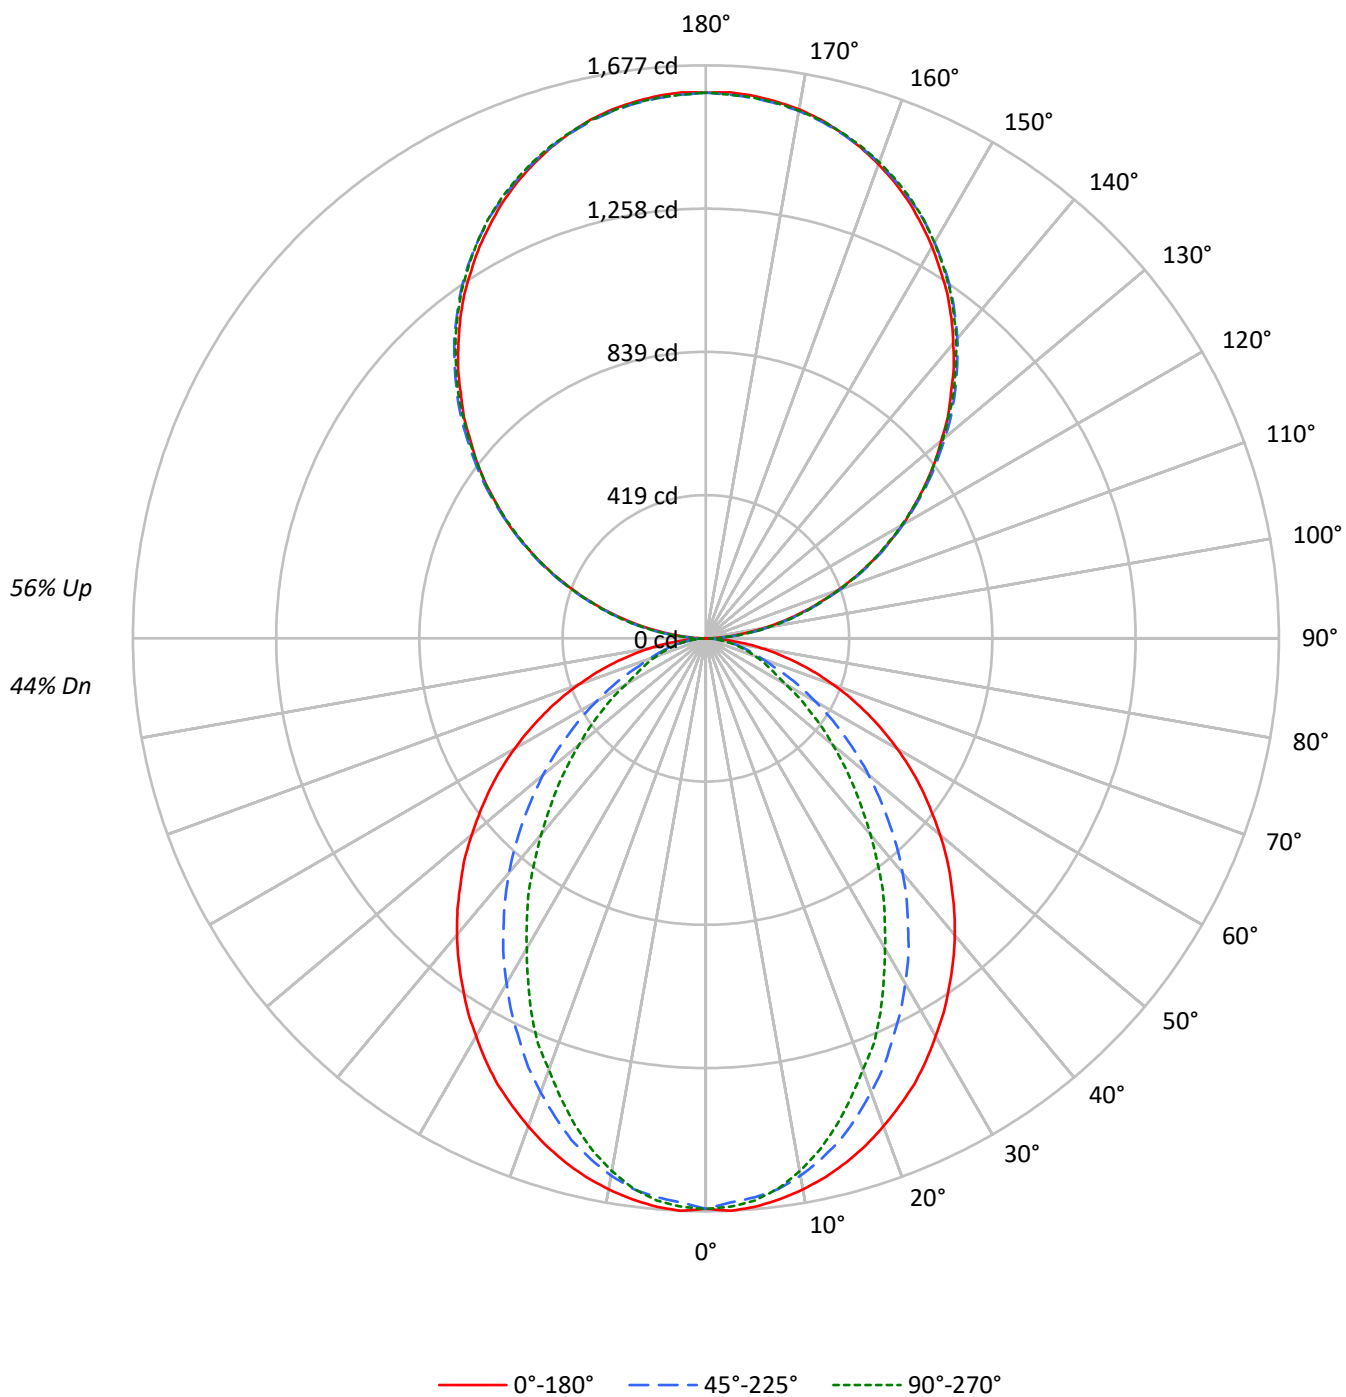

TEST NUMBER: P909074

CATALOG NUMBER: DFN2DIP-SQ3F0-040D050US840-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	97	93	89	86	88	85	82	79	70	68	66	57	56	54	45	44	43
2	88	81	75	71	81	75	70	65	62	59	55	51	48	46	40	38	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	34	32
4	74	64	56	50	68	59	52	47	49	44	40	41	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	37	33	30	29	27	25
6	63	51	43	38	57	47	41	35	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	25	22	20
8	54	42	35	30	50	39	32	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	25	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	19	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1913	1913	1913
5°	1915	1881	1894
10°	1895	1843	1832
15°	1867	1781	1736
20°	1832	1696	1618
25°	1795	1600	1505
30°	1746	1503	1362
35°	1698	1398	1235
40°	1650	1290	1091
45°	1593	1170	960
50°	1535	1049	832
55°	1474	920	709
60°	1402	785	583
65°	1321	649	524
70°	1222	521	473
75°	1097	457	430
80°	917	379	371
85°	621	247	275

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1605 cd/sqm

TEST NUMBER: P909074

CATALOG NUMBER: DFN2DIP-SQ3F0-040D050US840-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	156.5	2.0
10°-20°	429.5	5.4
20°-30°	603.0	7.6
30°-40°	657.4	8.3
40°-50°	604.2	7.6
50°-60°	474.5	6.0
60°-70°	308.9	3.9
70°-80°	159.0	2.0
80°-90°	45.1	0.6
90°-100°	98.8	1.3
100°-110°	314.0	4.0
110°-120°	537.3	6.8
120°-130°	706.6	8.9
130°-140°	793.2	10.0
140°-150°	777.8	9.8
150°-160°	652.5	8.3
160°-170°	432.7	5.5
170°-180°	151.2	1.9
0°-30°	1189.0	15.0
0°-40°	1846.4	23.4
0°-60°	2925.1	37.0
0°-90°	3438.1	43.5
90°-120°	950.1	12.0
90°-150°	3227.7	40.8
90°-180°	4464.0	56.5
0°-180°	7902.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1670	1670	1670	1670	1670	
5°	1670	1662	1642	1656	1651	158
15°	1588	1571	1520	1491	1476	447
25°	1441	1393	1293	1231	1209	663
35°	1242	1165	1032	937	903	777
45°	1015	914	756	648	612	784
55°	772	654	491	400	372	690
65°	521	399	263	212	207	517
75°	278	172	121	110	109	294
85°	65	33	29	29	29	75
90°	1	17	47	44	46	8
95°	70	84	86	86	84	78
105°	290	294	297	299	299	306
115°	539	547	544	543	539	533
125°	784	796	792	788	787	701
135°	1014	1029	1032	1031	1027	784
145°	1232	1241	1249	1250	1245	769
155°	1408	1412	1416	1423	1419	648
165°	1532	1530	1530	1540	1533	432
175°	1594	1590	1587	1597	1589	151
180°	1597	1597	1597	1597	1597	

TEST NUMBER: P909074

CATALOG NUMBER: DFN2DIP-SQ3F0-040D050US840-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1669.5	1669.5	1669.5	1669.5	1669.5
2.5°	1677.1	1669.5	1652.8	1668.1	1665.0
5°	1669.5	1661.9	1642.2	1655.9	1651.4
7.5°	1655.9	1646.9	1625.8	1631.6	1624.2
10°	1637.8	1627.2	1597.0	1592.4	1583.5
12.5°	1615.2	1601.5	1560.6	1551.7	1535.0
15°	1587.9	1571.2	1519.9	1491.3	1476.2
17.5°	1556.2	1532.0	1468.4	1435.3	1411.1
20°	1519.9	1489.7	1414.1	1376.4	1343.1
22.5°	1480.7	1445.9	1358.2	1306.9	1284.3
25°	1441.4	1393.0	1293.2	1231.4	1208.6
27.5°	1394.6	1343.1	1232.8	1161.9	1127.0
30°	1344.7	1287.2	1166.3	1089.3	1048.5
32.5°	1296.4	1226.8	1103.0	1012.3	974.4
35°	1242.0	1164.9	1032.0	936.8	903.4
37.5°	1189.1	1105.9	965.4	861.1	823.4
40°	1133.2	1042.6	896.0	788.7	749.4
42.5°	1075.7	979.1	826.5	714.6	676.9
45°	1015.3	914.0	755.5	648.1	611.9
47.5°	958.0	850.7	687.5	580.2	546.9
50°	894.4	787.2	621.0	516.6	485.0
52.5°	832.4	719.1	557.5	457.8	429.1
55°	772.0	654.2	491.0	400.4	371.7
57.5°	710.1	589.3	432.1	347.5	323.4
60°	646.6	525.7	370.1	293.2	269.0
62.5°	584.8	463.9	317.2	244.8	232.8
65°	521.3	398.8	262.9	211.6	206.9
67.5°	460.9	338.4	211.6	185.8	181.3
70°	397.4	279.5	175.2	160.2	154.0
72.5°	337.0	225.1	146.5	134.5	131.5
75°	277.9	172.2	120.9	110.3	108.9
77.5°	219.1	122.3	95.2	89.2	86.0
80°	164.6	87.7	72.4	66.6	66.6
82.5°	114.8	59.0	49.9	46.8	46.8
85°	64.9	33.2	28.7	28.7	28.7
87.5°	24.2	12.0	12.0	10.6	10.6
90°	1.4	17.4	47.2	44.3	45.7
92.5°	29.9	40.4	41.9	43.3	43.3
95°	70.3	83.8	86.1	86.1	83.8
97.5°	116.9	129.5	134.8	134.8	134.8
100°	170.9	182.0	185.8	185.8	184.4
102.5°	227.7	235.9	241.2	242.7	241.2
105°	289.8	293.7	296.6	298.9	298.9
107.5°	351.4	357.2	357.2	358.2	351.4
110°	411.1	418.9	418.9	418.9	415.0

TEST NUMBER: P909074

CATALOG NUMBER: DFN2DIP-SQ3F0-040D050US840-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	475.6	483.8	482.4	478.6	475.6
115°	539.2	546.9	544.5	543.1	539.2
117.5°	602.3	612.9	606.1	602.3	598.4
120°	665.8	676.4	665.8	665.8	661.5
122.5°	723.6	737.1	730.3	726.5	723.6
125°	784.3	796.3	792.4	788.1	786.7
127.5°	843.4	858.4	853.1	847.3	843.4
130°	898.9	916.2	913.7	910.9	905.5
132.5°	961.0	974.4	975.4	968.7	964.8
135°	1014.4	1029.3	1032.2	1030.8	1026.9
137.5°	1074.1	1086.1	1088.5	1087.5	1081.8
140°	1126.5	1138.6	1145.3	1145.3	1140.0
142.5°	1180.4	1192.6	1196.4	1197.8	1192.6
145°	1231.5	1241.1	1248.8	1250.3	1245.0
147.5°	1277.3	1289.3	1295.1	1297.5	1292.1
150°	1324.4	1332.6	1337.9	1342.2	1337.9
152.5°	1366.3	1374.5	1381.2	1386.5	1381.2
155°	1408.2	1412.0	1416.3	1423.1	1418.8
157.5°	1444.3	1447.1	1449.6	1459.3	1452.5
160°	1476.5	1479.5	1480.9	1489.0	1483.3
162.5°	1506.4	1506.4	1507.8	1517.0	1510.3
165°	1532.0	1530.5	1530.5	1540.1	1533.4
167.5°	1555.0	1550.6	1550.6	1560.3	1553.6
170°	1572.4	1568.5	1567.1	1576.7	1568.5
172.5°	1584.4	1580.5	1579.1	1588.7	1580.5
175°	1594.1	1590.1	1587.3	1596.9	1588.7
177.5°	1599.3	1595.5	1592.6	1600.7	1592.6
180°	1596.9	1596.9	1596.9	1596.9	1596.9

TEST NUMBER: P909074

CATALOG NUMBER: DFN2DIP-SQ3F0-040D050US840-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.73	9.51	9.74	10.53	11.89	4.69	5.47	5.70	6.49	7.85
	3H	10.40	11.09	11.42	12.12	13.51	5.87	6.56	6.89	7.59	8.98
	4H	11.00	11.66	12.04	12.69	14.08	6.31	6.97	7.35	8.00	9.39
	6H	11.41	12.02	12.46	13.06	14.46	6.62	7.23	7.67	8.27	9.67
	8H	11.54	12.12	12.59	13.17	14.57	6.71	7.29	7.76	8.34	9.74
	12H	11.60	12.14	12.65	13.19	14.61	6.75	7.30	7.81	8.34	9.77
4H	2H	8.74	9.40	9.78	10.43	11.82	5.27	5.93	6.32	6.97	8.36
	3H	10.56	11.11	11.61	12.17	13.57	6.61	7.16	7.67	8.22	9.63
	4H	11.24	11.75	12.30	12.80	14.22	7.15	7.66	8.21	8.71	10.14
	6H	11.75	12.18	12.82	13.26	14.68	7.56	7.99	8.63	9.07	10.49
	8H	11.92	12.32	12.99	13.39	14.83	7.69	8.09	8.76	9.16	10.59
	12H	12.01	12.38	13.10	13.46	14.90	7.75	8.11	8.83	9.19	10.63
8H	4H	11.21	11.61	12.28	12.68	14.11	7.43	7.83	8.50	8.90	10.33
	6H	11.76	12.10	12.86	13.21	14.64	7.94	8.27	9.03	9.38	10.81
	8H	11.98	12.27	13.08	13.36	14.82	8.12	8.41	9.22	9.51	10.96
	12H	12.11	12.37	13.21	13.46	14.95	8.23	8.49	9.34	9.58	11.07
12H	4H	11.15	11.52	12.24	12.60	14.04	7.43	7.79	8.52	8.87	10.32
	6H	11.74	12.03	12.84	13.12	14.58	7.98	8.27	9.08	9.37	10.82
	8H	11.95	12.21	13.06	13.30	14.79	8.19	8.44	9.29	9.53	11.02

END OF REPORT

FIELD PERFORMANCE MAY DIFFER FROM LABORATORY PERFORMANCE

8 of 8