

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909082

Luminaire Tested: DFN2DIP-SQ3F0-040D070US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909082
REPORT IS A COMBINATION OF REPORTS P899916 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-040D070US840-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9689.7 lumens
Efficiency: N/A
Efficacy: 114.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 84.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909082

CATALOG NUMBER: DFN2DIP-SQ3F0-040D070US840-RLLFLL

Luminous Intensity Polar Plot

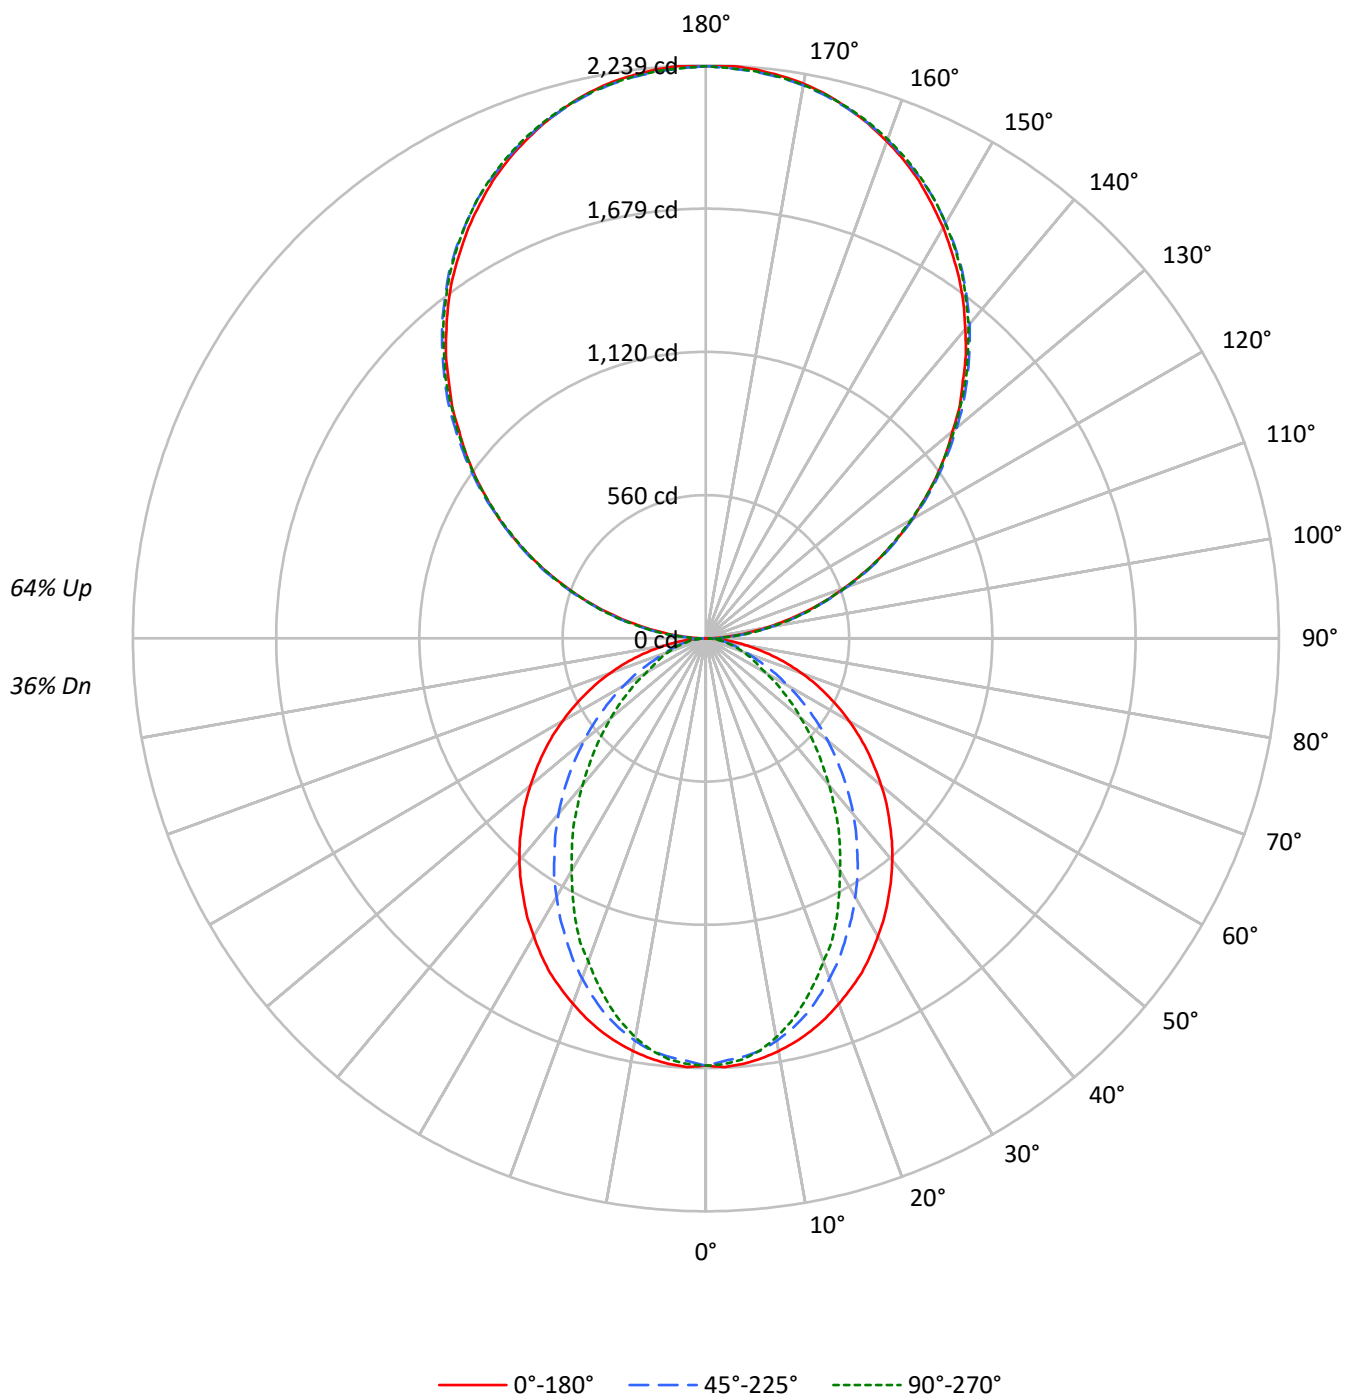

TEST NUMBER: P909082

CATALOG NUMBER: DFN2DIP-SQ3F0-040D070US840-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	75	75	75	58	58	58	43	43	43
1	95	91	87	84	86	82	79	76	66	64	62	52	50	49	38	37	37
2	87	80	74	69	78	72	67	63	59	55	52	46	44	42	34	33	31
3	79	70	63	58	71	64	58	53	52	48	44	41	38	36	31	29	27
4	73	62	55	49	65	57	50	45	46	42	38	37	33	31	27	25	24
5	67	56	48	42	60	51	44	39	42	37	33	33	29	27	25	23	21
6	61	50	42	37	55	46	39	34	37	32	29	30	26	24	23	20	18
7	57	45	37	32	51	41	35	30	34	29	25	27	24	21	21	18	17
8	53	41	33	28	48	38	31	26	31	26	23	25	21	19	19	17	15
9	49	37	30	25	44	34	28	24	28	24	20	23	19	17	18	15	14
10	46	34	27	23	42	31	25	21	26	21	18	21	18	15	16	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1913	1913	1913
5°	1915	1881	1894
10°	1895	1843	1832
15°	1867	1781	1736
20°	1832	1696	1618
25°	1795	1600	1505
30°	1746	1503	1362
35°	1698	1398	1235
40°	1650	1290	1091
45°	1593	1170	960
50°	1535	1049	832
55°	1474	920	709
60°	1402	785	583
65°	1321	649	524
70°	1222	521	473
75°	1097	457	430
80°	917	379	371
85°	621	247	275

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2248 cd/sqm

TEST NUMBER: P909082

CATALOG NUMBER: DFN2DIP-SQ3F0-040D070US840-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	156.5	1.6
10°-20°	429.5	4.4
20°-30°	603.0	6.2
30°-40°	657.4	6.8
40°-50°	604.2	6.2
50°-60°	474.5	4.9
60°-70°	308.9	3.2
70°-80°	159.0	1.6
80°-90°	46.9	0.5
90°-100°	138.3	1.4
100°-110°	439.6	4.5
110°-120°	752.2	7.8
120°-130°	989.3	10.2
130°-140°	1110.5	11.5
140°-150°	1088.9	11.2
150°-160°	913.5	9.4
160°-170°	605.8	6.3
170°-180°	211.7	2.2
0°-30°	1189.0	12.3
0°-40°	1846.4	19.1
0°-60°	2925.1	30.2
0°-90°	3439.9	35.5
90°-120°	1330.1	13.7
90°-150°	4518.8	46.6
90°-180°	6250.0	64.5
0°-180°	9689.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1670	1670	1670	1670	1670	
5°	1670	1662	1642	1656	1651	158
15°	1588	1571	1520	1491	1476	447
25°	1441	1393	1293	1231	1209	663
35°	1242	1165	1032	937	903	777
45°	1015	914	756	648	612	784
55°	772	654	491	400	372	690
65°	521	399	263	212	207	517
75°	278	172	121	110	109	294
85°	65	33	29	29	29	75
90°	2	24	66	62	64	10
95°	98	117	121	121	117	109
105°	406	411	415	419	419	428
115°	755	766	762	760	755	747
125°	1098	1115	1109	1103	1101	981
135°	1420	1441	1445	1443	1438	1098
145°	1724	1738	1748	1750	1743	1077
155°	1972	1977	1983	1992	1986	907
165°	2145	2143	2143	2156	2147	605
175°	2232	2226	2222	2236	2224	212
180°	2236	2236	2236	2236	2236	

TEST NUMBER: P909082

CATALOG NUMBER: DFN2DIP-SQ3F0-040D070US840-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1669.5	1669.5	1669.5	1669.5	1669.5
2.5°	1677.1	1669.5	1652.8	1668.1	1665.0
5°	1669.5	1661.9	1642.2	1655.9	1651.4
7.5°	1655.9	1646.9	1625.8	1631.6	1624.2
10°	1637.8	1627.2	1597.0	1592.4	1583.5
12.5°	1615.2	1601.5	1560.6	1551.7	1535.0
15°	1587.9	1571.2	1519.9	1491.3	1476.2
17.5°	1556.2	1532.0	1468.4	1435.3	1411.1
20°	1519.9	1489.7	1414.1	1376.4	1343.1
22.5°	1480.7	1445.9	1358.2	1306.9	1284.3
25°	1441.4	1393.0	1293.2	1231.4	1208.6
27.5°	1394.6	1343.1	1232.8	1161.9	1127.0
30°	1344.7	1287.2	1166.3	1089.3	1048.5
32.5°	1296.4	1226.8	1103.0	1012.3	974.4
35°	1242.0	1164.9	1032.0	936.8	903.4
37.5°	1189.1	1105.9	965.4	861.1	823.4
40°	1133.2	1042.6	896.0	788.7	749.4
42.5°	1075.7	979.1	826.5	714.6	676.9
45°	1015.3	914.0	755.5	648.1	611.9
47.5°	958.0	850.7	687.5	580.2	546.9
50°	894.4	787.2	621.0	516.6	485.0
52.5°	832.4	719.1	557.5	457.8	429.1
55°	772.0	654.2	491.0	400.4	371.7
57.5°	710.1	589.3	432.1	347.5	323.4
60°	646.6	525.7	370.1	293.2	269.0
62.5°	584.8	463.9	317.2	244.8	232.8
65°	521.3	398.8	262.9	211.6	206.9
67.5°	460.9	338.4	211.6	185.8	181.3
70°	397.4	279.5	175.2	160.2	154.0
72.5°	337.0	225.1	146.5	134.5	131.5
75°	277.9	172.2	120.9	110.3	108.9
77.5°	219.1	122.3	95.2	89.2	86.0
80°	164.6	87.7	72.4	66.6	66.6
82.5°	114.8	59.0	49.9	46.8	46.8
85°	64.9	33.2	28.7	28.7	28.7
87.5°	24.2	12.0	12.0	10.6	10.6
90°	2.0	24.2	66.0	62.0	64.0
92.5°	41.8	56.7	58.7	60.7	60.7
95°	98.4	117.2	120.7	120.7	117.2
97.5°	163.8	181.3	188.7	188.7	188.7
100°	239.2	254.8	260.1	260.1	258.1
102.5°	318.8	330.2	337.7	339.7	337.7
105°	405.8	411.1	415.2	418.6	418.6
107.5°	492.0	500.1	500.1	501.5	492.0
110°	575.6	586.4	586.4	586.4	581.0

TEST NUMBER: P909082

CATALOG NUMBER: DFN2DIP-SQ3F0-040D070US840-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	665.9	677.4	675.4	669.9	665.9
115°	754.9	765.7	762.3	760.3	754.9
117.5°	843.1	858.0	848.6	843.1	837.8
120°	932.1	947.0	932.1	932.1	926.0
122.5°	1013.0	1031.9	1022.5	1017.0	1013.0
125°	1097.9	1114.8	1109.4	1103.4	1101.4
127.5°	1180.8	1201.7	1194.4	1186.3	1180.8
130°	1258.4	1282.6	1279.3	1275.3	1267.8
132.5°	1345.3	1364.2	1365.5	1356.1	1350.7
135°	1420.2	1441.0	1445.1	1443.0	1437.6
137.5°	1503.7	1520.6	1523.9	1522.6	1514.5
140°	1577.2	1594.1	1603.5	1603.5	1596.1
142.5°	1652.6	1669.5	1674.9	1676.9	1669.5
145°	1724.1	1737.6	1748.4	1750.4	1743.0
147.5°	1788.2	1805.0	1813.1	1816.4	1809.1
150°	1854.2	1865.6	1873.1	1879.2	1873.1
152.5°	1912.8	1924.3	1933.7	1941.2	1933.7
155°	1971.5	1976.8	1983.0	1992.4	1986.3
157.5°	2022.1	2026.1	2029.4	2043.0	2033.5
160°	2067.2	2071.2	2073.3	2084.7	2076.6
162.5°	2109.0	2109.0	2111.0	2123.7	2114.4
165°	2144.7	2142.6	2142.6	2156.2	2146.7
167.5°	2177.1	2171.0	2171.0	2184.4	2175.0
170°	2201.3	2196.0	2193.9	2207.4	2196.0
172.5°	2218.2	2212.7	2210.7	2224.2	2212.7
175°	2231.6	2226.2	2222.2	2235.6	2224.2
177.5°	2239.1	2233.6	2229.6	2241.1	2229.6
180°	2235.6	2235.6	2235.6	2235.6	2235.6

TEST NUMBER: P909082

CATALOG NUMBER: DFN2DIP-SQ3F0-040D070US840-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.84	8.56	8.92	9.64	11.10	3.80	4.52	4.88	5.60	7.06
	3H	9.50	10.15	10.59	11.23	12.72	4.97	5.62	6.06	6.70	8.19
	4H	10.10	10.72	11.20	11.80	13.29	5.41	6.03	6.51	7.11	8.60
	6H	10.52	11.08	11.62	12.17	13.67	5.72	6.29	6.83	7.38	8.88
	8H	10.64	11.17	11.75	12.28	13.77	5.81	6.34	6.92	7.45	8.94
	12H	10.69	11.20	11.81	12.30	13.82	5.84	6.35	6.96	7.45	8.97
4H	2H	7.84	8.45	8.95	9.54	11.03	4.38	4.99	5.48	6.08	7.57
	3H	9.65	10.17	10.77	11.28	12.78	5.71	6.22	6.82	7.33	8.84
	4H	10.34	10.81	11.45	11.91	13.43	6.25	6.72	7.36	7.82	9.34
	6H	10.84	11.25	11.97	12.37	13.89	6.66	7.06	7.78	8.18	9.70
	8H	11.01	11.39	12.14	12.51	14.04	6.78	7.15	7.90	8.27	9.80
	12H	11.10	11.44	12.24	12.57	14.11	6.84	7.18	7.97	8.30	9.84
8H	4H	10.30	10.67	11.42	11.79	13.32	6.52	6.89	7.64	8.01	9.54
	6H	10.85	11.16	12.00	12.32	13.85	7.03	7.33	8.17	8.49	10.02
	8H	11.07	11.34	12.22	12.48	14.02	7.21	7.48	8.36	8.62	10.17
	12H	11.20	11.44	12.35	12.57	14.16	7.32	7.56	8.47	8.69	10.28
12H	4H	10.24	10.58	11.38	11.71	13.25	6.52	6.86	7.66	7.99	9.52
	6H	10.83	11.10	11.98	12.24	13.79	7.07	7.34	8.22	8.48	10.03
	8H	11.04	11.28	12.19	12.41	14.00	7.27	7.51	8.43	8.65	10.23

END OF REPORT