

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909093

Luminaire Tested: DFN2DIP-SQ3F0-040D100US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909093
REPORT IS A COMBINATION OF REPORTS P901489 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-040D100US840-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13996.7 lumens
Efficiency: N/A
Efficacy: 127.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 109.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909093

CATALOG NUMBER: DFN2DIP-SQ3F0-040D100US840-FLLONL

Luminous Intensity Polar Plot

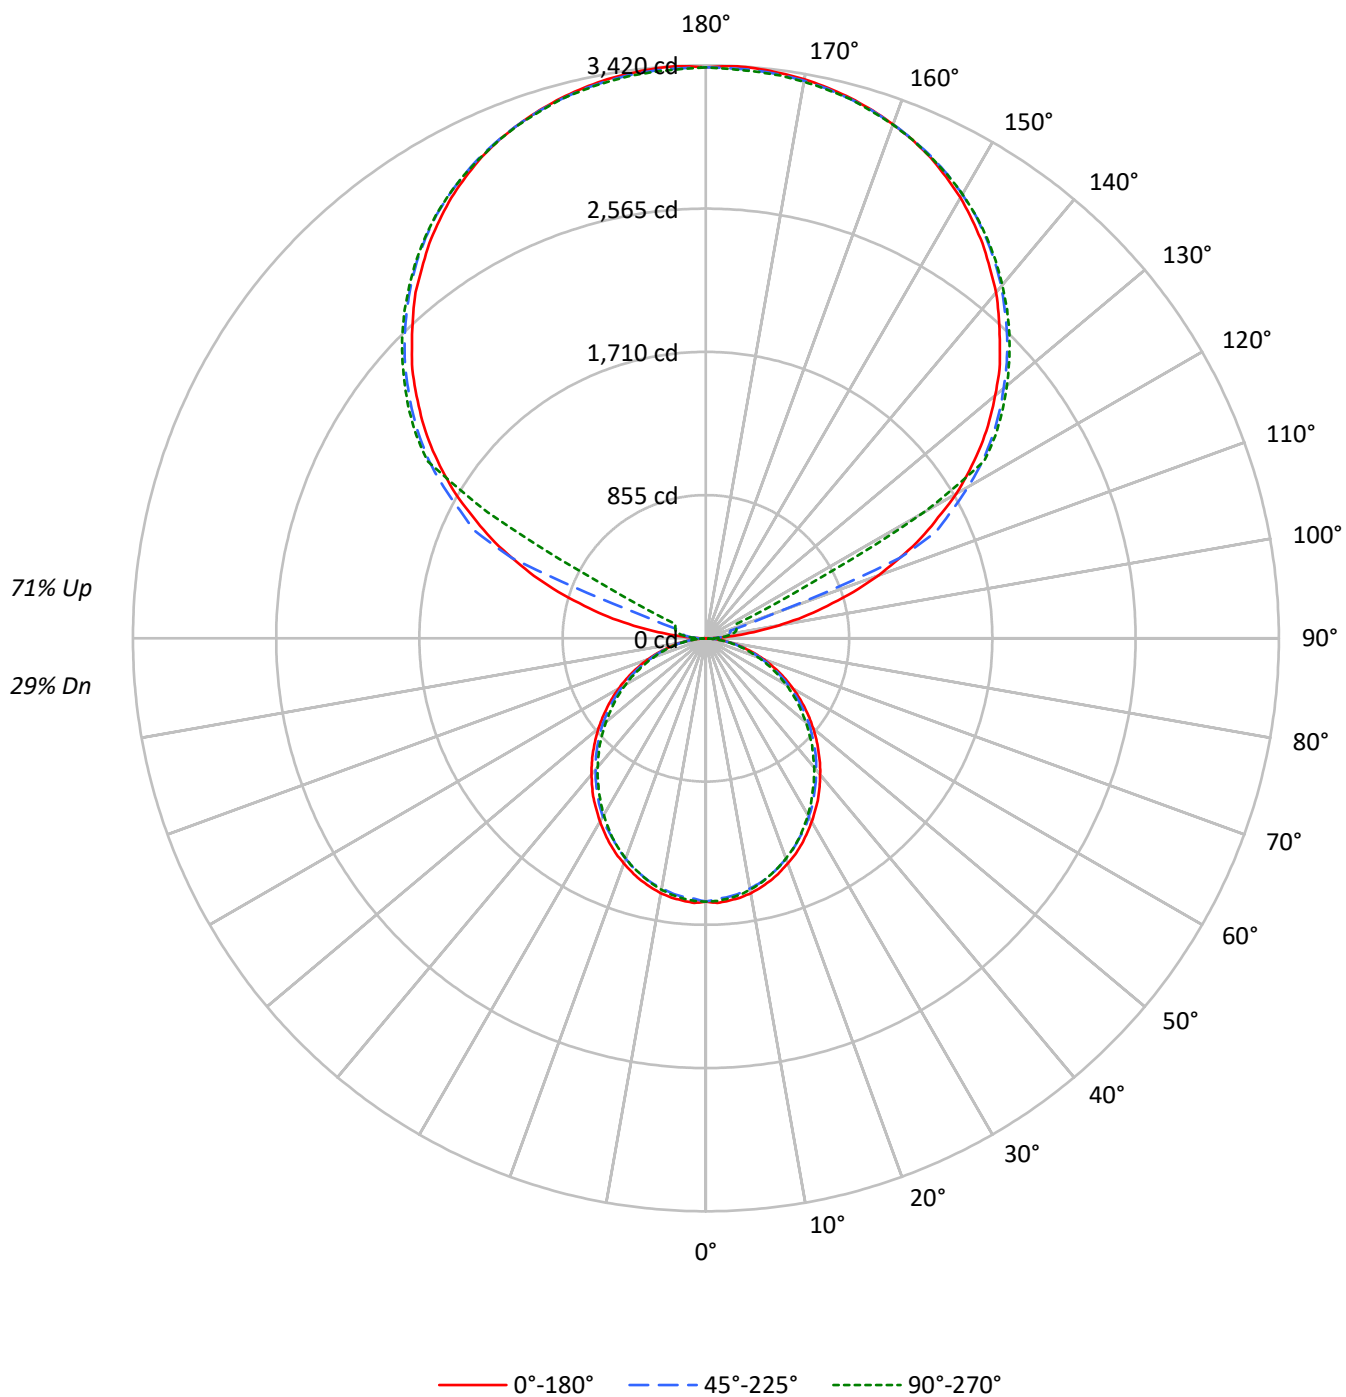

TEST NUMBER: P909093

CATALOG NUMBER: DFN2DIP-SQ3F0-040D100US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	91	91	91	91	71	71	71	53	53	53	36	36	36
1	93	89	85	82	83	80	77	74	62	60	58	47	45	44	32	31	31
2	85	77	72	67	76	70	65	60	55	51	48	41	39	37	28	27	26
3	77	68	61	55	69	61	55	50	48	44	41	36	33	31	25	23	22
4	71	60	53	47	63	54	48	43	43	38	34	32	29	27	22	21	19
5	65	53	46	40	58	48	41	36	38	33	30	29	26	23	20	18	16
6	59	48	40	34	53	43	36	31	34	29	26	26	23	20	18	16	14
7	55	43	35	30	49	39	32	27	31	26	23	24	20	18	17	14	13
8	51	39	31	26	45	35	29	24	28	23	20	22	18	16	15	13	11
9	47	35	28	23	42	32	26	21	26	21	18	20	16	14	14	12	10
10	44	32	25	21	39	29	23	19	24	19	16	18	15	13	13	11	9

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1801	1801	1801
5°	1803	1775	1787
10°	1787	1750	1762
15°	1759	1720	1724
20°	1723	1678	1685
25°	1686	1629	1639
30°	1641	1584	1582
35°	1598	1530	1521
40°	1545	1475	1463
45°	1492	1421	1404
50°	1434	1364	1335
55°	1373	1297	1272
60°	1305	1219	1200
65°	1229	1137	1115
70°	1134	1038	1022
75°	1002	919	937
80°	842	766	775
85°	593	508	507

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2332 cd/sqm

TEST NUMBER: P909093

CATALOG NUMBER: DFN2DIP-SQ3F0-040D100US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.9	1.1
10°-20°	416.2	3.0
20°-30°	611.7	4.4
30°-40°	710.5	5.1
40°-50°	709.6	5.1
50°-60°	618.7	4.4
60°-70°	457.4	3.3
70°-80°	258.8	1.8
80°-90°	74.3	0.5
90°-100°	112.4	0.8
100°-110°	418.9	3.0
110°-120°	1111.1	7.9
120°-130°	1842.9	13.2
130°-140°	1957.5	14.0
140°-150°	1819.3	13.0
150°-160°	1462.7	10.5
160°-170°	942.5	6.7
170°-180°	324.4	2.3
0°-30°	1175.9	8.4
0°-40°	1886.3	13.5
0°-60°	3214.6	23.0
0°-90°	4005.0	28.6
90°-120°	1642.4	11.7
90°-150°	7262.1	51.9
90°-180°	9992.0	71.4
0°-180°	13996.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1572	1572	1572	1572	1572	
5°	1572	1566	1549	1561	1558	149
15°	1496	1487	1468	1474	1466	421
25°	1354	1342	1316	1319	1316	623
35°	1168	1153	1129	1120	1112	730
45°	951	940	917	901	895	734
55°	720	710	692	674	667	643
65°	485	476	461	447	440	480
75°	254	251	243	234	237	271
85°	62	60	59	54	53	69
90°	2	30	49	62	66	13
95°	160	79	96	109	106	190
105°	750	824	151	177	187	801
115°	1418	1460	1522	380	202	1396
125°	2005	2037	2084	2101	2108	1788
135°	2481	2520	2542	2567	2562	1916
145°	2878	2876	2917	2935	2922	1800
155°	3169	3147	3176	3191	3172	1460
165°	3339	3324	3332	3349	3332	943
175°	3416	3398	3403	3420	3396	325
180°	3408	3408	3408	3408	3408	

TEST NUMBER: P909093

CATALOG NUMBER: DFN2DIP-SQ3F0-040D100US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1571.8	1571.8	1571.8	1571.8	1571.8
2.5°	1580.9	1573.4	1556.7	1571.8	1568.9
5°	1571.8	1565.8	1549.1	1561.2	1558.3
7.5°	1561.2	1552.2	1535.5	1547.7	1544.7
10°	1544.7	1534.1	1516.0	1528.0	1523.5
12.5°	1521.9	1512.9	1494.8	1502.4	1499.2
15°	1496.2	1487.2	1467.5	1473.6	1466.1
17.5°	1464.5	1455.5	1435.8	1443.3	1435.8
20°	1429.7	1420.7	1399.6	1404.0	1398.2
22.5°	1395.0	1381.4	1361.7	1361.7	1358.7
25°	1354.1	1342.1	1316.5	1319.4	1316.5
27.5°	1308.8	1298.2	1278.7	1274.1	1266.7
30°	1263.5	1251.4	1228.8	1224.3	1218.2
32.5°	1215.2	1206.2	1181.9	1172.9	1166.7
35°	1168.3	1153.3	1129.0	1119.9	1112.4
37.5°	1115.4	1101.8	1077.5	1067.0	1059.4
40°	1061.1	1048.8	1024.6	1011.2	1005.1
42.5°	1008.1	995.9	971.9	956.6	947.7
45°	950.7	940.2	917.4	900.9	894.7
47.5°	894.7	884.1	860.0	843.3	834.4
50°	835.8	828.2	807.1	785.9	778.3
52.5°	778.3	767.8	748.2	731.5	720.9
55°	719.5	710.3	692.3	674.1	666.6
57.5°	660.5	653.0	633.2	615.1	609.0
60°	601.5	595.5	574.4	557.7	553.2
62.5°	544.1	533.5	518.5	503.3	497.3
65°	485.2	476.1	461.0	447.4	439.9
67.5°	424.7	417.1	403.6	393.0	387.0
70°	368.8	362.7	349.1	338.5	332.5
72.5°	311.4	305.3	297.8	287.2	282.7
75°	253.9	251.0	243.3	234.3	237.3
77.5°	202.5	196.4	193.4	188.8	184.4
80°	151.2	149.6	146.5	142.1	139.1
82.5°	102.8	102.8	101.4	95.2	95.2
85°	61.9	60.5	59.0	54.3	52.9
87.5°	27.3	24.2	21.2	16.7	15.0
90°	2.3	29.6	49.2	61.8	66.4
92.5°	61.8	51.8	59.2	64.1	66.4
95°	160.2	78.8	96.0	108.7	106.0
97.5°	288.4	86.3	125.6	133.2	135.6
100°	436.7	98.7	140.6	160.2	165.2
102.5°	599.2	594.5	145.5	172.5	180.1
105°	749.7	823.7	150.6	177.4	187.4
107.5°	924.8	986.3	155.5	182.5	192.4
110°	1092.6	1144.2	431.6	185.1	194.7

TEST NUMBER: P909093

CATALOG NUMBER: DFN2DIP-SQ3F0-040D100US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1250.4	1294.6	1252.8	189.8	197.4
115°	1418.0	1459.9	1521.7	379.8	202.4
117.5°	1563.5	1612.8	1654.9	1302.0	656.0
120°	1726.4	1763.2	1807.8	1837.3	1504.4
122.5°	1864.3	1903.8	1953.3	1967.9	1970.6
125°	2004.9	2037.1	2084.0	2101.2	2108.5
127.5°	2133.1	2167.7	2204.8	2229.5	2231.8
130°	2254.0	2293.6	2320.6	2347.7	2345.4
132.5°	2377.3	2409.5	2436.5	2458.7	2456.4
135°	2481.0	2520.5	2542.5	2567.4	2562.4
137.5°	2589.4	2619.0	2643.8	2668.5	2661.1
140°	2695.3	2715.3	2742.2	2764.5	2752.2
142.5°	2784.4	2801.7	2833.6	2853.2	2841.0
145°	2878.1	2875.5	2917.4	2934.7	2922.3
147.5°	2959.2	2951.9	2993.7	3006.1	2996.5
150°	3038.3	3021.0	3060.6	3075.2	3062.9
152.5°	3104.7	3085.1	3122.1	3136.9	3119.7
155°	3169.0	3146.9	3176.5	3191.2	3171.6
157.5°	3220.8	3201.2	3223.4	3240.7	3220.8
160°	3265.3	3250.4	3265.3	3279.9	3262.7
162.5°	3304.5	3289.8	3302.2	3319.4	3297.2
165°	3339.0	3324.4	3331.7	3349.0	3331.7
167.5°	3366.3	3351.3	3359.0	3376.3	3354.0
170°	3388.5	3373.7	3378.6	3395.9	3373.7
172.5°	3403.1	3388.5	3393.6	3410.8	3388.5
175°	3415.5	3398.2	3403.1	3420.5	3395.9
177.5°	3420.5	3403.1	3405.9	3423.1	3400.8
180°	3408.2	3408.2	3408.2	3408.2	3408.2

TEST NUMBER: P909093

CATALOG NUMBER: DFN2DIP-SQ3F0-040D100US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.88	7.57	8.00	8.69	10.23	6.43	7.13	7.55	8.24	9.79
	3H	8.52	9.14	9.65	10.27	11.83	8.03	8.65	9.16	9.78	11.34
	4H	9.10	9.69	10.23	10.81	12.38	8.60	9.19	9.74	10.32	11.89
	6H	9.48	10.03	10.63	11.16	12.74	8.98	9.53	10.13	10.65	12.23
	8H	9.58	10.10	10.73	11.24	12.81	9.08	9.60	10.23	10.74	12.31
	12H	9.62	10.12	10.78	11.25	12.85	9.11	9.61	10.27	10.74	12.34
4H	2H	7.31	7.91	8.46	9.03	10.60	6.96	7.55	8.10	8.67	10.24
	3H	9.16	9.65	10.31	10.80	12.38	8.75	9.24	9.90	10.39	11.97
	4H	9.86	10.32	11.02	11.45	13.06	9.44	9.89	10.59	11.03	12.63
	6H	10.36	10.75	11.52	11.91	13.50	9.93	10.32	11.09	11.48	13.07
	8H	10.51	10.87	11.67	12.02	13.63	10.07	10.43	11.23	11.59	13.19
	12H	10.57	10.90	11.75	12.06	13.68	10.12	10.45	11.30	11.61	13.23
8H	4H	10.04	10.40	11.20	11.56	13.16	9.66	10.03	10.82	11.18	12.79
	6H	10.66	10.96	11.84	12.15	13.76	10.27	10.57	11.45	11.77	13.37
	8H	10.87	11.14	12.06	12.31	13.93	10.48	10.74	11.67	11.92	13.54
	12H	10.99	11.23	12.18	12.40	14.05	10.58	10.81	11.77	11.98	13.64
12H	4H	10.02	10.35	11.19	11.51	13.12	9.65	9.98	10.82	11.14	12.75
	6H	10.69	10.95	11.87	12.12	13.74	10.31	10.57	11.50	11.75	13.37
	8H	10.92	11.15	12.10	12.32	13.97	10.53	10.76	11.72	11.94	13.59

END OF REPORT