

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909115

Luminaire Tested: DFN2DIP-SQ3F0-050D060US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909115
REPORT IS A COMBINATION OF REPORTS P901420 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D060US840-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10290.5 lumens
Efficiency: N/A
Efficacy: 117.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 87.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909115

CATALOG NUMBER: DFN2DIP-SQ3F0-050D060US840-RLLONL

Luminous Intensity Polar Plot

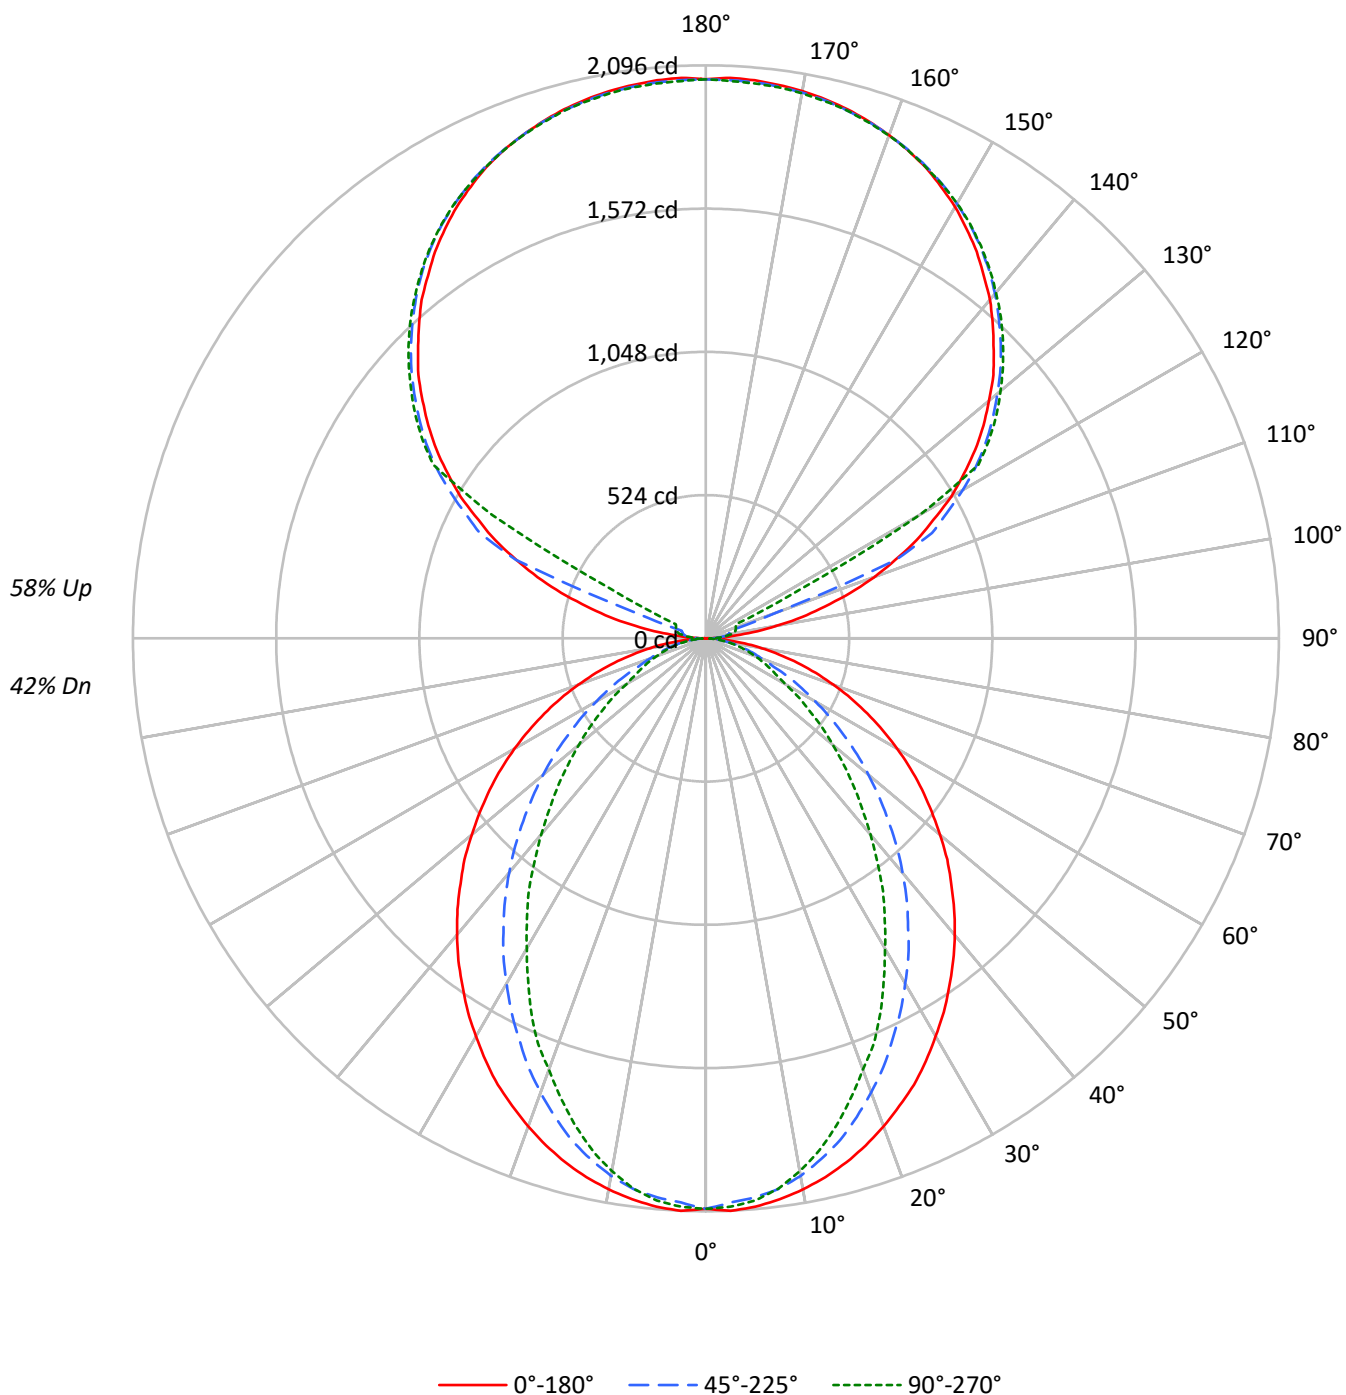

TEST NUMBER: P909115

CATALOG NUMBER: DFN2DIP-SQ3F0-050D060US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	43	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	46	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	39	34	30	32	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	27	33	28	24	27	23	20	22	19	17
9	50	38	31	26	46	35	29	25	30	25	22	25	21	18	20	17	15
10	47	35	28	23	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2391	2391	2391
5°	2393	2352	2368
10°	2368	2304	2290
15°	2334	2226	2170
20°	2290	2120	2023
25°	2244	2001	1881
30°	2183	1879	1702
35°	2123	1748	1544
40°	2062	1612	1364
45°	1992	1463	1200
50°	1918	1312	1040
55°	1842	1150	887
60°	1753	982	729
65°	1651	811	656
70°	1527	651	592
75°	1371	571	537
80°	1146	474	463
85°	778	309	344

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1992 cd/sqm

TEST NUMBER: P909115

CATALOG NUMBER: DFN2DIP-SQ3F0-050D060US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.6	1.9
10°-20°	536.9	5.2
20°-30°	753.8	7.3
30°-40°	821.7	8.0
40°-50°	755.2	7.3
50°-60°	593.1	5.8
60°-70°	386.1	3.8
70°-80°	198.7	1.9
80°-90°	54.3	0.5
90°-100°	67.4	0.7
100°-110°	251.4	2.4
110°-120°	666.7	6.5
120°-130°	1105.7	10.7
130°-140°	1174.5	11.4
140°-150°	1091.6	10.6
150°-160°	877.6	8.5
160°-170°	565.5	5.5
170°-180°	194.6	1.9
0°-30°	1486.3	14.4
0°-40°	2308.0	22.4
0°-60°	3656.4	35.5
0°-90°	4295.6	41.7
90°-120°	985.5	9.6
90°-150°	4357.2	42.3
90°-180°	5995.0	58.3
0°-180°	10290.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2087	2087	2087	2087	2087	
5°	2087	2078	2053	2070	2064	198
15°	1985	1964	1900	1864	1845	559
25°	1802	1741	1617	1539	1511	829
35°	1552	1456	1290	1171	1129	972
45°	1269	1143	944	810	765	980
55°	965	818	614	500	465	862
65°	652	499	329	264	259	646
75°	348	215	151	138	136	368
85°	81	42	36	36	36	93
90°	1	18	30	37	40	10
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P909115

CATALOG NUMBER: DFN2DIP-SQ3F0-050D060US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2086.9	2086.9	2086.9	2086.9	2086.9
2.5°	2096.3	2086.9	2066.1	2085.1	2081.2
5°	2086.9	2077.5	2052.9	2069.8	2064.3
7.5°	2069.8	2058.6	2032.2	2039.6	2030.1
10°	2047.2	2034.0	1996.3	1990.5	1979.2
12.5°	2018.9	2002.0	1950.9	1939.6	1918.7
15°	1984.9	1964.1	1900.0	1864.1	1845.2
17.5°	1945.2	1915.0	1835.6	1794.1	1763.8
20°	1900.0	1862.1	1767.7	1720.6	1678.9
22.5°	1850.9	1807.4	1697.8	1633.7	1605.4
25°	1801.7	1741.2	1616.6	1539.2	1510.8
27.5°	1743.2	1678.9	1541.1	1452.3	1408.9
30°	1680.9	1609.0	1457.9	1361.7	1310.6
32.5°	1620.4	1533.5	1378.8	1265.4	1218.1
35°	1552.5	1456.1	1290.0	1170.9	1129.3
37.5°	1486.3	1382.4	1206.9	1076.4	1029.4
40°	1416.4	1303.2	1119.8	985.8	936.8
42.5°	1344.7	1223.9	1033.1	893.2	846.2
45°	1269.2	1142.6	944.3	810.1	764.8
47.5°	1197.4	1063.4	859.4	725.2	683.7
50°	1118.1	984.0	776.3	645.8	606.3
52.5°	1040.6	898.9	696.9	572.3	536.4
55°	965.0	817.7	613.7	500.5	464.6
57.5°	887.7	736.6	540.2	434.4	404.1
60°	808.3	657.2	462.6	366.5	336.2
62.5°	730.9	579.9	396.6	306.0	290.9
65°	651.6	498.6	328.6	264.5	258.7
67.5°	576.0	423.0	264.5	232.3	226.6
70°	496.8	349.4	219.0	200.2	192.6
72.5°	421.2	281.3	183.2	168.1	164.3
75°	347.5	215.2	151.1	137.8	136.0
77.5°	273.9	152.9	119.1	111.4	107.6
80°	205.8	109.6	90.6	83.1	83.1
82.5°	143.5	73.7	62.3	58.5	58.5
85°	81.2	41.5	35.9	35.9	35.9
87.5°	30.3	15.0	15.0	13.2	13.2
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8



TEST NUMBER: P909115

CATALOG NUMBER: DFN2DIP-SQ3F0-050D060US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P909115

CATALOG NUMBER: DFN2DIP-SQ3F0-050D060US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.32	10.09	10.35	11.12	12.51	5.28	6.05	6.31	7.08	8.47
	3H	10.99	11.67	12.03	12.72	14.12	6.46	7.14	7.50	8.19	9.59
	4H	11.59	12.24	12.64	13.28	14.70	6.90	7.55	7.95	8.59	10.01
	6H	12.00	12.60	13.07	13.65	15.08	7.21	7.81	8.27	8.86	10.28
	8H	12.13	12.70	13.19	13.76	15.18	7.30	7.87	8.36	8.93	10.35
	12H	12.19	12.72	13.26	13.78	15.23	7.34	7.88	8.41	8.93	10.38
4H	2H	9.33	9.98	10.39	11.02	12.44	5.86	6.51	6.92	7.56	8.97
	3H	11.15	11.69	12.21	12.76	14.19	7.20	7.74	8.27	8.82	10.24
	4H	11.83	12.33	12.90	13.39	14.84	7.74	8.24	8.81	9.30	10.75
	6H	12.34	12.76	13.42	13.85	15.29	8.15	8.57	9.23	9.66	11.11
	8H	12.51	12.91	13.59	13.99	15.44	8.27	8.67	9.36	9.75	11.21
	12H	12.60	12.96	13.70	14.05	15.51	8.33	8.69	9.43	9.78	11.25
8H	4H	11.79	12.19	12.88	13.27	14.73	8.01	8.41	9.10	9.49	10.95
	6H	12.35	12.68	13.46	13.80	15.26	8.52	8.85	9.63	9.97	11.43
	8H	12.57	12.85	13.68	13.96	15.43	8.71	8.99	9.82	10.10	11.57
	12H	12.70	12.95	13.81	14.05	15.56	8.82	9.07	9.93	10.17	11.68
12H	4H	11.74	12.10	12.84	13.19	14.66	8.02	8.37	9.12	9.47	10.93
	6H	12.33	12.61	13.44	13.72	15.19	8.57	8.86	9.68	9.96	11.44
	8H	12.54	12.79	13.65	13.89	15.41	8.77	9.02	9.89	10.12	11.64