

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909156

Luminaire Tested: DFN2DIP-SQ3F0-060D080US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909156
REPORT IS A COMBINATION OF REPORTS P899937 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D080US840-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13148.4 lumens
Efficiency: N/A
Efficacy: 115.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 113.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909156

CATALOG NUMBER: DFN2DIP-SQ3F0-060D080US840-FLLFLL

Luminous Intensity Polar Plot

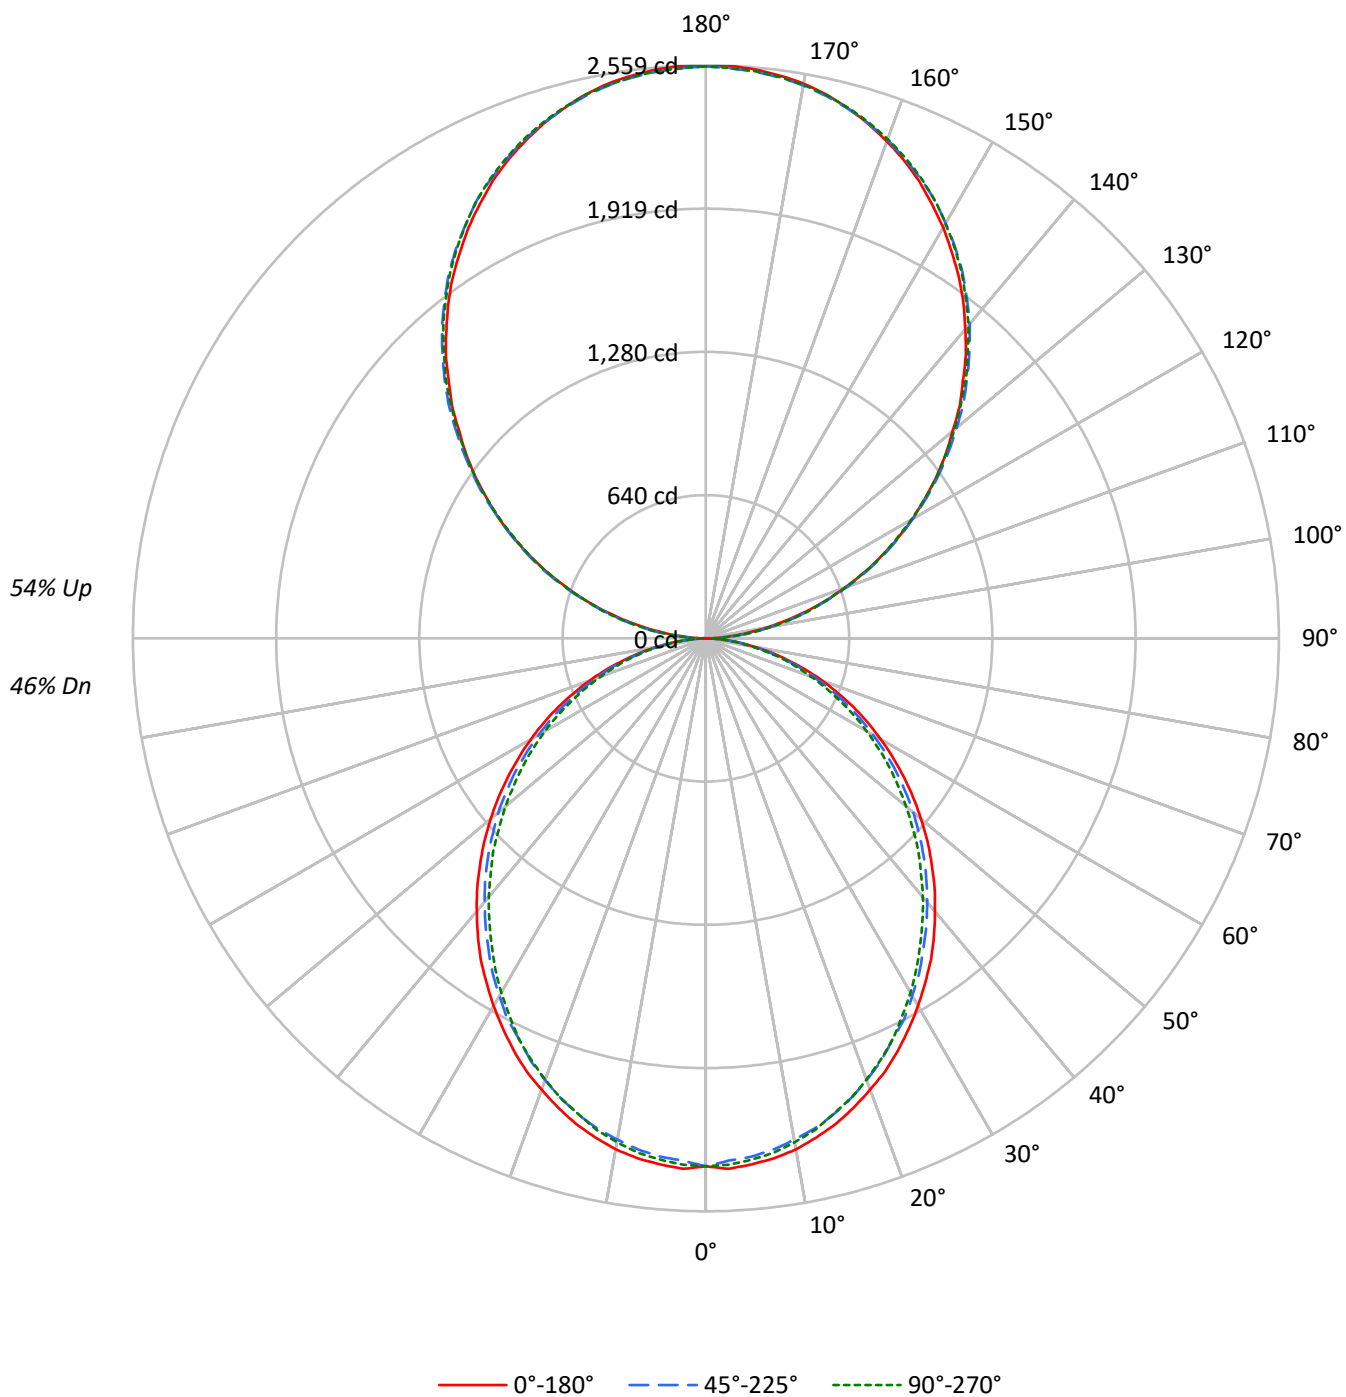

TEST NUMBER: P909156

CATALOG NUMBER: DFN2DIP-SQ3F0-060D080US840-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	93	89	85	89	85	82	79	71	69	66	58	56	55	46	45	44
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	41	39	37
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	34	32
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27
5	67	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	33	28	25	26	23	21
7	57	45	37	32	53	42	35	30	36	30	26	30	25	22	24	21	19
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2701	2701	2701
5°	2704	2662	2681
10°	2680	2624	2644
15°	2639	2579	2586
20°	2584	2517	2527
25°	2529	2444	2459
30°	2461	2375	2373
35°	2397	2295	2282
40°	2317	2213	2195
45°	2238	2131	2106
50°	2151	2045	2003
55°	2060	1946	1909
60°	1957	1828	1800
65°	1844	1706	1672
70°	1701	1557	1534
75°	1502	1378	1405
80°	1263	1150	1161
85°	889	762	760

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2571 cd/sqm

TEST NUMBER: P909156

CATALOG NUMBER: DFN2DIP-SQ3F0-060D080US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	1.7
10°-20°	624.4	4.7
20°-30°	917.5	7.0
30°-40°	1065.7	8.1
40°-50°	1064.4	8.1
50°-60°	928.1	7.1
60°-70°	686.1	5.2
70°-80°	388.2	3.0
80°-90°	109.7	0.8
90°-100°	158.1	1.2
100°-110°	502.4	3.8
110°-120°	859.7	6.5
120°-130°	1130.6	8.6
130°-140°	1269.1	9.7
140°-150°	1244.5	9.5
150°-160°	1043.9	7.9
160°-170°	692.3	5.3
170°-180°	242.0	1.8
0°-30°	1763.8	13.4
0°-40°	2829.5	21.5
0°-60°	4821.9	36.7
0°-90°	6005.9	45.7
90°-120°	1520.1	11.6
90°-150°	5164.3	39.3
90°-180°	7143.0	54.3
0°-180°	13148.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	2	28	76	71	73	13
95°	112	134	138	138	134	125
105°	464	470	474	478	478	489
115°	863	875	871	869	863	853
125°	1255	1274	1268	1261	1259	1121
135°	1623	1647	1652	1649	1643	1254
145°	1970	1986	1998	2000	1992	1231
155°	2253	2259	2266	2277	2270	1037
165°	2451	2449	2449	2464	2453	691
175°	2550	2544	2540	2555	2542	242
180°	2555	2555	2555	2555	2555	

TEST NUMBER: P909156

CATALOG NUMBER: DFN2DIP-SQ3F0-060D080US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	2.3	27.8	75.5	70.9	73.2
92.5°	47.8	64.7	67.1	69.3	69.3
95°	112.5	134.0	137.8	137.8	134.0
97.5°	187.2	207.2	215.7	215.7	215.7
100°	273.5	291.1	297.3	297.3	295.0
102.5°	364.4	377.5	385.9	388.2	385.9
105°	463.7	469.9	474.5	478.4	478.4
107.5°	562.3	571.6	571.6	573.1	562.3
110°	657.8	670.1	670.1	670.1	664.0

TEST NUMBER: P909156

CATALOG NUMBER: DFN2DIP-SQ3F0-060D080US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	761.0	774.2	771.8	765.7	761.0
115°	862.7	875.0	871.2	868.9	862.7
117.5°	963.6	980.6	969.8	963.6	957.5
120°	1065.3	1082.3	1065.3	1065.3	1058.3
122.5°	1157.7	1179.3	1168.5	1162.4	1157.7
125°	1254.8	1274.0	1267.9	1260.9	1258.7
127.5°	1349.6	1373.4	1364.9	1355.7	1349.6
130°	1438.1	1465.8	1462.0	1457.4	1449.0
132.5°	1537.5	1559.0	1560.6	1549.8	1543.7
135°	1623.0	1646.9	1651.5	1649.2	1643.1
137.5°	1718.5	1737.8	1741.6	1740.1	1730.8
140°	1802.5	1821.7	1832.5	1832.5	1824.0
142.5°	1888.8	1908.0	1914.2	1916.5	1908.0
145°	1970.4	1985.8	1998.1	2000.4	1992.0
147.5°	2043.6	2062.9	2072.0	2076.0	2067.5
150°	2119.1	2132.1	2140.6	2147.6	2140.6
152.5°	2186.1	2199.2	2210.0	2218.5	2210.0
155°	2253.1	2259.3	2266.2	2276.9	2270.1
157.5°	2310.9	2315.5	2319.4	2334.7	2324.0
160°	2362.5	2367.1	2369.4	2382.5	2373.3
162.5°	2410.2	2410.2	2412.6	2427.2	2416.4
165°	2451.0	2448.7	2448.7	2464.2	2453.4
167.5°	2488.0	2481.1	2481.1	2496.5	2485.7
170°	2515.8	2509.6	2507.3	2522.7	2509.6
172.5°	2535.1	2528.9	2526.6	2541.9	2528.9
175°	2550.4	2544.3	2539.6	2555.1	2541.9
177.5°	2558.9	2552.7	2548.1	2561.2	2548.1
180°	2555.1	2555.1	2555.1	2555.1	2555.1

TEST NUMBER: P909156

CATALOG NUMBER: DFN2DIP-SQ3F0-060D080US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.28	11.10	11.27	12.10	13.44	9.83	10.65	10.82	11.66	12.99
	3H	11.93	12.67	12.93	13.68	15.03	11.44	12.18	12.44	13.19	14.54
	4H	12.51	13.21	13.53	14.23	15.59	12.02	12.72	13.03	13.73	15.09
	6H	12.91	13.55	13.93	14.57	15.94	12.41	13.05	13.43	14.07	15.44
	8H	13.01	13.62	14.04	14.66	16.03	12.51	13.12	13.54	14.16	15.53
	12H	13.05	13.64	14.09	14.67	16.06	12.54	13.13	13.58	14.16	15.55
4H	2H	10.73	11.43	11.75	12.45	13.81	10.37	11.07	11.40	12.09	13.45
	3H	12.59	13.17	13.62	14.21	15.59	12.18	12.76	13.21	13.81	15.18
	4H	13.29	13.83	14.33	14.87	16.26	12.87	13.41	13.91	14.44	15.84
	6H	13.80	14.26	14.85	15.32	16.72	13.37	13.83	14.42	14.89	16.28
	8H	13.95	14.38	15.00	15.43	16.84	13.51	13.94	14.56	15.00	16.40
	12H	14.02	14.41	15.09	15.47	16.89	13.57	13.96	14.64	15.03	16.44
8H	4H	13.48	13.91	14.53	14.97	16.37	13.11	13.54	14.16	14.59	16.00
	6H	14.11	14.46	15.18	15.56	16.96	13.72	14.08	14.80	15.17	16.58
	8H	14.32	14.64	15.40	15.72	17.14	13.93	14.24	15.01	15.32	16.75
	12H	14.45	14.73	15.53	15.80	17.26	14.04	14.31	15.12	15.39	16.85
12H	4H	13.47	13.85	14.53	14.92	16.34	13.10	13.49	14.17	14.55	15.97
	6H	14.13	14.45	15.22	15.53	16.95	13.76	14.07	14.84	15.15	16.58
	8H	14.37	14.65	15.46	15.72	17.18	13.99	14.27	15.07	15.34	16.80