

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909172

Luminaire Tested: DFN2DIP-SQ3F0-060D120US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909172
REPORT IS A COMBINATION OF REPORTS P900009 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D120US840-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16723.4 lumens
Efficiency: N/A
Efficacy: 113.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 147.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909172

CATALOG NUMBER: DFN2DIP-SQ3F0-060D120US840-FLLFLL

Luminous Intensity Polar Plot

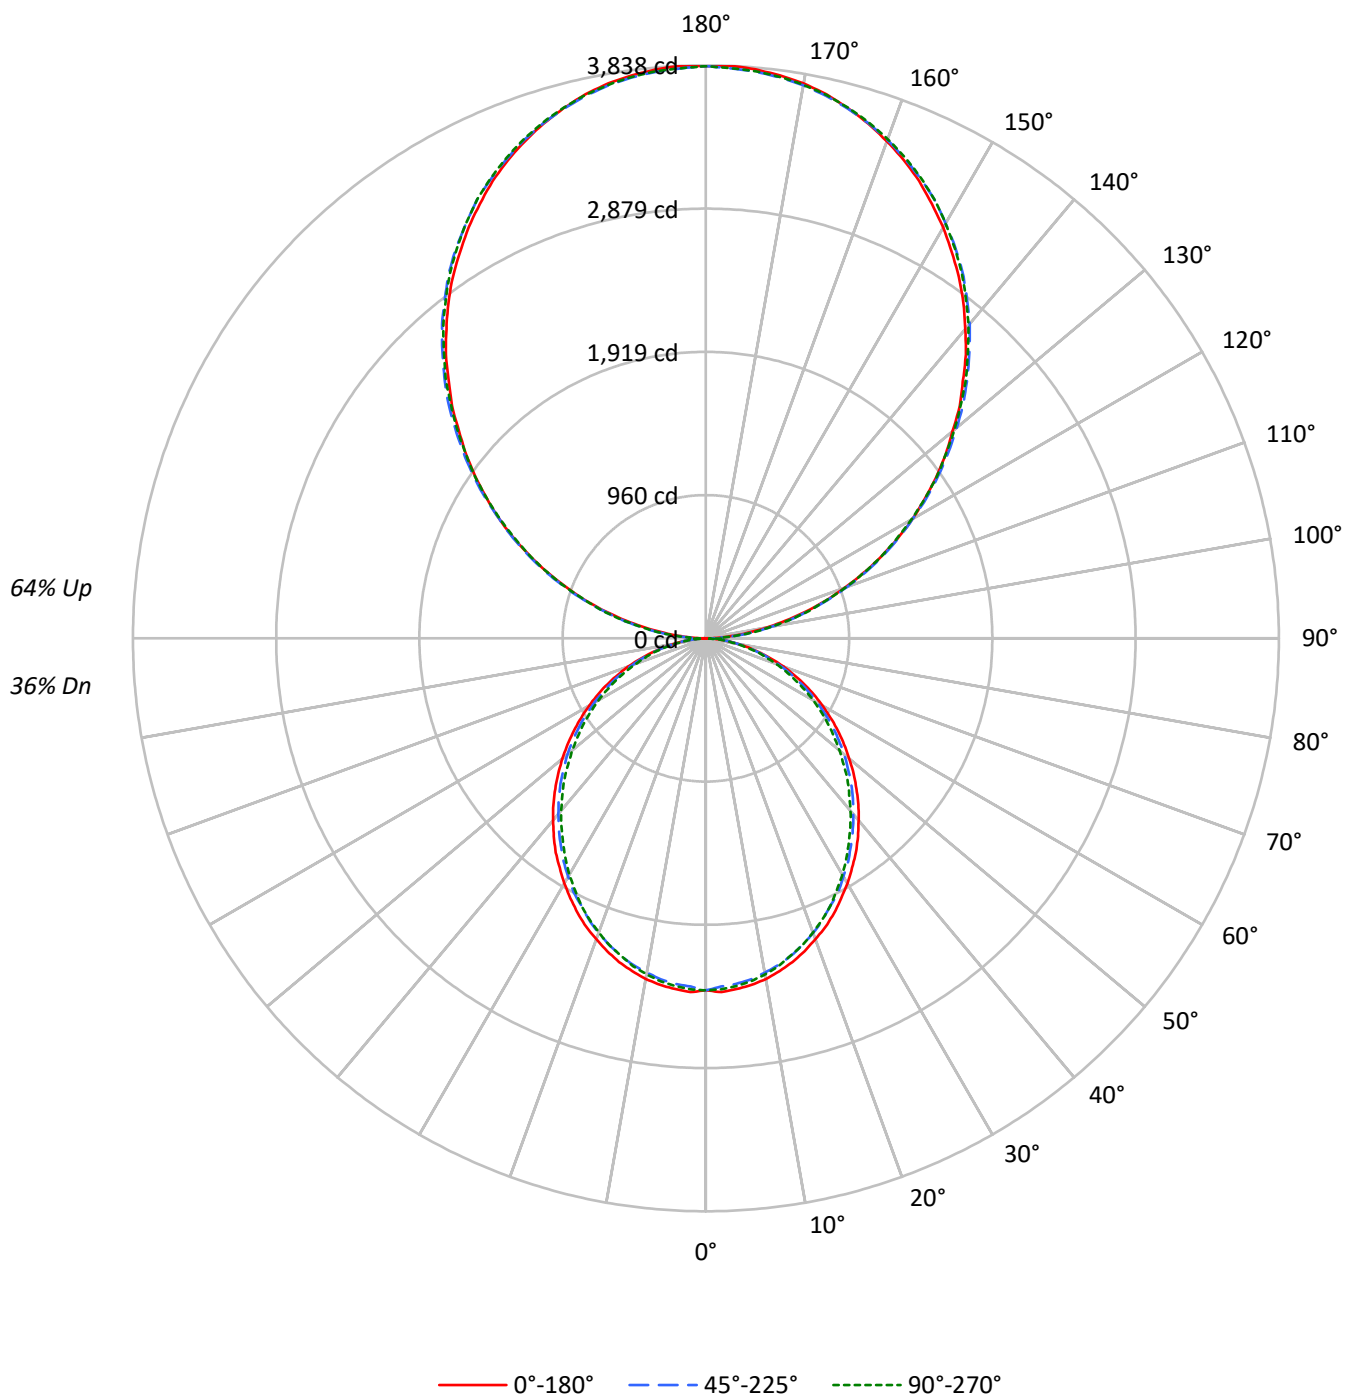

TEST NUMBER: P909172

CATALOG NUMBER: DFN2DIP-SQ3F0-060D120US840-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	43	43	43
1	95	90	87	83	85	82	79	76	66	64	62	52	50	49	38	37	36
2	86	79	73	68	78	72	66	62	58	54	51	45	43	41	34	32	31
3	79	69	62	56	71	63	57	52	51	47	43	40	37	34	30	28	26
4	72	61	54	48	65	56	49	44	45	40	37	36	32	29	27	24	22
5	66	54	47	41	59	50	43	38	40	35	31	32	28	25	24	22	20
6	61	49	41	35	55	45	38	33	36	31	27	29	25	22	22	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	20	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	16	14
9	48	36	29	24	44	33	27	22	27	22	19	22	18	16	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2701	2701	2701
5°	2704	2662	2681
10°	2680	2624	2644
15°	2639	2579	2586
20°	2584	2517	2527
25°	2529	2444	2459
30°	2461	2375	2373
35°	2397	2295	2282
40°	2317	2213	2195
45°	2238	2131	2106
50°	2151	2045	2003
55°	2060	1946	1909
60°	1957	1828	1800
65°	1844	1706	1672
70°	1701	1557	1534
75°	1502	1378	1405
80°	1263	1150	1161
85°	889	762	760

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3856 cd/sqm

TEST NUMBER: P909172

CATALOG NUMBER: DFN2DIP-SQ3F0-060D120US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	1.3
10°-20°	624.4	3.7
20°-30°	917.5	5.5
30°-40°	1065.7	6.4
40°-50°	1064.4	6.4
50°-60°	928.1	5.5
60°-70°	686.1	4.1
70°-80°	388.2	2.3
80°-90°	113.3	0.7
90°-100°	237.2	1.4
100°-110°	753.5	4.5
110°-120°	1289.5	7.7
120°-130°	1696.0	10.1
130°-140°	1903.6	11.4
140°-150°	1866.7	11.2
150°-160°	1565.9	9.4
160°-170°	1038.5	6.2
170°-180°	363.0	2.2
0°-30°	1763.8	10.5
0°-40°	2829.5	16.9
0°-60°	4821.9	28.8
0°-90°	6009.5	35.9
90°-120°	2280.2	13.6
90°-150°	7746.5	46.3
90°-180°	10714.0	64.1
0°-180°	16723.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	3	42	113	106	110	16
95°	169	201	207	207	201	188
105°	696	705	712	718	718	734
115°	1294	1313	1307	1303	1294	1280
125°	1882	1911	1902	1892	1888	1682
135°	2434	2470	2477	2474	2465	1882
145°	2956	2979	2997	3001	2988	1847
155°	3380	3389	3399	3416	3405	1556
165°	3677	3673	3673	3696	3680	1037
175°	3826	3816	3810	3832	3813	363
180°	3832	3832	3832	3832	3832	

TEST NUMBER: P909172

CATALOG NUMBER: DFN2DIP-SQ3F0-060D120US840-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	3.4	41.6	113.2	106.3	109.8
92.5°	71.6	97.0	100.5	104.0	104.0
95°	168.6	201.1	206.8	206.8	201.1
97.5°	280.7	310.8	323.6	323.6	323.6
100°	410.2	436.8	446.0	446.0	442.5
102.5°	546.5	566.1	578.9	582.4	578.9
105°	695.6	704.8	711.8	717.5	717.5
107.5°	843.4	857.4	857.4	859.6	843.4
110°	986.7	1005.2	1005.2	1005.2	996.0

TEST NUMBER: P909172

CATALOG NUMBER: DFN2DIP-SQ3F0-060D120US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1141.6	1161.2	1157.7	1148.5	1141.6
115°	1294.0	1312.6	1306.8	1303.3	1294.0
117.5°	1445.4	1470.9	1454.7	1445.4	1436.2
120°	1598.0	1623.4	1598.0	1598.0	1587.6
122.5°	1736.7	1769.0	1752.8	1743.5	1736.7
125°	1882.2	1911.1	1901.9	1891.5	1887.9
127.5°	2024.4	2060.1	2047.4	2033.6	2024.4
130°	2157.2	2198.8	2193.0	2186.1	2173.3
132.5°	2306.2	2338.6	2340.9	2324.7	2315.5
135°	2434.5	2470.3	2477.3	2473.8	2464.6
137.5°	2577.8	2606.7	2612.4	2610.1	2596.3
140°	2703.7	2732.6	2748.8	2748.8	2736.0
142.5°	2833.2	2862.1	2871.2	2874.7	2862.1
145°	2955.6	2978.7	2997.2	3000.7	2988.0
147.5°	3065.3	3094.2	3108.2	3113.9	3101.2
150°	3178.7	3198.2	3211.0	3221.4	3211.0
152.5°	3279.1	3298.7	3315.0	3327.7	3315.0
155°	3379.6	3388.9	3399.3	3415.5	3405.1
157.5°	3466.4	3473.2	3479.0	3502.1	3486.0
160°	3543.7	3550.7	3554.1	3573.8	3559.9
162.5°	3615.3	3615.3	3618.9	3640.8	3624.6
165°	3676.6	3673.2	3673.2	3696.2	3680.1
167.5°	3732.1	3721.7	3721.7	3744.8	3728.6
170°	3773.7	3764.4	3760.9	3784.1	3764.4
172.5°	3802.5	3793.3	3789.8	3812.9	3793.3
175°	3825.7	3816.4	3809.5	3832.5	3812.9
177.5°	3838.4	3829.1	3822.1	3841.8	3822.1
180°	3832.5	3832.5	3832.5	3832.5	3832.5

TEST NUMBER: P909172

CATALOG NUMBER: DFN2DIP-SQ3F0-060D120US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.23	9.97	10.30	11.05	12.50	8.78	9.53	9.85	10.60	12.06
	3H	10.87	11.54	11.95	12.62	14.10	10.38	11.05	11.46	12.13	13.61
	4H	11.45	12.09	12.54	13.17	14.65	10.96	11.59	12.05	12.68	14.16
	6H	11.84	12.43	12.94	13.51	15.01	11.34	11.93	12.44	13.01	14.51
	8H	11.94	12.50	13.05	13.60	15.09	11.44	12.00	12.54	13.10	14.59
	12H	11.99	12.51	13.09	13.61	15.12	11.48	12.01	12.58	13.10	14.61
4H	2H	9.67	10.31	10.77	11.39	12.87	9.31	9.95	10.41	11.03	12.51
	3H	11.52	12.05	12.62	13.16	14.65	11.11	11.64	12.22	12.75	14.25
	4H	12.23	12.71	13.33	13.81	15.33	11.80	12.29	12.91	13.39	14.90
	6H	12.73	13.15	13.85	14.27	15.78	12.30	12.72	13.41	13.84	15.35
	8H	12.87	13.26	13.99	14.38	15.90	12.44	12.83	13.55	13.94	15.47
	12H	12.94	13.29	14.07	14.42	15.95	12.49	12.84	13.62	13.97	15.50
8H	4H	12.41	12.80	13.52	13.91	15.44	12.03	12.42	13.15	13.53	15.06
	6H	13.03	13.35	14.17	14.51	16.03	12.64	12.97	13.78	14.12	15.64
	8H	13.25	13.53	14.39	14.66	16.21	12.85	13.13	14.00	14.27	15.81
	12H	13.37	13.62	14.51	14.75	16.33	12.96	13.21	14.10	14.34	15.92
12H	4H	12.39	12.74	13.52	13.87	15.40	12.02	12.37	13.15	13.50	15.03
	6H	13.06	13.34	14.20	14.47	16.02	12.68	12.97	13.83	14.10	15.64
	8H	13.29	13.54	14.44	14.67	16.25	12.91	13.16	14.05	14.29	15.87