

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909187

Luminaire Tested: DFN2DIP-SQ3F0-070D060US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909187
REPORT IS A COMBINATION OF REPORTS P901424 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D060US840-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12007.2 lumens
Efficiency: N/A
Efficacy: 108.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 110.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909187

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US840-RLLONL

Luminous Intensity Polar Plot

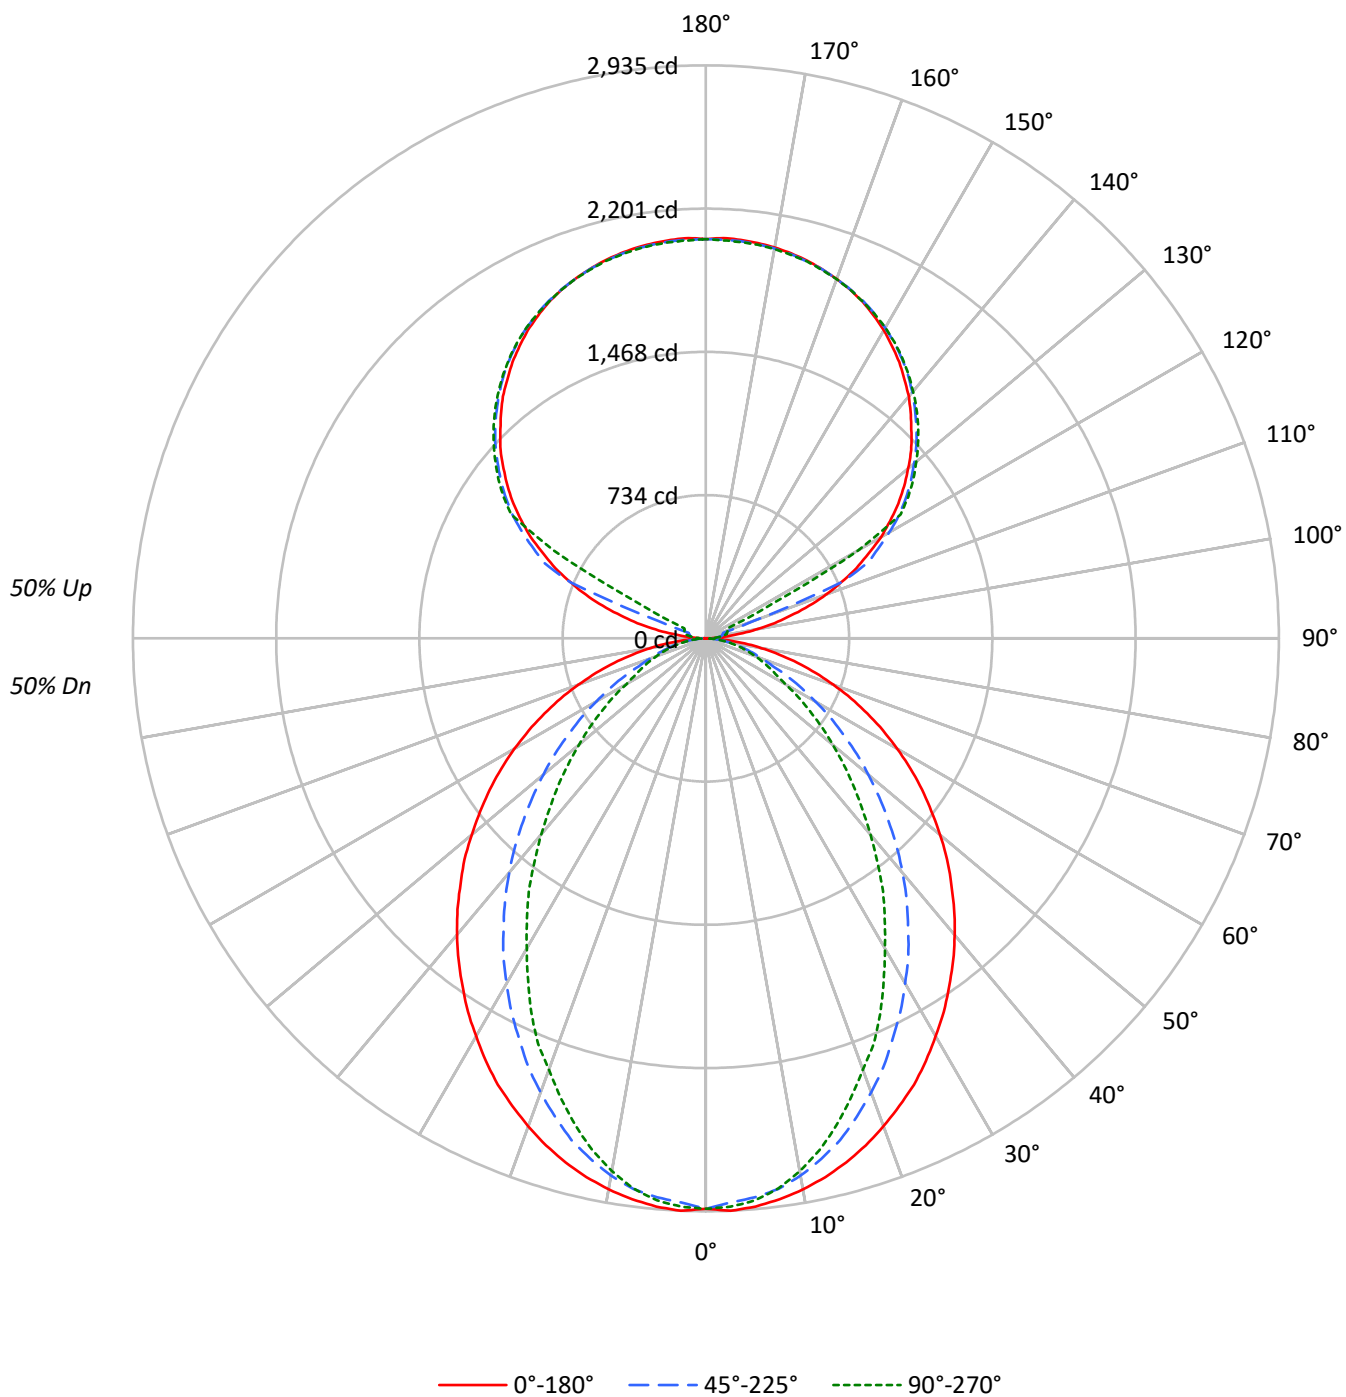

TEST NUMBER: P909187

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	94	90	87	91	87	84	81	74	72	69	62	60	59	50	49	48
2	90	83	77	72	83	77	72	67	65	62	58	55	52	50	45	43	41
3	82	73	66	60	76	68	62	57	58	53	50	49	45	43	40	38	36
4	76	65	57	52	70	60	54	49	52	47	43	44	40	37	36	34	31
5	70	58	50	45	64	54	47	42	47	41	37	40	35	32	33	30	28
6	64	52	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	59	47	40	34	55	44	37	32	38	33	29	33	29	25	28	24	22
8	55	43	36	30	51	40	34	29	35	30	26	30	26	23	25	22	20
9	52	40	32	27	48	37	30	26	32	27	23	28	24	21	24	20	18
10	48	36	29	25	45	34	28	23	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3348	3348	3348
5°	3351	3292	3314
10°	3316	3225	3206
15°	3268	3117	3038
20°	3205	2968	2832
25°	3141	2801	2634
30°	3056	2630	2383
35°	2972	2447	2162
40°	2887	2258	1909
45°	2788	2048	1680
50°	2686	1836	1457
55°	2579	1610	1242
60°	2455	1374	1021
65°	2311	1135	918
70°	2138	912	829
75°	1920	799	752
80°	1604	663	648
85°	1088	432	481

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2788 cd/sqm

TEST NUMBER: P909187

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	273.8	2.3
10°-20°	751.7	6.3
20°-30°	1055.3	8.8
30°-40°	1150.4	9.6
40°-50°	1057.3	8.8
50°-60°	830.4	6.9
60°-70°	540.5	4.5
70°-80°	278.2	2.3
80°-90°	74.6	0.6
90°-100°	67.4	0.6
100°-110°	251.4	2.1
110°-120°	666.7	5.6
120°-130°	1105.7	9.2
130°-140°	1174.5	9.8
140°-150°	1091.6	9.1
150°-160°	877.6	7.3
160°-170°	565.5	4.7
170°-180°	194.6	1.6
0°-30°	2080.9	17.3
0°-40°	3231.2	26.9
0°-60°	5118.9	42.6
0°-90°	6012.2	50.1
90°-120°	985.5	8.2
90°-150°	4357.2	36.3
90°-180°	5995.0	49.9
0°-180°	12007.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2922	2922	2922	2922	2922	
5°	2922	2908	2874	2898	2890	277
15°	2779	2750	2660	2610	2583	783
25°	2522	2438	2263	2155	2115	1160
35°	2173	2038	1806	1639	1581	1360
45°	1777	1600	1322	1134	1071	1372
55°	1351	1145	859	701	651	1207
65°	912	698	460	370	362	904
75°	486	301	212	193	190	515
85°	114	58	50	50	50	130
90°	1	18	30	37	40	11
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P909187

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2921.6	2921.6	2921.6	2921.6	2921.6
2.5°	2934.8	2921.6	2892.5	2919.1	2913.8
5°	2921.6	2908.4	2874.0	2897.8	2889.9
7.5°	2897.8	2882.1	2845.1	2855.4	2842.3
10°	2866.1	2847.6	2794.8	2786.7	2771.0
12.5°	2826.5	2802.7	2731.2	2715.4	2686.2
15°	2778.8	2749.7	2659.9	2609.7	2583.3
17.5°	2723.3	2681.0	2569.9	2511.7	2469.4
20°	2659.9	2606.9	2474.8	2408.8	2350.5
22.5°	2591.2	2530.3	2376.8	2287.0	2247.6
25°	2522.4	2437.7	2263.2	2155.0	2115.2
27.5°	2440.5	2350.5	2157.5	2033.3	1972.4
30°	2353.3	2252.6	2041.0	1906.4	1834.9
32.5°	2268.6	2146.9	1930.3	1771.5	1705.3
35°	2173.4	2038.5	1806.0	1639.4	1581.0
37.5°	2080.9	1935.3	1689.6	1506.9	1441.1
40°	1983.0	1824.5	1567.8	1380.2	1311.4
42.5°	1882.6	1713.4	1446.3	1250.5	1184.7
45°	1776.9	1599.5	1322.1	1134.2	1070.8
47.5°	1676.4	1488.7	1203.2	1015.2	957.2
50°	1565.3	1377.7	1086.7	904.1	848.9
52.5°	1456.7	1258.4	975.6	801.1	750.9
55°	1351.0	1144.8	859.2	700.7	650.6
57.5°	1242.7	1031.2	756.3	608.1	565.8
60°	1131.7	920.1	647.7	513.1	470.7
62.5°	1023.3	811.8	555.1	428.4	407.3
65°	912.2	697.9	460.1	370.3	362.1
67.5°	806.5	592.2	370.3	325.1	317.3
70°	695.4	489.2	306.6	280.2	269.5
72.5°	589.7	393.8	256.4	235.4	230.0
75°	486.5	301.2	211.5	193.0	190.5
77.5°	383.4	214.0	166.6	155.9	150.7
80°	288.1	153.4	126.8	116.4	116.4
82.5°	200.9	103.2	87.3	81.9	81.9
85°	113.6	58.1	50.2	50.2	50.2
87.5°	42.3	21.0	21.0	18.5	18.5
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8

TEST NUMBER: P909187

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P909187

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.32	12.15	12.28	13.12	14.39	7.28	8.11	8.24	9.08	10.35
	3H	12.99	13.73	13.97	14.72	16.01	8.46	9.20	9.43	10.19	11.48
	4H	13.60	14.30	14.58	15.29	16.59	8.91	9.61	9.89	10.59	11.90
	6H	14.01	14.66	15.01	15.65	16.97	9.22	9.87	10.22	10.86	12.18
	8H	14.14	14.75	15.14	15.76	17.07	9.31	9.92	10.31	10.93	12.24
	12H	14.20	14.78	15.21	15.78	17.12	9.35	9.93	10.36	10.94	12.27
4H	2H	11.33	12.04	12.33	13.02	14.33	7.87	8.57	8.87	9.56	10.86
	3H	13.16	13.74	14.16	14.76	16.07	9.21	9.80	10.22	10.81	12.13
	4H	13.85	14.38	14.86	15.39	16.73	9.76	10.29	10.77	11.30	12.64
	6H	14.36	14.82	15.38	15.85	17.19	10.17	10.63	11.19	11.66	13.00
	8H	14.53	14.96	15.55	15.98	17.33	10.29	10.72	11.32	11.75	13.10
	12H	14.62	15.01	15.66	16.05	17.41	10.36	10.74	11.40	11.78	13.14
8H	4H	13.81	14.24	14.84	15.27	16.62	10.03	10.46	11.06	11.49	12.84
	6H	14.37	14.73	15.42	15.79	17.14	10.54	10.90	11.59	11.96	13.31
	8H	14.59	14.90	15.64	15.95	17.32	10.73	11.04	11.78	12.09	13.46
	12H	14.72	15.00	15.78	16.04	17.45	10.84	11.12	11.90	12.16	13.58
12H	4H	13.76	14.15	14.81	15.19	16.55	10.04	10.42	11.08	11.46	12.82
	6H	14.35	14.66	15.40	15.71	17.08	10.59	10.90	11.65	11.95	13.32
	8H	14.57	14.84	15.62	15.88	17.30	10.80	11.07	11.85	12.12	13.53

END OF REPORT