

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909190

Luminaire Tested: DFN2DIP-SQ3F0-070D070US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909190
REPORT IS A COMBINATION OF REPORTS P899922 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D070US840-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12264.8 lumens
Efficiency: N/A
Efficacy: 103.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 118.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909190

CATALOG NUMBER: DFN2DIP-SQ3F0-070D070US840-RLLFLL

Luminous Intensity Polar Plot

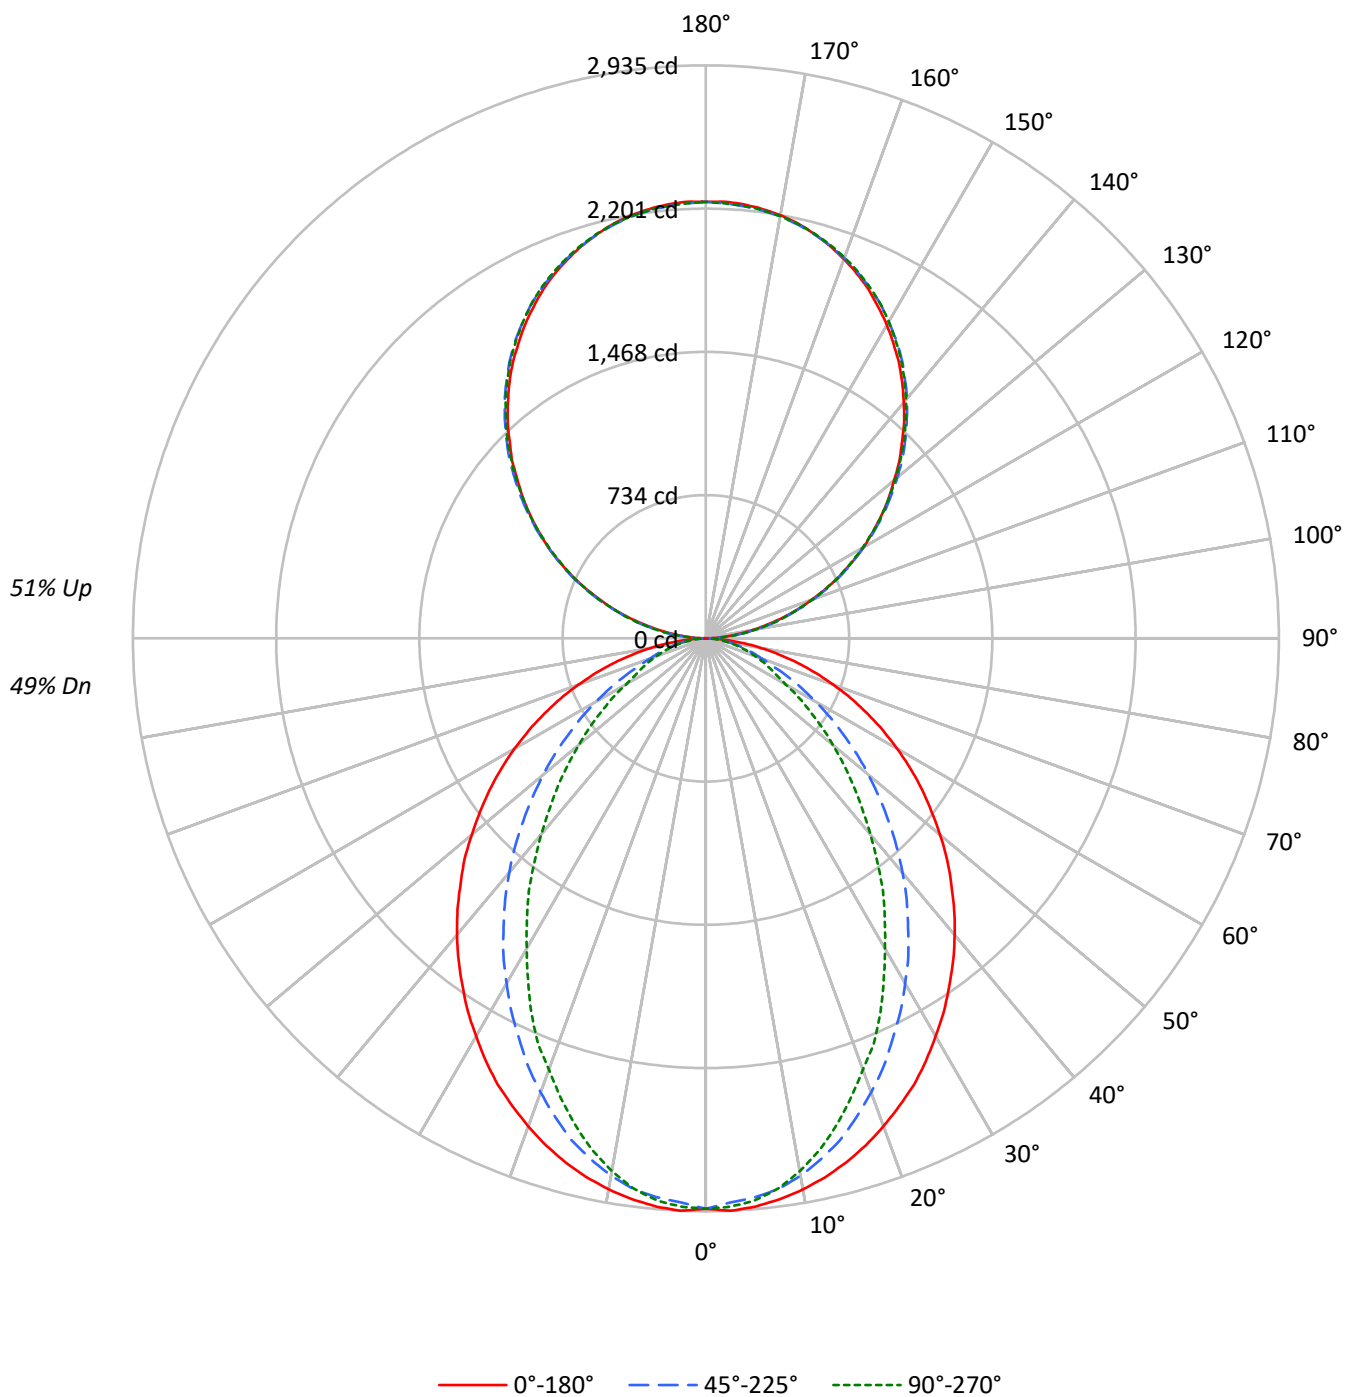

TEST NUMBER: P909190

CATALOG NUMBER: DFN2DIP-SQ3F0-070D070US840-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3348	3348	3348
5°	3351	3292	3314
10°	3316	3225	3206
15°	3268	3117	3038
20°	3205	2968	2832
25°	3141	2801	2634
30°	3056	2630	2383
35°	2972	2447	2162
40°	2887	2258	1909
45°	2788	2048	1680
50°	2686	1836	1457
55°	2579	1610	1242
60°	2455	1374	1021
65°	2311	1135	918
70°	2138	912	829
75°	1920	799	752
80°	1604	663	648
85°	1088	432	481

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2788 cd/sqm

TEST NUMBER: P909190

CATALOG NUMBER: DFN2DIP-SQ3F0-070D070US840-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	273.8	2.2
10°-20°	751.7	6.1
20°-30°	1055.3	8.6
30°-40°	1150.4	9.4
40°-50°	1057.3	8.6
50°-60°	830.4	6.8
60°-70°	540.5	4.4
70°-80°	278.2	2.3
80°-90°	77.4	0.6
90°-100°	138.3	1.1
100°-110°	439.6	3.6
110°-120°	752.2	6.1
120°-130°	989.3	8.1
130°-140°	1110.5	9.1
140°-150°	1088.9	8.9
150°-160°	913.5	7.4
160°-170°	605.8	4.9
170°-180°	211.7	1.7
0°-30°	2080.9	17.0
0°-40°	3231.2	26.3
0°-60°	5118.9	41.7
0°-90°	6015.0	49.0
90°-120°	1330.1	10.8
90°-150°	4518.8	36.8
90°-180°	6250.0	51.0
0°-180°	12264.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2922	2922	2922	2922	2922	
5°	2922	2908	2874	2898	2890	277
15°	2779	2750	2660	2610	2583	783
25°	2522	2438	2263	2155	2115	1160
35°	2173	2038	1806	1639	1581	1360
45°	1777	1600	1322	1134	1071	1372
55°	1351	1145	859	701	651	1207
65°	912	698	460	370	362	904
75°	486	301	212	193	190	515
85°	114	58	50	50	50	130
90°	2	24	66	62	64	12
95°	98	117	121	121	117	109
105°	406	411	415	419	419	428
115°	755	766	762	760	755	747
125°	1098	1115	1109	1103	1101	981
135°	1420	1441	1445	1443	1438	1098
145°	1724	1738	1748	1750	1743	1077
155°	1972	1977	1983	1992	1986	907
165°	2145	2143	2143	2156	2147	605
175°	2232	2226	2222	2236	2224	212
180°	2236	2236	2236	2236	2236	

TEST NUMBER: P909190

CATALOG NUMBER: DFN2DIP-SQ3F0-070D070US840-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2921.6	2921.6	2921.6	2921.6	2921.6
2.5°	2934.8	2921.6	2892.5	2919.1	2913.8
5°	2921.6	2908.4	2874.0	2897.8	2889.9
7.5°	2897.8	2882.1	2845.1	2855.4	2842.3
10°	2866.1	2847.6	2794.8	2786.7	2771.0
12.5°	2826.5	2802.7	2731.2	2715.4	2686.2
15°	2778.8	2749.7	2659.9	2609.7	2583.3
17.5°	2723.3	2681.0	2569.9	2511.7	2469.4
20°	2659.9	2606.9	2474.8	2408.8	2350.5
22.5°	2591.2	2530.3	2376.8	2287.0	2247.6
25°	2522.4	2437.7	2263.2	2155.0	2115.2
27.5°	2440.5	2350.5	2157.5	2033.3	1972.4
30°	2353.3	2252.6	2041.0	1906.4	1834.9
32.5°	2268.6	2146.9	1930.3	1771.5	1705.3
35°	2173.4	2038.5	1806.0	1639.4	1581.0
37.5°	2080.9	1935.3	1689.6	1506.9	1441.1
40°	1983.0	1824.5	1567.8	1380.2	1311.4
42.5°	1882.6	1713.4	1446.3	1250.5	1184.7
45°	1776.9	1599.5	1322.1	1134.2	1070.8
47.5°	1676.4	1488.7	1203.2	1015.2	957.2
50°	1565.3	1377.7	1086.7	904.1	848.9
52.5°	1456.7	1258.4	975.6	801.1	750.9
55°	1351.0	1144.8	859.2	700.7	650.6
57.5°	1242.7	1031.2	756.3	608.1	565.8
60°	1131.7	920.1	647.7	513.1	470.7
62.5°	1023.3	811.8	555.1	428.4	407.3
65°	912.2	697.9	460.1	370.3	362.1
67.5°	806.5	592.2	370.3	325.1	317.3
70°	695.4	489.2	306.6	280.2	269.5
72.5°	589.7	393.8	256.4	235.4	230.0
75°	486.5	301.2	211.5	193.0	190.5
77.5°	383.4	214.0	166.6	155.9	150.7
80°	288.1	153.4	126.8	116.4	116.4
82.5°	200.9	103.2	87.3	81.9	81.9
85°	113.6	58.1	50.2	50.2	50.2
87.5°	42.3	21.0	21.0	18.5	18.5
90°	2.0	24.2	66.0	62.0	64.0
92.5°	41.8	56.7	58.7	60.7	60.7
95°	98.4	117.2	120.7	120.7	117.2
97.5°	163.8	181.3	188.7	188.7	188.7
100°	239.2	254.8	260.1	260.1	258.1
102.5°	318.8	330.2	337.7	339.7	337.7
105°	405.8	411.1	415.2	418.6	418.6
107.5°	492.0	500.1	500.1	501.5	492.0
110°	575.6	586.4	586.4	586.4	581.0

TEST NUMBER: P909190

CATALOG NUMBER: DFN2DIP-SQ3F0-070D070US840-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	665.9	677.4	675.4	669.9	665.9
115°	754.9	765.7	762.3	760.3	754.9
117.5°	843.1	858.0	848.6	843.1	837.8
120°	932.1	947.0	932.1	932.1	926.0
122.5°	1013.0	1031.9	1022.5	1017.0	1013.0
125°	1097.9	1114.8	1109.4	1103.4	1101.4
127.5°	1180.8	1201.7	1194.4	1186.3	1180.8
130°	1258.4	1282.6	1279.3	1275.3	1267.8
132.5°	1345.3	1364.2	1365.5	1356.1	1350.7
135°	1420.2	1441.0	1445.1	1443.0	1437.6
137.5°	1503.7	1520.6	1523.9	1522.6	1514.5
140°	1577.2	1594.1	1603.5	1603.5	1596.1
142.5°	1652.6	1669.5	1674.9	1676.9	1669.5
145°	1724.1	1737.6	1748.4	1750.4	1743.0
147.5°	1788.2	1805.0	1813.1	1816.4	1809.1
150°	1854.2	1865.6	1873.1	1879.2	1873.1
152.5°	1912.8	1924.3	1933.7	1941.2	1933.7
155°	1971.5	1976.8	1983.0	1992.4	1986.3
157.5°	2022.1	2026.1	2029.4	2043.0	2033.5
160°	2067.2	2071.2	2073.3	2084.7	2076.6
162.5°	2109.0	2109.0	2111.0	2123.7	2114.4
165°	2144.7	2142.6	2142.6	2156.2	2146.7
167.5°	2177.1	2171.0	2171.0	2184.4	2175.0
170°	2201.3	2196.0	2193.9	2207.4	2196.0
172.5°	2218.2	2212.7	2210.7	2224.2	2212.7
175°	2231.6	2226.2	2222.2	2235.6	2224.2
177.5°	2239.1	2233.6	2229.6	2241.1	2229.6
180°	2235.6	2235.6	2235.6	2235.6	2235.6

TEST NUMBER: P909190

CATALOG NUMBER: DFN2DIP-SQ3F0-070D070US840-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.22	12.04	12.19	13.02	14.31	7.18	8.00	8.15	8.98	10.27
	3H	12.89	13.63	13.87	14.62	15.93	8.36	9.10	9.34	10.09	11.40
	4H	13.50	14.19	14.49	15.19	16.50	8.81	9.50	9.80	10.50	11.81
	6H	13.91	14.55	14.92	15.55	16.88	9.12	9.76	10.13	10.76	12.09
	8H	14.04	14.65	15.05	15.66	16.99	9.21	9.82	10.22	10.83	12.16
	12H	14.10	14.68	15.12	15.69	17.04	9.25	9.83	10.27	10.84	12.19
4H	2H	11.23	11.93	12.24	12.92	14.24	7.77	8.47	8.77	9.46	10.78
	3H	13.06	13.64	14.07	14.66	15.99	9.11	9.69	10.12	10.71	12.05
	4H	13.75	14.27	14.76	15.29	16.64	9.66	10.18	10.67	11.20	12.55
	6H	14.26	14.71	15.29	15.75	17.10	10.07	10.52	11.10	11.56	12.91
	8H	14.43	14.85	15.46	15.88	17.25	10.19	10.62	11.22	11.65	13.01
	12H	14.52	14.90	15.57	15.95	17.32	10.25	10.64	11.30	11.68	13.05
8H	4H	13.71	14.13	14.74	15.17	16.53	9.93	10.36	10.96	11.39	12.75
	6H	14.27	14.62	15.33	15.70	17.06	10.44	10.79	11.50	11.87	13.23
	8H	14.48	14.79	15.55	15.85	17.23	10.63	10.94	11.69	11.99	13.38
	12H	14.62	14.89	15.68	15.94	17.37	10.74	11.01	11.81	12.07	13.49
12H	4H	13.66	14.04	14.71	15.09	16.46	9.94	10.32	10.98	11.37	12.74
	6H	14.25	14.55	15.31	15.61	17.00	10.49	10.80	11.55	11.86	13.24
	8H	14.46	14.73	15.53	15.79	17.21	10.69	10.97	11.76	12.02	13.44

END OF REPORT