

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909205

Luminaire Tested: DFN2DIP-SQ3F0-070D110US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909205
REPORT IS A COMBINATION OF REPORTS P901513 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D110US840-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17995.8 lumens
Efficiency: N/A
Efficacy: 118.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 151.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909205

CATALOG NUMBER: DFN2DIP-SQ3F0-070D110US840-FLLONL

Luminous Intensity Polar Plot

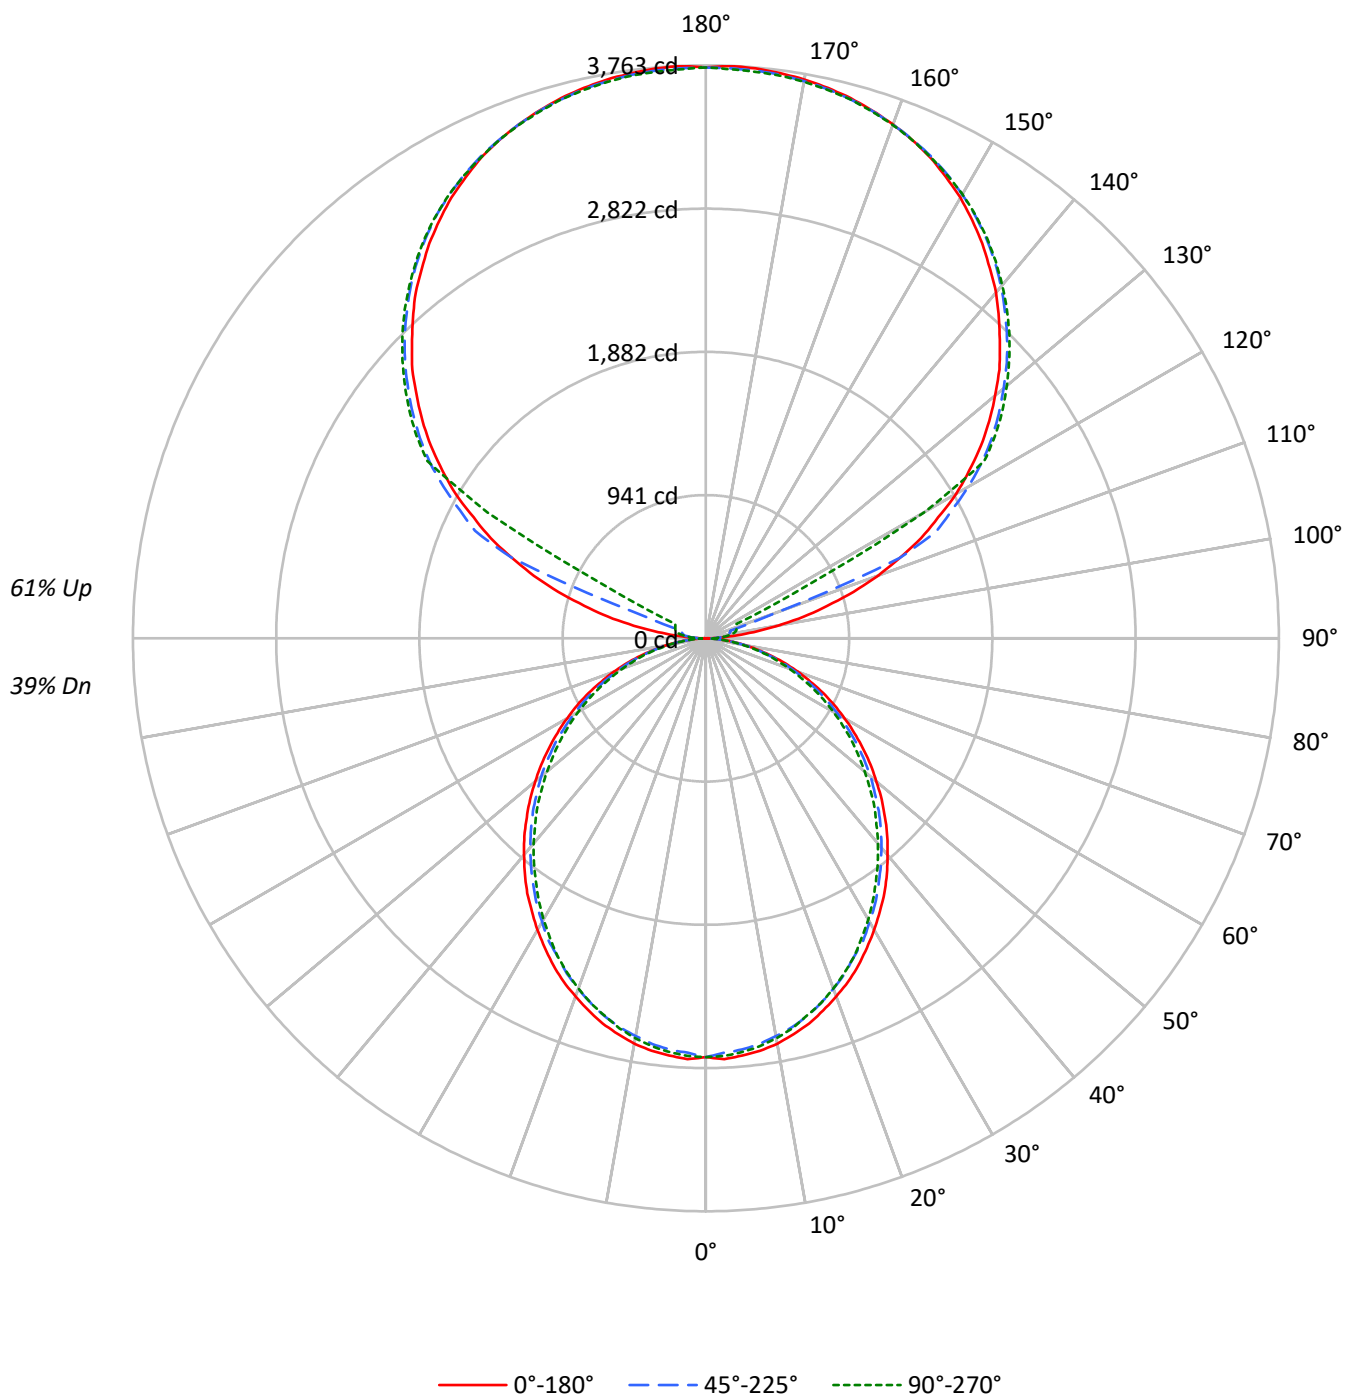

TEST NUMBER: P909205

CATALOG NUMBER: DFN2DIP-SQ3F0-070D110US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	95	91	87	84	86	83	80	77	68	65	63	54	52	51	41	40	39
2	87	79	73	68	79	72	67	63	59	56	52	47	44	42	36	34	33
3	79	70	63	57	72	64	58	53	52	48	44	42	38	36	32	30	28
4	72	62	54	48	65	56	50	44	46	41	37	37	33	31	28	26	24
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	23	21
6	61	49	41	36	55	45	38	33	37	32	28	30	26	23	23	20	18
7	56	44	37	31	51	41	34	29	34	28	25	27	23	20	21	18	16
8	52	40	33	27	47	37	30	26	31	26	22	25	21	18	19	17	15
9	49	37	29	24	44	34	27	23	28	23	19	23	19	16	18	15	13
10	45	34	26	22	41	31	25	20	26	21	17	21	17	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3152	3152	3152
5°	3155	3106	3128
10°	3127	3062	3084
15°	3079	3009	3017
20°	3015	2937	2948
25°	2951	2851	2869
30°	2872	2771	2768
35°	2796	2677	2662
40°	2703	2582	2561
45°	2611	2487	2457
50°	2510	2386	2337
55°	2403	2270	2227
60°	2283	2133	2100
65°	2152	1990	1950
70°	1984	1816	1789
75°	1753	1608	1639
80°	1473	1341	1355
85°	1038	889	887

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2611 cd/sqm

TEST NUMBER: P909205

CATALOG NUMBER: DFN2DIP-SQ3F0-070D110US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	258.9	1.4
10°-20°	728.4	4.0
20°-30°	1070.5	5.9
30°-40°	1243.3	6.9
40°-50°	1241.7	6.9
50°-60°	1082.8	6.0
60°-70°	800.4	4.4
70°-80°	452.9	2.5
80°-90°	126.1	0.7
90°-100°	123.6	0.7
100°-110°	460.8	2.6
110°-120°	1222.2	6.8
120°-130°	2027.1	11.3
130°-140°	2153.3	12.0
140°-150°	2001.2	11.1
150°-160°	1608.9	8.9
160°-170°	1036.7	5.8
170°-180°	356.8	2.0
0°-30°	2057.8	11.4
0°-40°	3301.1	18.3
0°-60°	5625.6	31.3
0°-90°	7005.0	38.9
90°-120°	1806.7	10.0
90°-150°	7988.3	44.4
90°-180°	10991.0	61.1
0°-180°	17995.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2751	2751	2751	2751	2751	
5°	2751	2740	2711	2732	2727	261
15°	2618	2603	2568	2579	2566	737
25°	2370	2349	2304	2309	2304	1090
35°	2045	2018	1976	1960	1947	1277
45°	1664	1645	1605	1576	1566	1284
55°	1259	1243	1211	1180	1166	1126
65°	849	833	807	783	770	840
75°	444	439	426	410	415	474
85°	108	106	103	95	93	121
90°	3	32	54	68	73	17
95°	176	87	106	120	117	209
105°	825	906	166	195	206	881
115°	1560	1606	1674	418	223	1536
125°	2205	2241	2292	2311	2319	1967
135°	2729	2773	2797	2824	2819	2108
145°	3166	3163	3209	3228	3215	1980
155°	3486	3462	3494	3510	3489	1606
165°	3673	3657	3665	3684	3665	1038
175°	3757	3738	3744	3763	3736	358
180°	3749	3749	3749	3749	3749	

TEST NUMBER: P909205

CATALOG NUMBER: DFN2DIP-SQ3F0-070D110US840-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2750.6	2750.6	2750.6	2750.6	2750.6
2.5°	2766.6	2753.4	2724.2	2750.6	2745.5
5°	2750.6	2740.3	2711.1	2732.1	2727.0
7.5°	2732.1	2716.3	2687.2	2708.6	2703.2
10°	2703.2	2684.6	2652.9	2674.0	2666.1
12.5°	2663.3	2647.7	2616.0	2629.1	2623.7
15°	2618.5	2602.7	2568.2	2578.9	2565.7
17.5°	2562.8	2547.2	2512.6	2525.9	2512.6
20°	2501.9	2486.3	2449.2	2457.1	2446.7
22.5°	2441.3	2417.5	2383.0	2383.0	2377.6
25°	2369.9	2348.7	2303.9	2309.0	2303.9
27.5°	2290.4	2271.9	2237.7	2229.8	2216.6
30°	2211.3	2189.9	2150.4	2142.5	2131.8
32.5°	2126.5	2110.8	2068.4	2052.5	2041.7
35°	2044.6	2018.2	1975.8	1959.8	1946.6
37.5°	1952.0	1928.1	1885.7	1867.2	1854.0
40°	1856.8	1835.5	1793.1	1769.6	1758.9
42.5°	1764.2	1742.9	1700.8	1674.2	1658.4
45°	1663.8	1645.3	1605.4	1576.5	1565.8
47.5°	1565.8	1547.3	1504.9	1475.7	1460.1
50°	1462.6	1449.4	1412.3	1375.3	1362.1
52.5°	1362.1	1343.6	1309.4	1280.2	1261.6
55°	1259.1	1243.1	1211.4	1179.7	1166.5
57.5°	1155.9	1142.7	1108.1	1076.4	1065.8
60°	1052.6	1042.2	1005.2	976.0	968.2
62.5°	952.1	933.6	907.3	880.9	870.2
65°	849.2	833.1	806.8	782.9	769.7
67.5°	743.4	729.9	706.3	687.8	677.1
70°	645.4	634.8	610.9	592.4	582.0
72.5°	544.9	534.3	521.1	502.6	494.7
75°	444.2	439.2	425.7	410.0	415.4
77.5°	354.5	343.8	338.4	330.5	322.8
80°	264.6	261.9	256.5	248.6	243.3
82.5°	179.9	179.9	177.3	166.7	166.7
85°	108.4	105.8	103.3	95.1	92.6
87.5°	47.7	42.4	37.1	29.2	26.4
90°	2.6	32.5	54.1	68.0	73.1
92.5°	68.0	57.1	65.0	70.6	73.1
95°	176.2	86.6	105.6	119.5	116.6
97.5°	317.3	95.0	138.1	146.5	149.2
100°	480.3	108.6	154.6	176.2	181.7
102.5°	659.0	653.9	160.1	189.8	198.1
105°	824.7	906.2	165.6	195.2	206.2
107.5°	1017.3	1084.9	171.1	200.7	211.7
110°	1201.8	1258.6	474.8	203.6	214.2

TEST NUMBER: P909205

CATALOG NUMBER: DFN2DIP-SQ3F0-070D110US840-FLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1375.5	1424.1	1378.1	208.7	217.1
115°	1559.7	1605.8	1673.9	417.8	222.6
117.5°	1719.9	1774.0	1820.4	1432.2	721.5
120°	1899.0	1939.5	1988.5	2021.0	1654.8
122.5°	2050.7	2094.2	2148.6	2164.7	2167.7
125°	2205.3	2240.8	2292.3	2311.3	2319.4
127.5°	2346.4	2384.4	2425.3	2452.4	2455.0
130°	2479.4	2522.9	2552.5	2582.5	2580.0
132.5°	2615.0	2650.5	2680.2	2704.6	2702.1
135°	2729.2	2772.6	2796.7	2824.2	2818.6
137.5°	2848.3	2880.8	2908.2	2935.3	2927.2
140°	2965.0	2986.8	3016.5	3040.9	3027.4
142.5°	3062.8	3081.8	3116.9	3138.6	3125.0
145°	3165.9	3163.0	3209.0	3228.1	3214.6
147.5°	3255.2	3247.1	3293.2	3306.7	3296.1
150°	3342.2	3323.2	3366.6	3382.7	3369.2
152.5°	3415.3	3393.7	3434.2	3450.7	3431.7
155°	3485.9	3461.6	3494.1	3510.3	3488.7
157.5°	3542.8	3521.2	3545.7	3564.7	3542.8
160°	3591.8	3575.3	3591.8	3607.8	3588.9
162.5°	3634.9	3618.9	3632.4	3651.4	3626.9
165°	3673.0	3656.8	3664.9	3683.9	3664.9
167.5°	3702.9	3686.5	3694.9	3713.9	3689.4
170°	3727.4	3711.0	3716.4	3735.5	3711.0
172.5°	3743.5	3727.4	3732.9	3751.9	3727.4
175°	3757.0	3738.0	3743.5	3762.6	3735.5
177.5°	3762.6	3743.5	3746.4	3765.4	3740.9
180°	3749.0	3749.0	3749.0	3749.0	3749.0

TEST NUMBER: P909205

CATALOG NUMBER: DFN2DIP-SQ3F0-070D110US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.11	10.88	11.15	11.93	13.35	9.66	10.43	10.71	11.48	12.91
	3H	11.76	12.45	12.81	13.51	14.95	11.27	11.96	12.32	13.02	14.46
	4H	12.34	12.99	13.40	14.05	15.50	11.84	12.50	12.91	13.56	15.01
	6H	12.73	13.33	13.81	14.40	15.86	12.23	12.83	13.31	13.90	15.36
	8H	12.83	13.40	13.91	14.48	15.94	12.33	12.90	13.41	13.98	15.44
	12H	12.87	13.42	13.96	14.49	15.97	12.36	12.91	13.45	13.98	15.46
4H	2H	10.55	11.21	11.63	12.27	13.72	10.20	10.85	11.27	11.91	13.36
	3H	12.41	12.95	13.49	14.04	15.50	12.00	12.54	13.08	13.63	15.09
	4H	13.11	13.61	14.20	14.69	16.17	12.69	13.19	13.78	14.27	15.75
	6H	13.62	14.05	14.71	15.15	16.63	13.19	13.62	14.28	14.72	16.19
	8H	13.76	14.16	14.86	15.26	16.75	13.33	13.73	14.42	14.82	16.31
	12H	13.83	14.19	14.94	15.30	16.80	13.38	13.74	14.49	14.85	16.35
8H	4H	13.30	13.70	14.39	14.79	16.28	12.92	13.32	14.02	14.42	15.91
	6H	13.92	14.25	15.04	15.39	16.88	13.53	13.87	14.65	15.00	16.49
	8H	14.13	14.43	15.26	15.54	17.05	13.74	14.03	14.87	15.15	16.66
	12H	14.26	14.51	15.39	15.63	17.17	13.85	14.10	14.98	15.22	16.76
12H	4H	13.28	13.64	14.39	14.75	16.24	12.91	13.27	14.02	14.38	15.88
	6H	13.95	14.24	15.07	15.36	16.86	13.57	13.86	14.70	14.98	16.49
	8H	14.18	14.44	15.31	15.55	17.09	13.80	14.05	14.93	15.17	16.71