

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909228

Luminaire Tested: DFN2DIP-SQ3F0-080D080US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909228
REPORT IS A COMBINATION OF REPORTS P899941 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-080D080US840-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15148.0 lumens
Efficiency: N/A
Efficacy: 110.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 136.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909228

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US840-FLLFLL

Luminous Intensity Polar Plot

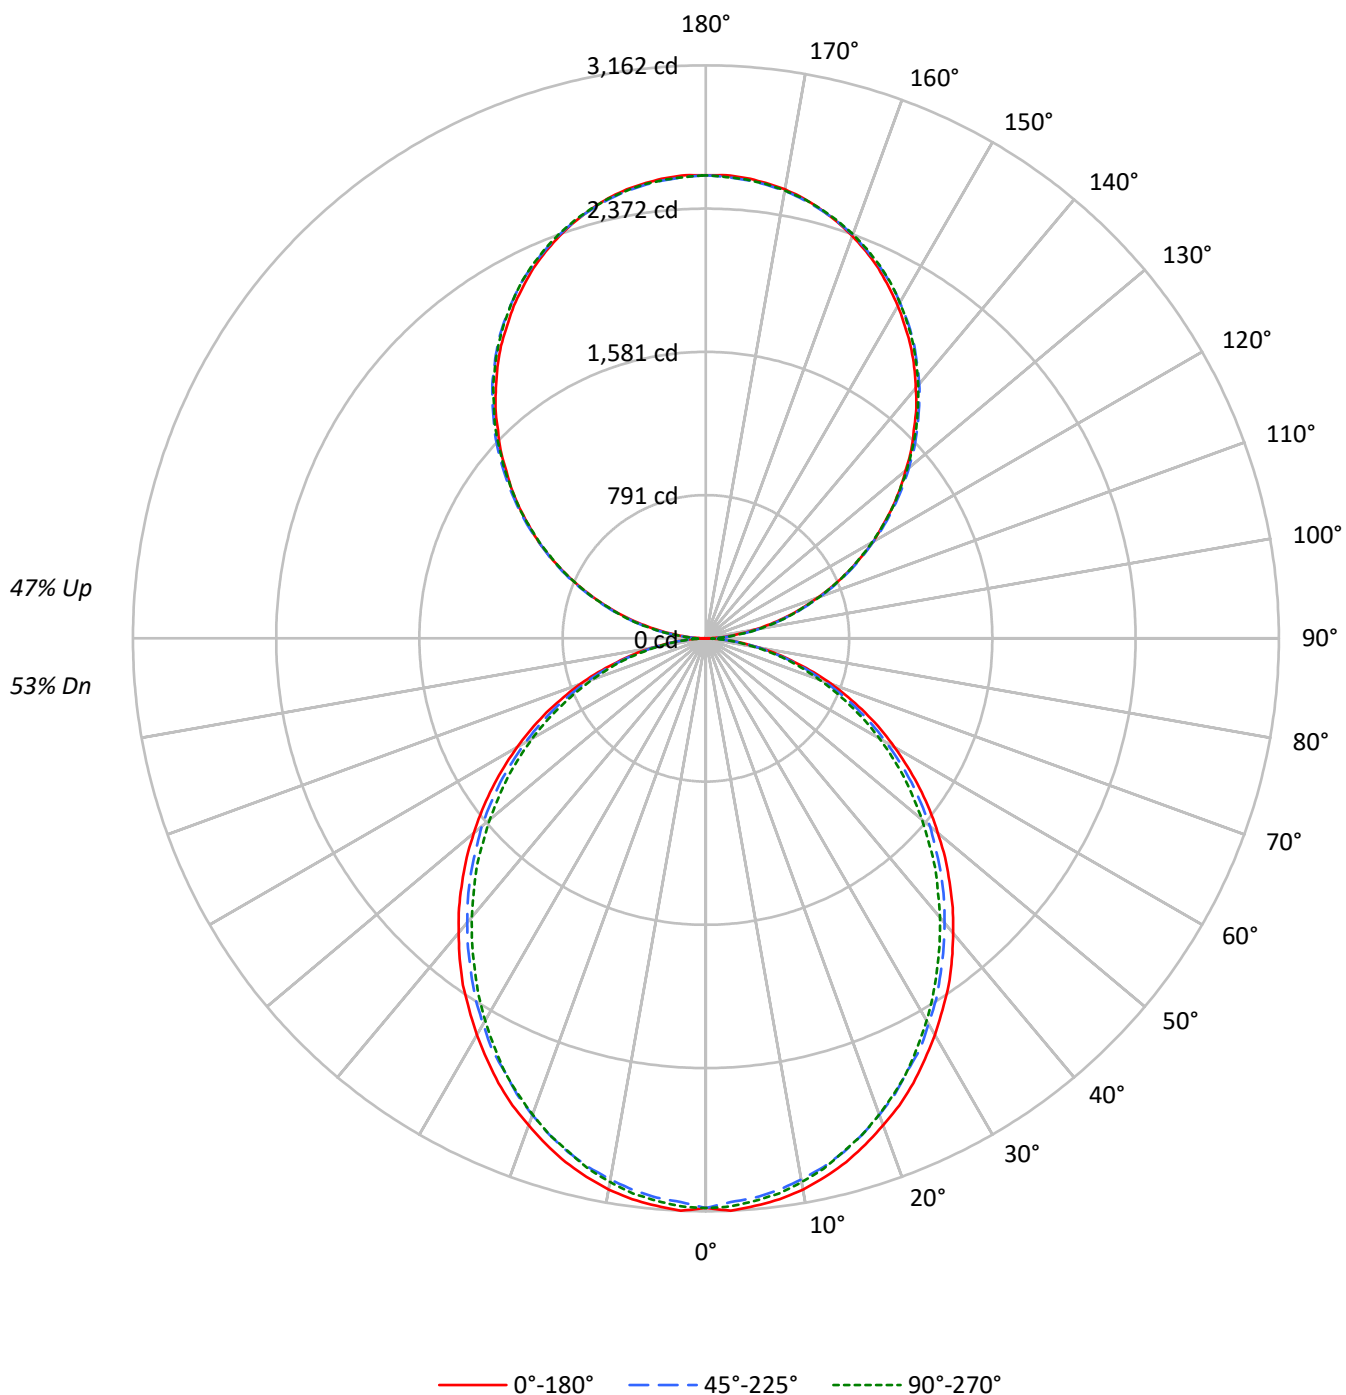

TEST NUMBER: P909228

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US840-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3602	3602	3602
5°	3605	3549	3574
10°	3574	3499	3525
15°	3519	3439	3448
20°	3446	3357	3369
25°	3373	3259	3279
30°	3282	3167	3164
35°	3195	3060	3042
40°	3090	2951	2926
45°	2984	2842	2808
50°	2868	2727	2671
55°	2747	2595	2544
60°	2609	2438	2400
65°	2459	2275	2229
70°	2268	2076	2045
75°	2004	1838	1873
80°	1684	1533	1548
85°	1185	1017	1013

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2984 cd/sqm

TEST NUMBER: P909228

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	295.9	2.0
10°-20°	832.5	5.5
20°-30°	1223.4	8.1
30°-40°	1420.9	9.4
40°-50°	1419.1	9.4
50°-60°	1237.5	8.2
60°-70°	914.7	6.0
70°-80°	517.6	3.4
80°-90°	143.9	0.9
90°-100°	158.1	1.0
100°-110°	502.4	3.3
110°-120°	859.7	5.7
120°-130°	1130.6	7.5
130°-140°	1269.1	8.4
140°-150°	1244.5	8.2
150°-160°	1043.9	6.9
160°-170°	692.3	4.6
170°-180°	242.0	1.6
0°-30°	2351.8	15.5
0°-40°	3772.7	24.9
0°-60°	6429.3	42.4
0°-90°	8005.4	52.8
90°-120°	1520.1	10.0
90°-150°	5164.3	34.1
90°-180°	7143.0	47.2
0°-180°	15148.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3144	3144	3144	3144	3144	
5°	3144	3132	3098	3122	3117	298
15°	2992	2975	2935	2947	2932	843
25°	2708	2684	2633	2639	2633	1246
35°	2337	2306	2258	2240	2225	1459
45°	1902	1880	1835	1802	1790	1467
55°	1439	1421	1384	1348	1333	1287
65°	970	952	922	895	880	959
75°	508	502	487	469	475	542
85°	124	121	118	109	106	138
90°	2	28	76	71	73	15
95°	112	134	138	138	134	125
105°	464	470	474	478	478	489
115°	863	875	871	869	863	853
125°	1255	1274	1268	1261	1259	1121
135°	1623	1647	1652	1649	1643	1254
145°	1970	1986	1998	2000	1992	1231
155°	2253	2259	2266	2277	2270	1037
165°	2451	2449	2449	2464	2453	691
175°	2550	2544	2540	2555	2542	242
180°	2555	2555	2555	2555	2555	

TEST NUMBER: P909228

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3143.5	3143.5	3143.5	3143.5	3143.5
2.5°	3161.8	3146.7	3113.4	3143.5	3137.8
5°	3143.5	3131.7	3098.4	3122.4	3116.6
7.5°	3122.4	3104.4	3071.1	3095.4	3089.4
10°	3089.4	3068.2	3031.9	3056.0	3047.1
12.5°	3043.8	3025.9	2989.6	3004.7	2998.6
15°	2992.5	2974.6	2935.1	2947.3	2932.2
17.5°	2929.0	2911.0	2871.6	2886.7	2871.6
20°	2859.4	2841.5	2799.1	2808.1	2796.2
22.5°	2790.2	2762.9	2723.4	2723.4	2717.3
25°	2708.4	2684.3	2633.0	2638.8	2633.0
27.5°	2617.6	2596.5	2557.3	2548.3	2533.2
30°	2527.2	2502.7	2457.6	2448.6	2436.4
32.5°	2430.3	2412.4	2363.9	2345.6	2333.5
35°	2336.6	2306.5	2258.1	2239.8	2224.7
37.5°	2230.8	2203.5	2155.2	2133.9	2118.9
40°	2122.1	2097.7	2049.3	2022.4	2010.1
42.5°	2016.3	1991.9	1943.8	1913.3	1895.4
45°	1901.5	1880.3	1834.7	1801.7	1789.6
47.5°	1789.6	1768.4	1719.9	1686.6	1668.6
50°	1671.5	1656.5	1614.1	1571.8	1556.7
52.5°	1556.7	1535.5	1496.4	1463.1	1441.9
55°	1439.0	1420.7	1384.5	1348.3	1333.1
57.5°	1321.0	1306.0	1266.5	1230.2	1218.0
60°	1203.0	1191.1	1148.7	1115.4	1106.4
62.5°	1088.1	1067.0	1036.8	1006.7	994.5
65°	970.5	952.2	922.0	894.7	879.7
67.5°	849.5	834.1	807.2	786.1	773.9
70°	737.6	725.4	698.2	677.0	665.1
72.5°	622.8	610.7	595.5	574.4	565.4
75°	507.7	501.9	486.6	468.6	474.6
77.5°	405.1	392.8	386.8	377.8	368.8
80°	302.5	299.2	293.2	284.2	278.0
82.5°	205.6	205.6	202.7	190.5	190.5
85°	123.8	120.9	118.1	108.8	105.8
87.5°	54.5	48.5	42.3	33.3	30.2
90°	2.3	27.8	75.5	70.9	73.2
92.5°	47.8	64.7	67.1	69.3	69.3
95°	112.5	134.0	137.8	137.8	134.0
97.5°	187.2	207.2	215.7	215.7	215.7
100°	273.5	291.1	297.3	297.3	295.0
102.5°	364.4	377.5	385.9	388.2	385.9
105°	463.7	469.9	474.5	478.4	478.4
107.5°	562.3	571.6	571.6	573.1	562.3
110°	657.8	670.1	670.1	670.1	664.0



TEST NUMBER: P909228

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	761.0	774.2	771.8	765.7	761.0
115°	862.7	875.0	871.2	868.9	862.7
117.5°	963.6	980.6	969.8	963.6	957.5
120°	1065.3	1082.3	1065.3	1065.3	1058.3
122.5°	1157.7	1179.3	1168.5	1162.4	1157.7
125°	1254.8	1274.0	1267.9	1260.9	1258.7
127.5°	1349.6	1373.4	1364.9	1355.7	1349.6
130°	1438.1	1465.8	1462.0	1457.4	1449.0
132.5°	1537.5	1559.0	1560.6	1549.8	1543.7
135°	1623.0	1646.9	1651.5	1649.2	1643.1
137.5°	1718.5	1737.8	1741.6	1740.1	1730.8
140°	1802.5	1821.7	1832.5	1832.5	1824.0
142.5°	1888.8	1908.0	1914.2	1916.5	1908.0
145°	1970.4	1985.8	1998.1	2000.4	1992.0
147.5°	2043.6	2062.9	2072.0	2076.0	2067.5
150°	2119.1	2132.1	2140.6	2147.6	2140.6
152.5°	2186.1	2199.2	2210.0	2218.5	2210.0
155°	2253.1	2259.3	2266.2	2276.9	2270.1
157.5°	2310.9	2315.5	2319.4	2334.7	2324.0
160°	2362.5	2367.1	2369.4	2382.5	2373.3
162.5°	2410.2	2410.2	2412.6	2427.2	2416.4
165°	2451.0	2448.7	2448.7	2464.2	2453.4
167.5°	2488.0	2481.1	2481.1	2496.5	2485.7
170°	2515.8	2509.6	2507.3	2522.7	2509.6
172.5°	2535.1	2528.9	2526.6	2541.9	2528.9
175°	2550.4	2544.3	2539.6	2555.1	2541.9
177.5°	2558.9	2552.7	2548.1	2561.2	2548.1
180°	2555.1	2555.1	2555.1	2555.1	2555.1

TEST NUMBER: P909228

CATALOG NUMBER: DFN2DIP-SQ3F0-080D080US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.95	12.84	12.88	13.79	15.02	11.50	12.39	12.44	13.34	14.57
	3H	13.61	14.40	14.55	15.36	16.61	13.12	13.91	14.06	14.87	16.12
	4H	14.19	14.95	15.15	15.91	17.17	13.70	14.45	14.66	15.41	16.68
	6H	14.59	15.28	15.56	16.25	17.53	14.09	14.78	15.06	15.75	17.03
	8H	14.69	15.35	15.67	16.34	17.61	14.19	14.85	15.17	15.84	17.11
	12H	14.74	15.37	15.72	16.35	17.65	14.23	14.86	15.21	15.84	17.14
4H	2H	12.41	13.16	13.37	14.13	15.39	12.05	12.81	13.02	13.77	15.03
	3H	14.27	14.90	15.25	15.89	17.17	13.86	14.49	14.84	15.49	16.76
	4H	14.98	15.56	15.97	16.54	17.85	14.56	15.13	15.54	16.12	17.42
	6H	15.50	15.99	16.49	17.00	18.30	15.06	15.56	16.06	16.57	17.87
	8H	15.64	16.11	16.64	17.11	18.42	15.21	15.67	16.20	16.67	17.99
	12H	15.72	16.13	16.73	17.15	18.47	15.27	15.68	16.28	16.70	18.02
8H	4H	15.18	15.64	16.17	16.64	17.96	14.80	15.26	15.80	16.27	17.58
	6H	15.80	16.19	16.83	17.23	18.54	15.42	15.80	16.44	16.85	18.16
	8H	16.02	16.36	17.05	17.39	18.72	15.63	15.97	16.66	17.00	18.33
	12H	16.15	16.45	17.18	17.47	18.85	15.74	16.04	16.77	17.06	18.44
12H	4H	15.16	15.58	16.18	16.60	17.92	14.80	15.21	15.81	16.23	17.55
	6H	15.83	16.17	16.86	17.20	18.53	15.46	15.80	16.49	16.83	18.16
	8H	16.07	16.37	17.10	17.40	18.77	15.69	15.99	16.72	17.01	18.39