

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909247

Luminaire Tested: DFN2DIP-SQ3F0-080D120US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909247
REPORT IS A COMBINATION OF REPORTS P901534 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-080D120US840-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18864.3 lumens
Efficiency: N/A
Efficacy: 110.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 170.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909247

CATALOG NUMBER: DFN2DIP-SQ3F0-080D120US840-RLLONL

Luminous Intensity Polar Plot

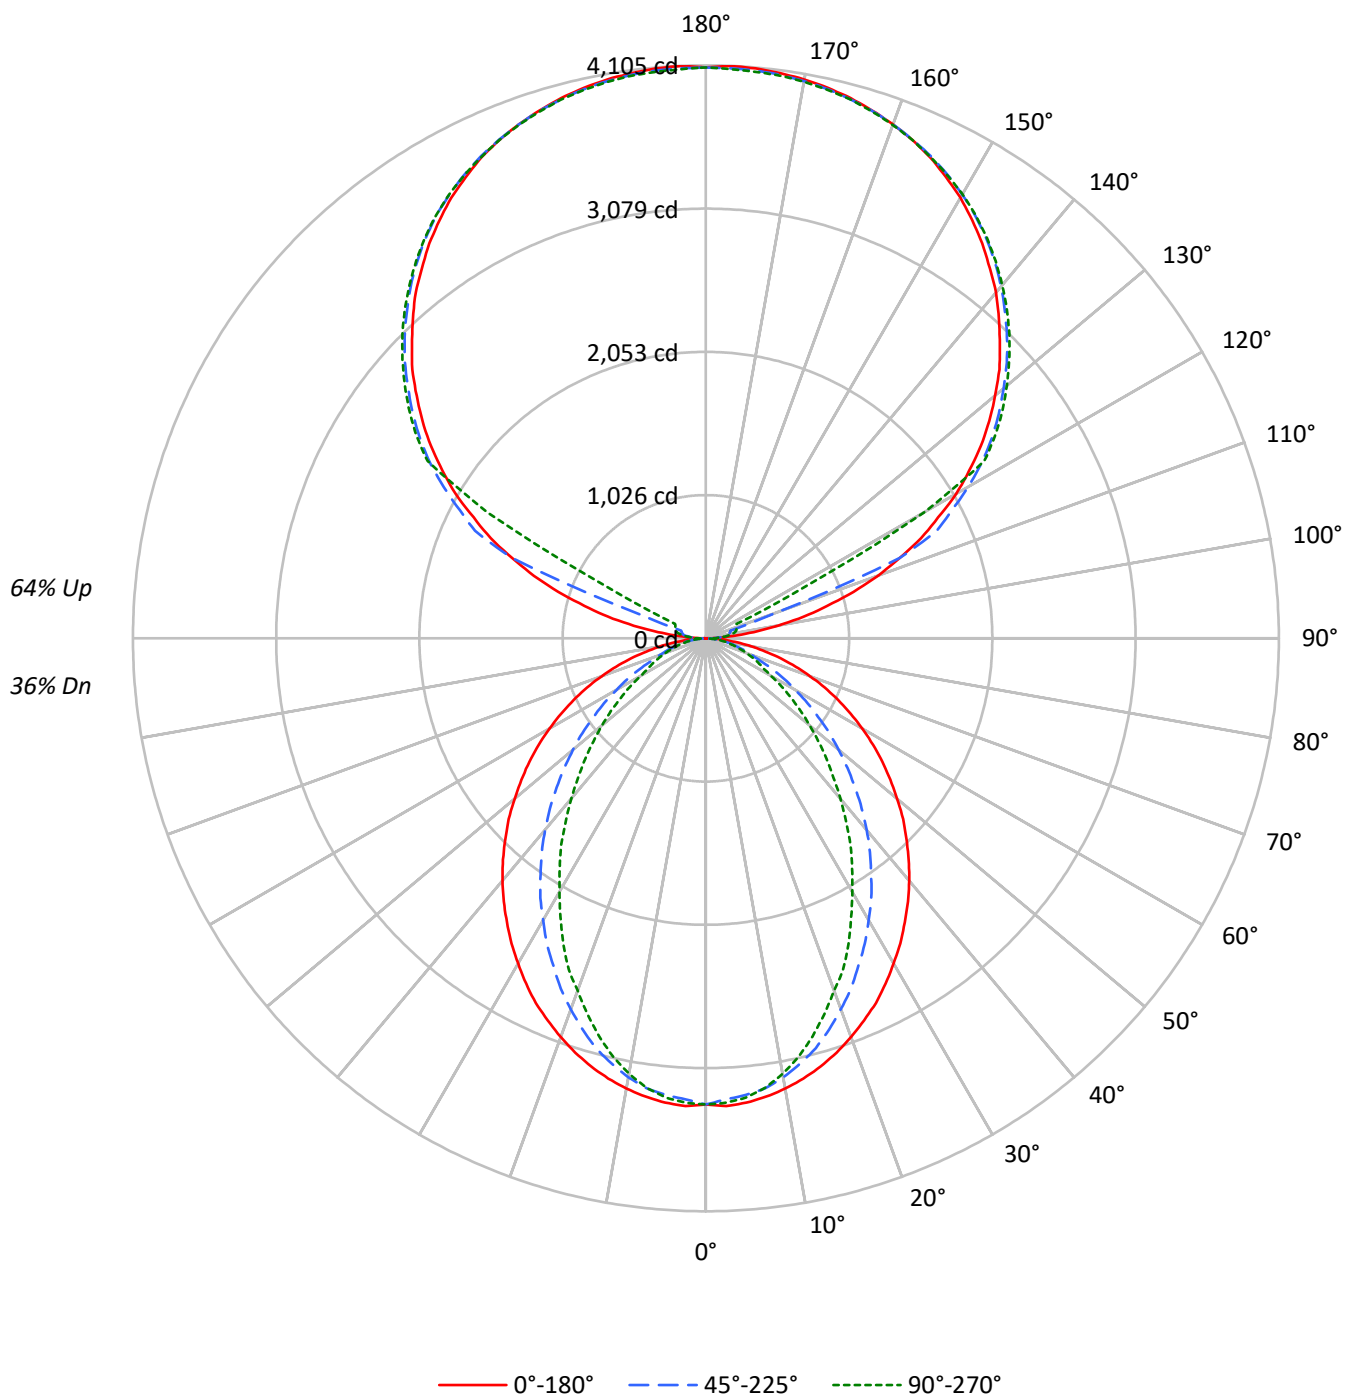

TEST NUMBER: P909247

CATALOG NUMBER: DFN2DIP-SQ3F0-080D120US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	91	87	84	86	83	80	77	67	65	63	52	51	50	39	38	38
2	87	80	74	69	78	73	68	63	59	56	53	46	44	42	35	33	32
3	79	70	63	58	72	64	58	53	52	48	45	41	38	36	31	29	28
4	73	63	55	49	66	57	51	46	47	42	38	37	34	31	28	26	24
5	67	56	48	42	60	51	44	39	42	37	33	33	30	27	25	23	21
6	62	50	42	37	56	46	39	34	38	33	29	30	27	24	23	21	19
7	57	45	38	32	52	41	35	30	34	29	26	28	24	21	21	19	17
8	53	41	34	29	48	38	31	27	31	26	23	25	22	19	20	17	15
9	49	37	30	25	45	34	28	24	29	24	20	23	20	17	18	16	14
10	46	34	27	23	42	32	25	21	26	22	18	22	18	15	17	14	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3826	3826	3826
5°	3830	3763	3788
10°	3789	3686	3663
15°	3735	3562	3472
20°	3663	3392	3237
25°	3590	3201	3010
30°	3493	3006	2723
35°	3397	2797	2471
40°	3299	2580	2182
45°	3186	2340	1920
50°	3069	2099	1665
55°	2947	1840	1419
60°	2805	1571	1167
65°	2642	1297	1049
70°	2444	1042	947
75°	2194	913	859
80°	1833	758	741
85°	1244	494	550

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3186 cd/sqm

TEST NUMBER: P909247

CATALOG NUMBER: DFN2DIP-SQ3F0-080D120US840-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	312.9	1.7
10°-20°	859.1	4.6
20°-30°	1206.1	6.4
30°-40°	1314.7	7.0
40°-50°	1208.4	6.4
50°-60°	949.0	5.0
60°-70°	617.7	3.3
70°-80°	318.0	1.7
80°-90°	88.4	0.5
90°-100°	134.9	0.7
100°-110°	502.7	2.7
110°-120°	1333.3	7.1
120°-130°	2211.4	11.7
130°-140°	2349.0	12.5
140°-150°	2183.2	11.6
150°-160°	1755.2	9.3
160°-170°	1131.0	6.0
170°-180°	389.3	2.1
0°-30°	2378.1	12.6
0°-40°	3692.9	19.6
0°-60°	5850.2	31.0
0°-90°	6874.3	36.4
90°-120°	1970.9	10.4
90°-150°	8714.5	46.2
90°-180°	11990.0	63.6
0°-180°	18864.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3339	3339	3339	3339	3339	
5°	3339	3324	3284	3312	3303	317
15°	3176	3142	3040	2982	2952	895
25°	2883	2786	2587	2463	2417	1326
35°	2484	2330	2064	1874	1807	1555
45°	2031	1828	1511	1296	1224	1568
55°	1544	1308	982	801	744	1380
65°	1043	798	526	423	414	1034
75°	556	344	242	221	218	588
85°	130	66	57	57	57	149
90°	3	35	59	74	80	18
95°	192	94	115	130	127	228
105°	900	989	181	213	225	961
115°	1702	1752	1826	456	243	1675
125°	2406	2444	2501	2521	2530	2146
135°	2977	3025	3051	3081	3075	2300
145°	3454	3451	3501	3522	3507	2160
155°	3803	3776	3812	3829	3806	1752
165°	4007	3989	3998	4019	3998	1132
175°	4098	4078	4084	4105	4075	390
180°	4090	4090	4090	4090	4090	

TEST NUMBER: P909247

CATALOG NUMBER: DFN2DIP-SQ3F0-080D120US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3339.0	3339.0	3339.0	3339.0	3339.0
2.5°	3354.1	3339.0	3305.7	3336.1	3330.0
5°	3339.0	3324.0	3284.5	3311.8	3302.8
7.5°	3311.8	3293.8	3251.5	3263.4	3248.2
10°	3275.5	3254.4	3194.1	3184.8	3166.8
12.5°	3230.4	3203.1	3121.3	3103.3	3070.0
15°	3175.8	3142.5	3039.9	2982.5	2952.3
17.5°	3112.3	3063.9	2937.0	2870.6	2822.2
20°	3039.9	2979.3	2828.3	2753.0	2686.2
22.5°	2961.3	2891.7	2716.4	2613.8	2568.6
25°	2882.8	2786.0	2586.6	2462.9	2417.3
27.5°	2789.1	2686.2	2465.7	2323.7	2254.1
30°	2689.5	2574.3	2332.7	2178.8	2097.0
32.5°	2592.6	2453.6	2206.1	2024.6	1948.9
35°	2484.0	2329.8	2064.0	1873.6	1806.9
37.5°	2378.1	2211.8	1931.0	1722.2	1646.9
40°	2266.3	2085.2	1791.8	1577.3	1498.7
42.5°	2151.5	1958.2	1652.9	1429.3	1353.8
45°	2030.6	1828.1	1511.0	1296.2	1223.8
47.5°	1915.9	1701.4	1375.0	1160.2	1093.9
50°	1788.9	1574.5	1242.0	1033.3	970.1
52.5°	1664.9	1438.1	1115.0	915.6	858.3
55°	1544.0	1308.4	982.0	800.8	743.5
57.5°	1420.3	1178.5	864.3	695.1	646.6
60°	1293.2	1051.6	740.2	586.3	538.0
62.5°	1169.5	927.8	634.5	489.6	465.5
65°	1042.6	797.6	525.7	423.2	413.8
67.5°	921.7	676.8	423.2	371.5	362.6
70°	794.8	559.2	350.4	320.2	308.1
72.5°	673.9	450.1	293.1	269.0	262.9
75°	555.9	344.4	241.8	220.6	217.7
77.5°	438.3	244.6	190.5	178.2	172.2
80°	329.2	175.4	144.9	133.0	133.0
82.5°	229.5	118.0	99.7	93.6	93.6
85°	129.9	66.3	57.4	57.4	57.4
87.5°	48.4	24.0	24.0	21.2	21.2
90°	2.8	35.4	59.1	74.1	79.8
92.5°	74.1	62.2	71.0	77.0	79.8
95°	192.2	94.5	115.2	130.4	127.2
97.5°	346.2	103.7	150.8	159.9	162.7
100°	523.9	118.5	168.6	192.2	198.2
102.5°	719.0	713.4	174.6	207.0	216.1
105°	899.6	988.6	180.7	213.0	224.9
107.5°	1109.7	1183.6	186.6	218.9	230.9
110°	1311.1	1373.0	518.0	222.1	233.7

TEST NUMBER: P909247

CATALOG NUMBER: DFN2DIP-SQ3F0-080D120US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1500.6	1553.6	1503.4	227.7	236.8
115°	1701.5	1751.8	1825.9	455.8	242.9
117.5°	1876.2	1935.3	1985.9	1562.4	787.2
120°	2071.6	2115.9	2169.3	2204.8	1805.2
122.5°	2237.2	2284.6	2344.0	2361.6	2364.7
125°	2405.8	2444.5	2500.7	2521.4	2530.2
127.5°	2559.7	2601.2	2645.8	2675.3	2678.2
130°	2704.8	2752.3	2784.6	2817.3	2814.5
132.5°	2852.8	2891.4	2923.8	2950.5	2947.7
135°	2977.2	3024.6	3051.0	3080.9	3074.9
137.5°	3107.3	3142.7	3172.6	3202.1	3193.3
140°	3234.5	3258.3	3290.6	3317.4	3302.7
142.5°	3341.2	3362.0	3400.3	3423.8	3409.1
145°	3453.7	3450.6	3500.8	3521.6	3506.8
147.5°	3551.1	3542.3	3592.6	3607.3	3595.7
150°	3645.9	3625.2	3672.7	3690.3	3675.5
152.5°	3725.7	3702.2	3746.5	3764.4	3743.7
155°	3802.6	3776.3	3811.8	3829.4	3805.9
157.5°	3864.9	3841.3	3868.1	3888.8	3864.9
160°	3918.3	3900.4	3918.3	3935.8	3915.1
162.5°	3965.4	3947.9	3962.6	3983.3	3956.7
165°	4006.8	3989.3	3998.1	4018.9	3998.1
167.5°	4039.6	4021.6	4030.8	4051.5	4024.8
170°	4066.2	4048.3	4054.3	4075.0	4048.3
172.5°	4083.8	4066.2	4072.3	4093.0	4066.2
175°	4098.5	4077.8	4083.8	4104.6	4075.0
177.5°	4104.6	4083.8	4087.0	4107.7	4081.1
180°	4089.9	4089.9	4089.9	4089.9	4089.9

TEST NUMBER: P909247

CATALOG NUMBER: DFN2DIP-SQ3F0-080D120US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.36	11.09	11.43	12.16	13.61	6.32	7.05	7.39	8.12	9.58
	3H	12.03	12.68	13.11	13.76	15.23	7.50	8.15	8.58	9.23	10.70
	4H	12.63	13.25	13.72	14.32	15.80	7.94	8.56	9.03	9.63	11.11
	6H	13.04	13.61	14.14	14.69	16.18	8.25	8.82	9.35	9.90	11.39
	8H	13.16	13.70	14.26	14.80	16.28	8.33	8.87	9.44	9.97	11.46
	12H	13.22	13.73	14.33	14.82	16.33	8.37	8.88	9.48	9.97	11.48
4H	2H	10.36	10.98	11.46	12.06	13.54	6.90	7.52	8.00	8.60	10.08
	3H	12.18	12.69	13.28	13.80	15.29	8.23	8.75	9.34	9.86	11.35
	4H	12.86	13.34	13.97	14.43	15.94	8.77	9.25	9.88	10.34	11.85
	6H	13.37	13.77	14.49	14.89	16.40	9.18	9.58	10.30	10.70	12.21
	8H	13.54	13.92	14.66	15.03	16.55	9.30	9.68	10.42	10.79	12.31
	12H	13.63	13.97	14.76	15.09	16.62	9.36	9.70	10.49	10.83	12.35
8H	4H	12.82	13.20	13.94	14.31	15.83	9.04	9.42	10.16	10.53	12.05
	6H	13.38	13.69	14.52	14.84	16.36	9.55	9.86	10.69	11.01	12.53
	8H	13.59	13.86	14.74	15.00	16.54	9.74	10.01	10.88	11.14	12.68
	12H	13.72	13.96	14.87	15.09	16.67	9.84	10.08	10.99	11.21	12.79
12H	4H	12.77	13.11	13.90	14.23	15.76	9.04	9.38	10.18	10.51	12.03
	6H	13.35	13.63	14.50	14.76	16.30	9.60	9.87	10.74	11.00	12.54
	8H	13.57	13.81	14.71	14.94	16.51	9.80	10.04	10.94	11.17	12.74

END OF REPORT