

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909253

Luminaire Tested: DFN2DIP-SQ3F0-090D050US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909253
REPORT IS A COMBINATION OF REPORTS P901409 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D050US840-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13996.8 lumens
Efficiency: N/A
Efficacy: 112.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 124.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909253

CATALOG NUMBER: DFN2DIP-SQ3F0-090D050US840-FLLONL

Luminous Intensity Polar Plot

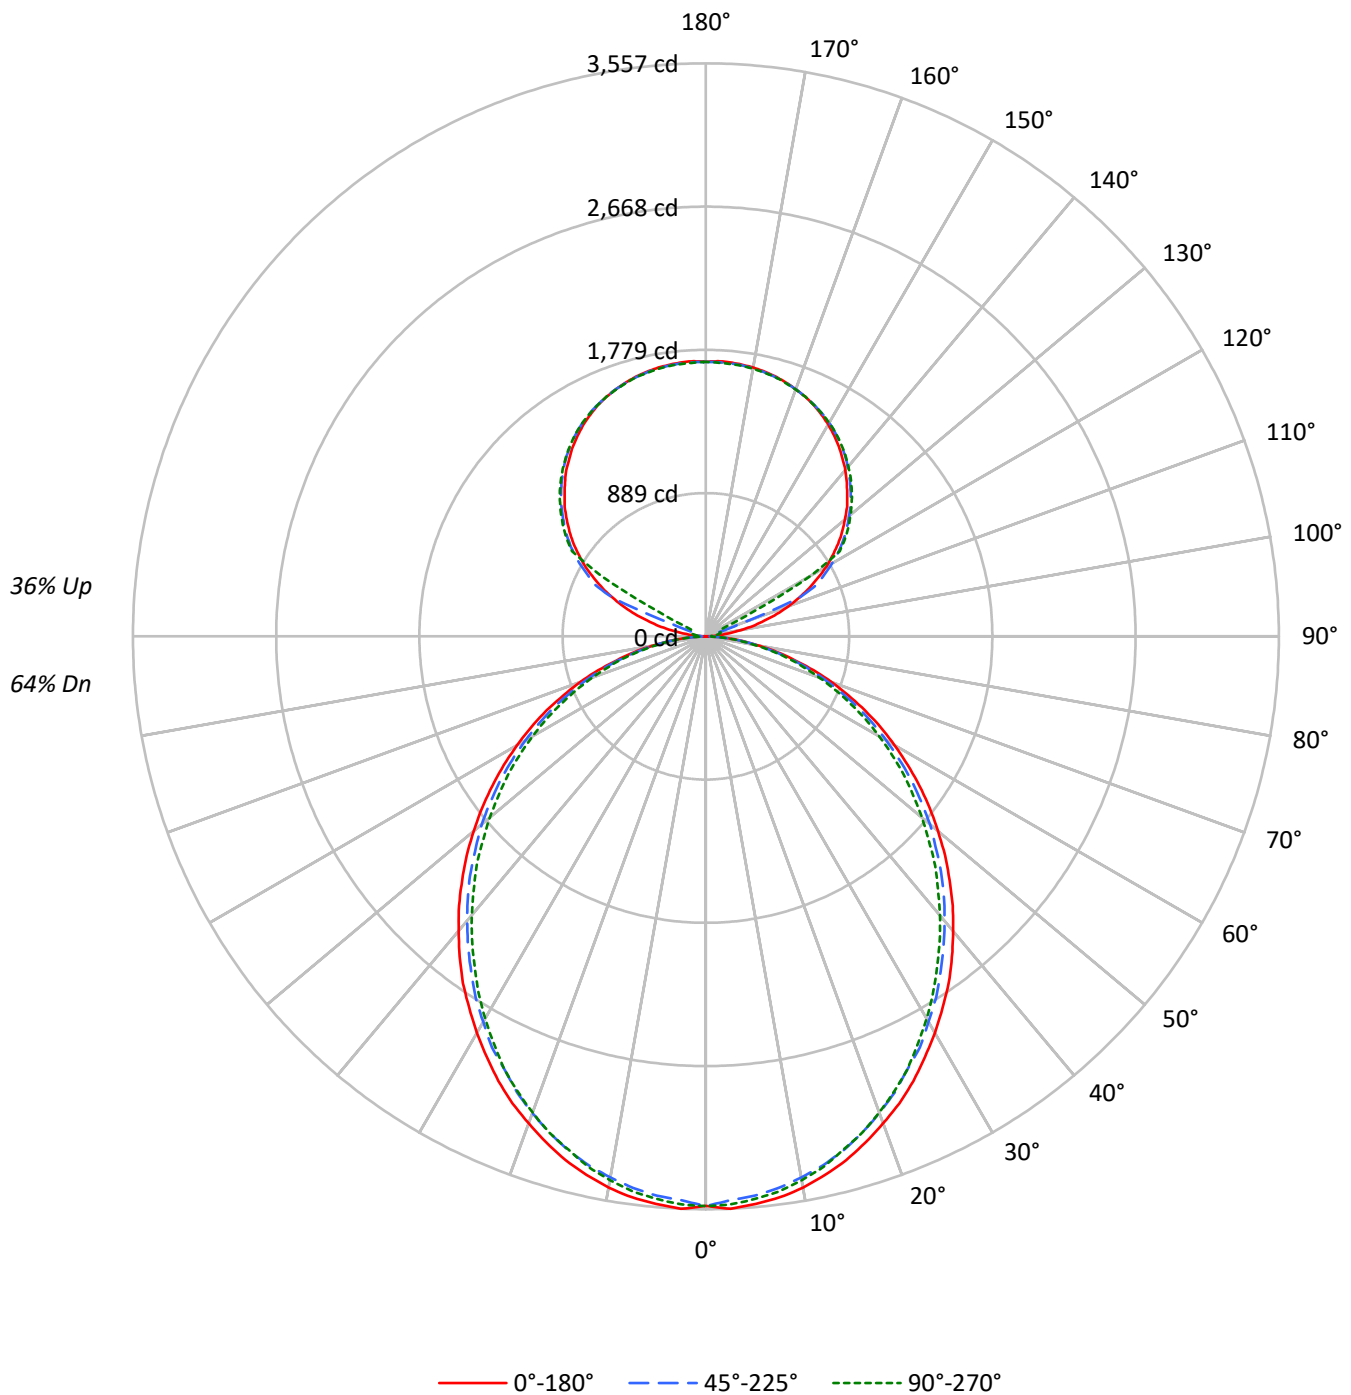

TEST NUMBER: P909253

CATALOG NUMBER: DFN2DIP-SQ3F0-090D050US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	91	91	91	80	80	80	69	69	69
1	101	97	93	89	95	91	87	84	80	78	75	70	68	67	61	60	59
2	92	84	78	73	86	79	74	69	70	66	62	62	59	56	54	51	49
3	84	74	67	61	79	70	63	58	62	57	52	55	51	47	48	45	42
4	77	66	58	51	72	62	55	49	55	49	45	49	44	40	43	39	36
5	71	59	50	44	66	55	48	42	49	43	39	44	39	35	39	35	32
6	65	53	44	38	61	50	42	37	45	38	34	40	35	31	35	31	28
7	60	48	40	34	57	45	38	33	41	34	30	36	31	27	32	28	25
8	56	43	35	30	53	41	34	29	37	31	27	33	28	24	29	25	22
9	52	40	32	27	49	38	31	26	34	28	24	30	26	22	27	23	20
10	49	37	29	24	46	35	28	23	31	26	22	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4052	4052	4052
5°	4056	3993	4021
10°	4021	3936	3965
15°	3959	3869	3879
20°	3876	3776	3791
25°	3794	3666	3689
30°	3692	3563	3559
35°	3595	3442	3423
40°	3476	3320	3292
45°	3357	3197	3159
50°	3227	3068	3005
55°	3090	2919	2863
60°	2935	2742	2700
65°	2767	2559	2508
70°	2551	2335	2301
75°	2254	2067	2107
80°	1894	1724	1742
85°	1334	1143	1140

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3357 cd/sqm

TEST NUMBER: P909253

CATALOG NUMBER: DFN2DIP-SQ3F0-090D050US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	332.9	2.4
10°-20°	936.5	6.7
20°-30°	1376.3	9.8
30°-40°	1598.5	11.4
40°-50°	1596.5	11.4
50°-60°	1392.1	9.9
60°-70°	1029.1	7.4
70°-80°	582.2	4.2
80°-90°	156.7	1.1
90°-100°	56.2	0.4
100°-110°	209.5	1.5
110°-120°	555.6	4.0
120°-130°	921.4	6.6
130°-140°	978.8	7.0
140°-150°	909.7	6.5
150°-160°	731.3	5.2
160°-170°	471.2	3.4
170°-180°	162.2	1.2
0°-30°	2645.7	18.9
0°-40°	4244.2	30.3
0°-60°	7232.9	51.7
0°-90°	9000.9	64.3
90°-120°	821.2	5.9
90°-150°	3631.1	25.9
90°-180°	4996.0	35.7
0°-180°	13996.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3536	3536	3536	3536	3536	
5°	3536	3523	3486	3513	3506	336
15°	3367	3346	3302	3316	3299	948
25°	3047	3020	2962	2969	2962	1402
35°	2629	2595	2540	2520	2503	1642
45°	2139	2115	2064	2027	2013	1651
55°	1619	1598	1558	1517	1500	1447
65°	1092	1071	1037	1007	990	1079
75°	571	565	547	527	534	610
85°	139	136	133	122	119	155
90°	1	15	25	31	33	13
95°	80	39	48	54	53	95
105°	375	412	75	89	94	401
115°	709	730	761	190	101	698
125°	1002	1019	1042	1051	1054	894
135°	1240	1260	1271	1284	1281	958
145°	1439	1438	1459	1467	1461	900
155°	1584	1574	1588	1596	1586	730
165°	1670	1662	1666	1674	1666	472
175°	1708	1699	1702	1710	1698	163
180°	1704	1704	1704	1704	1704	

TEST NUMBER: P909253

CATALOG NUMBER: DFN2DIP-SQ3F0-090D050US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3536.4	3536.4	3536.4	3536.4	3536.4
2.5°	3557.0	3540.1	3502.6	3536.4	3530.0
5°	3536.4	3523.1	3485.7	3512.7	3506.2
7.5°	3512.7	3492.5	3455.0	3482.4	3475.6
10°	3475.6	3451.7	3410.9	3438.0	3427.9
12.5°	3424.3	3404.1	3363.4	3380.2	3373.5
15°	3366.6	3346.4	3302.0	3315.7	3298.7
17.5°	3295.1	3274.9	3230.6	3247.5	3230.6
20°	3216.8	3196.6	3149.0	3159.1	3145.7
22.5°	3138.9	3108.3	3063.8	3063.8	3057.0
25°	3046.9	3019.8	2962.1	2968.6	2962.1
27.5°	2944.8	2920.9	2877.0	2866.9	2849.9
30°	2843.1	2815.6	2764.7	2754.6	2741.0
32.5°	2734.1	2713.9	2659.4	2638.9	2625.1
35°	2628.8	2594.8	2540.3	2519.8	2502.9
37.5°	2509.7	2479.0	2424.5	2400.8	2383.8
40°	2387.3	2360.0	2305.4	2275.1	2261.5
42.5°	2268.3	2240.9	2186.8	2152.5	2132.3
45°	2139.1	2115.4	2064.1	2026.9	2013.3
47.5°	2013.3	1989.4	1934.9	1897.4	1877.2
50°	1880.5	1863.5	1815.8	1768.3	1751.3
52.5°	1751.3	1727.5	1683.4	1646.0	1622.1
55°	1618.9	1598.3	1557.5	1516.8	1499.9
57.5°	1486.1	1469.2	1424.8	1384.0	1370.3
60°	1353.3	1340.0	1292.3	1254.9	1244.8
62.5°	1224.2	1200.3	1166.4	1132.6	1118.8
65°	1091.8	1071.2	1037.2	1006.6	989.7
67.5°	955.7	938.5	908.1	884.3	870.6
70°	829.8	816.1	785.5	761.6	748.3
72.5°	700.6	686.9	669.9	646.2	636.1
75°	571.2	564.6	547.3	527.1	534.0
77.5°	455.7	442.0	435.2	425.1	415.0
80°	340.2	336.6	329.7	319.6	312.9
82.5°	231.3	231.3	228.0	214.3	214.3
85°	139.3	136.0	132.8	122.3	119.1
87.5°	61.3	54.4	47.7	37.6	33.9
90°	1.2	14.7	24.6	30.9	33.2
92.5°	30.9	26.0	29.6	32.1	33.2
95°	80.1	39.4	48.1	54.3	53.0
97.5°	144.2	43.2	62.8	66.7	67.8
100°	218.3	49.4	70.3	80.1	82.6
102.5°	299.6	297.2	72.8	86.2	90.1
105°	374.9	411.9	75.2	88.8	93.7
107.5°	462.4	493.1	77.8	91.2	96.2
110°	546.3	572.1	215.8	92.5	97.4

TEST NUMBER: P909253

CATALOG NUMBER: DFN2DIP-SQ3F0-090D050US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	625.2	647.3	626.4	94.9	98.7
115°	709.0	729.9	760.8	190.0	101.2
117.5°	781.7	806.4	827.5	651.0	328.0
120°	863.1	881.6	903.8	918.7	752.1
122.5°	932.1	951.9	976.6	984.0	985.3
125°	1002.4	1018.6	1042.0	1050.6	1054.3
127.5°	1066.5	1083.8	1102.5	1114.7	1115.9
130°	1127.0	1146.8	1160.2	1173.9	1172.8
132.5°	1188.7	1204.8	1218.2	1229.4	1228.2
135°	1240.5	1260.3	1271.2	1283.7	1281.2
137.5°	1294.6	1309.5	1321.9	1334.2	1330.6
140°	1347.7	1357.7	1371.1	1382.2	1376.1
142.5°	1392.2	1400.9	1416.8	1426.6	1420.5
145°	1439.1	1437.7	1458.6	1467.3	1461.2
147.5°	1479.7	1475.9	1496.9	1503.1	1498.2
150°	1519.1	1510.6	1530.2	1537.6	1531.5
152.5°	1552.4	1542.6	1561.1	1568.5	1559.8
155°	1584.5	1573.5	1588.2	1595.6	1585.8
157.5°	1610.3	1600.5	1611.6	1620.3	1610.3
160°	1632.6	1625.2	1632.6	1639.9	1631.3
162.5°	1652.2	1645.0	1651.0	1659.7	1648.6
165°	1669.5	1662.2	1665.9	1674.5	1665.9
167.5°	1683.1	1675.7	1679.5	1688.1	1677.0
170°	1694.3	1686.8	1689.3	1697.9	1686.8
172.5°	1701.6	1694.3	1696.8	1705.4	1694.3
175°	1707.8	1699.1	1701.6	1710.2	1697.9
177.5°	1710.2	1701.6	1702.9	1711.5	1700.4
180°	1704.0	1704.0	1704.0	1704.0	1704.0

TEST NUMBER: P909253

CATALOG NUMBER: DFN2DIP-SQ3F0-090D050US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.32	14.33	14.15	15.18	16.23	12.88	13.89	13.70	14.73	15.78
	3H	14.99	15.89	15.83	16.75	17.83	14.50	15.40	15.34	16.26	17.34
	4H	15.58	16.44	16.44	17.30	18.39	15.09	15.94	15.94	16.80	17.89
	6H	15.99	16.77	16.85	17.64	18.75	15.49	16.27	16.35	17.14	18.25
	8H	16.09	16.84	16.97	17.73	18.83	15.59	16.34	16.47	17.23	18.33
	12H	16.14	16.86	17.02	17.74	18.87	15.64	16.35	16.52	17.23	18.36
4H	2H	13.80	14.65	14.66	15.52	16.61	13.44	14.30	14.30	15.16	16.25
	3H	15.67	16.39	16.54	17.28	18.39	15.26	15.98	16.13	16.87	17.98
	4H	16.39	17.04	17.27	17.93	19.06	15.96	16.61	16.85	17.51	18.64
	6H	16.91	17.47	17.80	18.39	19.52	16.48	17.04	17.37	17.95	19.09
	8H	17.06	17.58	17.96	18.49	19.64	16.62	17.15	17.52	18.06	19.20
	12H	17.14	17.61	18.06	18.54	19.69	16.69	17.16	17.61	18.09	19.24
8H	4H	16.59	17.12	17.49	18.03	19.18	16.22	16.74	17.12	17.65	18.80
	6H	17.22	17.66	18.15	18.61	19.76	16.84	17.27	17.77	18.23	19.37
	8H	17.44	17.83	18.38	18.77	19.94	17.05	17.43	17.99	18.38	19.54
	12H	17.58	17.92	18.52	18.85	20.07	17.17	17.51	18.11	18.44	19.66
12H	4H	16.58	17.06	17.50	17.99	19.14	16.22	16.69	17.14	17.62	18.77
	6H	17.25	17.64	18.19	18.58	19.75	16.88	17.27	17.82	18.21	19.37
	8H	17.50	17.84	18.44	18.77	19.99	17.12	17.46	18.06	18.39	19.61