

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909267

Luminaire Tested: DFN2DIP-SQ3F0-090D080US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909267
REPORT IS A COMBINATION OF REPORTS P901464 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D080US840-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15723.6 lumens
Efficiency: N/A
Efficacy: 106.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 148.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909267

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US840-RLLONL

Luminous Intensity Polar Plot

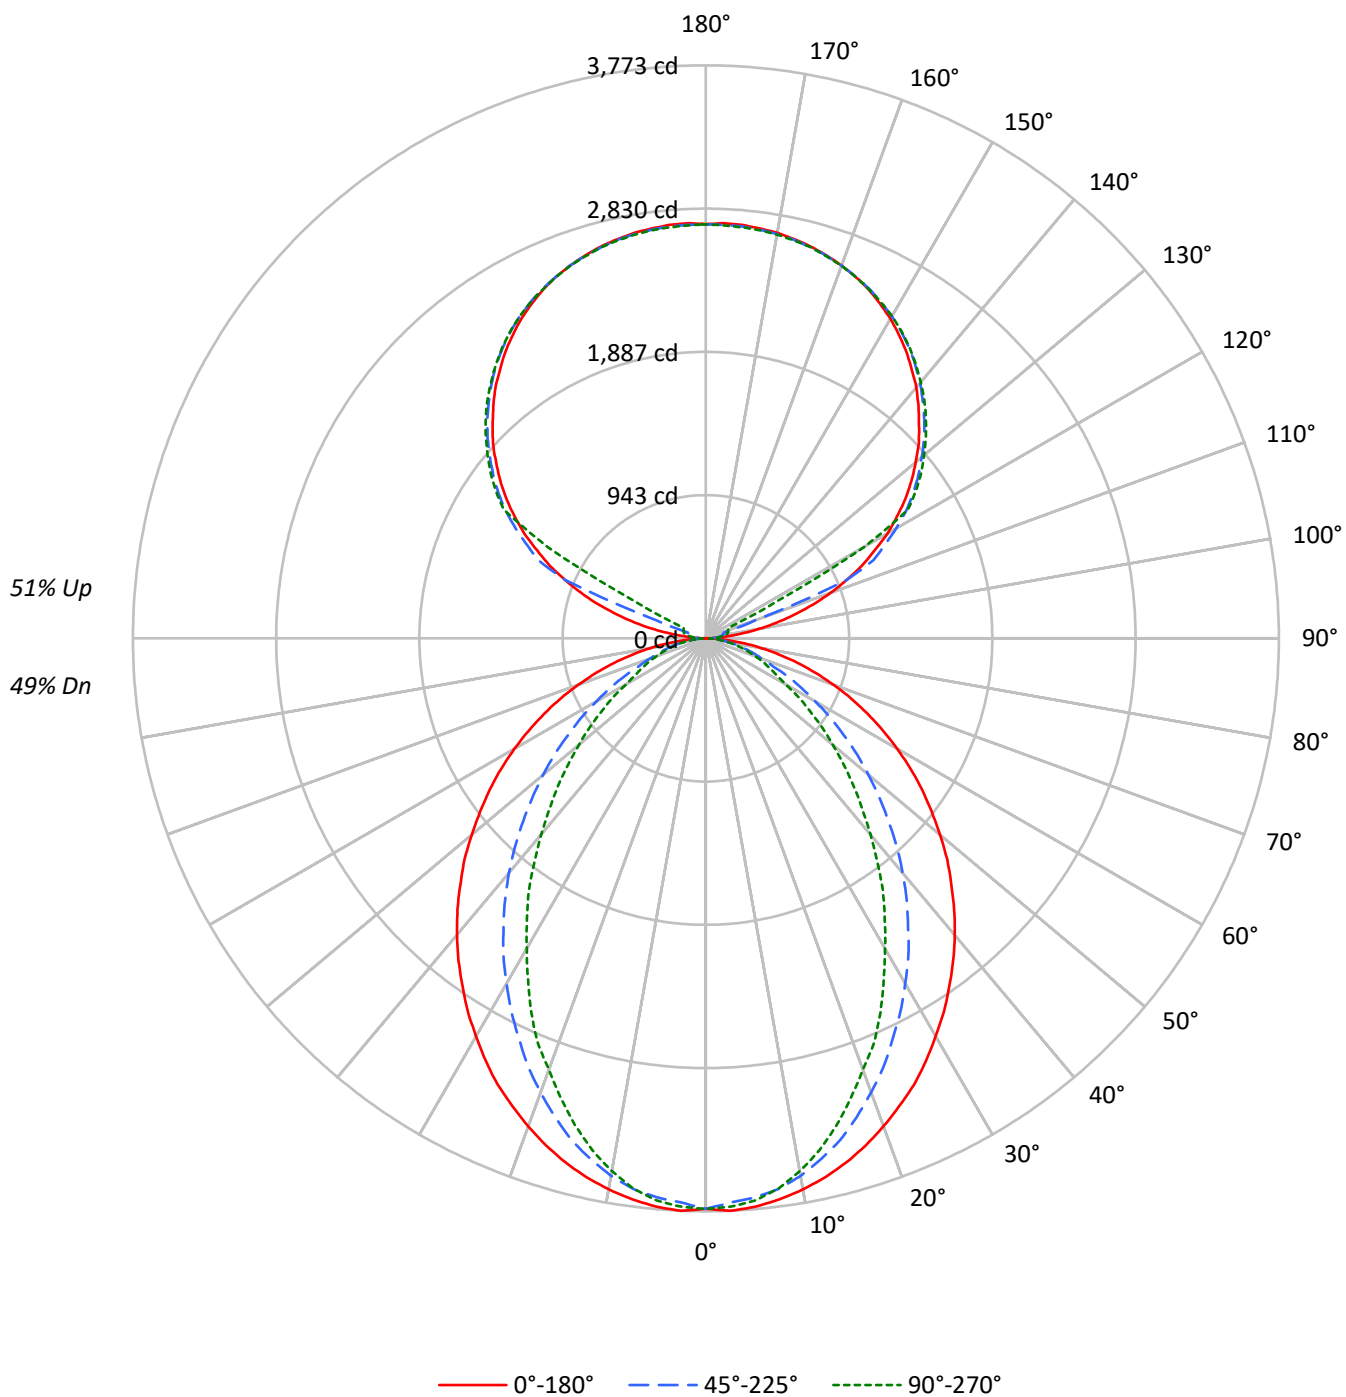

TEST NUMBER: P909267

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	52	49	44	42	41
3	82	73	66	60	75	68	62	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	37	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	30	27
6	64	52	44	39	59	49	42	37	42	36	32	36	31	28	30	27	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	28	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4304	4304	4304
5°	4308	4233	4261
10°	4263	4147	4121
15°	4201	4007	3906
20°	4121	3816	3642
25°	4039	3601	3387
30°	3929	3382	3064
35°	3822	3146	2780
40°	3712	2903	2455
45°	3585	2633	2160
50°	3453	2361	1873
55°	3315	2070	1596
60°	3156	1767	1313
65°	2972	1459	1180
70°	2749	1172	1066
75°	2468	1027	966
80°	2062	852	834
85°	1398	555	618

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3585 cd/sqm

TEST NUMBER: P909267

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	352.1	2.2
10°-20°	966.5	6.1
20°-30°	1356.9	8.6
30°-40°	1479.1	9.4
40°-50°	1359.4	8.6
50°-60°	1067.6	6.8
60°-70°	694.9	4.4
70°-80°	357.7	2.3
80°-90°	96.1	0.6
90°-100°	89.9	0.6
100°-110°	335.1	2.1
110°-120°	888.9	5.7
120°-130°	1474.3	9.4
130°-140°	1566.0	10.0
140°-150°	1455.4	9.3
150°-160°	1170.1	7.4
160°-170°	754.0	4.8
170°-180°	259.5	1.7
0°-30°	2675.4	17.0
0°-40°	4154.5	26.4
0°-60°	6581.5	41.9
0°-90°	7730.3	49.2
90°-120°	1314.0	8.4
90°-150°	5809.7	36.9
90°-180°	7993.0	50.8
0°-180°	15723.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3756	3756	3756	3756	3756	
5°	3756	3739	3695	3726	3716	356
15°	3573	3535	3420	3355	3321	1007
25°	3243	3134	2910	2771	2720	1492
35°	2794	2621	2322	2108	2033	1749
45°	2284	2057	1700	1458	1377	1764
55°	1737	1472	1105	901	836	1552
65°	1173	897	592	476	466	1163
75°	625	387	272	248	245	661
85°	146	75	64	64	64	168
90°	2	24	39	49	53	15
95°	128	63	77	87	85	152
105°	600	659	120	142	150	641
115°	1134	1168	1217	304	162	1117
125°	1604	1630	1667	1681	1687	1430
135°	1985	2016	2034	2054	2050	1533
145°	2302	2300	2334	2348	2338	1440
155°	2535	2518	2541	2553	2537	1168
165°	2671	2660	2665	2679	2665	755
175°	2732	2719	2723	2736	2717	260
180°	2726	2726	2726	2726	2726	

TEST NUMBER: P909267

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3756.4	3756.4	3756.4	3756.4	3756.4
2.5°	3773.4	3756.4	3718.8	3753.2	3746.3
5°	3756.4	3739.4	3695.1	3725.7	3715.6
7.5°	3725.7	3705.5	3657.9	3671.3	3654.3
10°	3685.0	3661.2	3593.4	3582.9	3562.7
12.5°	3634.1	3603.5	3511.5	3491.3	3453.7
15°	3572.8	3535.3	3419.9	3355.3	3321.4
17.5°	3501.4	3447.0	3304.1	3229.4	3175.0
20°	3419.9	3351.7	3181.8	3097.1	3022.0
22.5°	3331.5	3253.3	3056.0	2940.5	2889.7
25°	3243.2	3134.2	2909.9	2770.7	2719.5
27.5°	3137.9	3022.0	2773.9	2614.1	2535.9
30°	3025.7	2896.2	2624.2	2451.1	2359.1
32.5°	2916.7	2760.2	2481.7	2277.7	2192.5
35°	2794.5	2621.0	2322.0	2107.8	2032.8
37.5°	2675.4	2488.3	2172.3	1937.5	1852.8
40°	2549.6	2345.8	2015.8	1774.5	1686.2
42.5°	2420.4	2203.0	1859.6	1607.9	1523.1
45°	2284.5	2056.6	1699.8	1458.1	1376.6
47.5°	2155.4	1914.1	1546.9	1305.3	1230.6
50°	2012.6	1771.2	1397.2	1162.5	1091.4
52.5°	1873.0	1618.0	1254.5	1030.1	965.5
55°	1737.0	1471.9	1104.7	901.0	836.4
57.5°	1597.8	1325.9	972.4	781.9	727.5
60°	1454.9	1183.0	832.8	659.6	605.2
62.5°	1315.8	1043.8	713.8	550.8	523.7
65°	1172.9	897.4	591.5	476.1	465.6
67.5°	1036.9	761.3	476.1	418.0	407.9
70°	894.1	629.0	394.3	360.3	346.6
72.5°	758.1	506.3	329.6	302.6	295.8
75°	625.4	387.4	272.0	248.1	244.9
77.5°	493.0	275.2	214.2	200.6	193.7
80°	370.4	197.3	163.0	149.7	149.7
82.5°	258.2	132.7	112.2	105.3	105.3
85°	146.0	74.6	64.5	64.5	64.5
87.5°	54.4	27.1	27.1	23.8	23.8
90°	1.9	23.6	39.4	49.4	53.2
92.5°	49.4	41.5	47.4	51.3	53.2
95°	128.2	63.0	76.9	86.9	84.8
97.5°	230.8	69.1	100.5	106.6	108.5
100°	349.3	79.0	112.5	128.2	132.1
102.5°	479.4	475.5	116.4	137.9	144.1
105°	599.8	659.0	120.4	142.0	150.0
107.5°	739.8	789.0	124.4	145.9	153.9
110°	874.1	915.3	345.4	148.0	155.8

TEST NUMBER: P909267

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1000.4	1035.7	1002.3	151.8	157.9
115°	1134.4	1167.9	1217.3	303.9	161.9
117.5°	1250.8	1290.2	1323.9	1041.6	524.8
120°	1381.1	1410.6	1446.2	1469.9	1203.5
122.5°	1491.4	1523.1	1562.7	1574.4	1576.5
125°	1603.9	1629.6	1667.1	1680.9	1686.8
127.5°	1706.5	1734.1	1763.9	1783.5	1785.4
130°	1803.2	1834.8	1856.4	1878.2	1876.3
132.5°	1901.9	1927.6	1949.2	1967.0	1965.1
135°	1984.8	2016.4	2034.0	2054.0	2049.9
137.5°	2071.5	2095.2	2115.1	2134.8	2128.9
140°	2156.3	2172.2	2193.8	2211.6	2201.7
142.5°	2227.6	2241.3	2266.8	2282.6	2272.7
145°	2302.5	2300.4	2333.9	2347.7	2337.8
147.5°	2367.4	2361.6	2395.0	2404.9	2397.1
150°	2430.6	2416.8	2448.4	2460.1	2450.3
152.5°	2483.9	2468.1	2497.6	2509.6	2495.8
155°	2535.2	2517.6	2541.2	2552.9	2537.3
157.5°	2576.6	2560.9	2578.7	2592.5	2576.6
160°	2612.2	2600.3	2612.2	2623.9	2610.1
162.5°	2643.6	2631.9	2641.7	2655.5	2637.8
165°	2671.3	2659.6	2665.4	2679.2	2665.4
167.5°	2693.0	2681.1	2687.2	2701.0	2683.2
170°	2710.9	2698.9	2702.9	2716.7	2698.9
172.5°	2722.6	2710.9	2714.8	2728.7	2710.9
175°	2732.4	2718.6	2722.6	2736.3	2716.7
177.5°	2736.3	2722.6	2724.6	2738.5	2720.7
180°	2726.5	2726.5	2726.5	2726.5	2726.5

TEST NUMBER: P909267

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.11	12.93	13.08	13.91	15.20	8.07	8.89	9.04	9.87	11.16
	3H	13.78	14.51	14.76	15.50	16.81	9.25	9.98	10.23	10.97	12.28
	4H	14.38	15.08	15.38	16.07	17.39	9.69	10.39	10.69	11.38	12.70
	6H	14.80	15.44	15.81	16.44	17.77	10.01	10.65	11.01	11.65	12.98
	8H	14.92	15.53	15.94	16.55	17.87	10.10	10.70	11.11	11.72	13.04
	12H	14.98	15.56	16.00	16.57	17.92	10.14	10.71	11.15	11.72	13.07
4H	2H	12.12	12.82	13.12	13.81	15.13	8.66	9.35	9.66	10.35	11.66
	3H	13.94	14.52	14.95	15.55	16.87	10.00	10.58	11.01	11.60	12.93
	4H	14.63	15.16	15.65	16.18	17.53	10.54	11.07	11.56	12.09	13.44
	6H	15.14	15.60	16.17	16.63	17.98	10.95	11.41	11.98	12.45	13.80
	8H	15.31	15.74	16.34	16.77	18.13	11.08	11.50	12.11	12.53	13.90
	12H	15.41	15.79	16.45	16.84	18.20	11.14	11.52	12.19	12.57	13.94
8H	4H	14.60	15.02	15.63	16.05	17.42	10.82	11.24	11.85	12.27	13.64
	6H	15.16	15.51	16.21	16.58	17.94	11.33	11.68	12.38	12.75	14.11
	8H	15.37	15.68	16.43	16.74	18.12	11.52	11.82	12.58	12.88	14.26
	12H	15.51	15.78	16.57	16.83	18.25	11.63	11.90	12.69	12.95	14.38
12H	4H	14.55	14.93	15.60	15.98	17.35	10.82	11.21	11.87	12.25	13.62
	6H	15.13	15.44	16.19	16.50	17.88	11.38	11.68	12.44	12.74	14.12
	8H	15.35	15.62	16.41	16.67	18.10	11.58	11.85	12.65	12.90	14.33

END OF REPORT