

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909305

Luminaire Tested: DFN2DIP-SQ3F0-100D090US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909305
REPORT IS A COMBINATION OF REPORTS P901483 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D090US840-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18995.6 lumens
Efficiency: N/A
Efficacy: 113.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 167
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909305

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US840-FLLONL

Luminous Intensity Polar Plot

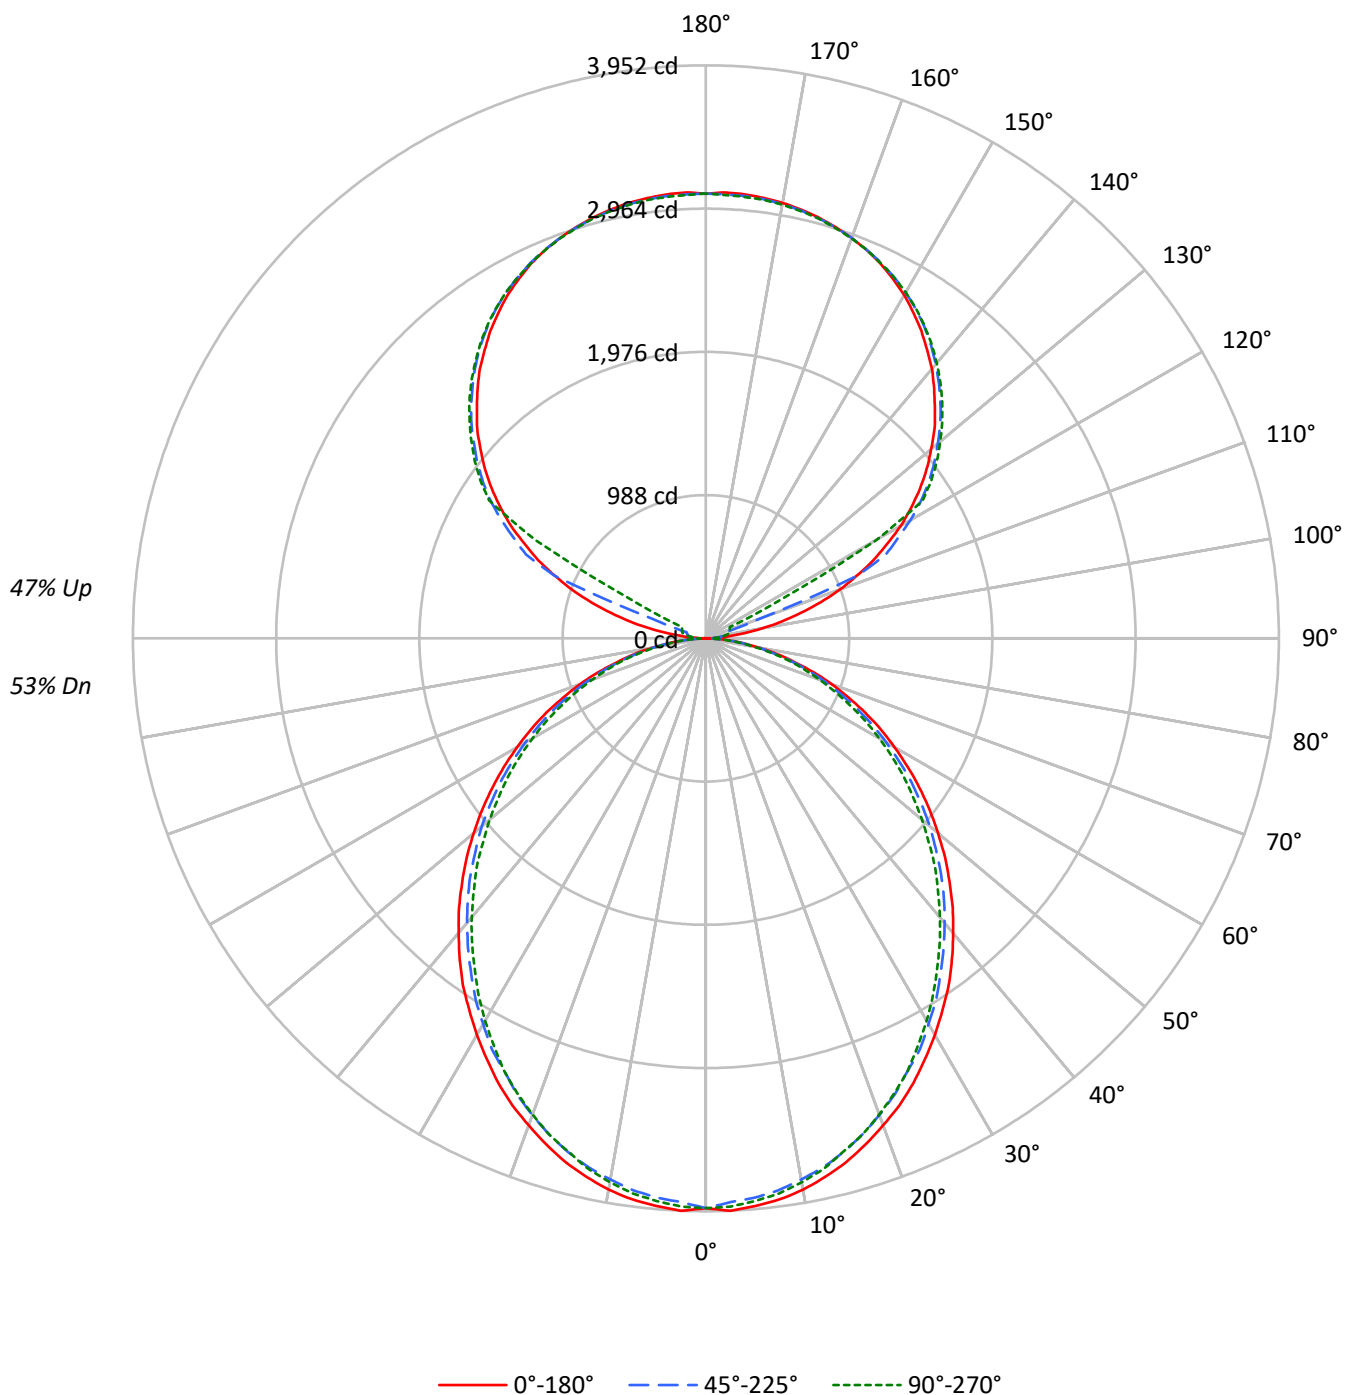

TEST NUMBER: P909305

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	49
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	40	38	35
4	75	64	56	50	69	59	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	35	31	35	31	27	30	26	23
7	59	46	38	33	54	43	36	31	37	32	27	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	28	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	19	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4502	4502	4502
5°	4507	4437	4468
10°	4467	4374	4406
15°	4399	4299	4310
20°	4307	4196	4212
25°	4216	4073	4099
30°	4102	3959	3955
35°	3994	3825	3803
40°	3862	3689	3658
45°	3730	3552	3510
50°	3585	3409	3339
55°	3433	3243	3181
60°	3262	3047	3000
65°	3074	2844	2786
70°	2835	2595	2556
75°	2504	2297	2341
80°	2105	1916	1935
85°	1481	1270	1267

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3730 cd/sqm

TEST NUMBER: P909305

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	369.8	1.9
10°-20°	1040.6	5.5
20°-30°	1529.3	8.1
30°-40°	1776.1	9.4
40°-50°	1773.9	9.3
50°-60°	1546.8	8.1
60°-70°	1143.4	6.0
70°-80°	646.9	3.4
80°-90°	176.2	0.9
90°-100°	101.2	0.5
100°-110°	377.0	2.0
110°-120°	1000.0	5.3
120°-130°	1658.6	8.7
130°-140°	1761.8	9.3
140°-150°	1637.4	8.6
150°-160°	1316.4	6.9
160°-170°	848.2	4.5
170°-180°	292.0	1.5
0°-30°	2939.7	15.5
0°-40°	4715.8	24.8
0°-60°	8036.5	42.3
0°-90°	10003.1	52.7
90°-120°	1478.2	7.8
90°-150°	6535.9	34.4
90°-180°	8992.0	47.3
0°-180°	18995.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3930	3930	3930	3930	3930	
5°	3930	3915	3873	3903	3896	373
15°	3741	3718	3669	3684	3665	1054
25°	3386	3355	3291	3298	3291	1558
35°	2921	2883	2823	2800	2781	1824
45°	2377	2350	2293	2252	2237	1834
55°	1799	1776	1731	1685	1666	1608
65°	1213	1190	1153	1118	1100	1199
75°	635	627	608	586	593	677
85°	155	151	148	136	132	173
90°	2	27	44	56	60	18
95°	144	71	86	98	95	171
105°	675	741	135	160	169	721
115°	1276	1314	1370	342	182	1256
125°	1804	1833	1876	1891	1898	1609
135°	2233	2268	2288	2311	2306	1725
145°	2590	2588	2626	2641	2630	1620
155°	2852	2832	2859	2872	2854	1314
165°	3005	2992	2999	3014	2999	849
175°	3074	3058	3063	3078	3056	293
180°	3067	3067	3067	3067	3067	

TEST NUMBER: P909305

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US840-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3929.5	3929.5	3929.5	3929.5	3929.5
2.5°	3952.3	3933.4	3891.7	3929.5	3922.2
5°	3929.5	3914.6	3872.9	3903.0	3895.8
7.5°	3903.0	3880.5	3838.8	3869.3	3861.7
10°	3861.7	3835.3	3789.9	3820.0	3808.8
12.5°	3804.8	3782.4	3737.0	3755.9	3748.2
15°	3740.6	3718.2	3668.8	3684.1	3665.3
17.5°	3661.3	3638.8	3589.5	3608.4	3589.5
20°	3574.2	3551.8	3498.9	3510.1	3495.2
22.5°	3487.7	3453.6	3404.3	3404.3	3396.7
25°	3385.5	3355.4	3291.3	3298.4	3291.3
27.5°	3272.0	3245.5	3196.6	3185.4	3166.5
30°	3159.0	3128.5	3071.9	3060.7	3045.5
32.5°	3037.9	3015.5	2954.9	2932.0	2916.8
35°	2920.8	2883.2	2822.6	2799.8	2780.9
37.5°	2788.5	2754.4	2693.9	2667.5	2648.6
40°	2652.6	2622.1	2561.6	2528.0	2512.7
42.5°	2520.3	2489.8	2429.7	2391.7	2369.2
45°	2376.8	2350.4	2293.4	2252.1	2237.0
47.5°	2237.0	2210.5	2149.9	2108.2	2085.8
50°	2089.4	2070.5	2017.6	1964.7	1945.9
52.5°	1945.9	1919.5	1870.5	1828.9	1802.4
55°	1798.8	1775.9	1730.6	1685.3	1666.5
57.5°	1651.2	1632.3	1583.1	1537.8	1522.6
60°	1503.7	1488.8	1435.9	1394.2	1383.0
62.5°	1360.2	1333.7	1296.1	1258.4	1243.1
65°	1213.1	1190.2	1152.6	1118.4	1099.6
67.5°	1062.0	1042.7	1009.1	982.6	967.4
70°	922.0	906.8	872.7	846.3	831.4
72.5°	778.5	763.3	744.5	718.0	706.7
75°	634.6	627.4	608.1	585.7	593.3
77.5°	506.3	491.1	483.4	472.2	461.0
80°	378.0	374.1	366.4	355.2	347.6
82.5°	257.0	257.0	253.4	238.1	238.1
85°	154.7	151.2	147.5	135.9	132.3
87.5°	68.2	60.5	52.9	41.7	37.7
90°	2.1	26.7	44.2	55.6	59.8
92.5°	55.6	46.7	53.2	57.8	59.8
95°	144.2	70.9	86.4	97.8	95.4
97.5°	259.6	77.8	113.1	119.9	122.0
100°	392.9	88.9	126.5	144.2	148.7
102.5°	539.3	535.0	131.0	155.2	162.1
105°	674.7	741.4	135.4	159.8	168.6
107.5°	832.3	887.7	140.0	164.2	173.2
110°	983.3	1029.8	388.5	166.5	175.3



TEST NUMBER: P909305

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US840-FLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1125.4	1165.2	1127.5	170.8	177.6
115°	1276.2	1313.8	1369.5	341.8	182.1
117.5°	1407.1	1451.5	1489.3	1171.8	590.4
120°	1553.7	1586.9	1627.0	1653.6	1353.9
122.5°	1677.9	1713.4	1758.0	1771.1	1773.5
125°	1804.3	1833.3	1875.5	1891.1	1897.6
127.5°	1919.8	1950.9	1984.4	2006.5	2008.6
130°	2028.6	2064.3	2088.5	2112.9	2110.9
132.5°	2139.6	2168.6	2192.8	2212.9	2210.8
135°	2232.9	2268.5	2288.3	2310.7	2306.2
137.5°	2330.5	2357.0	2379.4	2401.6	2395.0
140°	2425.8	2443.8	2468.0	2488.0	2477.0
142.5°	2506.0	2521.5	2550.2	2567.9	2556.9
145°	2590.3	2587.9	2625.7	2641.2	2630.1
147.5°	2663.3	2656.8	2694.4	2705.5	2696.7
150°	2734.5	2719.0	2754.5	2767.6	2756.6
152.5°	2794.3	2776.6	2809.8	2823.3	2807.7
155°	2852.1	2832.3	2858.8	2872.1	2854.4
157.5°	2898.7	2881.0	2901.0	2916.6	2898.7
160°	2938.7	2925.3	2938.7	2951.9	2936.4
162.5°	2974.1	2960.8	2971.9	2987.5	2967.5
165°	3005.2	2991.9	2998.6	3014.1	2998.6
167.5°	3029.7	3016.3	3023.0	3038.6	3018.6
170°	3049.7	3036.3	3040.7	3056.3	3036.3
172.5°	3062.9	3049.7	3054.1	3069.7	3049.7
175°	3073.9	3058.4	3062.9	3078.4	3056.3
177.5°	3078.4	3062.9	3065.2	3080.8	3060.8
180°	3067.4	3067.4	3067.4	3067.4	3067.4

TEST NUMBER: P909305

CATALOG NUMBER: DFN2DIP-SQ3F0-100D090US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.71	13.59	13.64	14.54	15.78	12.26	13.15	13.20	14.10	15.33
	3H	14.37	15.16	15.31	16.12	17.38	13.88	14.67	14.82	15.63	16.89
	4H	14.95	15.70	15.91	16.67	17.93	14.46	15.21	15.42	16.17	17.44
	6H	15.35	16.04	16.32	17.01	18.29	14.85	15.54	15.82	16.51	17.79
	8H	15.45	16.11	16.43	17.10	18.38	14.95	15.61	15.93	16.60	17.87
	12H	15.50	16.13	16.48	17.11	18.41	14.99	15.62	15.97	16.60	17.90
4H	2H	13.17	13.92	14.13	14.89	16.15	12.81	13.57	13.78	14.53	15.80
	3H	15.03	15.66	16.01	16.65	17.93	14.62	15.25	15.60	16.25	17.52
	4H	15.74	16.32	16.73	17.30	18.61	15.32	15.89	16.30	16.88	18.18
	6H	16.25	16.75	17.25	17.76	19.06	15.82	16.32	16.82	17.33	18.63
	8H	16.40	16.86	17.40	17.87	19.19	15.97	16.43	16.96	17.43	18.75
	12H	16.47	16.89	17.49	17.91	19.23	16.03	16.44	17.04	17.46	18.78
8H	4H	15.94	16.40	16.93	17.40	18.72	15.56	16.02	16.56	17.03	18.34
	6H	16.56	16.95	17.59	17.99	19.31	16.18	16.56	17.20	17.61	18.92
	8H	16.78	17.12	17.81	18.15	19.48	16.39	16.72	17.42	17.76	19.09
	12H	16.91	17.21	17.94	18.23	19.61	16.50	16.80	17.53	17.82	19.20
12H	4H	15.92	16.34	16.94	17.36	18.68	15.55	15.97	16.57	16.99	18.31
	6H	16.59	16.93	17.62	17.96	19.29	16.22	16.56	17.25	17.59	18.92
	8H	16.83	17.13	17.87	18.15	19.53	16.45	16.75	17.48	17.77	19.15