

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909310

Luminaire Tested: DFN2DIP-SQ3F0-100D100US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909310
REPORT IS A COMBINATION OF REPORTS P899982 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D100US840-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17521.1 lumens
Efficiency: N/A
Efficacy: 99.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 176
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909310

CATALOG NUMBER: DFN2DIP-SQ3F0-100D100US840-RLLFLL

Luminous Intensity Polar Plot

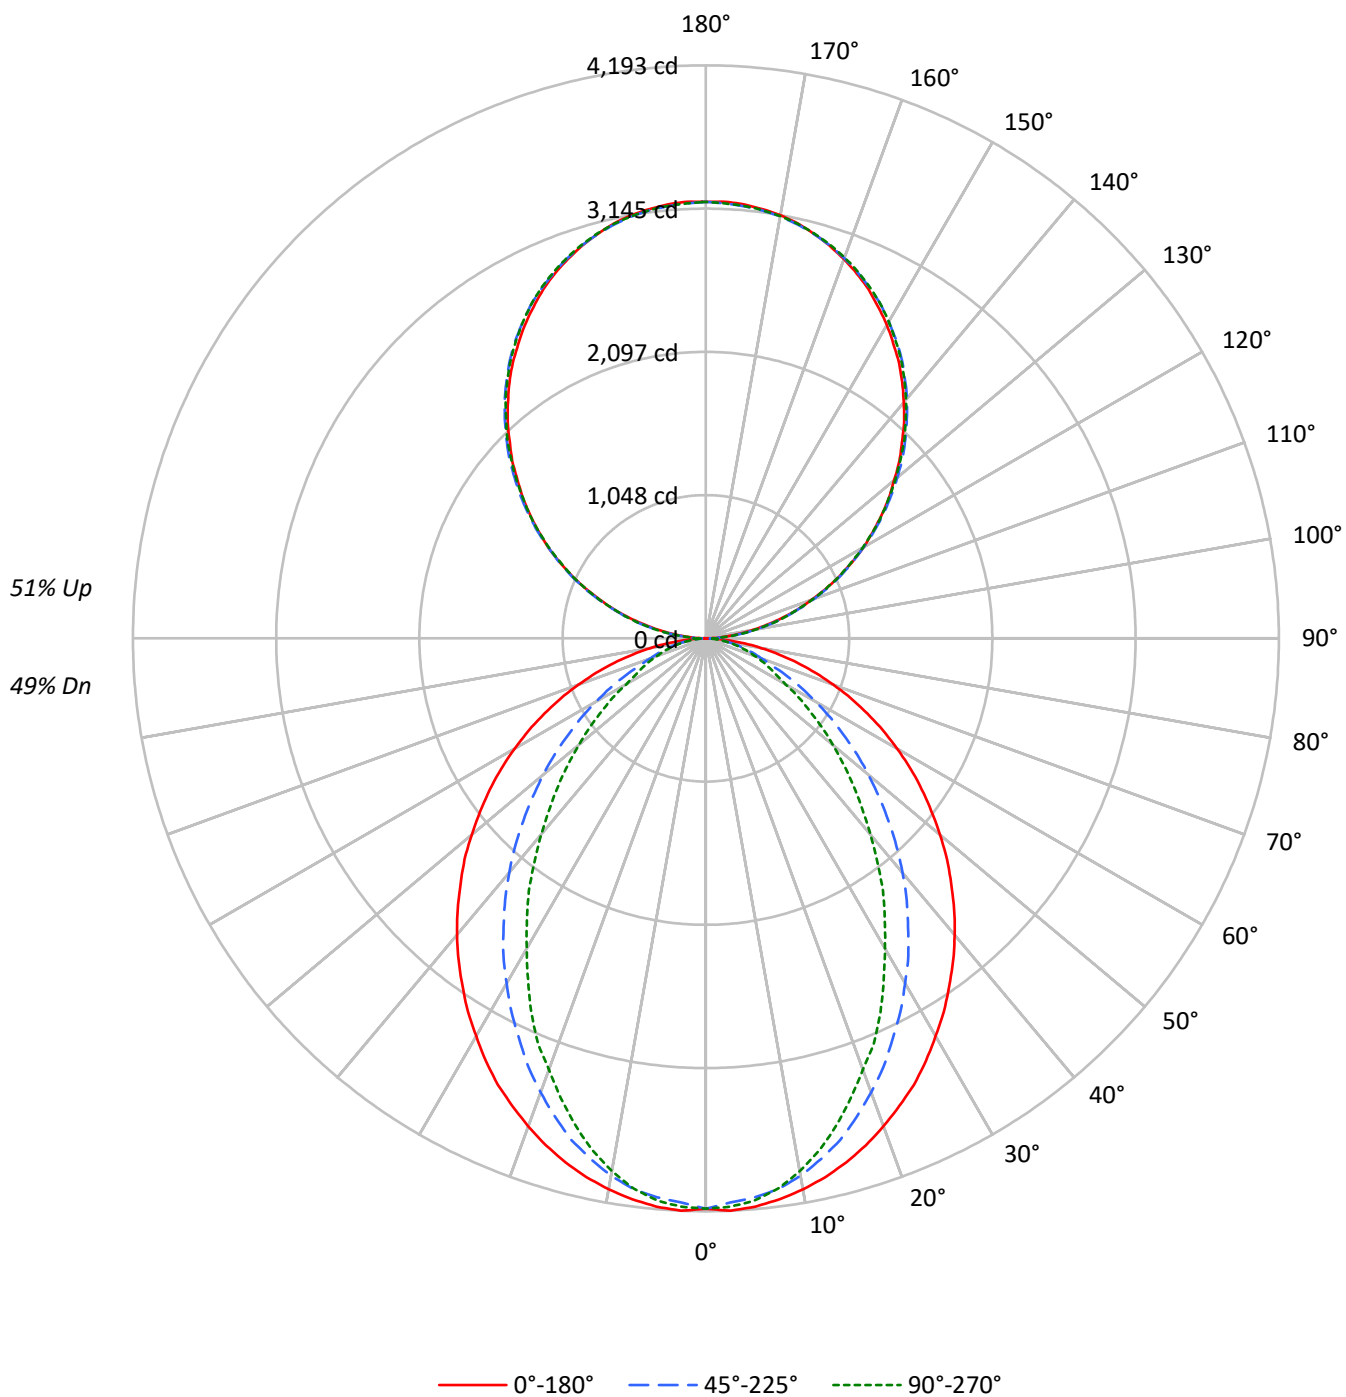

TEST NUMBER: P909310

CATALOG NUMBER: DFN2DIP-SQ3F0-100D100US840-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4782	4782	4782
5°	4787	4703	4735
10°	4736	4608	4579
15°	4668	4452	4340
20°	4579	4240	4046
25°	4487	4001	3763
30°	4366	3758	3404
35°	4246	3496	3089
40°	4124	3225	2728
45°	3983	2926	2400
50°	3837	2623	2081
55°	3684	2301	1774
60°	3506	1964	1459
65°	3302	1621	1311
70°	3054	1302	1184
75°	2742	1141	1074
80°	2291	948	926
85°	1554	617	687

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3983 cd/sqm

TEST NUMBER: P909310

CATALOG NUMBER: DFN2DIP-SQ3F0-100D100US840-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	391.2	2.2
10°-20°	1073.8	6.1
20°-30°	1507.6	8.6
30°-40°	1643.4	9.4
40°-50°	1510.5	8.6
50°-60°	1186.3	6.8
60°-70°	772.1	4.4
70°-80°	397.5	2.3
80°-90°	110.5	0.6
90°-100°	197.6	1.1
100°-110°	627.9	3.6
110°-120°	1074.6	6.1
120°-130°	1413.3	8.1
130°-140°	1586.4	9.1
140°-150°	1555.6	8.9
150°-160°	1304.9	7.4
160°-170°	865.4	4.9
170°-180°	302.5	1.7
0°-30°	2972.6	17.0
0°-40°	4616.1	26.3
0°-60°	7312.8	41.7
0°-90°	8592.9	49.0
90°-120°	1900.2	10.8
90°-150°	6455.4	36.8
90°-180°	8928.0	51.0
0°-180°	17521.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4174	4174	4174	4174	4174	
5°	4174	4155	4106	4140	4128	396
15°	3970	3928	3800	3728	3690	1119
25°	3604	3482	3233	3078	3022	1657
35°	3105	2912	2580	2342	2259	1943
45°	2538	2285	1889	1620	1530	1960
55°	1930	1636	1228	1001	929	1725
65°	1303	997	657	529	517	1292
75°	695	430	302	276	272	735
85°	162	83	72	72	72	186
90°	3	35	94	89	92	17
95°	141	168	172	172	168	156
105°	580	587	593	598	598	612
115°	1078	1094	1089	1086	1078	1067
125°	1568	1593	1585	1576	1573	1402
135°	2029	2059	2064	2062	2054	1568
145°	2463	2482	2498	2500	2490	1539
155°	2816	2824	2833	2846	2838	1296
165°	3064	3061	3061	3080	3067	864
175°	3188	3180	3175	3194	3177	303
180°	3194	3194	3194	3194	3194	



TEST NUMBER: P909310

CATALOG NUMBER: DFN2DIP-SQ3F0-100D100US840-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4173.8	4173.8	4173.8	4173.8	4173.8
2.5°	4192.6	4173.8	4132.1	4170.1	4162.6
5°	4173.8	4154.9	4105.6	4139.7	4128.4
7.5°	4139.7	4117.2	4064.3	4079.1	4060.4
10°	4094.4	4067.9	3992.6	3981.0	3958.6
12.5°	4037.9	4003.8	3901.6	3879.2	3837.5
15°	3969.8	3928.1	3799.8	3728.1	3690.5
17.5°	3890.4	3829.9	3671.3	3588.3	3527.8
20°	3799.8	3724.1	3535.3	3441.2	3357.8
22.5°	3701.7	3614.7	3395.5	3267.3	3210.8
25°	3603.5	3482.5	3233.2	3078.5	3021.6
27.5°	3486.5	3357.8	3082.1	2904.6	2817.6
30°	3361.8	3217.9	2915.8	2723.5	2621.3
32.5°	3240.9	3066.9	2757.5	2530.7	2436.1
35°	3104.9	2912.3	2580.0	2342.0	2258.6
37.5°	2972.7	2764.7	2413.7	2152.8	2058.6
40°	2832.9	2606.5	2239.8	1971.7	1873.5
42.5°	2689.4	2447.7	2066.3	1786.6	1692.3
45°	2538.3	2285.0	1888.8	1620.2	1529.6
47.5°	2394.9	2126.8	1718.8	1450.3	1367.4
50°	2236.1	1968.0	1552.5	1291.6	1212.6
52.5°	2081.0	1797.8	1393.8	1144.5	1072.8
55°	1930.0	1635.5	1227.5	1001.1	929.3
57.5°	1775.3	1473.1	1080.5	868.8	808.3
60°	1616.6	1314.4	925.3	733.0	672.5
62.5°	1461.9	1159.7	793.0	612.0	581.9
65°	1303.2	997.0	657.2	529.0	517.4
67.5°	1152.2	846.0	529.0	464.4	453.2
70°	993.4	698.9	438.0	400.3	385.2
72.5°	842.3	562.6	366.3	336.2	328.6
75°	694.9	430.4	302.2	275.7	272.1
77.5°	547.9	305.8	238.0	222.8	215.2
80°	411.5	219.2	181.2	166.3	166.3
82.5°	286.9	147.4	124.6	117.0	117.0
85°	162.3	82.9	71.7	71.7	71.7
87.5°	60.5	30.1	30.1	26.5	26.5
90°	2.9	34.6	94.3	88.6	91.5
92.5°	59.7	80.9	83.8	86.6	86.6
95°	140.6	167.5	172.4	172.4	167.5
97.5°	234.0	259.0	269.6	269.6	269.6
100°	341.8	364.0	371.6	371.6	368.8
102.5°	455.4	471.8	482.4	485.2	482.4
105°	579.7	587.3	593.1	597.9	597.9
107.5°	702.9	714.5	714.5	716.4	702.9
110°	822.3	837.7	837.7	837.7	830.0

TEST NUMBER: P909310

CATALOG NUMBER: DFN2DIP-SQ3F0-100D100US840-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	951.3	967.7	964.8	957.0	951.3
115°	1078.4	1093.8	1089.0	1086.1	1078.4
117.5°	1204.6	1225.8	1212.2	1204.6	1196.8
120°	1331.6	1352.8	1331.6	1331.6	1323.0
122.5°	1447.1	1474.1	1460.7	1453.0	1447.1
125°	1568.5	1592.6	1584.9	1576.2	1573.4
127.5°	1687.0	1716.8	1706.2	1694.7	1687.0
130°	1797.7	1832.3	1827.6	1821.7	1811.2
132.5°	1921.9	1948.8	1950.8	1937.3	1929.6
135°	2028.7	2058.6	2064.4	2061.5	2053.8
137.5°	2148.2	2172.2	2177.1	2175.1	2163.5
140°	2253.1	2277.1	2290.7	2290.7	2280.1
142.5°	2361.0	2385.0	2392.7	2395.6	2385.0
145°	2463.0	2482.2	2497.7	2500.5	2489.9
147.5°	2554.5	2578.6	2590.1	2595.0	2584.3
150°	2648.9	2665.2	2675.8	2684.4	2675.8
152.5°	2732.6	2749.0	2762.5	2773.1	2762.5
155°	2816.4	2824.1	2832.8	2846.2	2837.5
157.5°	2888.6	2894.4	2899.2	2918.4	2905.0
160°	2953.1	2958.9	2961.7	2978.1	2966.6
162.5°	3012.8	3012.8	3015.7	3033.9	3020.5
165°	3063.8	3060.9	3060.9	3080.2	3066.8
167.5°	3110.1	3101.4	3101.4	3120.7	3107.2
170°	3144.7	3137.0	3134.1	3153.4	3137.0
172.5°	3168.8	3161.1	3158.2	3177.4	3161.1
175°	3188.0	3180.4	3174.6	3193.8	3177.4
177.5°	3198.6	3191.0	3185.1	3201.5	3185.1
180°	3193.8	3193.8	3193.8	3193.8	3193.8

TEST NUMBER: P909310

CATALOG NUMBER: DFN2DIP-SQ3F0-100D100US840-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.46	13.28	13.43	14.26	15.55	8.42	9.24	9.39	10.22	11.51
	3H	14.13	14.87	15.11	15.86	17.17	9.60	10.34	10.58	11.33	12.64
	4H	14.74	15.43	15.73	16.43	17.74	10.05	10.74	11.04	11.74	13.05
	6H	15.15	15.79	16.16	16.79	18.12	10.36	11.00	11.37	12.00	13.33
	8H	15.28	15.89	16.29	16.90	18.23	10.45	11.06	11.46	12.07	13.40
	12H	15.34	15.92	16.35	16.92	18.28	10.49	11.07	11.51	12.08	13.43
4H	2H	12.47	13.17	13.48	14.16	15.48	9.01	9.71	10.01	10.70	12.02
	3H	14.30	14.87	15.31	15.90	17.23	10.35	10.93	11.36	11.95	13.29
	4H	14.98	15.51	16.00	16.53	17.88	10.90	11.42	11.91	12.44	13.79
	6H	15.50	15.95	16.52	16.99	18.34	11.31	11.76	12.34	12.80	14.15
	8H	15.67	16.09	16.70	17.12	18.49	11.43	11.86	12.46	12.89	14.25
	12H	15.76	16.14	16.81	17.19	18.56	11.49	11.87	12.54	12.92	14.29
8H	4H	14.95	15.37	15.98	16.41	17.77	11.17	11.60	12.20	12.63	13.99
	6H	15.51	15.86	16.57	16.93	18.30	11.68	12.03	12.74	13.10	14.47
	8H	15.72	16.03	16.79	17.09	18.47	11.87	12.17	12.93	13.23	14.62
	12H	15.86	16.13	16.92	17.18	18.61	11.98	12.25	13.05	13.30	14.73
12H	4H	14.90	15.28	15.95	16.33	17.70	11.18	11.56	12.22	12.60	13.98
	6H	15.49	15.79	16.55	16.85	18.24	11.73	12.04	12.79	13.10	14.48
	8H	15.70	15.97	16.77	17.03	18.45	11.93	12.20	13.00	13.26	14.68

END OF REPORT