

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909327

Luminaire Tested: DFN2DIP-SQ3F0-110D050US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909327
REPORT IS A COMBINATION OF REPORTS P901414 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-110D050US840-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14441.1 lumens
Efficiency: N/A
Efficacy: 97.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 148.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909327

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US840-RLLONL

Luminous Intensity Polar Plot

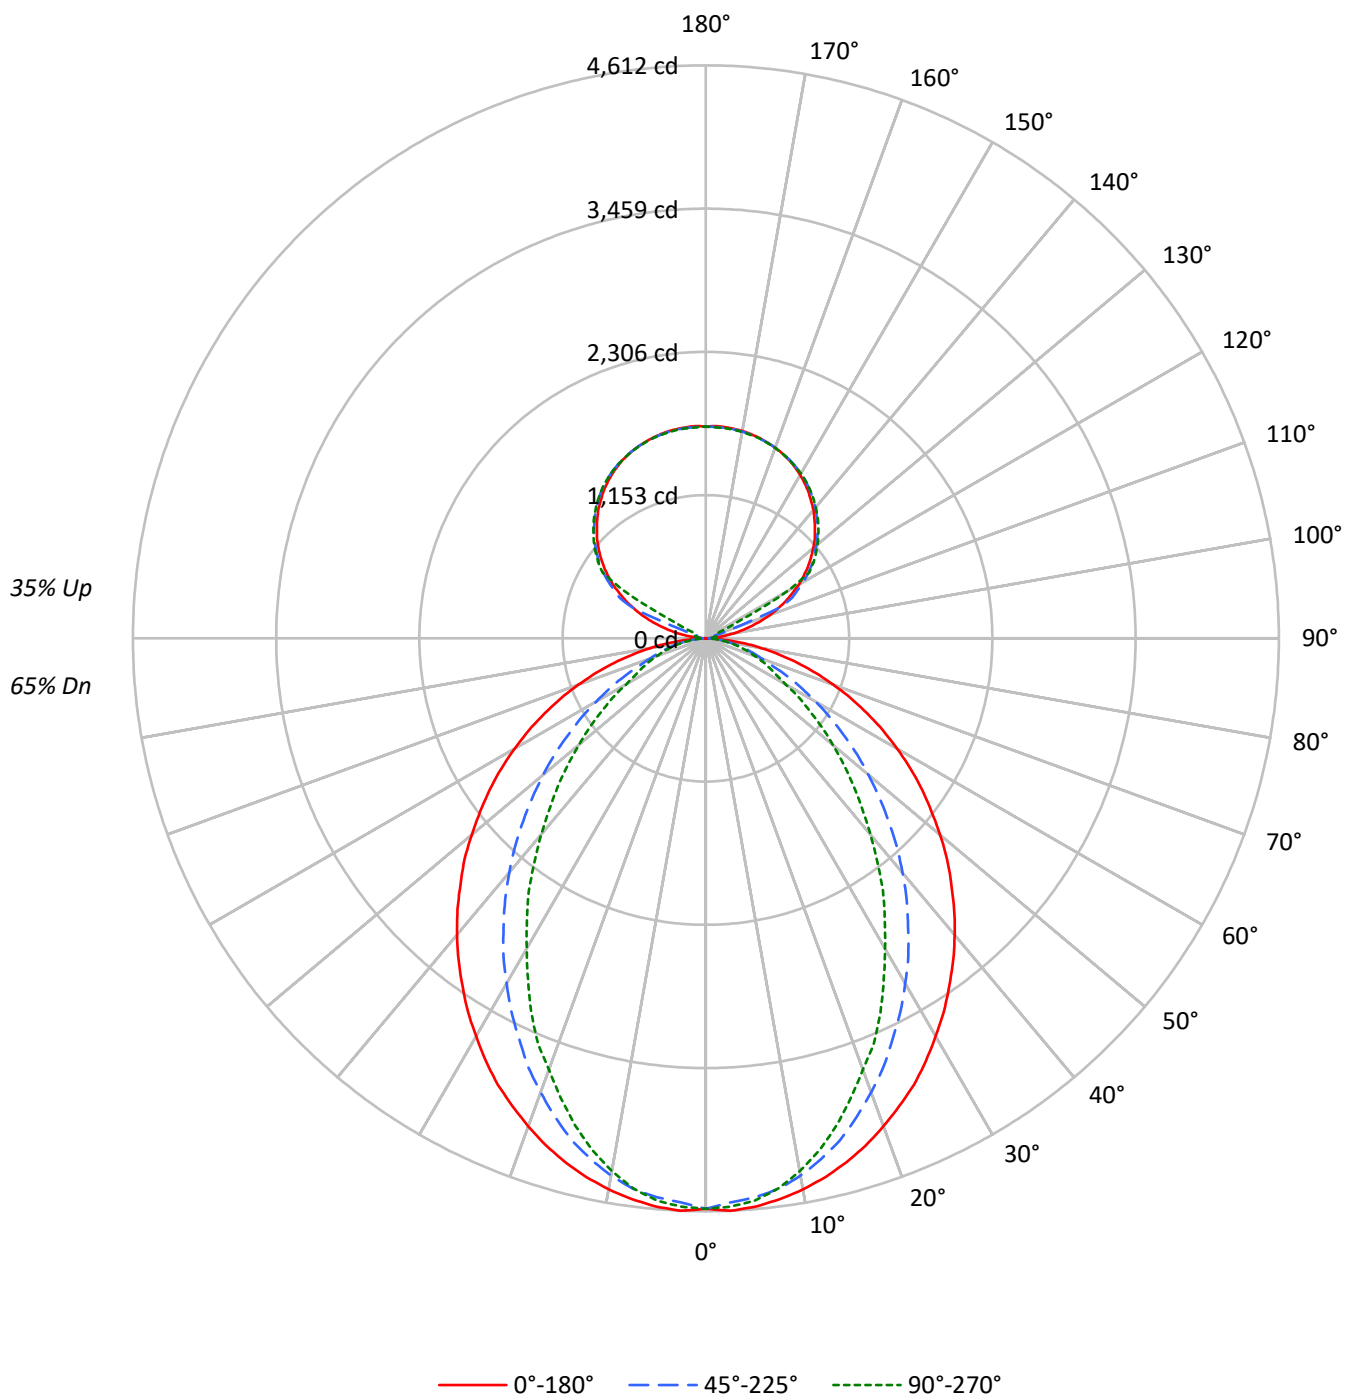

TEST NUMBER: P909327

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	70	70	70
1	102	98	94	91	96	92	89	86	82	79	77	72	70	69	63	62	61
2	93	86	80	75	88	81	76	72	72	68	65	64	61	58	56	54	52
3	86	76	69	63	80	72	66	61	64	59	55	57	53	50	50	48	45
4	79	68	60	54	74	64	57	52	58	52	48	51	47	43	46	42	39
5	72	61	53	47	68	58	51	45	52	46	42	46	42	38	41	38	35
6	67	55	47	41	63	52	45	40	47	41	37	42	37	34	38	34	31
7	62	50	42	37	59	48	40	35	43	37	33	39	34	30	35	31	28
8	58	46	38	33	55	44	36	32	39	34	29	36	31	27	32	28	25
9	54	42	34	29	51	40	33	28	36	31	27	33	28	25	30	26	23
10	51	39	31	27	48	37	30	26	34	28	24	31	26	23	28	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5261	5261	5261
5°	5266	5174	5209
10°	5210	5069	5037
15°	5135	4898	4774
20°	5037	4664	4451
25°	4936	4402	4139
30°	4802	4133	3744
35°	4671	3845	3398
40°	4537	3548	3000
45°	4382	3218	2640
50°	4220	2886	2289
55°	4052	2530	1951
60°	3857	2160	1604
65°	3632	1784	1442
70°	3360	1432	1302
75°	3017	1255	1181
80°	2521	1042	1019
85°	1709	679	756

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4382 cd/sqm

TEST NUMBER: P909327

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	430.3	3.0
10°-20°	1181.2	8.2
20°-30°	1658.4	11.5
30°-40°	1807.8	12.5
40°-50°	1661.5	11.5
50°-60°	1304.9	9.0
60°-70°	849.4	5.9
70°-80°	437.2	3.0
80°-90°	114.6	0.8
90°-100°	56.2	0.4
100°-110°	209.5	1.5
110°-120°	555.6	3.8
120°-130°	921.4	6.4
130°-140°	978.8	6.8
140°-150°	909.7	6.3
150°-160°	731.3	5.1
160°-170°	471.2	3.3
170°-180°	162.2	1.1
0°-30°	3269.9	22.6
0°-40°	5077.7	35.2
0°-60°	8044.1	55.7
0°-90°	9445.3	65.4
90°-120°	821.2	5.7
90°-150°	3631.1	25.1
90°-180°	4996.0	34.6
0°-180°	14441.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4591	4591	4591	4591	4591	
5°	4591	4570	4516	4554	4541	435
15°	4367	4321	4180	4101	4060	1231
25°	3964	3831	3556	3386	3324	1823
35°	3416	3203	2838	2576	2484	2138
45°	2792	2514	2078	1782	1683	2156
55°	2123	1799	1350	1101	1022	1897
65°	1434	1097	723	582	569	1421
75°	764	473	332	303	299	808
85°	178	91	79	79	79	205
90°	1	15	25	31	33	14
95°	80	39	48	54	53	95
105°	375	412	75	89	94	401
115°	709	730	761	190	101	698
125°	1002	1019	1042	1051	1054	894
135°	1240	1260	1271	1284	1281	958
145°	1439	1438	1459	1467	1461	900
155°	1584	1574	1588	1596	1586	730
165°	1670	1662	1666	1674	1666	472
175°	1708	1699	1702	1710	1698	163
180°	1704	1704	1704	1704	1704	

TEST NUMBER: P909327

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4591.2	4591.2	4591.2	4591.2	4591.2
2.5°	4611.9	4591.2	4545.3	4587.2	4578.8
5°	4591.2	4570.4	4516.2	4553.7	4541.4
7.5°	4553.7	4528.9	4470.8	4487.1	4466.3
10°	4503.9	4474.7	4391.9	4379.1	4354.4
12.5°	4441.7	4404.2	4291.8	4267.1	4221.2
15°	4366.8	4320.9	4179.8	4101.0	4059.5
17.5°	4279.5	4213.0	4038.4	3947.1	3880.5
20°	4179.8	4096.5	3888.9	3785.3	3693.6
22.5°	4071.9	3976.1	3735.1	3594.0	3531.8
25°	3963.8	3830.7	3556.5	3386.4	3323.8
27.5°	3835.2	3693.6	3390.3	3195.0	3099.4
30°	3698.0	3539.8	3207.4	2995.8	2883.4
32.5°	3564.9	3373.6	3033.2	2783.8	2679.8
35°	3415.5	3203.4	2838.0	2576.2	2484.5
37.5°	3270.0	3041.2	2655.0	2368.0	2264.5
40°	3116.1	2867.1	2463.8	2168.8	2060.8
42.5°	2958.3	2692.5	2272.9	1965.2	1861.6
45°	2792.2	2513.6	2077.6	1782.2	1682.6
47.5°	2634.3	2339.5	1890.7	1595.3	1504.1
50°	2459.7	2164.8	1707.8	1420.8	1333.9
52.5°	2289.2	1977.5	1533.2	1259.0	1180.0
55°	2122.9	1799.0	1350.2	1101.2	1022.3
57.5°	1952.9	1620.4	1188.4	955.7	889.1
60°	1778.3	1445.9	1017.8	806.3	739.7
62.5°	1608.1	1275.8	872.4	673.2	640.1
65°	1433.5	1096.7	723.0	581.9	569.1
67.5°	1267.4	930.6	581.9	510.9	498.6
70°	1092.8	768.8	481.8	440.4	423.6
72.5°	926.6	618.9	402.9	369.8	361.4
75°	764.4	473.4	332.3	303.3	299.3
77.5°	602.6	336.4	261.9	245.1	236.7
80°	452.7	241.2	199.2	183.0	183.0
82.5°	315.6	162.2	137.1	128.8	128.8
85°	178.5	91.3	78.9	78.9	78.9
87.5°	66.6	33.0	33.0	29.1	29.1
90°	1.2	14.7	24.6	30.9	33.2
92.5°	30.9	26.0	29.6	32.1	33.2
95°	80.1	39.4	48.1	54.3	53.0
97.5°	144.2	43.2	62.8	66.7	67.8
100°	218.3	49.4	70.3	80.1	82.6
102.5°	299.6	297.2	72.8	86.2	90.1
105°	374.9	411.9	75.2	88.8	93.7
107.5°	462.4	493.1	77.8	91.2	96.2
110°	546.3	572.1	215.8	92.5	97.4

TEST NUMBER: P909327

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	625.2	647.3	626.4	94.9	98.7
115°	709.0	729.9	760.8	190.0	101.2
117.5°	781.7	806.4	827.5	651.0	328.0
120°	863.1	881.6	903.8	918.7	752.1
122.5°	932.1	951.9	976.6	984.0	985.3
125°	1002.4	1018.6	1042.0	1050.6	1054.3
127.5°	1066.5	1083.8	1102.5	1114.7	1115.9
130°	1127.0	1146.8	1160.2	1173.9	1172.8
132.5°	1188.7	1204.8	1218.2	1229.4	1228.2
135°	1240.5	1260.3	1271.2	1283.7	1281.2
137.5°	1294.6	1309.5	1321.9	1334.2	1330.6
140°	1347.7	1357.7	1371.1	1382.2	1376.1
142.5°	1392.2	1400.9	1416.8	1426.6	1420.5
145°	1439.1	1437.7	1458.6	1467.3	1461.2
147.5°	1479.7	1475.9	1496.9	1503.1	1498.2
150°	1519.1	1510.6	1530.2	1537.6	1531.5
152.5°	1552.4	1542.6	1561.1	1568.5	1559.8
155°	1584.5	1573.5	1588.2	1595.6	1585.8
157.5°	1610.3	1600.5	1611.6	1620.3	1610.3
160°	1632.6	1625.2	1632.6	1639.9	1631.3
162.5°	1652.2	1645.0	1651.0	1659.7	1648.6
165°	1669.5	1662.2	1665.9	1674.5	1665.9
167.5°	1683.1	1675.7	1679.5	1688.1	1677.0
170°	1694.3	1686.8	1689.3	1697.9	1686.8
172.5°	1701.6	1694.3	1696.8	1705.4	1694.3
175°	1707.8	1699.1	1701.6	1710.2	1697.9
177.5°	1710.2	1701.6	1702.9	1711.5	1700.4
180°	1704.0	1704.0	1704.0	1704.0	1704.0

TEST NUMBER: P909327

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.21	15.18	15.03	16.02	17.06	10.17	11.15	10.99	11.98	13.02
	3H	15.89	16.77	16.73	17.61	18.68	11.36	12.24	12.20	13.08	14.15
	4H	16.51	17.33	17.36	18.18	19.26	11.82	12.64	12.67	13.49	14.57
	6H	16.93	17.69	17.79	18.55	19.64	12.14	12.90	13.00	13.76	14.85
	8H	17.06	17.78	17.93	18.66	19.75	12.23	12.95	13.10	13.83	14.92
	12H	17.12	17.81	18.00	18.68	19.80	12.28	12.96	13.15	13.83	14.95
4H	2H	14.24	15.07	15.10	15.92	17.00	10.78	11.60	11.64	12.46	13.53
	3H	16.08	16.76	16.95	17.65	18.74	12.14	12.82	13.00	13.71	14.80
	4H	16.78	17.40	17.65	18.28	19.40	12.69	13.31	13.56	14.19	15.31
	6H	17.29	17.83	18.19	18.74	19.86	13.11	13.64	14.00	14.55	15.67
	8H	17.47	17.97	18.36	18.87	20.00	13.23	13.73	14.13	14.64	15.77
	12H	17.57	18.02	18.48	18.94	20.08	13.30	13.75	14.22	14.67	15.81
8H	4H	16.75	17.25	17.65	18.15	19.29	12.97	13.47	13.87	14.38	15.51
	6H	17.32	17.73	18.24	18.68	19.81	13.49	13.90	14.41	14.85	15.98
	8H	17.53	17.90	18.46	18.83	19.98	13.68	14.04	14.61	14.98	16.13
	12H	17.67	18.00	18.61	18.92	20.13	13.80	14.12	14.73	15.05	16.25
12H	4H	16.71	17.16	17.63	18.08	19.22	12.98	13.43	13.90	14.36	15.49
	6H	17.29	17.66	18.23	18.60	19.75	13.54	13.90	14.47	14.84	15.99
	8H	17.52	17.84	18.45	18.77	19.97	13.75	14.07	14.68	15.00	16.20