

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909328

Luminaire Tested: DFN2DIP-SQ3F0-110D060US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909328
REPORT IS A COMBINATION OF REPORTS P899911 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-110D060US840-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16359.8 lumens
Efficiency: N/A
Efficacy: 104.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 157
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909328

CATALOG NUMBER: DFN2DIP-SQ3F0-110D060US840-FLLFLL

Luminous Intensity Polar Plot

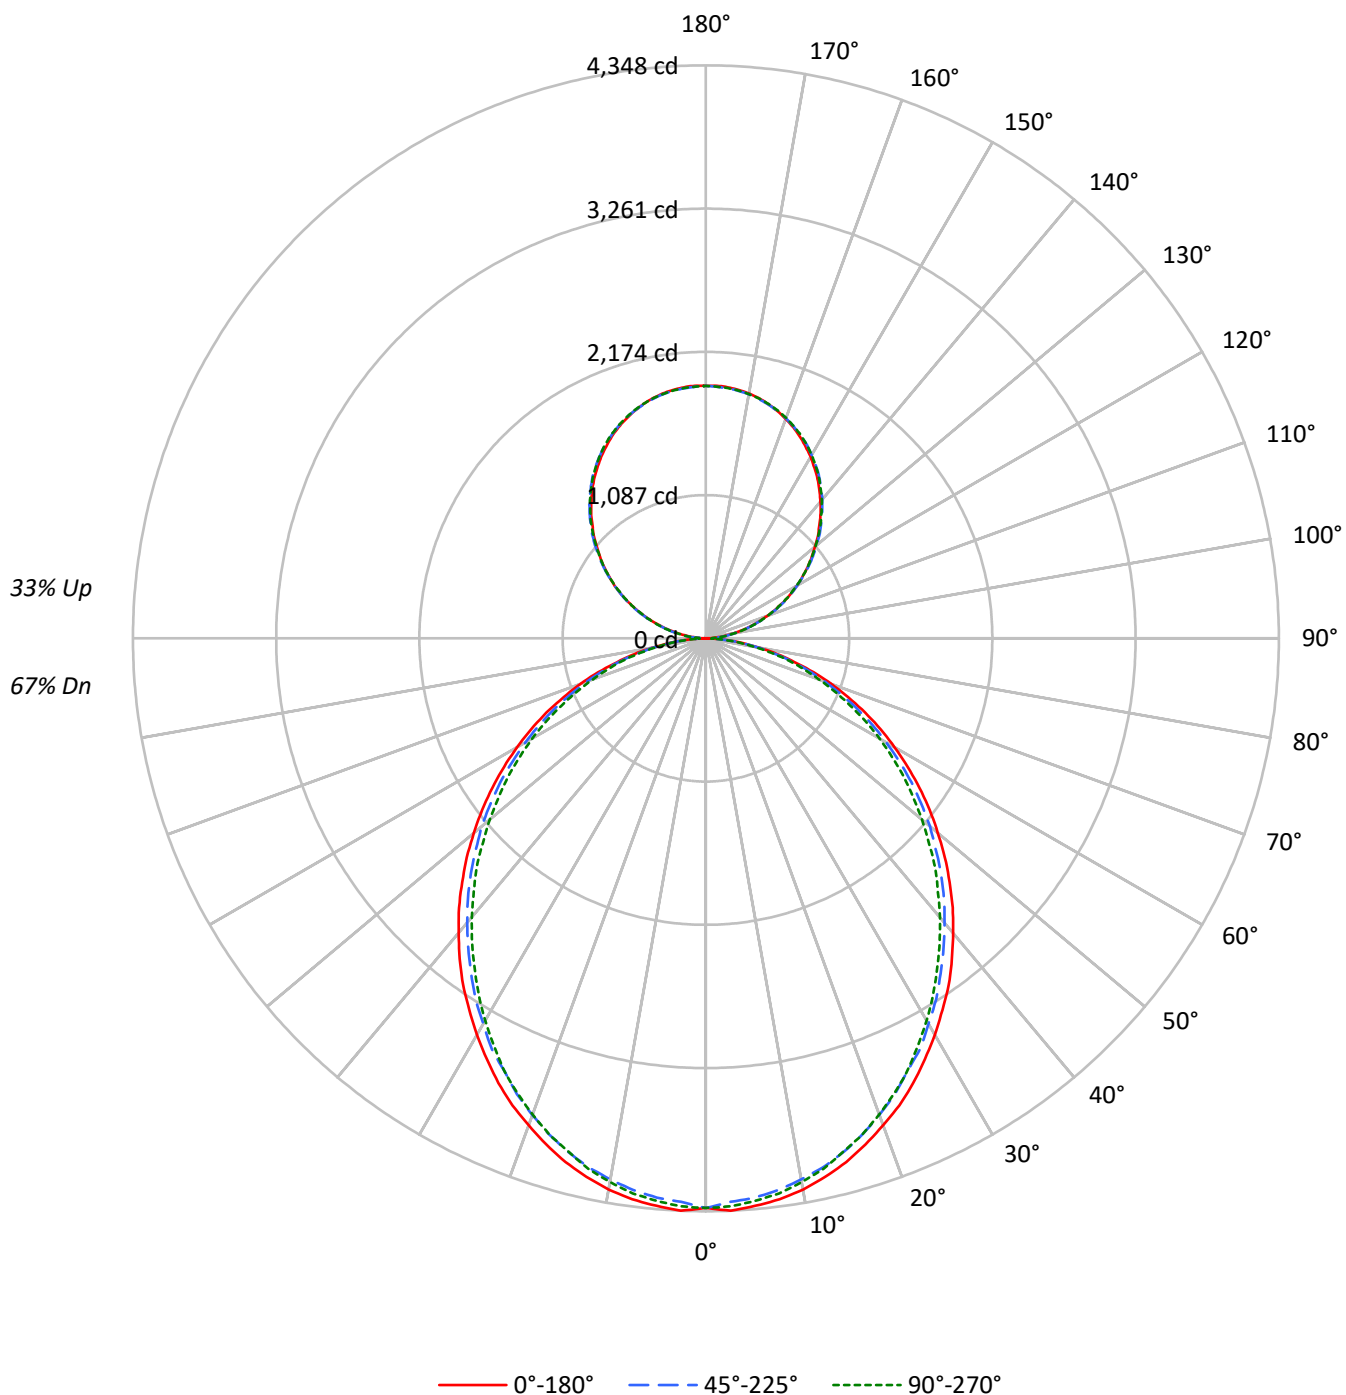

TEST NUMBER: P909328

CATALOG NUMBER: DFN2DIP-SQ3F0-110D060US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	105	105	105	105	93	93	93	82	82	82	72	72	72
1	102	97	93	90	96	92	88	85	82	79	76	72	70	68	64	62	61
2	93	85	79	73	87	80	75	70	72	67	63	63	60	57	56	54	51
3	85	75	67	61	79	71	64	58	63	58	53	56	52	48	50	46	44
4	77	66	58	52	73	63	55	50	56	50	46	50	45	42	44	41	38
5	71	59	51	45	67	56	49	43	50	44	39	45	40	36	40	36	33
6	66	53	45	39	62	51	43	37	45	39	35	41	36	32	36	32	29
7	61	48	40	34	57	46	38	33	41	35	31	37	32	28	33	29	26
8	56	44	36	30	53	42	34	29	38	32	27	34	29	25	31	26	23
9	53	40	32	27	50	38	31	26	35	29	24	31	26	23	28	24	21
10	49	37	29	24	46	35	28	24	32	26	22	29	24	21	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4953	4953	4953
5°	4957	4880	4915
10°	4914	4811	4847
15°	4839	4729	4741
20°	4738	4615	4633
25°	4638	4481	4509
30°	4512	4355	4350
35°	4394	4207	4183
40°	4248	4058	4024
45°	4103	3908	3861
50°	3944	3750	3673
55°	3777	3568	3499
60°	3588	3352	3300
65°	3381	3128	3065
70°	3118	2854	2812
75°	2755	2526	2576
80°	2316	2108	2129
85°	1631	1397	1393

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4103 cd/sqm

TEST NUMBER: P909328

CATALOG NUMBER: DFN2DIP-SQ3F0-110D060US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.8	2.5
10°-20°	1144.7	7.0
20°-30°	1682.2	10.3
30°-40°	1953.7	11.9
40°-50°	1951.3	11.9
50°-60°	1701.5	10.4
60°-70°	1257.8	7.7
70°-80°	711.6	4.3
80°-90°	193.3	1.2
90°-100°	118.6	0.7
100°-110°	376.8	2.3
110°-120°	644.8	3.9
120°-130°	848.0	5.2
130°-140°	951.8	5.8
140°-150°	933.4	5.7
150°-160°	783.0	4.8
160°-170°	519.2	3.2
170°-180°	181.5	1.1
0°-30°	3233.7	19.8
0°-40°	5187.4	31.7
0°-60°	8840.2	54.0
0°-90°	11002.9	67.3
90°-120°	1140.1	7.0
90°-150°	3873.3	23.7
90°-180°	5357.0	32.7
0°-180°	16359.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4322	4322	4322	4322	4322	
5°	4322	4306	4260	4293	4285	410
15°	4115	4090	4036	4052	4032	1159
25°	3724	3691	3620	3628	3620	1714
35°	3213	3172	3105	3080	3059	2006
45°	2614	2585	2523	2477	2461	2018
55°	1979	1954	1904	1854	1833	1769
65°	1334	1309	1268	1230	1210	1319
75°	698	690	669	644	653	745
85°	170	166	162	150	146	190
90°	2	21	57	53	55	16
95°	84	100	103	103	100	94
105°	348	352	356	359	359	367
115°	647	656	653	652	647	640
125°	941	956	951	946	944	841
135°	1217	1235	1239	1237	1232	941
145°	1478	1489	1499	1500	1494	923
155°	1690	1694	1700	1708	1702	778
165°	1838	1836	1836	1848	1840	519
175°	1913	1908	1905	1916	1906	182
180°	1916	1916	1916	1916	1916	

TEST NUMBER: P909328

CATALOG NUMBER: DFN2DIP-SQ3F0-110D060US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4322.4	4322.4	4322.4	4322.4	4322.4
2.5°	4347.5	4326.8	4280.9	4322.4	4314.4
5°	4322.4	4306.1	4260.2	4293.2	4285.4
7.5°	4293.2	4268.6	4222.8	4256.3	4247.9
10°	4247.9	4218.7	4168.9	4201.9	4189.6
12.5°	4185.3	4160.5	4110.8	4131.5	4123.1
15°	4114.7	4090.0	4035.7	4052.5	4031.8
17.5°	4027.3	4002.7	3948.5	3969.2	3948.5
20°	3931.7	3907.0	3848.8	3861.1	3844.9
22.5°	3836.5	3798.9	3744.7	3744.7	3736.3
25°	3724.0	3691.0	3620.4	3628.3	3620.4
27.5°	3599.2	3570.1	3516.3	3503.9	3483.2
30°	3474.8	3441.3	3379.1	3366.8	3350.0
32.5°	3341.6	3317.0	3250.4	3225.2	3208.4
35°	3212.9	3171.5	3104.8	3079.7	3059.0
37.5°	3067.4	3029.9	2963.3	2934.2	2913.5
40°	2917.9	2884.4	2817.8	2780.8	2764.0
42.5°	2772.4	2738.9	2672.7	2630.8	2606.2
45°	2614.5	2585.4	2522.7	2477.4	2460.6
47.5°	2460.6	2431.6	2364.9	2319.1	2294.3
50°	2298.4	2277.7	2219.4	2161.2	2140.5
52.5°	2140.5	2111.3	2057.6	2011.7	1982.6
55°	1978.6	1953.5	1903.7	1853.8	1833.1
57.5°	1816.3	1795.6	1741.4	1691.5	1674.8
60°	1654.1	1637.8	1579.5	1533.7	1521.4
62.5°	1496.2	1467.1	1425.6	1384.2	1367.5
65°	1334.3	1309.2	1267.8	1230.3	1209.6
67.5°	1168.1	1147.0	1109.9	1080.9	1064.1
70°	1014.2	997.4	960.0	930.9	914.5
72.5°	856.4	839.6	818.9	789.8	777.4
75°	698.0	690.1	668.9	644.3	652.7
77.5°	556.9	540.2	531.8	519.5	507.2
80°	415.9	411.4	403.0	390.7	382.3
82.5°	282.7	282.7	278.7	262.0	262.0
85°	170.3	166.2	162.3	149.5	145.5
87.5°	74.9	66.6	58.2	45.8	41.4
90°	1.7	20.8	56.7	53.1	54.8
92.5°	35.9	48.6	50.3	52.0	52.0
95°	84.3	100.5	103.4	103.4	100.5
97.5°	140.4	155.4	161.8	161.8	161.8
100°	205.1	218.3	223.0	223.0	221.3
102.5°	273.3	283.1	289.4	291.1	289.4
105°	347.8	352.4	355.9	358.8	358.8
107.5°	421.7	428.7	428.7	429.8	421.7
110°	493.4	502.6	502.6	502.6	498.0



TEST NUMBER: P909328

CATALOG NUMBER: DFN2DIP-SQ3F0-110D060US840-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	570.8	580.6	578.9	574.2	570.8
115°	647.0	656.3	653.4	651.7	647.0
117.5°	722.8	735.5	727.3	722.8	718.1
120°	799.0	811.7	799.0	799.0	793.8
122.5°	868.3	884.4	876.4	871.8	868.3
125°	941.1	955.5	950.9	945.7	944.0
127.5°	1012.2	1030.1	1023.7	1016.8	1012.2
130°	1078.6	1099.4	1096.5	1093.1	1086.7
132.5°	1153.2	1169.3	1170.4	1162.4	1157.7
135°	1217.3	1235.2	1238.6	1236.9	1232.2
137.5°	1288.9	1303.3	1306.3	1305.0	1298.2
140°	1351.9	1366.3	1374.4	1374.4	1368.1
142.5°	1416.5	1431.0	1435.6	1437.3	1431.0
145°	1477.8	1489.3	1498.6	1500.4	1494.0
147.5°	1532.7	1547.1	1554.1	1556.9	1550.5
150°	1589.3	1599.1	1605.5	1610.6	1605.5
152.5°	1639.5	1649.4	1657.5	1663.9	1657.5
155°	1689.8	1694.5	1699.6	1707.8	1702.5
157.5°	1733.1	1736.7	1739.5	1751.1	1743.0
160°	1771.9	1775.3	1777.1	1786.9	1780.0
162.5°	1807.7	1807.7	1809.4	1820.4	1812.3
165°	1838.3	1836.5	1836.5	1848.2	1840.1
167.5°	1866.0	1860.9	1860.9	1872.4	1864.3
170°	1886.8	1882.2	1880.5	1892.0	1882.2
172.5°	1901.3	1896.6	1894.9	1906.4	1896.6
175°	1912.8	1908.2	1904.7	1916.3	1906.4
177.5°	1919.1	1914.6	1911.1	1920.9	1911.1
180°	1916.3	1916.3	1916.3	1916.3	1916.3

TEST NUMBER: P909328

CATALOG NUMBER: DFN2DIP-SQ3F0-110D060US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.25	15.29	15.05	16.11	17.11	13.81	14.85	14.60	15.67	16.67
	3H	15.92	16.86	16.73	17.68	18.71	15.43	16.37	16.24	17.19	18.22
	4H	16.51	17.40	17.34	18.23	19.27	16.02	16.90	16.84	17.74	18.78
	6H	16.92	17.74	17.76	18.58	19.63	16.42	17.24	17.26	18.08	19.13
	8H	17.03	17.81	17.87	18.67	19.72	16.53	17.30	17.37	18.16	19.22
	12H	17.08	17.82	17.93	18.68	19.76	16.57	17.31	17.42	18.17	19.25
4H	2H	14.73	15.62	15.56	16.45	17.49	14.38	15.26	15.20	16.09	17.13
	3H	16.61	17.35	17.45	18.21	19.27	16.20	16.94	17.04	17.80	18.86
	4H	17.33	18.00	18.18	18.86	19.95	16.90	17.57	17.75	18.44	19.52
	6H	17.85	18.43	18.72	19.32	20.40	17.41	18.00	18.28	18.88	19.97
	8H	18.00	18.54	18.87	19.43	20.53	17.56	18.10	18.43	18.99	20.09
	12H	18.08	18.57	18.97	19.47	20.58	17.63	18.12	18.52	19.02	20.13
8H	4H	17.53	18.08	18.40	18.96	20.06	17.16	17.70	18.03	18.58	19.68
	6H	18.17	18.62	19.06	19.54	20.64	17.78	18.23	18.68	19.16	20.26
	8H	18.38	18.78	19.29	19.70	20.82	17.99	18.39	18.90	19.31	20.43
	12H	18.52	18.87	19.43	19.78	20.95	18.11	18.46	19.02	19.37	20.54
12H	4H	17.53	18.02	18.42	18.92	20.03	17.16	17.65	18.05	18.55	19.66
	6H	18.19	18.59	19.10	19.51	20.63	17.82	18.22	18.73	19.14	20.26
	8H	18.44	18.79	19.35	19.70	20.87	18.06	18.41	18.97	19.32	20.49