

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909352

Luminaire Tested: DFN2DIP-SQ3F0-110D120US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909352
REPORT IS A COMBINATION OF REPORTS P900019 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-110D120US840-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 21722.2 lumens
Efficiency: N/A
Efficacy: 105.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 206
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909352

CATALOG NUMBER: DFN2DIP-SQ3F0-110D120US840-FLLFLL

Luminous Intensity Polar Plot

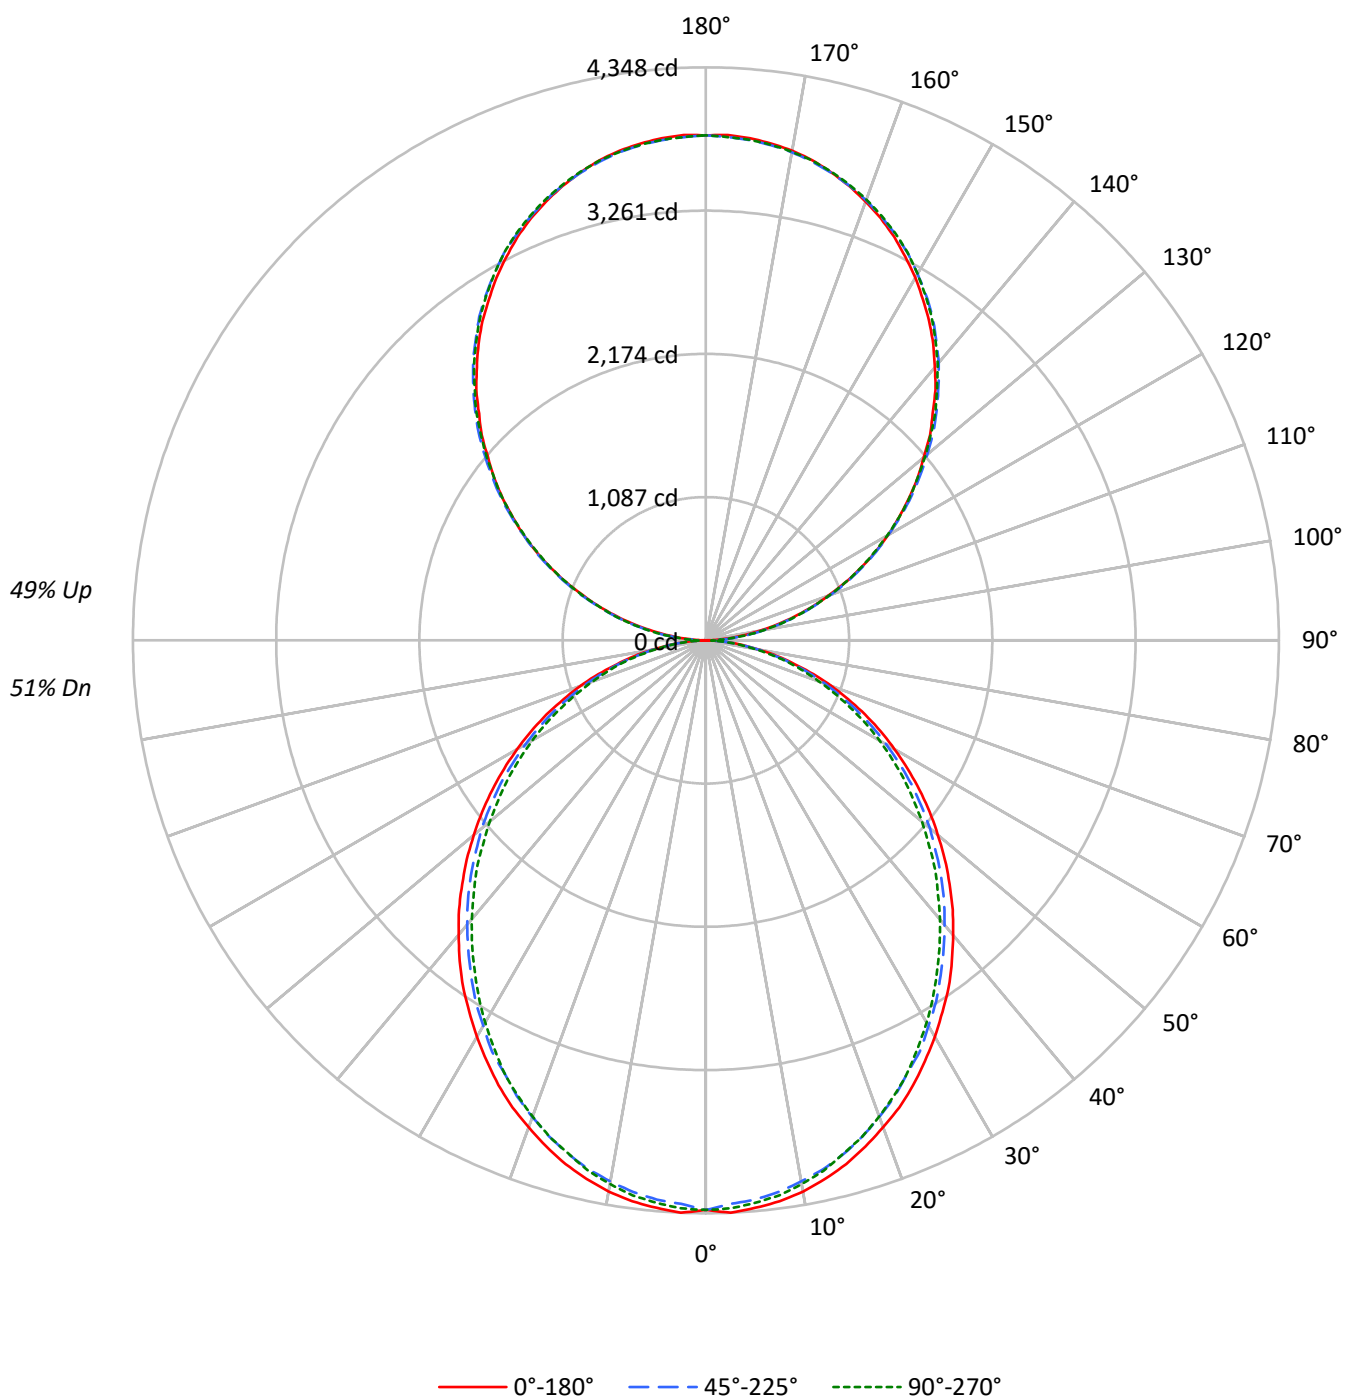

TEST NUMBER: P909352

CATALOG NUMBER: DFN2DIP-SQ3F0-110D120US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	70	70	70	57	57	57
1	98	94	90	86	90	87	83	80	73	71	69	61	60	58	50	49	48
2	89	82	76	70	82	76	70	66	64	60	57	54	51	48	44	42	40
3	81	72	65	59	75	67	60	55	57	52	48	48	44	41	39	37	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	30
5	68	57	49	43	63	53	45	40	45	40	35	38	34	30	32	28	26
6	63	51	43	37	58	47	40	35	41	35	31	34	30	27	29	25	23
7	58	46	38	32	54	43	36	31	37	31	27	31	27	24	26	23	20
8	54	42	34	29	50	39	32	27	34	28	24	29	24	21	24	21	18
9	50	38	31	25	46	36	29	24	31	25	22	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	21	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4953	4953	4953
5°	4957	4880	4915
10°	4914	4811	4847
15°	4839	4729	4741
20°	4738	4615	4633
25°	4638	4481	4509
30°	4512	4355	4350
35°	4394	4207	4183
40°	4248	4058	4024
45°	4103	3908	3861
50°	3944	3750	3673
55°	3777	3568	3499
60°	3588	3352	3300
65°	3381	3128	3065
70°	3118	2854	2812
75°	2755	2526	2576
80°	2316	2108	2129
85°	1631	1397	1393

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 4103 cd/sqm

TEST NUMBER: P909352

CATALOG NUMBER: DFN2DIP-SQ3F0-110D120US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.8	1.9
10°-20°	1144.7	5.3
20°-30°	1682.2	7.7
30°-40°	1953.7	9.0
40°-50°	1951.3	9.0
50°-60°	1701.5	7.8
60°-70°	1257.8	5.8
70°-80°	711.6	3.3
80°-90°	198.7	0.9
90°-100°	237.2	1.1
100°-110°	753.5	3.5
110°-120°	1289.5	5.9
120°-130°	1696.0	7.8
130°-140°	1903.6	8.8
140°-150°	1866.7	8.6
150°-160°	1565.9	7.2
160°-170°	1038.5	4.8
170°-180°	363.0	1.7
0°-30°	3233.7	14.9
0°-40°	5187.4	23.9
0°-60°	8840.2	40.7
0°-90°	11008.3	50.7
90°-120°	2280.2	10.5
90°-150°	7746.5	35.7
90°-180°	10714.0	49.3
0°-180°	21722.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4322	4322	4322	4322	4322	
5°	4322	4306	4260	4293	4285	410
15°	4115	4090	4036	4052	4032	1159
25°	3724	3691	3620	3628	3620	1714
35°	3213	3172	3105	3080	3059	2006
45°	2614	2585	2523	2477	2461	2018
55°	1979	1954	1904	1854	1833	1769
65°	1334	1309	1268	1230	1210	1319
75°	698	690	669	644	653	745
85°	170	166	162	150	146	190
90°	3	42	113	106	110	21
95°	169	201	207	207	201	188
105°	696	705	712	718	718	734
115°	1294	1313	1307	1303	1294	1280
125°	1882	1911	1902	1892	1888	1682
135°	2434	2470	2477	2474	2465	1882
145°	2956	2979	2997	3001	2988	1847
155°	3380	3389	3399	3416	3405	1556
165°	3677	3673	3673	3696	3680	1037
175°	3826	3816	3810	3832	3813	363
180°	3832	3832	3832	3832	3832	

TEST NUMBER: P909352

CATALOG NUMBER: DFN2DIP-SQ3F0-110D120US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4322.4	4322.4	4322.4	4322.4	4322.4
2.5°	4347.5	4326.8	4280.9	4322.4	4314.4
5°	4322.4	4306.1	4260.2	4293.2	4285.4
7.5°	4293.2	4268.6	4222.8	4256.3	4247.9
10°	4247.9	4218.7	4168.9	4201.9	4189.6
12.5°	4185.3	4160.5	4110.8	4131.5	4123.1
15°	4114.7	4090.0	4035.7	4052.5	4031.8
17.5°	4027.3	4002.7	3948.5	3969.2	3948.5
20°	3931.7	3907.0	3848.8	3861.1	3844.9
22.5°	3836.5	3798.9	3744.7	3744.7	3736.3
25°	3724.0	3691.0	3620.4	3628.3	3620.4
27.5°	3599.2	3570.1	3516.3	3503.9	3483.2
30°	3474.8	3441.3	3379.1	3366.8	3350.0
32.5°	3341.6	3317.0	3250.4	3225.2	3208.4
35°	3212.9	3171.5	3104.8	3079.7	3059.0
37.5°	3067.4	3029.9	2963.3	2934.2	2913.5
40°	2917.9	2884.4	2817.8	2780.8	2764.0
42.5°	2772.4	2738.9	2672.7	2630.8	2606.2
45°	2614.5	2585.4	2522.7	2477.4	2460.6
47.5°	2460.6	2431.6	2364.9	2319.1	2294.3
50°	2298.4	2277.7	2219.4	2161.2	2140.5
52.5°	2140.5	2111.3	2057.6	2011.7	1982.6
55°	1978.6	1953.5	1903.7	1853.8	1833.1
57.5°	1816.3	1795.6	1741.4	1691.5	1674.8
60°	1654.1	1637.8	1579.5	1533.7	1521.4
62.5°	1496.2	1467.1	1425.6	1384.2	1367.5
65°	1334.3	1309.2	1267.8	1230.3	1209.6
67.5°	1168.1	1147.0	1109.9	1080.9	1064.1
70°	1014.2	997.4	960.0	930.9	914.5
72.5°	856.4	839.6	818.9	789.8	777.4
75°	698.0	690.1	668.9	644.3	652.7
77.5°	556.9	540.2	531.8	519.5	507.2
80°	415.9	411.4	403.0	390.7	382.3
82.5°	282.7	282.7	278.7	262.0	262.0
85°	170.3	166.2	162.3	149.5	145.5
87.5°	74.9	66.6	58.2	45.8	41.4
90°	3.4	41.6	113.2	106.3	109.8
92.5°	71.6	97.0	100.5	104.0	104.0
95°	168.6	201.1	206.8	206.8	201.1
97.5°	280.7	310.8	323.6	323.6	323.6
100°	410.2	436.8	446.0	446.0	442.5
102.5°	546.5	566.1	578.9	582.4	578.9
105°	695.6	704.8	711.8	717.5	717.5
107.5°	843.4	857.4	857.4	859.6	843.4
110°	986.7	1005.2	1005.2	1005.2	996.0

TEST NUMBER: P909352

CATALOG NUMBER: DFN2DIP-SQ3F0-110D120US840-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1141.6	1161.2	1157.7	1148.5	1141.6
115°	1294.0	1312.6	1306.8	1303.3	1294.0
117.5°	1445.4	1470.9	1454.7	1445.4	1436.2
120°	1598.0	1623.4	1598.0	1598.0	1587.6
122.5°	1736.7	1769.0	1752.8	1743.5	1736.7
125°	1882.2	1911.1	1901.9	1891.5	1887.9
127.5°	2024.4	2060.1	2047.4	2033.6	2024.4
130°	2157.2	2198.8	2193.0	2186.1	2173.3
132.5°	2306.2	2338.6	2340.9	2324.7	2315.5
135°	2434.5	2470.3	2477.3	2473.8	2464.6
137.5°	2577.8	2606.7	2612.4	2610.1	2596.3
140°	2703.7	2732.6	2748.8	2748.8	2736.0
142.5°	2833.2	2862.1	2871.2	2874.7	2862.1
145°	2955.6	2978.7	2997.2	3000.7	2988.0
147.5°	3065.3	3094.2	3108.2	3113.9	3101.2
150°	3178.7	3198.2	3211.0	3221.4	3211.0
152.5°	3279.1	3298.7	3315.0	3327.7	3315.0
155°	3379.6	3388.9	3399.3	3415.5	3405.1
157.5°	3466.4	3473.2	3479.0	3502.1	3486.0
160°	3543.7	3550.7	3554.1	3573.8	3559.9
162.5°	3615.3	3615.3	3618.9	3640.8	3624.6
165°	3676.6	3673.2	3673.2	3696.2	3680.1
167.5°	3732.1	3721.7	3721.7	3744.8	3728.6
170°	3773.7	3764.4	3760.9	3784.1	3764.4
172.5°	3802.5	3793.3	3789.8	3812.9	3793.3
175°	3825.7	3816.4	3809.5	3832.5	3812.9
177.5°	3838.4	3829.1	3822.1	3841.8	3822.1
180°	3832.5	3832.5	3832.5	3832.5	3832.5

TEST NUMBER: P909352

CATALOG NUMBER: DFN2DIP-SQ3F0-110D120US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.86	13.73	13.81	14.69	15.95	12.41	13.28	13.36	14.25	15.51
	3H	14.51	15.29	15.48	16.27	17.55	14.02	14.80	14.99	15.78	17.06
	4H	15.10	15.84	16.08	16.82	18.11	14.60	15.34	15.58	16.32	17.61
	6H	15.50	16.17	16.48	17.16	18.47	15.00	15.67	15.98	16.66	17.97
	8H	15.60	16.24	16.59	17.25	18.55	15.10	15.74	16.09	16.75	18.05
	12H	15.65	16.26	16.64	17.26	18.58	15.14	15.75	16.14	16.75	18.07
4H	2H	13.32	14.05	14.30	15.03	16.33	12.96	13.70	13.94	14.68	15.97
	3H	15.18	15.79	16.17	16.80	18.11	14.77	15.38	15.76	16.39	17.70
	4H	15.89	16.45	16.89	17.45	18.78	15.46	16.03	16.46	17.03	18.36
	6H	16.40	16.88	17.41	17.91	19.24	15.97	16.45	16.98	17.48	18.80
	8H	16.55	17.00	17.56	18.02	19.36	16.11	16.56	17.12	17.58	18.92
	12H	16.62	17.03	17.65	18.06	19.41	16.17	16.58	17.20	17.61	18.96
8H	4H	16.08	16.53	17.09	17.55	18.89	15.70	16.16	16.72	17.17	18.52
	6H	16.71	17.08	17.74	18.14	19.48	16.32	16.70	17.36	17.76	19.10
	8H	16.92	17.25	17.97	18.30	19.66	16.53	16.86	17.58	17.91	19.27
	12H	17.05	17.34	18.10	18.38	19.79	16.64	16.93	17.69	17.97	19.37
12H	4H	16.07	16.47	17.10	17.51	18.86	15.70	16.11	16.73	17.14	18.49
	6H	16.73	17.06	17.78	18.11	19.47	16.36	16.69	17.41	17.74	19.10
	8H	16.97	17.26	18.02	18.30	19.71	16.59	16.88	17.64	17.92	19.33

END OF REPORT