

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909367

Luminaire Tested: DFN2DIP-SQ3F0-120D060US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909367
REPORT IS A COMBINATION OF REPORTS P901434 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D060US840-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16299.2 lumens
Efficiency: N/A
Efficacy: 95.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 170.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909367

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US840-RLLONL

Luminous Intensity Polar Plot

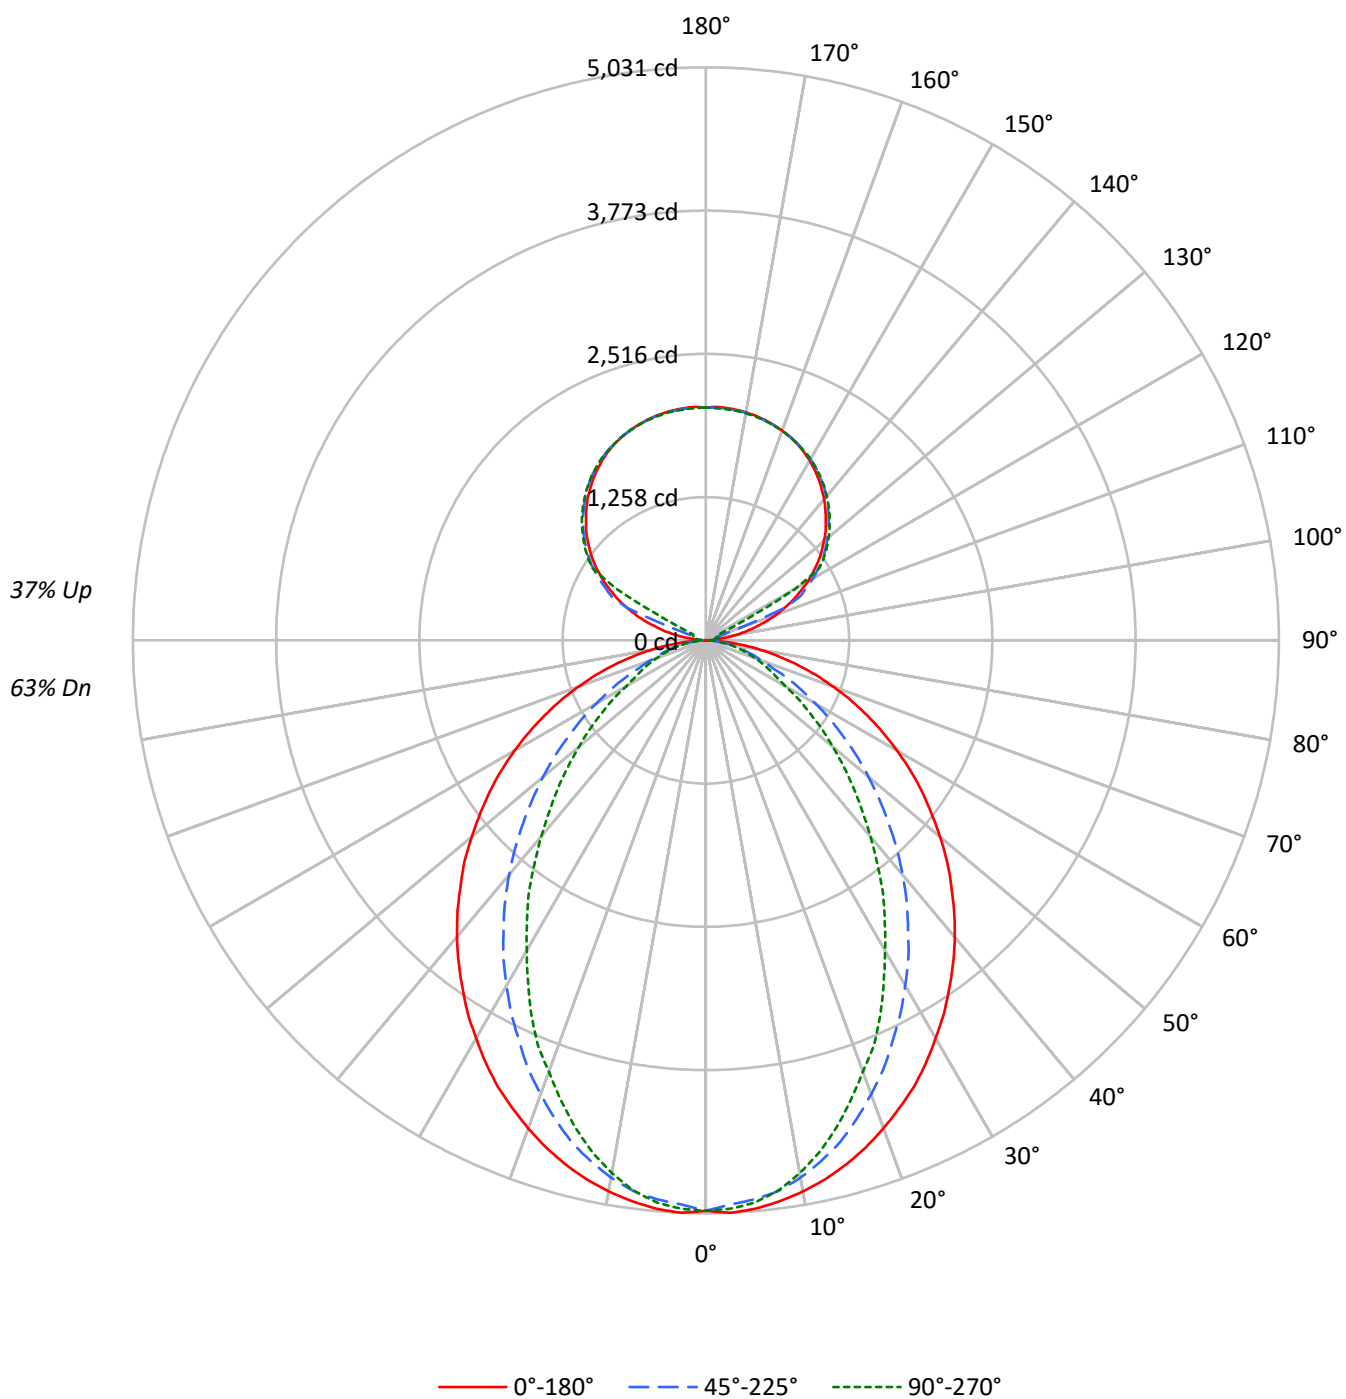

TEST NUMBER: P909367

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	91	91	91	79	79	79	68	68	68
1	101	97	93	90	95	91	88	85	80	78	76	71	69	67	61	60	59
2	93	86	80	75	87	81	75	71	71	67	64	63	60	57	55	52	51
3	85	76	69	63	80	72	65	60	63	58	54	56	52	49	49	46	44
4	78	68	60	54	73	64	57	52	57	51	47	50	46	43	44	41	38
5	72	61	53	47	67	57	50	45	51	45	41	46	41	37	40	37	34
6	67	55	47	41	62	52	45	39	46	41	36	41	37	33	37	33	30
7	62	50	42	36	58	47	40	35	42	36	32	38	33	30	34	30	27
8	58	45	38	32	54	43	36	31	39	33	29	35	30	27	31	27	24
9	54	42	34	29	51	40	33	28	36	30	26	32	27	24	29	25	22
10	50	38	31	26	47	37	30	25	33	28	24	30	25	22	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5739	5739	5739
5°	5744	5644	5682
10°	5684	5529	5495
15°	5602	5343	5208
20°	5495	5087	4856
25°	5385	4802	4515
30°	5239	4509	4085
35°	5095	4195	3706
40°	4949	3870	3273
45°	4780	3511	2880
50°	4604	3148	2497
55°	4421	2761	2129
60°	4208	2356	1750
65°	3963	1946	1573
70°	3665	1563	1421
75°	3291	1369	1289
80°	2750	1136	1111
85°	1865	740	824

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4780 cd/sqm

TEST NUMBER: P909367

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	469.4	2.9
10°-20°	1288.6	7.9
20°-30°	1809.2	11.1
30°-40°	1972.1	12.1
40°-50°	1812.6	11.1
50°-60°	1423.5	8.7
60°-70°	926.6	5.7
70°-80°	476.9	2.9
80°-90°	125.4	0.8
90°-100°	67.4	0.4
100°-110°	251.4	1.5
110°-120°	666.7	4.1
120°-130°	1105.7	6.8
130°-140°	1174.5	7.2
140°-150°	1091.6	6.7
150°-160°	877.6	5.4
160°-170°	565.5	3.5
170°-180°	194.6	1.2
0°-30°	3567.2	21.9
0°-40°	5539.3	34.0
0°-60°	8775.3	53.8
0°-90°	10304.2	63.2
90°-120°	985.5	6.0
90°-150°	4357.2	26.7
90°-180°	5995.0	36.8
0°-180°	16299.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5008	5008	5008	5008	5008	
5°	5008	4986	4927	4968	4954	475
15°	4764	4714	4560	4474	4429	1342
25°	4324	4179	3880	3694	3626	1989
35°	3726	3495	3096	2810	2710	2332
45°	3046	2742	2266	1944	1836	2352
55°	2316	1963	1473	1201	1115	2070
65°	1564	1196	789	635	621	1550
75°	834	516	363	331	326	882
85°	195	100	86	86	86	224
90°	1	18	30	37	40	15
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P909367

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5008.5	5008.5	5008.5	5008.5	5008.5
2.5°	5031.2	5008.5	4958.5	5004.2	4995.0
5°	5008.5	4985.9	4926.7	4967.6	4954.2
7.5°	4967.6	4940.7	4877.2	4895.0	4872.4
10°	4913.3	4881.6	4791.1	4777.2	4750.3
12.5°	4845.4	4804.6	4681.9	4655.1	4605.1
15°	4763.7	4713.7	4559.8	4473.7	4428.6
17.5°	4668.5	4595.9	4405.4	4306.0	4233.4
20°	4559.8	4469.0	4242.4	4129.4	4029.4
22.5°	4442.0	4337.7	4074.6	3920.7	3852.9
25°	4324.2	4178.9	3879.8	3694.2	3625.9
27.5°	4183.8	4029.4	3698.5	3485.6	3381.1
30°	4034.2	3861.6	3499.0	3268.1	3145.5
32.5°	3889.0	3680.3	3309.0	3036.9	2923.4
35°	3726.0	3494.6	3095.9	2810.4	2710.3
37.5°	3567.2	3317.7	2896.4	2583.3	2470.3
40°	3399.4	3127.8	2687.8	2366.0	2248.2
42.5°	3227.2	2937.3	2479.5	2143.8	2030.8
45°	3046.0	2742.1	2266.4	1944.3	1835.5
47.5°	2873.8	2552.1	2062.5	1740.4	1640.8
50°	2683.4	2361.7	1863.0	1549.9	1455.2
52.5°	2497.3	2157.3	1672.5	1373.4	1287.4
55°	2316.0	1962.6	1473.0	1201.2	1115.2
57.5°	2130.3	1767.8	1296.5	1042.6	970.0
60°	1940.0	1577.3	1110.3	879.6	807.0
62.5°	1754.3	1391.7	951.7	734.4	698.2
65°	1563.9	1196.5	788.7	634.8	620.9
67.5°	1382.6	1015.1	634.8	557.3	543.9
70°	1192.1	838.7	525.6	480.4	462.1
72.5°	1010.9	675.2	439.5	403.4	394.4
75°	833.8	516.4	362.6	330.8	326.5
77.5°	657.4	366.9	285.7	267.4	258.2
80°	493.9	263.1	217.3	199.5	199.5
82.5°	344.4	176.9	149.6	140.4	140.4
85°	194.8	99.6	86.0	86.0	86.0
87.5°	72.6	36.1	36.1	31.7	31.7
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8

TEST NUMBER: P909367

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P909367

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.34	15.29	15.18	16.15	17.22	10.30	11.25	11.14	12.11	13.18
	3H	16.02	16.87	16.87	17.74	18.84	11.49	12.34	12.34	13.21	14.31
	4H	16.63	17.43	17.50	18.31	19.42	11.94	12.74	12.81	13.62	14.73
	6H	17.05	17.79	17.94	18.67	19.80	12.26	13.00	13.14	13.88	15.00
	8H	17.18	17.88	18.07	18.78	19.91	12.35	13.05	13.24	13.95	15.08
	12H	17.24	17.91	18.14	18.81	19.95	12.40	13.06	13.29	13.96	15.11
4H	2H	14.37	15.17	15.24	16.04	17.15	10.90	11.71	11.78	12.58	13.69
	3H	16.20	16.87	17.09	17.78	18.90	12.26	12.92	13.15	13.83	14.96
	4H	16.90	17.50	17.79	18.41	19.56	12.81	13.41	13.70	14.32	15.47
	6H	17.41	17.93	18.33	18.86	20.02	13.22	13.75	14.14	14.67	15.83
	8H	17.59	18.08	18.50	19.00	20.16	13.35	13.84	14.27	14.76	15.93
	12H	17.69	18.12	18.62	19.06	20.24	13.42	13.86	14.35	14.80	15.97
8H	4H	16.87	17.36	17.79	18.28	19.45	13.09	13.58	14.01	14.50	15.67
	6H	17.44	17.84	18.38	18.80	19.97	13.61	14.01	14.55	14.97	16.14
	8H	17.65	18.01	18.60	18.96	20.14	13.79	14.15	14.74	15.10	16.29
	12H	17.79	18.10	18.74	19.05	20.28	13.91	14.22	14.86	15.17	16.41
12H	4H	16.83	17.27	17.76	18.21	19.38	13.10	13.54	14.04	14.48	15.65
	6H	17.41	17.77	18.36	18.72	19.91	13.65	14.01	14.61	14.97	16.15
	8H	17.63	17.95	18.59	18.89	20.13	13.86	14.18	14.82	15.13	16.36

END OF REPORT