

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909383

Luminaire Tested: DFN2DIP-SQ3F0-120D100US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909383
REPORT IS A COMBINATION OF REPORTS P901506 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D100US840-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 20298.3 lumens
Efficiency: N/A
Efficacy: 99.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 203.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909383

CATALOG NUMBER: DFN2DIP-SQ3F0-120D100US840-RLLONL

Luminous Intensity Polar Plot

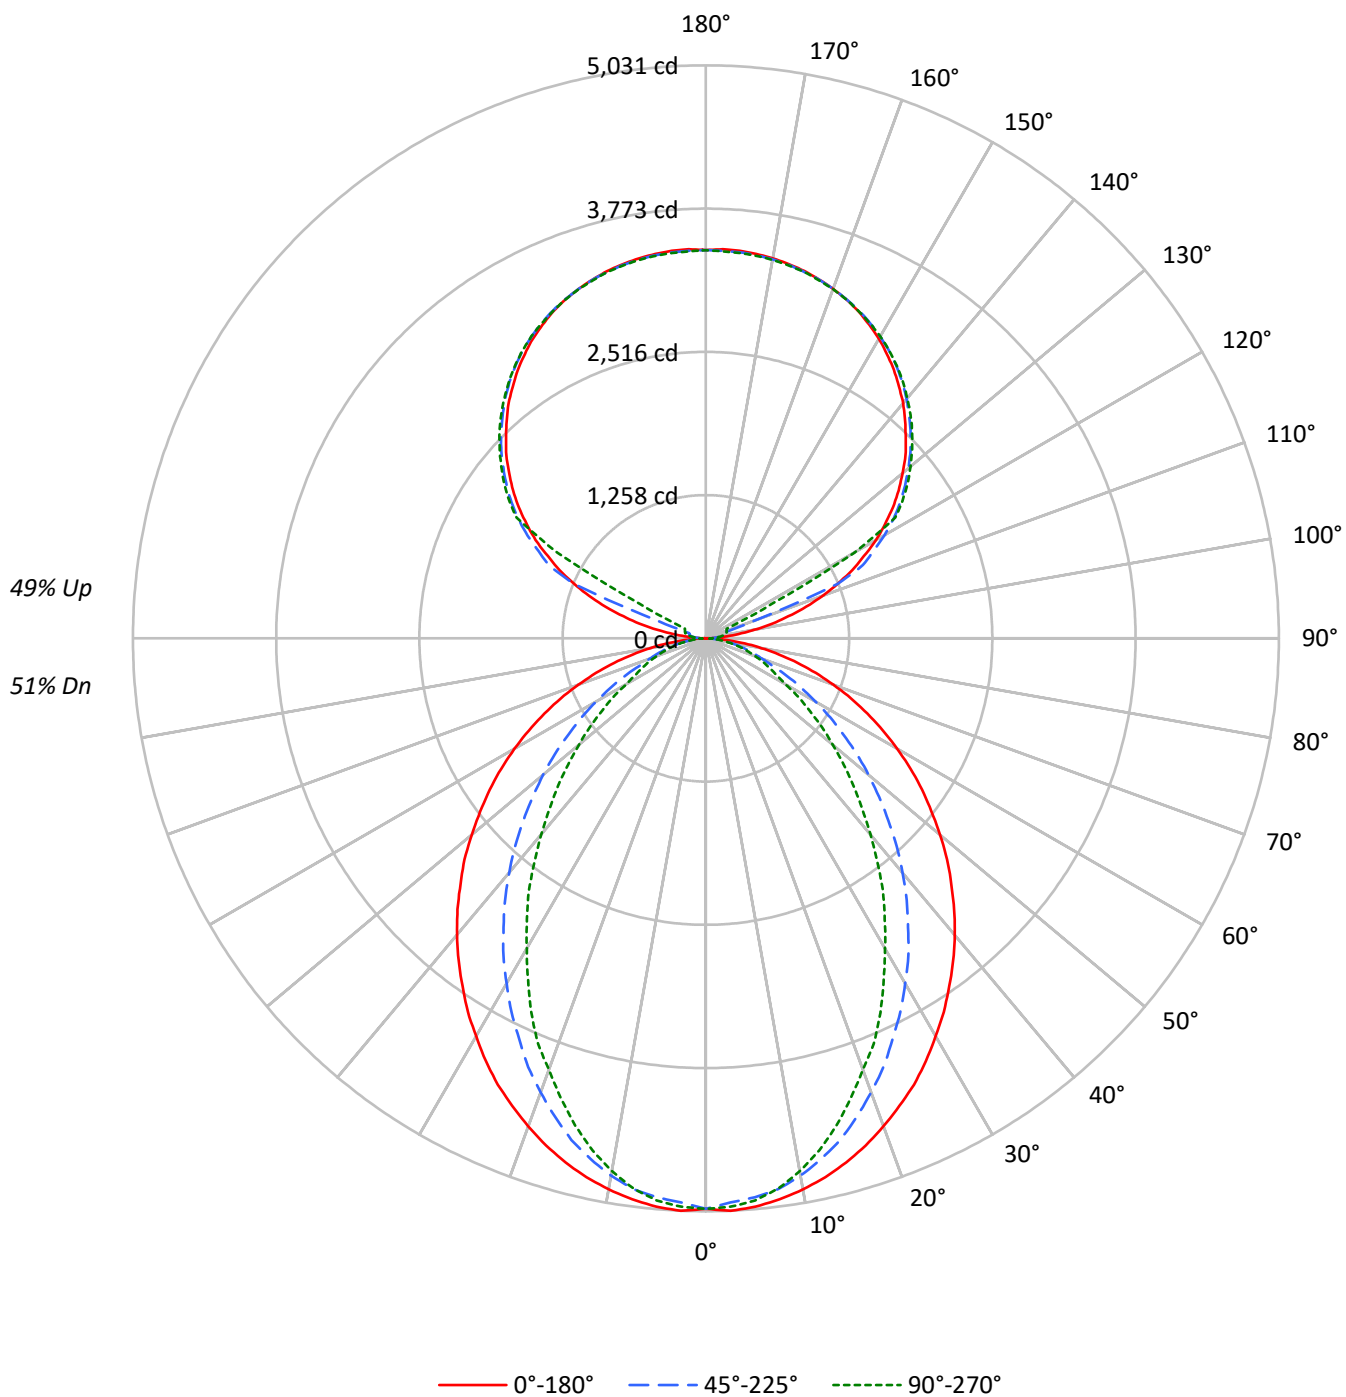

TEST NUMBER: P909383

CATALOG NUMBER: DFN2DIP-SQ3F0-120D100US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84		70	70	70		57
1	98	94	91	87	91	87	84	81	74	72	70		62	61	59		51
2	90	83	77	72	83	77	72	67	66	62	59		55	52	50		45
3	82	73	66	61	76	68	62	57	58	54	50		49	46	43		41
4	76	65	58	52	70	61	54	49	52	47	43		44	40	37		37
5	70	58	50	45	64	54	47	42	47	41	37		40	36	33		33
6	64	53	45	39	59	49	42	37	42	37	33		36	32	29		30
7	60	48	40	34	55	45	38	33	39	33	29		33	29	26		28
8	55	43	36	31	51	41	34	29	35	30	26		30	26	23		26
9	52	40	32	27	48	37	31	26	32	27	23		28	24	21		24
10	48	36	29	25	45	34	28	24	30	25	21		26	22	19		22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5739	5739	5739
5°	5744	5644	5682
10°	5684	5529	5495
15°	5602	5343	5208
20°	5495	5087	4856
25°	5385	4802	4515
30°	5239	4509	4085
35°	5095	4195	3706
40°	4949	3870	3273
45°	4780	3511	2880
50°	4604	3148	2497
55°	4421	2761	2129
60°	4208	2356	1750
65°	3963	1946	1573
70°	3665	1563	1421
75°	3291	1369	1289
80°	2750	1136	1111
85°	1865	740	824

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4780 cd/sqm

TEST NUMBER: P909383

CATALOG NUMBER: DFN2DIP-SQ3F0-120D100US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	469.4	2.3
10°-20°	1288.6	6.3
20°-30°	1809.2	8.9
30°-40°	1972.1	9.7
40°-50°	1812.6	8.9
50°-60°	1423.5	7.0
60°-70°	926.6	4.6
70°-80°	476.9	2.3
80°-90°	127.7	0.6
90°-100°	112.4	0.6
100°-110°	418.9	2.1
110°-120°	1111.1	5.5
120°-130°	1842.9	9.1
130°-140°	1957.5	9.6
140°-150°	1819.3	9.0
150°-160°	1462.7	7.2
160°-170°	942.5	4.6
170°-180°	324.4	1.6
0°-30°	3567.2	17.6
0°-40°	5539.3	27.3
0°-60°	8775.3	43.2
0°-90°	10306.6	50.8
90°-120°	1642.4	8.1
90°-150°	7262.1	35.8
90°-180°	9992.0	49.2
0°-180°	20298.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5008	5008	5008	5008	5008	
5°	5008	4986	4927	4968	4954	475
15°	4764	4714	4560	4474	4429	1342
25°	4324	4179	3880	3694	3626	1989
35°	3726	3495	3096	2810	2710	2332
45°	3046	2742	2266	1944	1836	2352
55°	2316	1963	1473	1201	1115	2070
65°	1564	1196	789	635	621	1550
75°	834	516	363	331	326	882
85°	195	100	86	86	86	224
90°	2	30	49	62	66	19
95°	160	79	96	109	106	190
105°	750	824	151	177	187	801
115°	1418	1460	1522	380	202	1396
125°	2005	2037	2084	2101	2108	1788
135°	2481	2520	2542	2567	2562	1916
145°	2878	2876	2917	2935	2922	1800
155°	3169	3147	3176	3191	3172	1460
165°	3339	3324	3332	3349	3332	943
175°	3416	3398	3403	3420	3396	325
180°	3408	3408	3408	3408	3408	

TEST NUMBER: P909383

CATALOG NUMBER: DFN2DIP-SQ3F0-120D100US840-RLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5008.5	5008.5	5008.5	5008.5	5008.5
2.5°	5031.2	5008.5	4958.5	5004.2	4995.0
5°	5008.5	4985.9	4926.7	4967.6	4954.2
7.5°	4967.6	4940.7	4877.2	4895.0	4872.4
10°	4913.3	4881.6	4791.1	4777.2	4750.3
12.5°	4845.4	4804.6	4681.9	4655.1	4605.1
15°	4763.7	4713.7	4559.8	4473.7	4428.6
17.5°	4668.5	4595.9	4405.4	4306.0	4233.4
20°	4559.8	4469.0	4242.4	4129.4	4029.4
22.5°	4442.0	4337.7	4074.6	3920.7	3852.9
25°	4324.2	4178.9	3879.8	3694.2	3625.9
27.5°	4183.8	4029.4	3698.5	3485.6	3381.1
30°	4034.2	3861.6	3499.0	3268.1	3145.5
32.5°	3889.0	3680.3	3309.0	3036.9	2923.4
35°	3726.0	3494.6	3095.9	2810.4	2710.3
37.5°	3567.2	3317.7	2896.4	2583.3	2470.3
40°	3399.4	3127.8	2687.8	2366.0	2248.2
42.5°	3227.2	2937.3	2479.5	2143.8	2030.8
45°	3046.0	2742.1	2266.4	1944.3	1835.5
47.5°	2873.8	2552.1	2062.5	1740.4	1640.8
50°	2683.4	2361.7	1863.0	1549.9	1455.2
52.5°	2497.3	2157.3	1672.5	1373.4	1287.4
55°	2316.0	1962.6	1473.0	1201.2	1115.2
57.5°	2130.3	1767.8	1296.5	1042.6	970.0
60°	1940.0	1577.3	1110.3	879.6	807.0
62.5°	1754.3	1391.7	951.7	734.4	698.2
65°	1563.9	1196.5	788.7	634.8	620.9
67.5°	1382.6	1015.1	634.8	557.3	543.9
70°	1192.1	838.7	525.6	480.4	462.1
72.5°	1010.9	675.2	439.5	403.4	394.4
75°	833.8	516.4	362.6	330.8	326.5
77.5°	657.4	366.9	285.7	267.4	258.2
80°	493.9	263.1	217.3	199.5	199.5
82.5°	344.4	176.9	149.6	140.4	140.4
85°	194.8	99.6	86.0	86.0	86.0
87.5°	72.6	36.1	36.1	31.7	31.7
90°	2.3	29.6	49.2	61.8	66.4
92.5°	61.8	51.8	59.2	64.1	66.4
95°	160.2	78.8	96.0	108.7	106.0
97.5°	288.4	86.3	125.6	133.2	135.6
100°	436.7	98.7	140.6	160.2	165.2
102.5°	599.2	594.5	145.5	172.5	180.1
105°	749.7	823.7	150.6	177.4	187.4
107.5°	924.8	986.3	155.5	182.5	192.4
110°	1092.6	1144.2	431.6	185.1	194.7

TEST NUMBER: P909383

CATALOG NUMBER: DFN2DIP-SQ3F0-120D100US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1250.4	1294.6	1252.8	189.8	197.4
115°	1418.0	1459.9	1521.7	379.8	202.4
117.5°	1563.5	1612.8	1654.9	1302.0	656.0
120°	1726.4	1763.2	1807.8	1837.3	1504.4
122.5°	1864.3	1903.8	1953.3	1967.9	1970.6
125°	2004.9	2037.1	2084.0	2101.2	2108.5
127.5°	2133.1	2167.7	2204.8	2229.5	2231.8
130°	2254.0	2293.6	2320.6	2347.7	2345.4
132.5°	2377.3	2409.5	2436.5	2458.7	2456.4
135°	2481.0	2520.5	2542.5	2567.4	2562.4
137.5°	2589.4	2619.0	2643.8	2668.5	2661.1
140°	2695.3	2715.3	2742.2	2764.5	2752.2
142.5°	2784.4	2801.7	2833.6	2853.2	2841.0
145°	2878.1	2875.5	2917.4	2934.7	2922.3
147.5°	2959.2	2951.9	2993.7	3006.1	2996.5
150°	3038.3	3021.0	3060.6	3075.2	3062.9
152.5°	3104.7	3085.1	3122.1	3136.9	3119.7
155°	3169.0	3146.9	3176.5	3191.2	3171.6
157.5°	3220.8	3201.2	3223.4	3240.7	3220.8
160°	3265.3	3250.4	3265.3	3279.9	3262.7
162.5°	3304.5	3289.8	3302.2	3319.4	3297.2
165°	3339.0	3324.4	3331.7	3349.0	3331.7
167.5°	3366.3	3351.3	3359.0	3376.3	3354.0
170°	3388.5	3373.7	3378.6	3395.9	3373.7
172.5°	3403.1	3388.5	3393.6	3410.8	3388.5
175°	3415.5	3398.2	3403.1	3420.5	3395.9
177.5°	3420.5	3403.1	3405.9	3423.1	3400.8
180°	3408.2	3408.2	3408.2	3408.2	3408.2

TEST NUMBER: P909383

CATALOG NUMBER: DFN2DIP-SQ3F0-120D100US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.26	14.09	14.21	15.06	16.32	9.22	10.05	10.17	11.02	12.28
	3H	14.93	15.68	15.90	16.65	17.94	10.40	11.15	11.37	12.12	13.41
	4H	15.54	16.24	16.52	17.22	18.52	10.85	11.55	11.83	12.53	13.83
	6H	15.95	16.60	16.95	17.59	18.90	11.16	11.81	12.15	12.80	14.10
	8H	16.08	16.70	17.08	17.70	19.00	11.25	11.87	12.25	12.87	14.17
	12H	16.14	16.73	17.14	17.72	19.05	11.29	11.88	12.29	12.87	14.20
4H	2H	13.27	13.98	14.26	14.96	16.26	9.81	10.52	10.80	11.50	12.79
	3H	15.10	15.69	16.10	16.70	18.00	11.15	11.74	12.15	12.75	14.06
	4H	15.79	16.32	16.79	17.33	18.66	11.70	12.23	12.70	13.24	14.57
	6H	16.30	16.76	17.31	17.79	19.11	12.11	12.57	13.13	13.60	14.93
	8H	16.47	16.90	17.49	17.92	19.26	12.23	12.66	13.25	13.68	15.03
	12H	16.56	16.95	17.60	17.99	19.33	12.30	12.68	13.33	13.72	15.07
8H	4H	15.75	16.18	16.77	17.20	18.55	11.97	12.41	12.99	13.42	14.77
	6H	16.31	16.67	17.36	17.73	19.07	12.48	12.84	13.53	13.90	15.24
	8H	16.53	16.84	17.58	17.89	19.25	12.67	12.98	13.72	14.03	15.39
	12H	16.66	16.94	17.72	17.98	19.38	12.78	13.06	13.84	14.10	15.50
12H	4H	15.71	16.09	16.74	17.13	18.48	11.98	12.37	13.01	13.40	14.75
	6H	16.29	16.60	17.34	17.65	19.01	12.53	12.85	13.58	13.89	15.25
	8H	16.51	16.78	17.56	17.82	19.23	12.74	13.01	13.79	14.05	15.46

END OF REPORT