

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911807

Luminaire Tested: DFN2DIP-SQ3F0-040D060US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911807
REPORT IS A COMBINATION OF REPORTS P901418 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-040D060US850-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10358.0 lumens
Efficiency: N/A
Efficacy: 133.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 77.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911807

CATALOG NUMBER: DFN2DIP-SQ3F0-040D060US850-RLLONL

Luminous Intensity Polar Plot

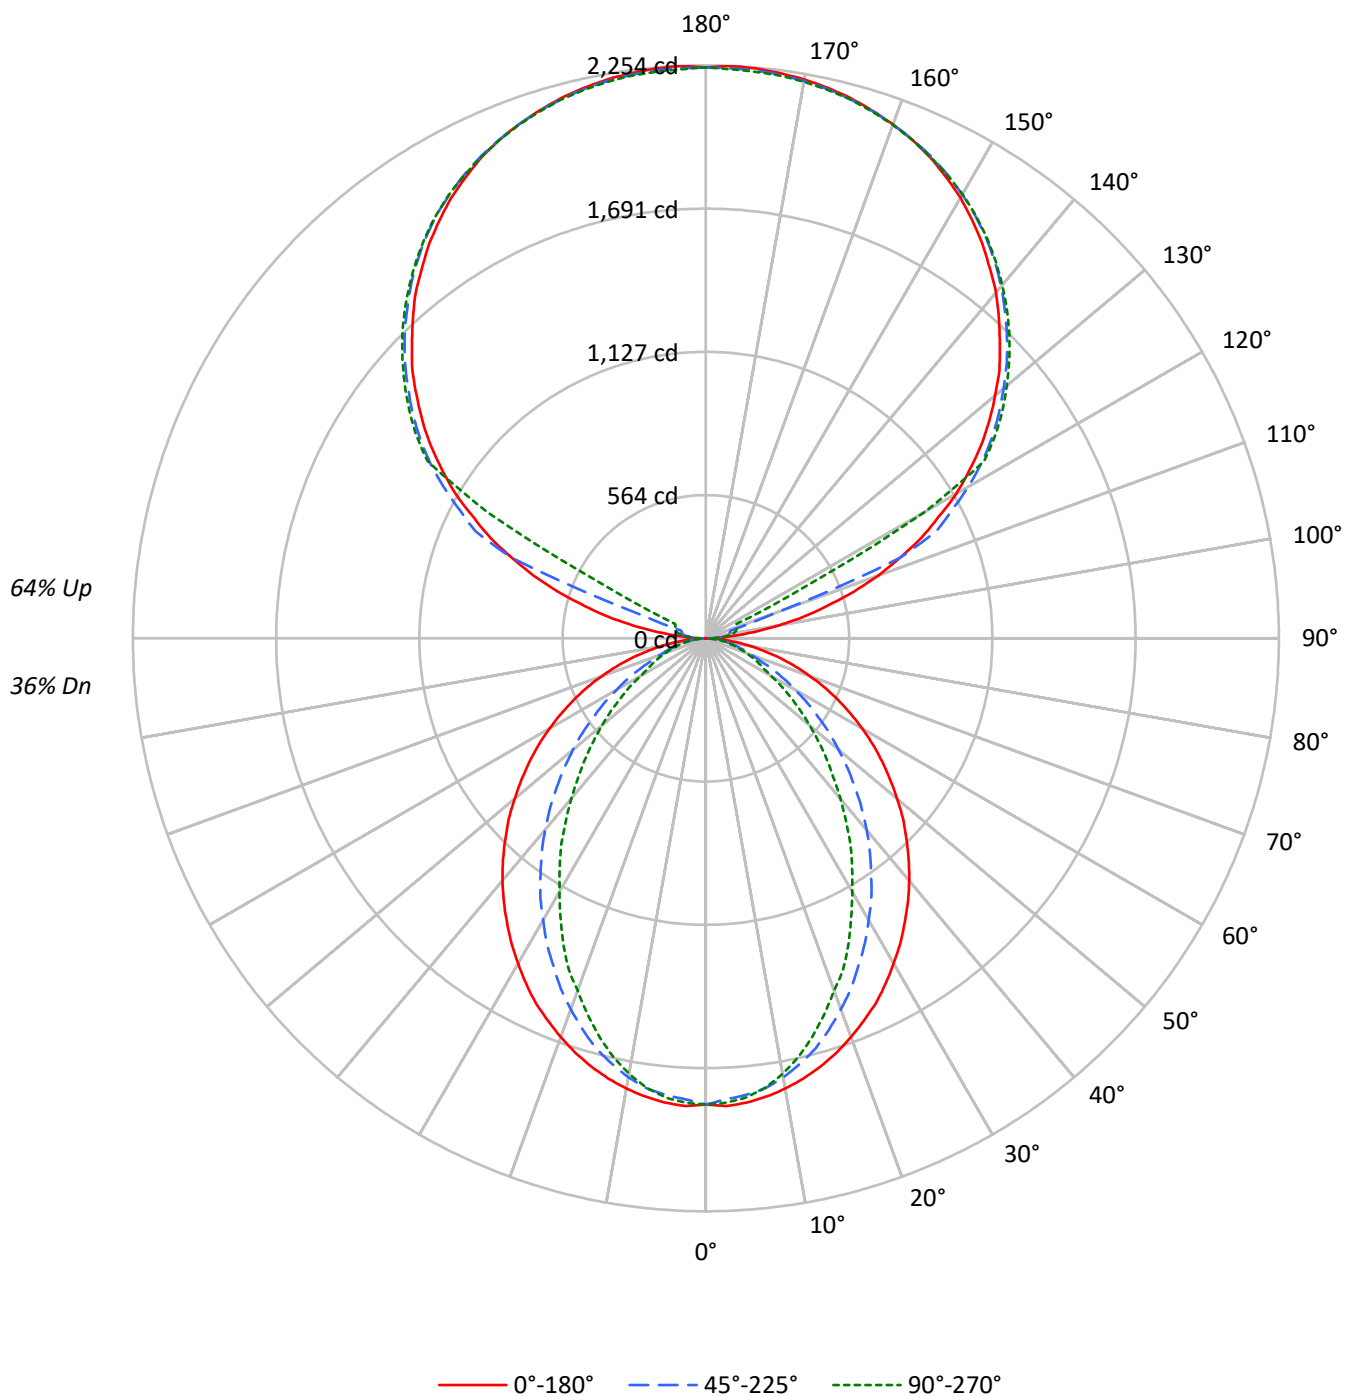

TEST NUMBER: P911807

CATALOG NUMBER: DFN2DIP-SQ3F0-040D060US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	91	87	84	86	83	80	77	67	65	63	52	51	50	39	38	38
2	87	80	74	69	78	73	68	63	59	56	53	46	44	42	35	33	32
3	79	70	63	58	72	64	58	53	52	48	45	41	38	36	31	29	28
4	73	63	55	49	66	57	51	46	47	42	38	37	34	31	28	26	24
5	67	56	48	42	60	51	44	39	42	37	33	33	30	27	25	23	21
6	62	50	42	37	56	46	39	34	38	33	29	30	27	24	23	21	19
7	57	45	38	32	52	41	35	30	34	29	26	28	24	21	21	19	17
8	53	41	34	29	48	38	31	27	31	26	23	25	22	19	20	17	15
9	49	37	30	25	45	34	28	24	29	24	20	23	20	17	18	16	14
10	46	34	27	23	42	32	25	21	26	22	18	22	18	15	17	14	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2101	2101	2101
5°	2103	2066	2080
10°	2081	2024	2012
15°	2051	1956	1906
20°	2011	1862	1777
25°	1971	1758	1653
30°	1918	1651	1495
35°	1865	1536	1357
40°	1812	1417	1198
45°	1750	1285	1054
50°	1685	1152	914
55°	1618	1011	779
60°	1540	862	641
65°	1451	712	576
70°	1342	572	520
75°	1204	501	472
80°	1007	416	407
85°	683	271	302

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1750 cd/sqm

TEST NUMBER: P911807

CATALOG NUMBER: DFN2DIP-SQ3F0-040D060US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	171.8	1.7
10°-20°	471.7	4.6
20°-30°	662.3	6.4
30°-40°	721.9	7.0
40°-50°	663.5	6.4
50°-60°	521.1	5.0
60°-70°	339.2	3.3
70°-80°	174.6	1.7
80°-90°	48.5	0.5
90°-100°	74.1	0.7
100°-110°	276.0	2.7
110°-120°	732.1	7.1
120°-130°	1214.2	11.7
130°-140°	1289.8	12.5
140°-150°	1198.7	11.6
150°-160°	963.8	9.3
160°-170°	621.0	6.0
170°-180°	213.7	2.1
0°-30°	1305.8	12.6
0°-40°	2027.7	19.6
0°-60°	3212.2	31.0
0°-90°	3774.5	36.4
90°-120°	1082.2	10.4
90°-150°	4785.0	46.2
90°-180°	6583.0	63.6
0°-180°	10358.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1833	1833	1833	1833	1833	
5°	1833	1825	1804	1818	1814	174
15°	1744	1726	1669	1638	1621	491
25°	1583	1530	1420	1352	1327	728
35°	1364	1279	1133	1029	992	854
45°	1115	1004	830	712	672	861
55°	848	718	539	440	408	758
65°	572	438	289	232	227	568
75°	305	189	133	121	120	323
85°	71	36	32	32	32	82
90°	2	20	32	41	44	10
95°	106	52	63	72	70	125
105°	494	543	99	117	124	528
115°	934	962	1003	250	133	920
125°	1321	1342	1373	1384	1389	1178
135°	1635	1661	1675	1692	1688	1263
145°	1896	1895	1922	1934	1926	1186
155°	2088	2074	2093	2103	2090	962
165°	2200	2190	2195	2207	2195	622
175°	2250	2239	2242	2254	2238	214
180°	2246	2246	2246	2246	2246	

TEST NUMBER: P911807

CATALOG NUMBER: DFN2DIP-SQ3F0-040D060US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1833.4	1833.4	1833.4	1833.4	1833.4
2.5°	1841.7	1833.4	1815.1	1831.8	1828.4
5°	1833.4	1825.1	1803.5	1818.4	1813.5
7.5°	1818.4	1808.6	1785.4	1791.8	1783.6
10°	1798.6	1786.9	1753.8	1748.7	1738.9
12.5°	1773.7	1758.8	1713.8	1704.0	1685.7
15°	1743.8	1725.5	1669.2	1637.7	1621.1
17.5°	1709.0	1682.4	1612.6	1576.2	1549.6
20°	1669.2	1635.9	1552.9	1511.6	1475.0
22.5°	1626.0	1587.9	1491.5	1435.2	1410.4
25°	1582.9	1529.8	1420.2	1352.3	1327.3
27.5°	1531.5	1475.0	1353.9	1275.9	1237.6
30°	1476.7	1413.5	1280.8	1196.3	1151.5
32.5°	1423.6	1347.2	1211.2	1111.7	1070.1
35°	1364.0	1279.2	1133.3	1028.7	992.1
37.5°	1305.8	1214.5	1060.2	945.6	904.3
40°	1244.4	1144.9	983.9	866.1	823.0
42.5°	1181.3	1075.2	907.6	784.7	743.4
45°	1115.0	1003.8	829.6	711.8	671.9
47.5°	1052.0	934.2	755.0	637.1	600.6
50°	982.2	864.5	681.9	567.4	532.7
52.5°	914.1	789.7	612.3	502.7	471.2
55°	847.8	718.4	539.2	439.7	408.2
57.5°	779.8	647.1	474.5	381.6	355.1
60°	710.1	577.3	406.4	321.9	295.4
62.5°	642.2	509.5	348.3	268.8	255.6
65°	572.5	437.9	288.7	232.3	227.2
67.5°	506.1	371.6	232.3	204.1	199.1
70°	436.4	307.0	192.4	175.9	169.1
72.5°	370.1	247.2	160.9	147.7	144.4
75°	305.2	189.1	132.7	121.1	119.6
77.5°	240.7	134.3	104.6	97.9	94.5
80°	180.8	96.3	79.5	73.1	73.1
82.5°	126.1	64.8	54.8	51.3	51.3
85°	71.3	36.5	31.5	31.5	31.5
87.5°	26.6	13.2	13.2	11.6	11.6
90°	1.6	19.5	32.4	40.7	43.8
92.5°	40.7	34.2	38.9	42.3	43.8
95°	105.6	51.9	63.3	71.6	69.9
97.5°	190.1	56.9	82.7	87.8	89.4
100°	287.7	65.0	92.6	105.6	108.8
102.5°	394.8	391.7	95.9	113.7	118.7
105°	493.9	542.7	99.1	116.9	123.5
107.5°	609.4	649.9	102.5	120.2	126.8
110°	720.0	753.9	284.5	122.0	128.3

TEST NUMBER: P911807

CATALOG NUMBER: DFN2DIP-SQ3F0-040D060US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	823.9	853.0	825.4	125.0	130.1
115°	934.3	961.9	1002.6	250.3	133.3
117.5°	1030.2	1062.6	1090.4	857.9	432.2
120°	1137.5	1161.8	1191.2	1210.6	991.2
122.5°	1228.3	1254.4	1287.0	1296.6	1298.4
125°	1321.0	1342.2	1373.1	1384.5	1389.2
127.5°	1405.5	1428.3	1452.8	1469.0	1470.5
130°	1485.2	1511.2	1529.0	1546.9	1545.4
132.5°	1566.5	1587.6	1605.4	1620.0	1618.5
135°	1634.8	1660.8	1675.3	1691.7	1688.3
137.5°	1706.1	1725.6	1742.0	1758.2	1753.4
140°	1776.0	1789.1	1806.9	1821.5	1813.4
142.5°	1834.6	1846.0	1867.1	1880.0	1871.9
145°	1896.4	1894.6	1922.2	1933.7	1925.6
147.5°	1949.8	1945.0	1972.6	1980.7	1974.4
150°	2002.0	1990.5	2016.6	2026.3	2018.2
152.5°	2045.8	2032.8	2057.1	2067.0	2055.5
155°	2088.0	2073.5	2093.0	2102.7	2089.7
157.5°	2122.2	2109.2	2123.8	2135.3	2122.2
160°	2151.5	2141.6	2151.5	2161.1	2149.8
162.5°	2177.3	2167.7	2175.7	2187.2	2172.5
165°	2200.1	2190.5	2195.3	2206.7	2195.3
167.5°	2218.0	2208.2	2213.2	2224.7	2209.9
170°	2232.7	2222.9	2226.2	2237.5	2222.9
172.5°	2242.4	2232.7	2236.0	2247.4	2232.7
175°	2250.5	2239.1	2242.4	2253.7	2237.5
177.5°	2253.7	2242.4	2244.1	2255.5	2240.8
180°	2245.6	2245.6	2245.6	2245.6	2245.6

TEST NUMBER: P911807

CATALOG NUMBER: DFN2DIP-SQ3F0-040D060US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.28	9.01	9.35	10.08	11.53	4.24	4.97	5.31	6.04	7.49
	3H	9.94	10.60	11.02	11.67	13.15	5.41	6.07	6.49	7.14	8.62
	4H	10.54	11.16	11.63	12.24	13.72	5.85	6.47	6.94	7.55	9.03
	6H	10.96	11.53	12.06	12.61	14.10	6.16	6.73	7.26	7.82	9.31
	8H	11.08	11.62	12.18	12.72	14.20	6.25	6.79	7.35	7.89	9.37
	12H	11.13	11.65	12.24	12.74	14.25	6.29	6.80	7.39	7.89	9.40
4H	2H	8.28	8.90	9.38	9.98	11.46	4.82	5.44	5.92	6.52	8.00
	3H	10.10	10.61	11.20	11.72	13.21	6.15	6.67	7.26	7.77	9.26
	4H	10.78	11.25	11.89	12.35	13.86	6.69	7.16	7.80	8.26	9.77
	6H	11.29	11.69	12.40	12.81	14.31	7.10	7.50	8.21	8.62	10.13
	8H	11.46	11.83	12.57	12.95	14.47	7.22	7.60	8.34	8.71	10.23
	12H	11.54	11.89	12.68	13.01	14.54	7.28	7.62	8.41	8.74	10.27
8H	4H	10.74	11.12	11.86	12.23	13.75	6.96	7.34	8.08	8.45	9.97
	6H	11.30	11.61	12.43	12.76	14.28	7.47	7.78	8.60	8.93	10.45
	8H	11.51	11.78	12.65	12.92	14.45	7.65	7.92	8.80	9.06	10.60
	12H	11.64	11.88	12.79	13.01	14.58	7.76	8.00	8.91	9.13	10.71
12H	4H	10.69	11.03	11.82	12.15	13.68	6.96	7.30	8.09	8.43	9.95
	6H	11.27	11.54	12.41	12.68	14.22	7.51	7.79	8.66	8.92	10.46
	8H	11.48	11.72	12.63	12.85	14.43	7.71	7.95	8.86	9.08	10.66

END OF REPORT